


DEMO WORK

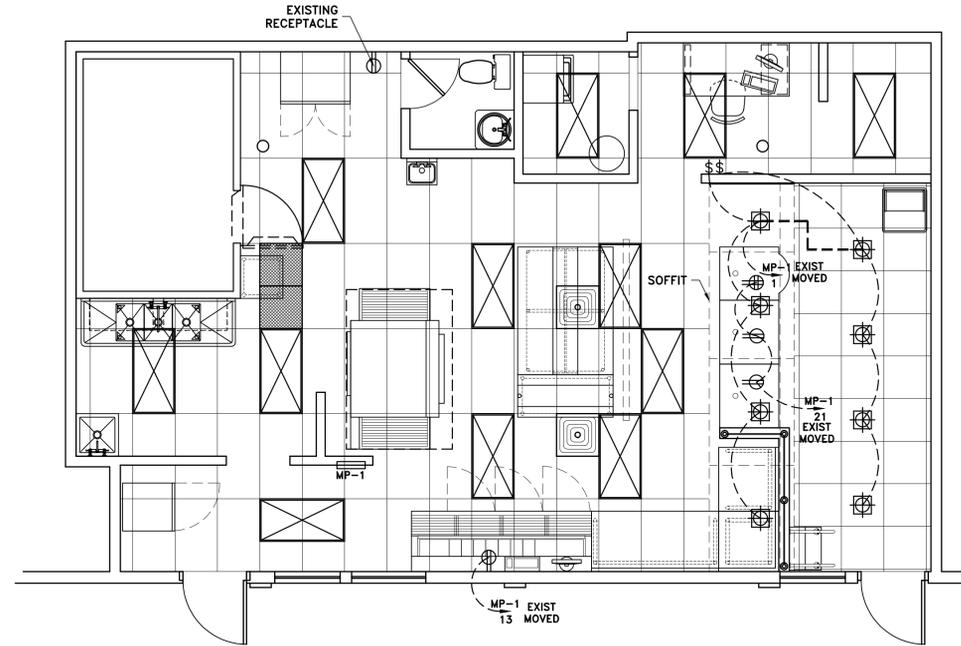


ELECTRICAL

KEY TO SYMBOLS

	DUPLEX RECEPTACLE
	GRND FAULT INTERRUPTER PROTECTED
	OUTLET W/ ISO GND. COMPUTER CIRCUIT
	QUADRUPLEX OUTLET
	QUADRUPLEX OUTLET W/ ISO GND. COMPUTER CIRCUIT
	JUNCTION BOX
	TELEPHONE JACK RECEPTACLE
	DATA JACK RECEPTACLE
	RECESSED LIGHT 14W LED LAMP (10)
	2X4 LIGHT FIXTURE (EXISTING)
	SWITCH
	DISCONNECT


NOTE:
THIS ELECTRICAL LAYOUT IS ONLY A SUGGESTION AND MAY CHANGE SLIGHTLY ON SITE

NOTE:
ONLY NEW OR RELOCATED CIRCUITS ARE SHOWN




EQUIPMENT SCHEDULE


MARK	QTY.	E&S PART NO.	ITEM DESCRIPTION
1	2	BY OWNER	6 FT STAINLESS STEEL DOUGH COUNTER 10" BACK SPLASH
2	1	PC 22139	UNIVERSAL CORNER WITH LEGS
3	1	EXISTING	3 FT STAINLESS STEEL DOUGH COUNTER 10" BACK SPLASH
4	1	EXISTING	MAKELINE 8'-6"
5	2	284001	SALE COUNTER 36" W/ ORDER TERMINAL
6	1	284004	PICKUP COUNTER
7	1	EXISTING	60" ROUTE STAND - HEAT RACK
8	1	EXISTING	6 FT CUT TABLE W/ OVER SHELF PC 320804
9	1	BY OWNER	GLASS WINDOW SNEEZE GUARD
10	1	BY OWNER	CHILD STAIRS 2 STEPS W/ HANDRAIL
11	1	-----	MENU BOARDS
12	1	EXISTING	TRASH RECEPTACLE
13	1	EXISTING	OVEN AND HOOD
14			

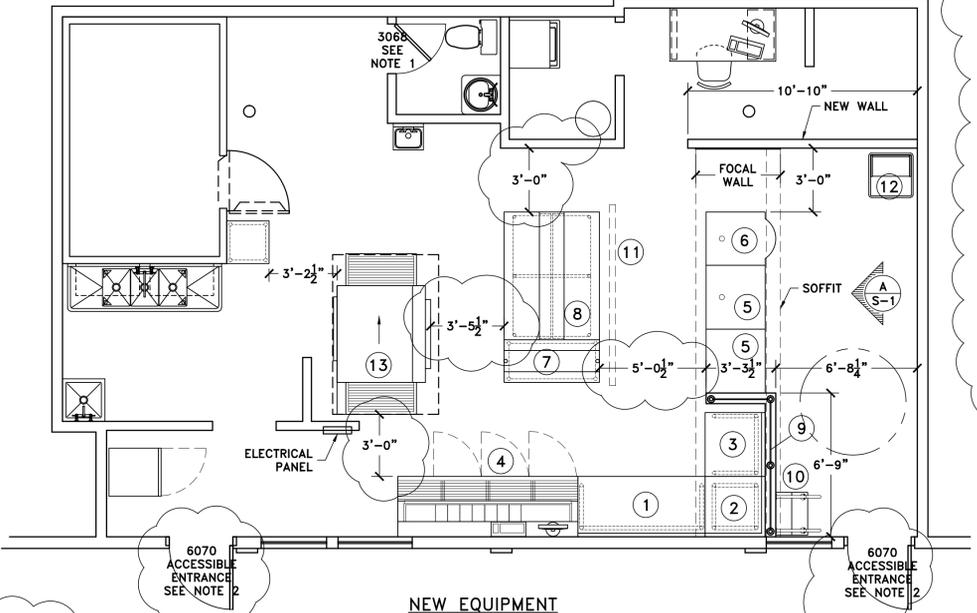

NEW EQUIPMENT

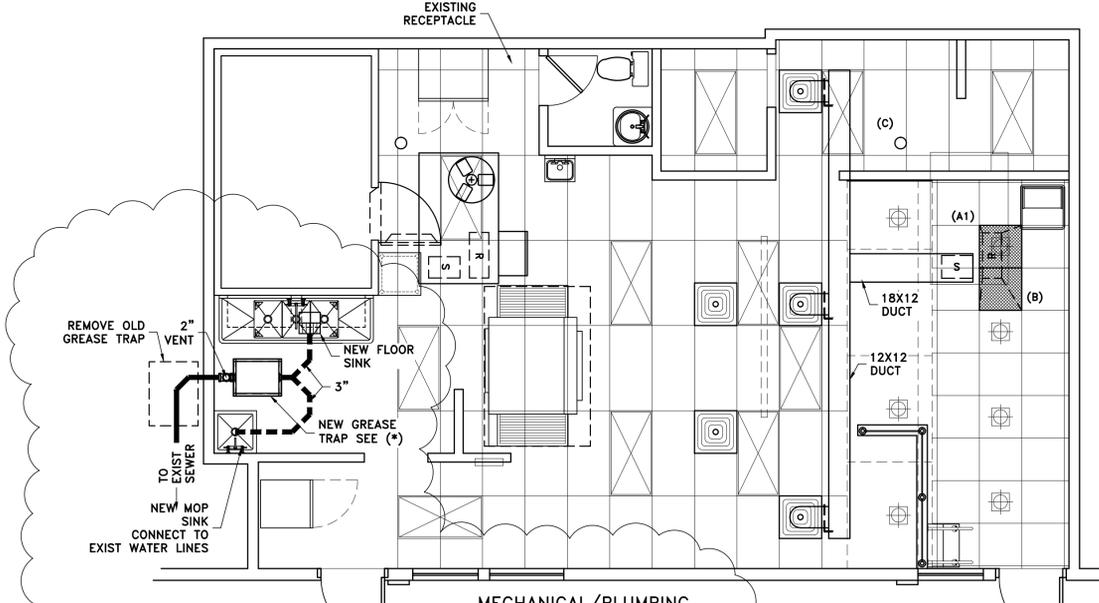

MECHANICAL/PLUMBING

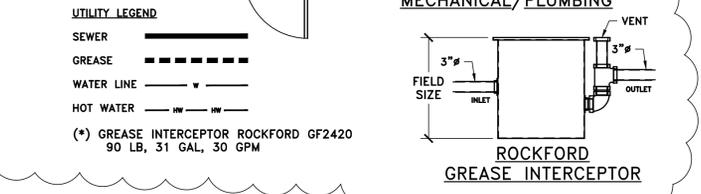

UTILITY LEGEND

SEWER:

GREASE:

WATER LINE:

HOT WATER:


(*) GREASE INTERCEPTOR ROCKFORD GF2420
90 LB, 31 GAL, 30 GPM

NOTE:
AIR BALANCING TO BE DONE BY AN APPROVED METHOD AND A TEST AND BALANCE REPORT MUST BE PROVIDED TO THE HVAC INSPECTOR AT FINAL INSPECTION



- EQUIPMENT**
- (A1) ROOFTOP 150K BTU/4 TON BRYANT (UNIT ON ROOF) 1600 CFM 580JPA150 6.8 KW 35.6A 208V 1 PH EFFICIENCY = 82% WEIGHT = 700 LBS
 - (B) RETURN GRILL 24X24
 - (C) SQUARE DIFFUSER 24X24 W/ 12" CONNECTION

UTILITY LEGEND


GAS LINE:

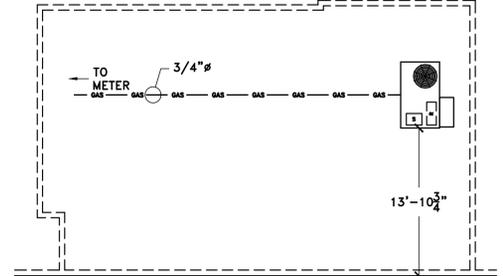


ROOF VIEW

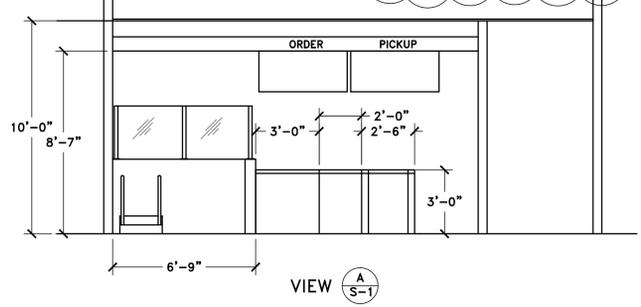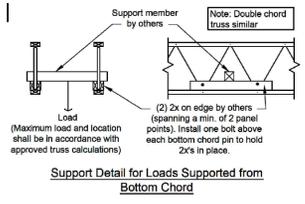

VIEW A-S-1

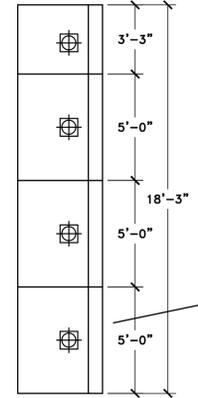

MECHANICAL

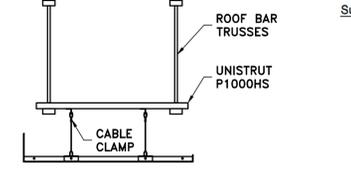

SECTION VIEW HANGING WITH 1/8" CABLE FROM BRACKET AT PANEL SEAMS

DOOR NOTES:

(1) ALL INTERIOR DOORS ARE TO HAVE SCHLAGE LEVER OPENERS AND DOORS WITH LOCKS WILL BE ABLE TO BE OPENED FROM EGRESS SIDE WITHOUT THE USE OF KEYS.

(2) ALL BUILDING ENTRY DOORS ARE TO BE EQUIPPED WITH PANIC OR FIRE EXIT HARDWARE (UL30). SEE INDICATED DOORS. IF AN INTERNAL KEY LOCKING DEVICE IS USED IT MUST BE NOTICEABLE IF LOCKED AND A DOUBLE KEY TYPE LOCK MUST BE USED. ALSO A SIGN WITH 1 INCH HIGH LETTERS ON A CONTRASTING BACKGROUND THAT SAYS "THIS DOOR TO REMAIN UNLOCKED WHEN BUILDING IS OCCUPIED"



DWG NO: D051717-1 SCALE: 1/4"=1'-0" REV. A

PREPARED FOR
TENANT FINISH AT
255 ANGLERS DRIVE
STEAM BOAT SPRINGS, CO

NET ENGINEERING SERVICES
JOHNSTOWN, CO
970-587-7100 FAX: 970-587-7111

DRAWING DESCRIPTION
REMODEL DETAILS

DATE DRAWN: 5/17/17
APPROVED BY:
CHECKED BY:
DRAWN BY: ROSS NICHOLS

DRAWING TYPE
S-1

SHEET OF