

RESPONSIBLE DIVISION:

UNLESS OTHERWISE INDICATED ALL HEATING, VENTILATING, AIR CONDITIONING, PLUMBING, AND OTHER MECHANICAL EQUIPMENT, MOTORS, AND CONTROLS SHALL BE FURNISHED, SET IN PLACE AND WIRED AS FOLLOWS:

ITEM	FURNISHED	SET	POWER WIRED	CONTROL WIRED
EQUIPMENT	23	23	26	--
COMBINATION MAGNETIC MOTOR STARTERS, MAGNETIC MOTOR STARTERS, VFD'S AND CONTACTORS	23(1)	26	26(2)	23
FUSED AND UNFUSED DISCONNECT SWITCHES, THERMAL OVERLOAD SWITCHES AND HEATERS, MANUAL MOTOR STARTERS	26	26	26	--
MANUAL-OPERATING AND MULTI-SPEED SWITCHES	23	26	26	26
CONTROLS, RELAYS, TRANSFORMERS	23	23	26	23
THERMOSTATS (LOW VOLTAGE) AND TIME SWITCHES	23	23	26	23
THERMOSTATS (LINE VOLTAGE)	23	23	26	26
TEMPERATURE CONTROL PANELS	23	23	26	23
MOTOR AND SOLENOID VALVES, DAMPER MOTORS, PE & EP SWITCHES	23	23(2)	--	23(2)
PUSH-BUTTON STATIONS AND PILOT LIGHTS	23	23(2)	--	23(2)
HEATING, COOLING, VENTILATION AND AIR CONDITIONING CONTROLS	23	23	26	23
EXHAUST FAN SWITCHES	23	26	26	23(2)

SUBSCRIPT FOOTNOTES:
 1. MOTOR STARTER TO INCLUDE CONTROL TRANSFORMER, HOA SWITCH, (1) NO AND (1) NC AUXILIARY CONTACT, AND "ON" AND "OFF" PILOT LIGHTS.
 2. IF ITEM IS FOR LINE VOLTAGE, SET IN PLACE AND CONNECT UNDER DIVISION 26. WHERE FACTORY MOUNTED ON EQUIPMENT OR ATTACHED TO PIPING OR DUCTS AND USING LINE VOLTAGE FURNISH AND SET UNDER DIVISION 23, CONNECT UNDER DIVISION 26.

ABBREVIATIONS:

44"	MOUNTING HEIGHT ABOVE FINISHED FLOOR TO CENTER OF DEVICE
A	AMPS
A.D.	ACCESS DOOR
AAV	AIR ADMITTANCE VALVE
ABV	ABOVE
AC	AIR CONDITIONING UNIT
AC	ABOVE COUNTER
AD	AREA DRAIN (SEE SYMBOLS)
A.F.C.	ABOVE FINISHED CEILING
A.F.G.	ABOVE FINISHED GRADE
AIC	AMPERE INTERRUPTING CAPACITY
AFCI	ARC FAULT CIRCUIT INTERRUPTERS
A.F.F.	ABOVE FINISHED FLOOR
AHU	AIR HANDLING UNIT
ALUM	ALUMINUM
AP	ACCESS PANEL OR DOOR
ATS	AUTOMATIC TRANSFER SWITCH
AV	AUDIO / VIDEO
AVG	AVERAGE
AWG	AMERICAN WIRE GAGE
BAS	BUILDING AUTOMATION SYSTEM
BS	BASEBOARD
BD	BACK DRAFT DAMPER
BFP	BACK FLOW PREVENTOR
BL	BOILER
BLDG	BUILDING
BLW	BELOW
BOB	BOTTOM OF BEAM
BOD	BOTTOM OF DUCT
BOP	BOTTOM OF PIPE
BSMT	BASEMENT
BTU	BRITISH THERMAL UNIT
C	CHILLER
CAFCI	COMBINATION ARC FAULT CIRCUIT INTERRUPTERS
CAP	CAPACITY
CB	CIRCUIT BREAKER
CBV	CIRCUIT BALANCING VALVE
CCT	CORRELATED COLOR TEMPERATURE
CKT	CIRCUIT
CFH	CUBIC FEET PER HOUR
CFM	CUBIC FEET PER MINUTE
CHWR	CHILLED WATER RETURN
CHWS	CHILLED WATER SUPPLY
CI	CAST IRON
CL	CENTER LINE
CLG	CEILING
CMU	CONCRETE MASONRY UNIT
CO	CLEAN OUT
COL	COLUMN
COMP	COMPRESSOR
CONC	CONCRETE
COND	CONDENSATE
CONN	CONNECTION
CONT	CONTINUATION
CONTR	CONTRACTOR
CRI	COLOR RENDERING INDEX
CT	COOLING TOWER
CT	CURRENT TRANSFORMER
CU	CONDENSING UNIT
CU	COPPER
CUH	CABINET UNIT HEATER
CVB	CONSTANT VOLUME BOX
CWR	CONDENSER WATER RETURN
CWS	CONDENSER WATER SUPPLY
DB	DRY BULB
DEPT	DEPARTMENT
DF	DRINKING FOUNTAIN
DIA	DIAMETER
DIAG	DIAGRAM
DIFF	DIFFERENTIAL
DISCH	DISCHARGE
DIV	DIVISION
DN	DOWN
DW	DUCT SILENCER
DWG	DRAWING
DX	DIRECT EXPANSION
EX	EXISTING
EA	EXHAUST AIR GRILLE/REGISTER
EAT	ENTERING AIR TEMPERATURE
EC	ELECTRICAL CONTRACTOR
ECC	ECCENTRIC
EF	EXHAUST FAN
EFF	EFFICIENCY
EL	ELEVATION
ELEC	ELECTRIC
ELEV	ELEVATOR
EM	EMERGENCY FUNCTION
ENT	ENTERING
EQ	ELECTRIC METALLIC TUBE
EQ	EQUAL
EQUIP	EQUIPMENT
EQUIV	EQUIV EQUIVALENT
ES	END SWITCH
ESP	EXTERNAL STATIC PRESSURE
ET	EXPANSION TANK
EWC	ELECTRIC WATER COOLER
EWT	ENTERING WATER TEMPERATURE
EX	EXHAUST
EXPAN	EXPANSION
EXT	EXTERNAL
F	DEGREES FAHRENHEIT
FA	FREE AREA
FC	FAN COIL UNIT
FC	FOOTCANDLE
FCV	FLOW CONTROL VALVE
FD	FIRE DAMPER
FD	FLOOR DRAIN
FIN	FINISHED
FLA	FULL LOAD AMPS
FLEX	FLEXIBLE
FLR	FLOOR
FOB	FLAT ON BOTTOM
FOT	FLAT ON TOP
FP	FIRE PROTECTION
FP	FIRE PUMP
FRM	FEET PER MINUTE
FPS	FEET PER SECOND
FS	FLOW SWITCH
FSD	FIRE/SMOKE DAMPER
FT	FEET
FXC	FLEXIBLE CONNECTION
GND	GROUND
GA	GAUGE
GAL	GALLON
GALV	GALVANIZED
GEC	GROUND ELECTRODE CONDUCTOR
GFCI / GFI	GROUND FAULT CIRCUIT INTERRUPTER
GC	GENERAL CONTRACTOR
GPH	GALLONS PER HOUR
GPM	GALLONS PER MINUTE
GRS/LB	GRAINS PER POUND
H 2O	WATER
HB	HOSE BIBB
HD	HEAD (SEE SCHEDULES)
HP	HEAT PUMP
HP	HORSEPOWER
HR	HOUR
HT	HEIGHT
HTR	HEATER
HWR	HEATING WATER RETURN
HWS	HEATING WATER SUPPLY
HX	HEAT EXCHANGER
HZ	HERTZ
ID	INSIDE DIAMETER
IG	ISOLATED GROUND
IN	INCHES
INV	INVERT
JBOX	JUNCTION BOX
K	KELVIN
KW	KILOWATT
KVA	KILO VOLT - AMPS
L	LENGTH
LAV	LAVATORY
LAV	LAVATORY
LB	POUND
LD	LINEAR DIFFUSER
LF	LINEAR FEET
LN	LINEAR
LIQ	LIQUID
LM	LUMEN
LRA	LOCKED ROTOR AMPS
LV	LOUVER
LVG	LEAVING
LWT	LEAVING WATER TEMPERATURE
MBH	THOUSANDS OF BTU PER HOUR
MC	MECHANICAL CONTRACTOR
MCA	MINIMUM CIRCUIT AMPACITY
MCB	MAIN CIRCUIT BREAKER
MD	MOTORIZED DAMPER
MDP	MAIN DISTRIBUTION PANEL
MED	MEDIUM
MFR	MANUFACTURER
MIN	MINIMUM
MISC	MISCELLANEOUS
MLO	MAIN LUG ONLY
MOCP	MAXIMUM OVERCURRENT PROTECTION
MTD	MOUNTED
MUA	MAKE-UP AIR UNIT
N	NEUTRAL
NC	NORMALLY CLOSED
NEG	NEGATIVE
NIC	NOT IN CONTRACT
NL	NIGHT / SECURITY LIGHT - DO NOT SWITCH
NO	NORMALLY OPEN
NOM	NOMINAL
NTS	NOT TO SCALE
OA	OUTSIDE AIR
OB	OPPOSED BLADE DAMPER
OC	ON CENTER
OCC	OCCUPIED
OC	ON CENTER
OC	OCCUPIED
OC	ON CENTER
OD	OUTSIDE DIAMETER
OL	OVERLOAD
ORD	OVERFLOW ROOF DRAIN
OZ	OUNCE
PBD	PARALLEL BLADE DAMPER
PD	PRESSURE DROP
PH	PHASE
POS	POSITIVE PRESSURE
POS	POINT OF SALES
PRV	PRESSURE REDUCING VALVE
PS	PRESSURE SWITCH
PSI	POUNDS PER SQUARE INCH
PT	PRESSURE TRANSMITTER
PTAC	PACKAGED TERMINAL AIR CONDITIONER
PLUG VALVE	PLUG VALVE
PVC	POLYVINYL CHLORIDE
QTY	QUANTITY
RA	RETURN AIR GRILLE / REGISTER
RCP	REFLECTED CEILING PLAN
RD	ROOF DRAIN
REL	RELIEF
REQD	REQUIRED
RF	RETURN FAN
RH	RELATIVE HUMIDITY
RHC	REHEAT COIL
RLA	RATED LOAD AMPS
RM	ROOM
RPM	REVOLUTIONS PER MINUTE
SA	SUPPLY AIR GRILLE / REGISTER
SC	SHORT CIRCUIT
SCA	SHORT CIRCUIT AVAILABLE
SCRC	SHORT CIRCUIT CURRENT RATING
SCH	SCHEDULE
SD	SMOKE DAMPER
SEF	SMOKE EXHAUST FAN
SF	SUPPLY FAN
SH	SENSIBLE HEAT
SH	SHOWER
SP	STATIC PRESSURE
SPD	SURGE PROTECTION DEVICE
SPEC	SPECIFICATION
SQ	SQUARE
SS	STAINLESS STEEL
SS	SAFETY SHOWER
STD	STANDARD
STL	STEEL
SYS	SYSTEM
TEMP	TEMPERATURE
TR	TRANSFER GRILLE / REGISTER
TR	TAMPER RESISTANT
TT	TEMPERATURE TRANSMITTER
TTB	TELECOMMUNICATIONS TERMINAL BACKBOARD
TYP	TYPICAL
TX	TRANSFORMER
UC	UNDERCUT DOOR
UH	UNIT HEATER
UNO	UNLESS NOTED OTHERWISE
UNOCC	UNOCCUPIED
UR	URINAL
V	VOLTS
VA	VOLT AMPERE
VA	VALVE
VAV	VARIABLE AIR VOLUME UNIT
VFD	VARIABLE FREQUENCY DRIVE
VRF	VARIABLE REFRIGERANT FLOW
VOLT	VOLTAGE
VTR	VENT THROUGH ROOF
W	WIDTH
W	WATTS
W	WITH
W/O	WITHOUT
WB	WET BULB
WC	WATER COLUMN
WC	WATER CLOSET
WG	WATER GAUGE
WP	WEATHERPROOF
WPIU	WEATHERPROOF IN-USE
WSR	WITHSTAND RATING
XFMR	TRANSFORMER

SUBSTITUTIONS:

A. SUBSTITUTIONS: SUBSTITUTION OF SPECIFIED EQUIPMENT WILL BE ALLOWED THROUGH A PRIOR APPROVAL PROCESS INITIATED BY THE CONTRACTOR. CONTRACTOR SHALL SUBMIT INTENDED SUBSTITUTION AT LEAST FIVE DAYS PRIOR TO BID FOR APPROVAL FROM ENGINEER. SUBMITTAL SHALL INCLUDE CAPACITIES, DIMENSIONS AND OPERATING INSTRUCTIONS FOR EACH PIECE OF EQUIPMENT. SUBSTITUTION SHALL OCCUR AT NO COST TO THE OWNER. CONTRACTOR IS RESPONSIBLE FOR COORDINATION OF APPROVED SUBSTITUTION AND SHALL INCUR ALL COSTS ASSOCIATED WITH THE SUBSTITUTION INCLUDING STRUCTURAL MODIFICATIONS, SPACE LAYOUT AND REDESIGN COSTS. SEE ALSO DIVISION I GENERAL REQUIREMENTS.

EXAMINATION OF SITE, DRAWINGS, SPECIFICATIONS:
 A. EXAMINE CAREFULLY THE SITE AND CONDITIONS OF THE SITE. PROVIDE ALL NECESSARY EQUIPMENT AND LABOR TO INSTALL A COMPLETE WORKING SYSTEM WITHIN THE SITE CONDITIONS.
 B. EXAMINE THE DRAWINGS AND SPECIFICATIONS 5 DAYS PRIOR TO BIDDING REPORT ANY ERRORS, OMISSIONS, INCONSISTENCIES, AND CONFLICTS TO THE ENGINEER TO BE REMEDIATED IN AN ADDENDUM TO THE PROJECT PRIOR TO BID TIME.
 C. DRAWINGS ARE DIAGRAMMATIC AND CATALOG NUMBERS GIVEN ARE FOR REFERENCE ONLY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE CAPACITY OF THE EQUIPMENT MEETS THE DRAWING REQUIREMENTS AND SHALL NOT DIMENSION FROM THE MECHANICAL, PLUMBING, OR PIPING DRAWINGS.
 D. THE LATEST ADOPTED VERSIONS OF THE INTERNATIONAL BUILDING CODES SHALL BE USED AS REQUIRED. THIS WILL ALSO INCLUDE THE LATEST ADOPTED VERSIONS OF THE MECHANICAL, PLUMBING, AND ENERGY CONSERVATION CODES. ALL METHODS AND MATERIALS REQUIRED BY THESE CODES SHALL BE REQUIRED BY THESE SPECIFICATIONS UNLESS INDICATED OTHERWISE. OTHER APPLICABLE LOCAL CODES AND ORDINANCES SHALL BE AS REQUIRED AND IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO BE KNOWLEDGEABLE OF THESE REQUIREMENTS.
 E. WHERE INSTALLATION PROCEDURES OR ANY PART THEREOF ARE REQUIRED TO BE IN ACCORDANCE WITH THE RECOMMENDATIONS OF THE MANUFACTURER OF THE MATERIAL BEING INSTALLED, PRINTED COPIES OF THESE RECOMMENDATIONS SHALL BE FURNISHED TO THE ENGINEER PRIOR TO INSTALLATION. INSTALLATION OF THE ITEM WILL NOT BE ALLOWED TO PROCEED UNTIL THE RECOMMENDATIONS ARE RECEIVED. FAILURE TO FURNISH THESE RECOMMENDATIONS CAN BE CAUSE FOR REJECTION OF THE MATERIAL.

DO NOT REPRODUCE THESE DRAWINGS AND SPECIFICATIONS WITHOUT THE EXPRESSED WRITTEN PERMISSION OF THE ENGINEER. THE DRAWINGS AND SPECIFICATIONS ARE INSTRUMENTS OF SERVICE AND SHALL REMAIN THE PROPERTY OF THE ENGINEER. WHETHER THE PROJECT FOR WHICH THEY ARE MADE IS EXECUTED OR NOT. THESE DRAWINGS AND SPECIFICATIONS SHALL NOT BE USED BY ANYONE ON ANY OTHER PROJECTS FOR ADDITIONS TO THIS PROJECT BY OTHERS EXCEPT BY THE EXPRESSED WRITTEN PERMISSION OF THE ENGINEER.

Bighorn Consulting Engineers, Inc.
 Mechanical & Electrical Engineers
 386 Indian Road
 Grand Junction, CO 81501
 Phone: (970) 241-8709

RIVERFRONT INDUSTRIAL PARK
 MECHANICAL - COVER SHEET
 1522 SHIELD DRIVE
 STEAMBOAT SPRINGS, COLORADO

DATE:	ISSUED FOR:
09/17/2024	PERMIT



DATE:	09/06/2024
JOB NO:	24-056
DRAWN BY:	---
CHECKED BY:	---
SCALE:	---
SHEET NUMBER:	MO-1

LINE TYPE	DESCRIPTION
140	HIGH TEMPERATURE (140°) WATER PIPE
CA	COMPRESSED AIR
DC	DECONTAMINATION PIPING
DER	DEIONIZED WATER RETURN
DES	DEIONIZED WATER SUPPLY
DIS	DISTILLED WATER SUPPLY
DIR	DISTILLED WATER RETURN
CD	EQUIPMENT CONDENSATE DRAIN
FP	FIRE MAIN
GW	GREASE WASTE PIPE
HE	HELIUM
HPS	HIGH PRESSURE STEAM
HPC	HIGH PRESSURE CONDENSATE
	HOT WATER RECIRCULATION (HWR)
	HOT WATER PIPE (HW)
H2	HYDROGEN
LPC	LOW PRESSURE CONDENSATE
LPS	LOW PRESSURE STEAM
MA	MEDICAL AIR
G	NATURAL GAS PIPE
N2	NITROGEN
N2O	NITROUS OXIDE
ORD	OVERFLOW STORM WATER PIPE
O2	OXYGEN
PG	PROPANE GAS
RD	ROOF DRAIN PIPE
	SOIL OR WASTE PIPE
S/O	SOIL / OIL WASTE PIPE
TWR	TOWER WATER RETURN
TWS	TOWER WATER SUPPLY
VAC	VACUUM
	VENT PIPE (V)

LINE TYPE	DESCRIPTION	LINE TYPE	DESCRIPTION
	PIPE RISING UP		PIPE DROPPING DOWN
	UNION - SCREWED OR FLANGED		UNION - SCREWED OR FLANGED
	PRESSURE REDUCING VALVE (PRV)		PRESSURE TRANSMITTER OR PRESSURE SWITCH
	GATE VALVE		PT/PS
	GLOBE VALVE		TH/TI
	PLUG VALVE		PV/GA
	BUTTERFLY VALVE		THERMOMETER/TEMPERATURE INDICATOR
	BALL VALVE		GAUGE WITH GAUGE COCK/ PRESSURE INDICATOR
	SWING CHECK VALVE		BACKFLOW PREVENTOR (REDUCED ZONE)
	LIFT CHECK VALVE		BACKFLOW PREVENTOR (DOUBLE CHECK VALVE ASSEMBLY)
	GATE VALVE, ANGLE		WATER HAMMER ARRESTER
	GLOBE VALVE, ANGLE		CIRCUIT SETTING
	TEMPERATURE AND PRESSURE RELIEF VALVE		HOSE BIBB
	RELIEF/SAFETY VALVE		ROOF DRAIN
	GAS COCK		FLOOR DRAIN
	GAS PRESSURE REGULATOR		AREA DRAIN
	STRAINER		FLOOR CLEAN OUT
	STRAINER WITH BLOW OFF VALVE		FLOOR SINK
	WATER HEATER		COG
	WATER METER		FS
	PRESSURE GAGE		COG
	TEMPERATURE GAGE		CLEAN OUT TO GRADE
			WALL CLEAN OUT
			FLEXIBLE-CONNECTION
			CHECK VALVE
			VACUUM BREAKER

RESPONSIBLE DIVISION:

UNLESS OTHERWISE INDICATED ALL HEATING, VENTILATING, AIR CONDITIONING, PLUMBING, AND OTHER MECHANICAL EQUIPMENT, MOTORS, AND CONTROLS SHALL BE FURNISHED, SET IN PLACE AND WIRED AS FOLLOWS:

ITEM	FURNISHED	SET	POWER WIRED	CONTROL WIRED
EQUIPMENT	23	23	26	--
COMBINATION MAGNETIC MOTOR STARTERS, MAGNETIC MOTOR STARTERS, VFD'S AND CONTACTORS	23(1)	26	26(2)	23
FUSED AND UNFUSED DISCONNECT SWITCHES, THERMAL OVERLOAD SWITCHES AND HEATERS, MANUAL MOTOR STARTERS	26	26	26	--
MANUAL-OPERATING AND MULTI-SPEED SWITCHES	23	26	26	26
CONTROLS, RELAYS, TRANSFORMERS	23	23	26	23
THERMOSTATS (LOW VOLTAGE) AND TIME SWITCHES	23	23	26	23
THERMOSTATS (LINE VOLTAGE)	23	23	26	26
TEMPERATURE CONTROL PANELS	23	23	26	23
MOTOR AND SOLENOID VALVES, DAMPER MOTORS, PE & EP SWITCHES	23	23(2)	--	23(2)
PUSH-BUTTON STATIONS AND PILOT LIGHTS	23	23(2)	--	23(2)
HEATING, COOLING, VENTILATION AND AIR CONDITIONING CONTROLS	23	23	26	23
EXHAUST FAN SWITCHES	23	26	26	23(2)

SUBSCRIPT FOOTNOTES:
 1. MOTOR STARTER TO INCLUDE CONTROL TRANSFORMER, HOA SWITCH, (1) NO AND (1) NC AUXILIARY CONTACT, AND "ON" AND "OFF" PILOT LIGHTS.
 2. IF ITEM IS FOR LINE VOLTAGE, SET IN PLACE AND CONNECT UNDER DIVISION 26. WHERE FACTORY MOUNTED ON EQUIPMENT OR ATTACHED TO PIPING OR DUCTS AND USING LINE VOLTAGE FURNISH AND SET UNDER DIVISION 23. CONNECT UNDER DIVISION 26.

ABBREVIATIONS:

44"	MOUNTING HEIGHT ABOVE FINISHED FLOOR TO CENTER OF DEVICE	DIA	DIAMETER	HP	HORSEPOWER	PTAC	PACKAGED TERMINAL AIR CONDITIONER
A	AMPS	DIAG	DIAGRAM	HR	HOUR	PV	PLUG VALVE
A.D.	ACCESS DOOR	DIFF	DIFFERENTIAL	HT	HEIGHT	PVC	POLYVINYL CHLORIDE
AV	AIR ADMITTANCE VALVE	DISCH	DISCHARGE	HTR	HEATER	QTY	QUANTITY
ABV	ABOVE	DIV	DIVISION	HWR	HEATING WATER RETURN	RA	RETURN AIR GRILLE / REGISTER
AC	AIR CONDITIONING UNIT	DN	DOWN	HWS	HEATING WATER SUPPLY	RCP	REFLECTED CEILING PLAN
AC	ABOVE COUNTER	DS	DUCT SILENCER	HX	HEAT EXCHANGER	RD	ROOF DRAIN
AD	AREA DRAIN (SEE SYMBOLS)	DWG	DRAWING	HZ	HERTZ	REL	RELIEF
A.F.C.	ABOVE FINISHED CEILING	DX	DIRECT EXPANSION	ID	INSIDE DIAMETER	REQD	REQUIRED
A.F.G.	ABOVE FINISHED GRADE	(E)	EXISTING	IG	ISOLATED GROUND	RF	RETURN FAN
AIC	AMPERE INTERRUPTING CAPACITY	EA	EXHAUST AIR GRILLE/REGISTER	IN	INCHES	RH	RELATIVE HUMIDITY
AFCI	ARC FAULT CIRCUIT INTERRUPTERS	EAT	ENTERING AIR TEMPERATURE	INV	INVERT	RHC	REHEAT COIL
A.F.F.	ABOVE FINISHED FLOOR	EC	ELECTRICAL CONTRACTOR	JBOX	JUNCTION BOX	RLA	RATED LOAD AMPS
AHU	AIR HANDLING UNIT	ECC	ECCENTRIC	K	KELVIN	RM	ROOM
ALUM	ALUMINUM	EF	EXHAUST FAN	KW	KILOWATT	RPM	REVOLUTIONS PER MINUTE
AP	ACCESS PANEL OR DOOR	EFF	EFFICIENCY	KVA	KILO VOLT - AMPS	SA	SUPPLY AIR GRILLE / REGISTER
ATS	AUTOMATIC TRANSFER SWITCH	ELEV	ELEVATOR	L	LENGTH	SC	SHORT CIRCUIT
AV	AUDIO / VIDEO	EM	EMERGENCY FUNCTION	LAT	LEAVING AIR TEMPERATURE	SCA	SHORT CIRCUIT AVAILABLE
AVG	AVERAGE	ENT	ENTERING	LD	LINEAR DIFFUSER	SCCR	SHORT CIRCUIT CURRENT RATING
AWG	AMERICAN WIRE GAGE	EQ	ELECTRIC METALLIC TUBE	LF	LINEAR FEET	SCH	SCHEDULE
BAS	BUILDING AUTOMATION SYSTEM	EQ	EQUAL	LIN	LINEAR	SD	SMOKE DAMPER
BB	BASEBOARD	EQUIP	EQUIPMENT	LIQ	LIQUID	SEF	SMOKE EXHAUST FAN
BD	BACK DRAFT DAMPER	EQUIV	EQUIVALENT	LM	LUMEN	SF	SUPPLY FAN
BFP	BACK FLOW PREVENTOR	ES	END SWITCH	LRA	LOCKED ROTOR AMPS	SH	SENSIBLE HEAT
BL	BOILER	ESP	EXTERNAL STATIC PRESSURE	LV	LOUVER	SH	SHOWER
BLDG	BUILDING	ET	EXPANSION TANK	LVG	LEAVING	SP	STATIC PRESSURE
BLW	BELOW	EWC	ELECTRIC WATER COOLER	LWT	LEAVING WATER TEMPERATURE	SPD	SURGE PROTECTION DEVICE
BOB	BOTTOM OF BEAM	EWT	ENTERING WATER TEMPERATURE	MBH	THOUSANDS OF BTU PER HOUR	SPEC	SPECIFICATION
BOD	BOTTOM OF DUCT	EX	EXHAUST	MC	MECHANICAL CONTRACTOR	SQ	SQUARE
BOP	BOTTOM OF PIPE	EXPN	EXPANSION	MCA	MINIMUM CIRCUIT AMPACITY	SS	STAINLESS STEEL
BSMT	BASEMENT	EXT	EXTERNAL	MCB	MAIN CIRCUIT BREAKER	SS	SAFETY SHOWER
BTU	BRITISH THERMAL UNIT	F	DEGREES FAHRENHEIT	MD	MOTORIZED DAMPER	STD	STANDARD
C	CHILLER	FA	FREE AREA	MDP	MAIN DISTRIBUTION PANEL	STL	STEEL
CAFCI	COMBINATION ARC FAULT CIRCUIT INTERRUPTERS	FC	FAN COIL UNIT	MED	MEDIUM	SYS	SYSTEM
CAP	CAPACITY	FCV	FLOW CONTROL VALVE	MFR	MANUFACTURER	TEMP	TEMPERATURE
CB	CIRCUIT BREAKER	FD	FIRE DAMPER	MIN	MINIMUM	TR	TRANSFER GRILLE / REGISTER
CBV	CIRCUIT BALANCING VALVE	FD	FLOOR DRAIN	MISC	MISCELLANEOUS	TR	TAMPER RESISTANT
CCT	CORRELATED COLOR TEMPERATURE	FIN	FINISHED	MLO	MAIN LUG ONLY	TT	TEMPERATURE TRANSMITTER
CKT	CIRCUIT	FLA	FULL LOAD AMPS	MOCP	MAXIMUM OVERCURRENT PROTECTION	TB	TELECOMMUNICATIONS TERMINAL BACKBOARD
CFH	CUBIC FEET PER HOUR	FLEX	FLEXIBLE	MTD	MOUNTED	TYP	TYPICAL
CFM	CUBIC FEET PER MINUTE	FLR	FLOOR	MUA	MAKE-UP AIR UNIT	TX	TRANSFORMER
CHWR	CHILLED WATER RETURN	FOT	FLAT ON TOP	N	NEUTRAL	UC	UNDERCUT DOOR
CHWS	CHILLED WATER SUPPLY	FP	FIRE PROTECTION	NC	NORMALLY CLOSED	UH	UNIT HEATER
CI	CAST IRON	FP	FIRE PUMP	NEG	NEGATIVE	UNO	UNLESS NOTED OTHERWISE
CL	CENTER LINE	FPM	FEET PER MINUTE	NIC	NOT IN CONTRACT	UNOCC	UNOCCUPIED
CLG	CEILING	FPS	FEET PER SECOND	NL	NIGHT / SECURITY LIGHT - DO NOT SWITCH	UR	URINAL
CMU	CONCRETE MASONRY UNIT	FSS	FEET PER SECOND	NO	NORMALLY OPEN	V	VOLTS
CO	CLEAN OUT	FS	FIRE/SMOKE DAMPER	NOM	NOMINAL	VA	VOLT AMPERE
COL	COLUMN	FT	FEET	NTS	NOT TO SCALE	VA	VALVE
COMP	COMPRESSOR	FXC	FLEXIBLE CONNECTION	OA	OUTSIDE AIR	VAV	VARIABLE AIR VOLUME UNIT
CONC	CONCRETE	GND	GROUND	OBD	OPPOSED BLADE DAMPER	VFD	VARIABLE FREQUENCY DRIVE
COND	CONDENSATE	GA	GAUGE	OC	ON CENTER	VRF	VARIABLE REFRIGERANT FLOW
CONN	CONNECTION	GAL	GALLON	OCC	OCCUPIED	VLT	VOLTAGE
CONT	CONTINUATION	GALV	GALVANIZED	OD	OUTSIDE DIAMETER	VTR	VENT THROUGH ROOF
CONTR	CONTRACTOR	GEC	GROUND ELECTRODE CONDUCTOR	OL	OVERLOAD	W	WIDTH
CRI	COLOR RENDERING INDEX	GFCI / GFI	GROUND FAULT CIRCUIT INTERRUPTER	ORD	OVERFLOW ROOF DRAIN	W	WATTS
CT	COOLING TOWER	GC	GENERAL CONTRACTOR	OZ	OUNCE	W	WITH
CT	CURRENT TRANSFORMER	GPH	GALLONS PER HOUR	PBD	PARALLEL BLADE DAMPER	W/O	WITHOUT
CU	CONDENSING UNIT	GPM	GALLONS PER MINUTE	PD	PRESSURE DROP	WB	WET BULB
CU	COPPER	GPM	GALLONS PER MINUTE	PH	PHASE	WC	WATER COLUMN
CUH	CABINET UNIT HEATER	GSLB	GRAMS PER POUND	POS	POSITIVE PRESSURE	WG	WATER GUAGE
CVB	CONSTANT VOLUME BOX	H2O	WATER	POS	POINT OF SALES	WP	WEATHERPROOF
CWR	CONDENSER WATER RETURN	HB	HOSE BIBB	PRV	PRESSURE REDUCING VALVE	WPIU	WEATHERPROOF IN-JUSE
CWS	CONDENSER WATER SUPPLY	HD	HEAD (SEE SCHEDULES)	PS	PRESSURE SWITCH	WTR	WITHSTAND RATING
DB	DRY BULB	HP	HEAT PUMP	PT	PRESSURE TRANSMITTER	XFMR	TRANSFORMER
DEPT	DEPARTMENT						
DF	DRINKING FOUNTAIN						

SUBSTITUTIONS:

A. SUBSTITUTIONS, SUBSTITUTION OF SPECIFIED EQUIPMENT WILL BE ALLOWED THROUGH A PRIOR APPROVAL PROCESS INITIATED BY THE CONTRACTOR. CONTRACTOR SHALL SUBMIT INTENDED SUBSTITUTION AT LEAST FIVE DAYS PRIOR TO BID FOR APPROVAL FROM ENGINEER. SUBMITTAL SHALL INCLUDE CAPACITIES, DIMENSIONS AND OPERATING INSTRUCTIONS FOR EACH PIECE OF EQUIPMENT. SUBSTITUTION SHALL OCCUR AT NO COST TO THE OWNER. CONTRACTOR IS RESPONSIBLE FOR COORDINATION OF APPROVED SUBSTITUTION AND SHALL INCUR ALL COSTS ASSOCIATED WITH THE SUBSTITUTION INCLUDING STRUCTURAL MODIFICATIONS, SPACE LAYOUT AND REDESIGN COSTS. SEE ALSO DIVISION I GENERAL REQUIREMENTS.

EXAMINATION OF SITE, DRAWINGS, SPECIFICATIONS:

A. EXAMINE CAREFULLY THE SITE AND CONDITIONS OF THE SITE. PROVIDE ALL NECESSARY EQUIPMENT AND LABOR TO INSTALL A COMPLETE WORKING SYSTEM WITHIN THE SITE CONDITIONS.

B. EXAMINE THE DRAWINGS AND SPECIFICATIONS AND 5 DAYS PRIOR TO BIDDING REPORT ANY ERRORS, OMISSIONS, INCONSISTENCIES, AND CONFLICTS TO THE ENGINEER TO BE REMEDIATED IN AN ADDENDUM TO THE PROJECT PRIOR TO BID TIME.


C. DRAWINGS ARE DIAGRAMMATIC AND CATALOG NUMBERS GIVEN ARE FOR REFERENCE ONLY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE CAPACITY OF THE EQUIPMENT MEETS THE DRAWING REQUIREMENTS AND SHALL NOT DIMENSION FROM THE MECHANICAL, PLUMBING, OR PIPING DRAWINGS.

D. THE LATEST ADOPTED VERSIONS OF THE INTERNATIONAL BUILDING CODES SHALL BE USED AS REQUIRED. THIS WILL ALSO INCLUDE THE LATEST ADOPTED VERSIONS OF THE MECHANICAL, PLUMBING, AND ENERGY CONSERVATION CODES. ALL METHODS AND MATERIALS REQUIRED BY THESE CODES SHALL BE REQUIRED BY THESE SPECIFICATIONS UNLESS INDICATED OTHERWISE. OTHER APPLICABLE LOCAL CODES AND ORDINANCES SHALL BE AS REQUIRED AND IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO BE KNOWLEDGEABLE OF THESE REQUIREMENTS.

E. WHERE INSTALLATION PROCEDURES OR ANY PART THEREOF ARE REQUIRED TO BE IN ACCORDANCE WITH THE RECOMMENDATIONS OF THE MANUFACTURER OF THE MATERIAL BEING INSTALLED, PRINTED COPIES OF THESE RECOMMENDATIONS SHALL BE FURNISHED TO THE ENGINEER PRIOR TO INSTALLATION. INSTALLATION OF THE ITEM WILL NOT BE ALLOWED TO PROCEED UNTIL THE RECOMMENDATIONS ARE RECEIVED. FAILURE TO FURNISH THESE RECOMMENDATIONS CAN BE CAUSE FOR REJECTION OF THE MATERIAL.

DO NOT REPRODUCE THESE DRAWINGS AND SPECIFICATIONS WITHOUT THE EXPRESSED WRITTEN PERMISSION OF THE DESIGNER. THE DRAWINGS AND SPECIFICATIONS ARE INSTRUMENTS OF THE SERVICE AND SHALL REMAIN THE PROPERTY OF THE DESIGNER. WHETHER THE PROJECT FOR WHICH THEY ARE MADE IS EXECUTED OR NOT. THESE DRAWINGS AND SPECIFICATIONS SHALL NOT BE USED BY ANYONE ON ANY OTHER PROJECTS FOR ADDITIONS TO THIS PROJECT BY OTHERS EXCEPT BY THE EXPRESSED WRITTEN PERMISSION OF THE DESIGNER.

Bighorn Consulting Engineers, Inc.
 Mechanical & Electrical Engineers
 386 Indian Road
 Grand Junction, CO 81501
 Phone: (970) 241-8709



RIVERFRONT INDUSTRIAL PARK
 PLUMBING - COVER SHEET
 1522 SHIELD DRIVE
 STEAMBOAT SPRINGS, COLORADO


DATE:	ISSUED FOR:
09/17/2024	PERMIT




DATE:	09/06/2024
JOB NO:	24-056
DRAWN BY:	---
CHECKED BY:	---
SCALE:	---
SHEET NUMBER:	P0-1

DO NOT REPRODUCE THESE DRAWINGS AND SPECIFICATIONS WITHOUT THE EXPRESSED WRITTEN PERMISSION OF THE DESIGNER. THE DRAWINGS AND SPECIFICATIONS ARE INSTRUMENTS OF THE SERVICE AND SHALL REMAIN THE PROPERTY OF THE DESIGNER. WHETHER THE PROJECT FOR WHICH THEY ARE MADE IS EXECUTED OR NOT, THESE DRAWINGS AND SPECIFICATIONS SHALL NOT BE USED BY ANYONE ON ANY OTHER PROJECTS FOR ADDITIONS TO THIS PROJECT BY OTHERS EXCEPT BY THE EXPRESSED WRITTEN PERMISSION OF THE DESIGNER.

Bighorn Consulting Engineers, Inc.
 Mechanical & Electrical Engineers
 386 Indian Road
 Grand Junction, CO 81501
 Phone: (970) 241-8709



RIVERFRONT INDUSTRIAL PARK
 MECHANICAL & PLUMBING - B3 LEVEL 1 FLOOR PLAN
 1522 SHIELD DRIVE
 STEAMBOAT SPRINGS, COLORADO

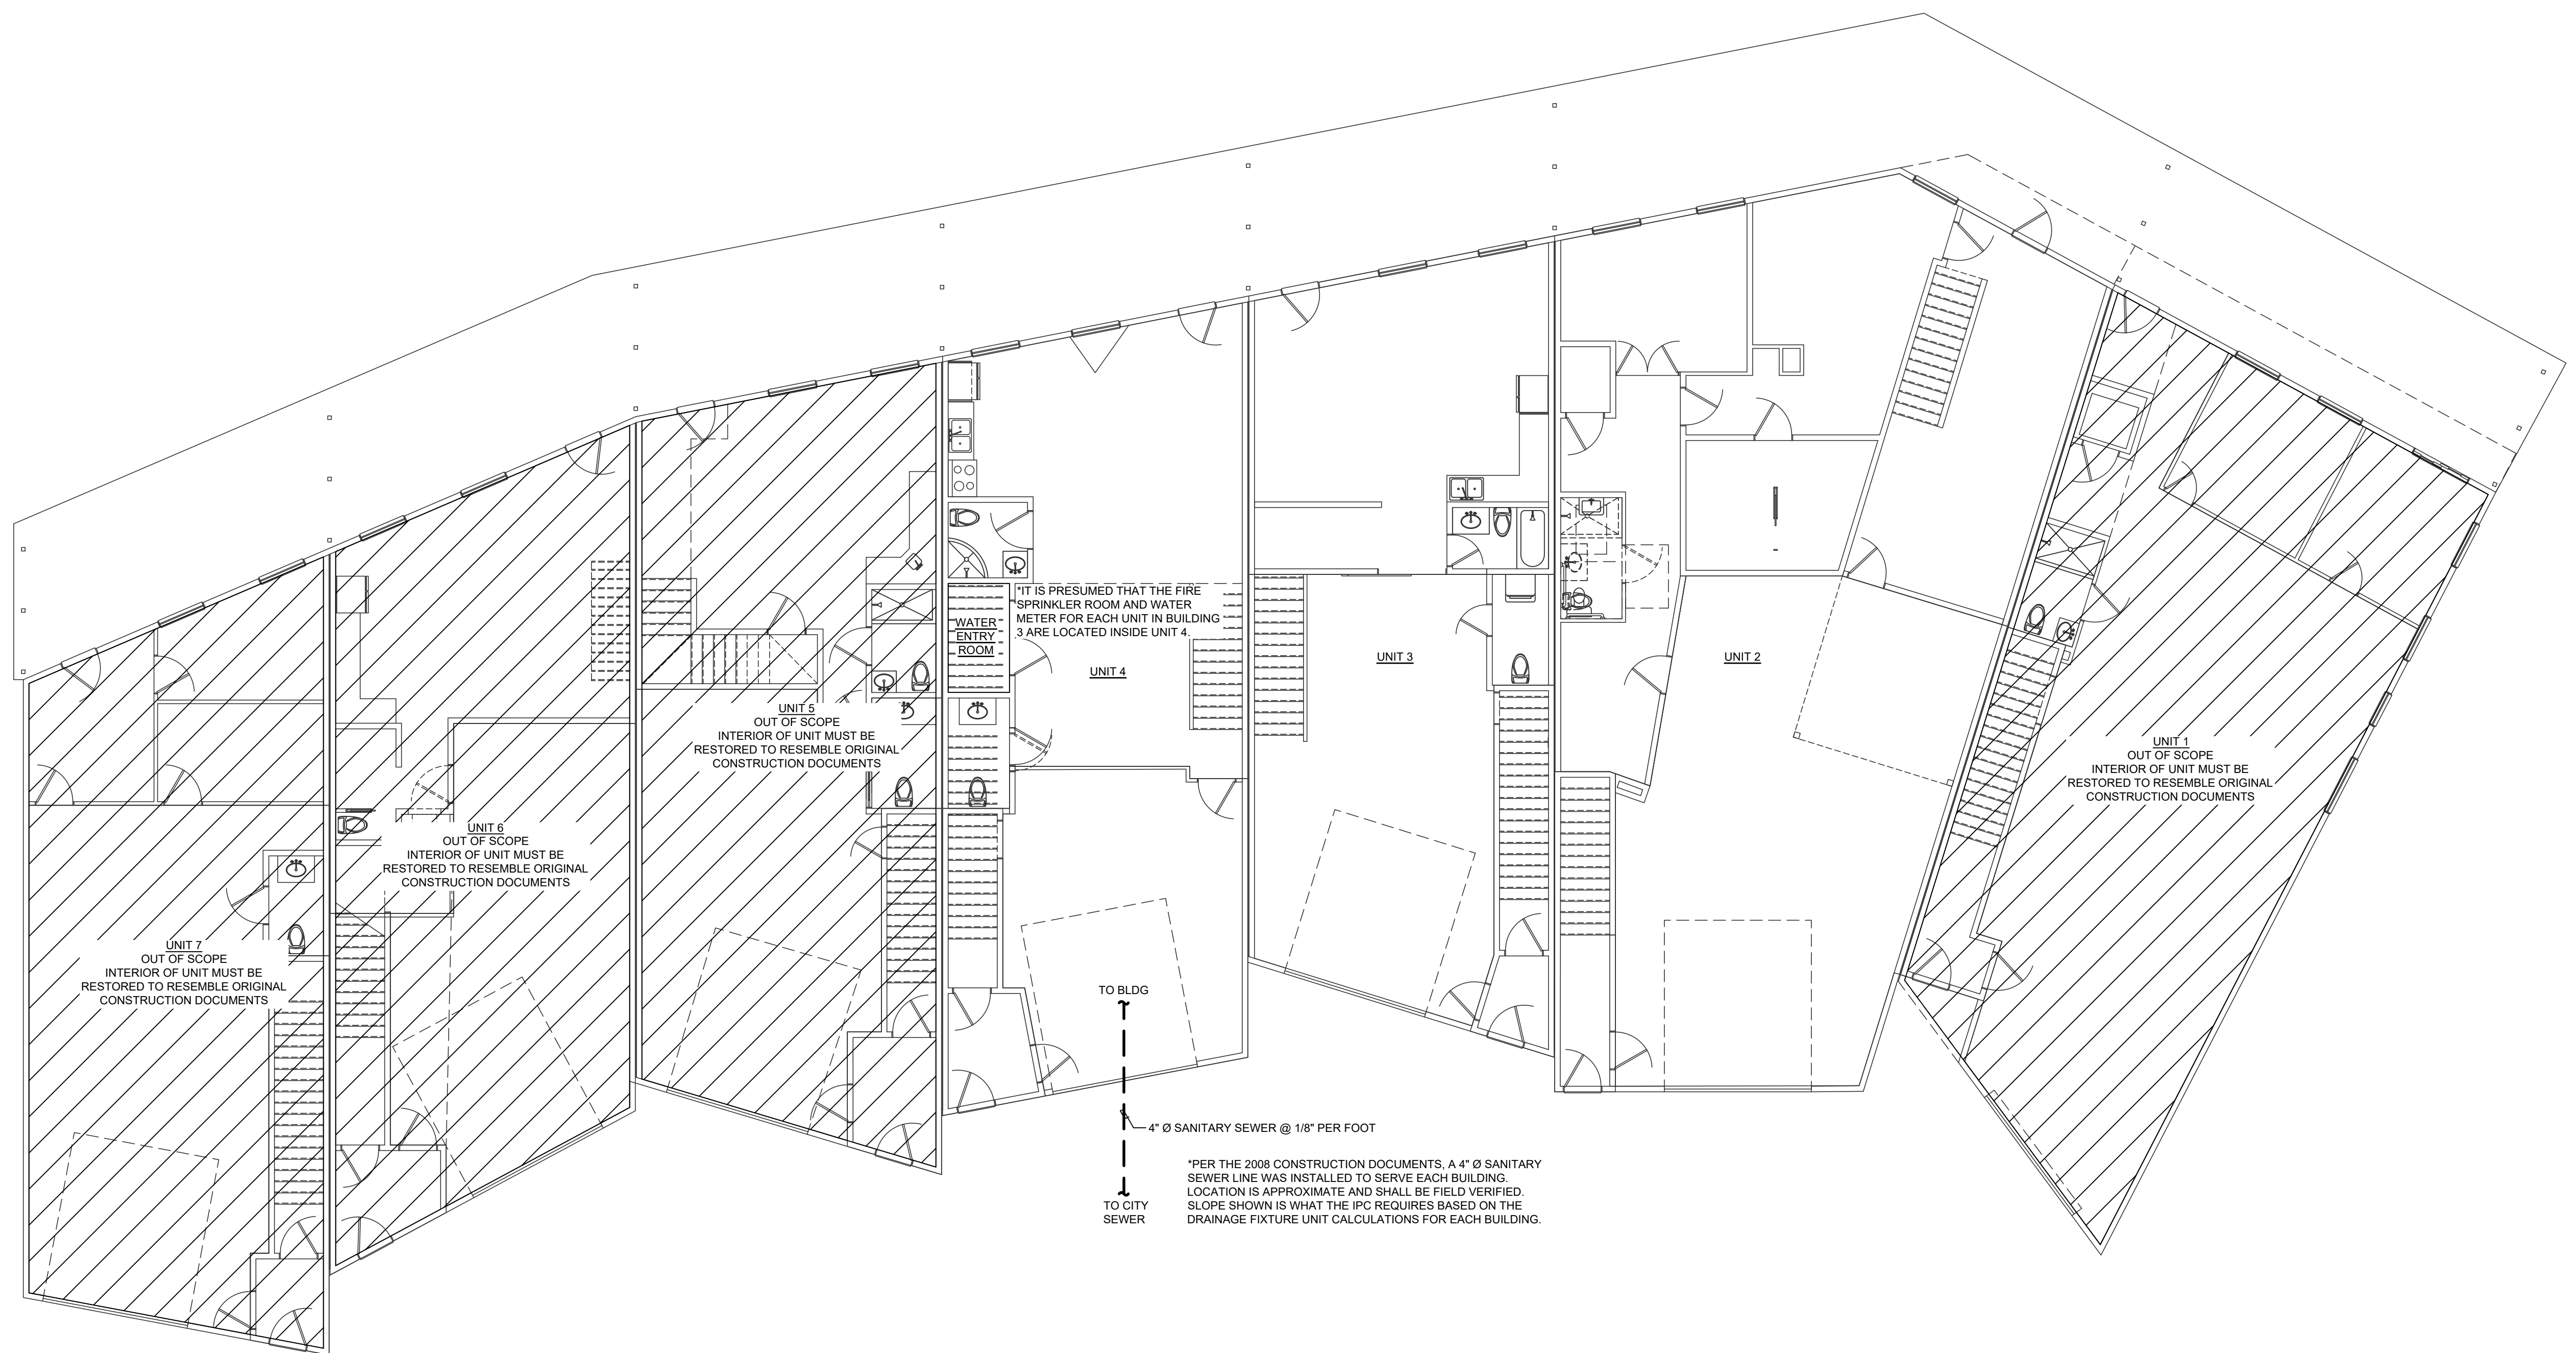

IT IS PRESUMED THAT THE FIRE SPRINKLER ROOM AND WATER METER FOR EACH UNIT IN BUILDING 3 ARE LOCATED INSIDE UNIT 4.

UNIT 5
 OUT OF SCOPE
 INTERIOR OF UNIT MUST BE RESTORED TO RESEMBLE ORIGINAL CONSTRUCTION DOCUMENTS

UNIT 6
 OUT OF SCOPE
 INTERIOR OF UNIT MUST BE RESTORED TO RESEMBLE ORIGINAL CONSTRUCTION DOCUMENTS

UNIT 7
 OUT OF SCOPE
 INTERIOR OF UNIT MUST BE RESTORED TO RESEMBLE ORIGINAL CONSTRUCTION DOCUMENTS

TO BLDG
 ↓
 4" Ø SANITARY SEWER @ 1/8" PER FOOT
 ↓
 TO CITY SEWER



*PER THE 2008 CONSTRUCTION DOCUMENTS, A 4" Ø SANITARY SEWER LINE WAS INSTALLED TO SERVE EACH BUILDING. LOCATION IS APPROXIMATE AND SHALL BE FIELD VERIFIED. SLOPE SHOWN IS WHAT THE IPC REQUIRES BASED ON THE DRAINAGE FIXTURE UNIT CALCULATIONS FOR EACH BUILDING.

MECHANICAL & PLUMBING - B3 LEVEL 1 FLOOR PLAN
 SCALE: 1/8" = 1'-0"

DATE:	ISSUED FOR:
09/17/2024	PERMIT



DATE:	09/06/2024
JOB NO:	24-056
DRAWN BY:	---
CHECKED BY:	---
SCALE:	AS SHOWN
SHEET NUMBER:	MP1-1

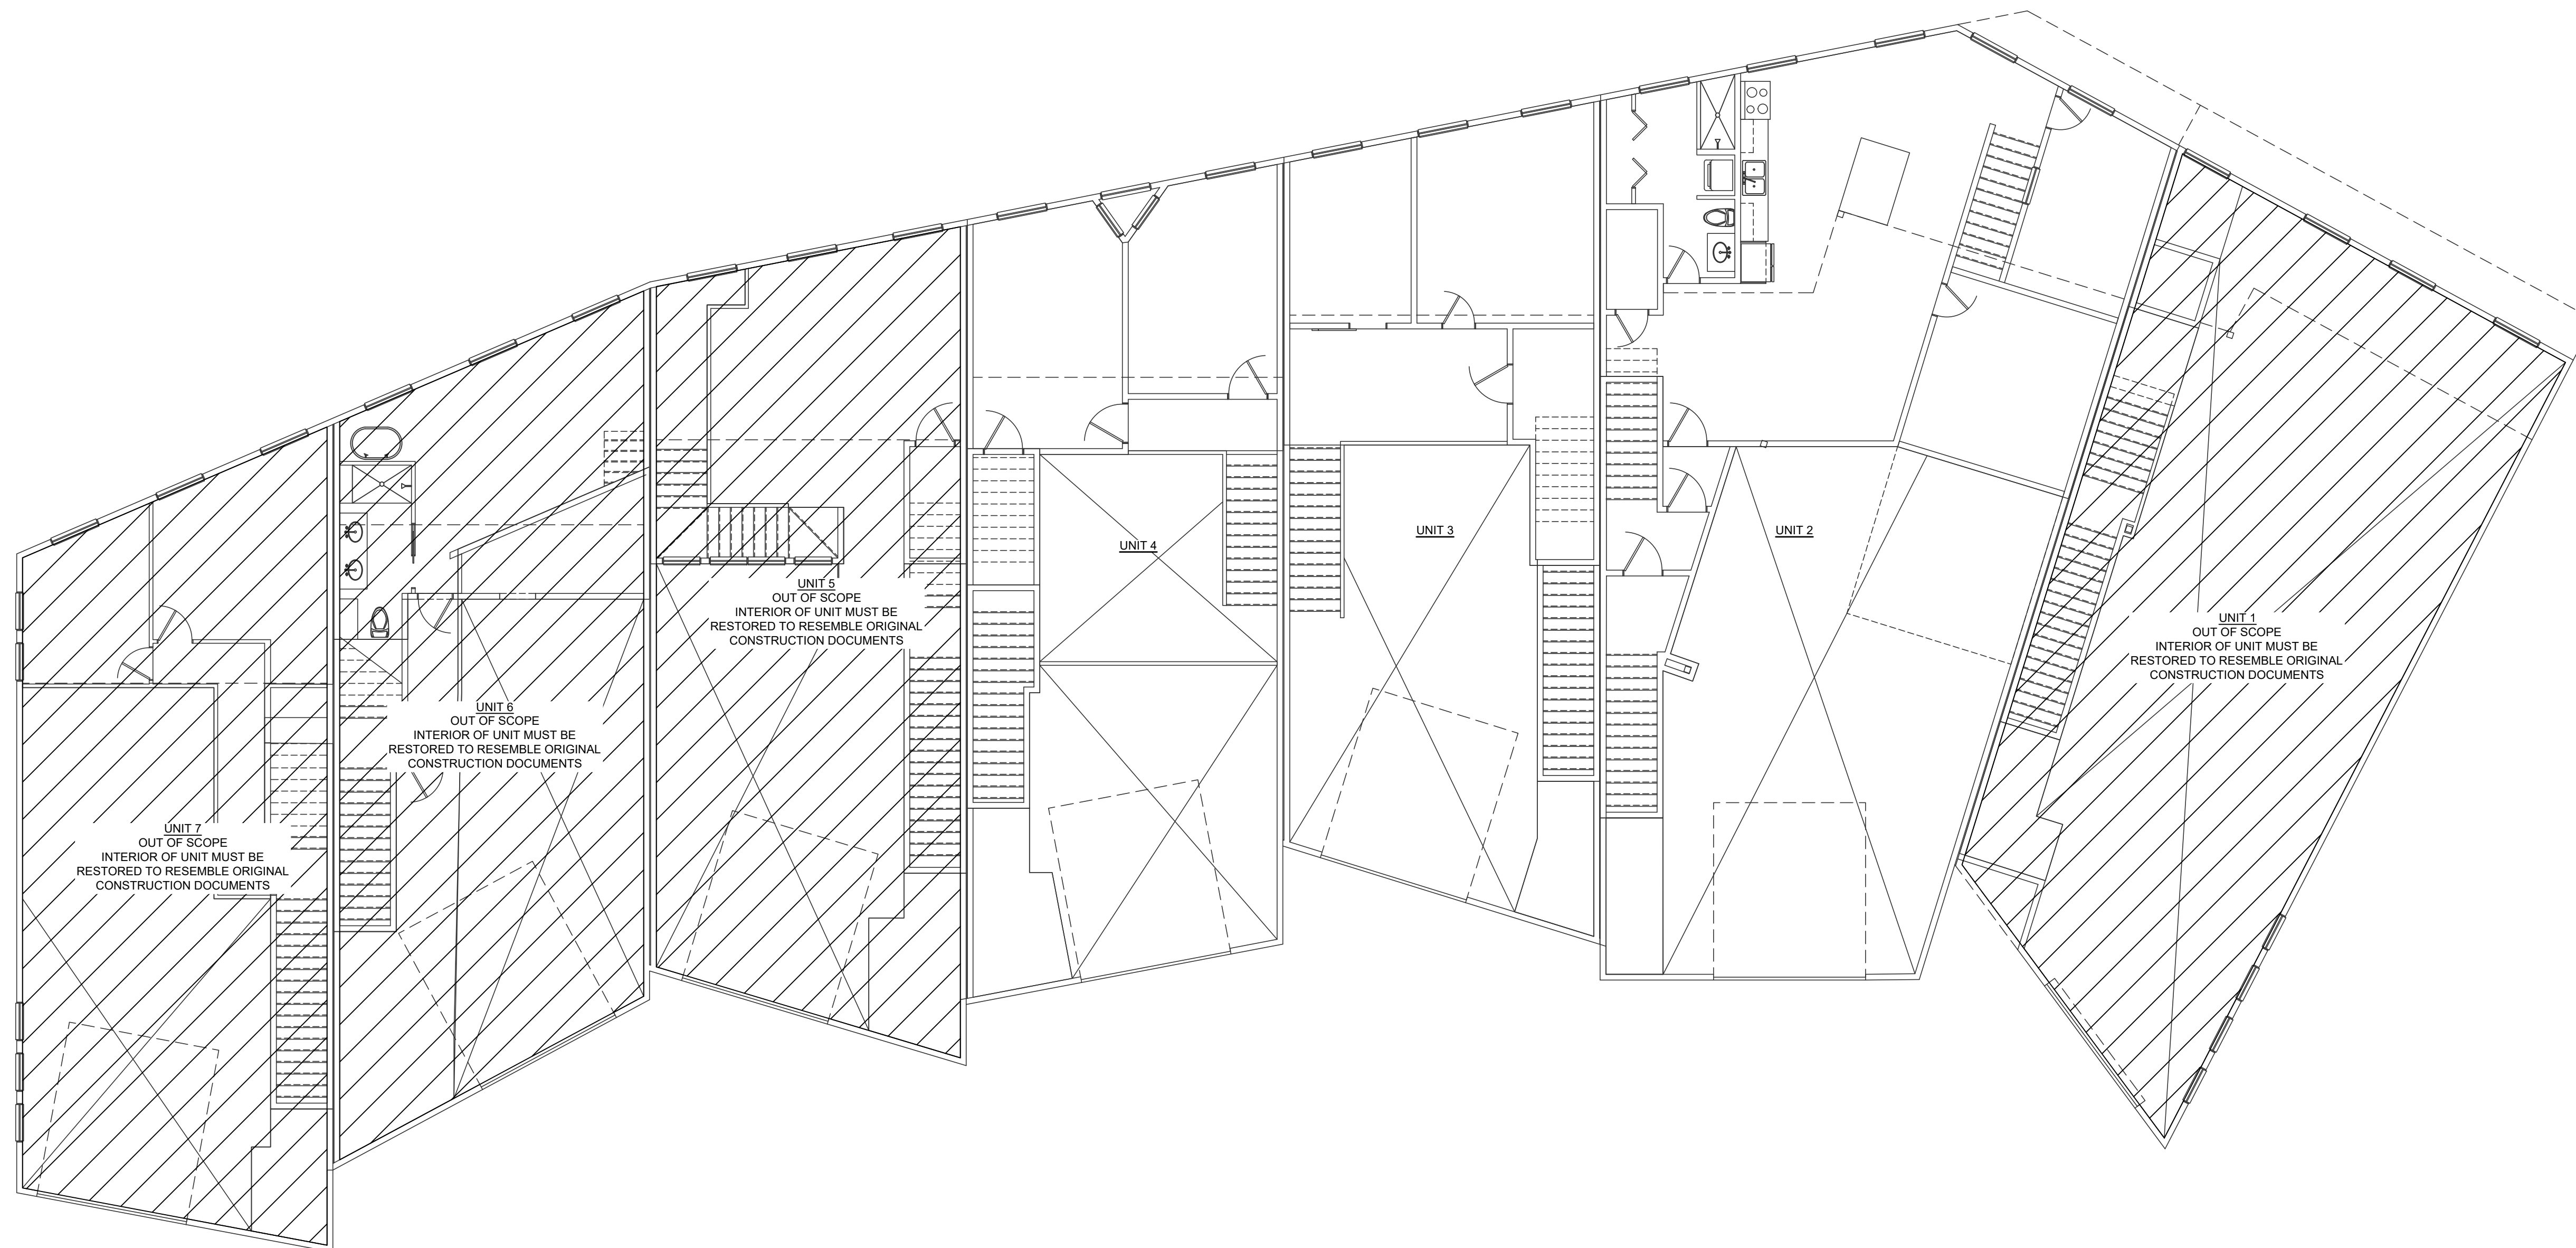


MECHANICAL & PLUMBING - B3 LEVEL 2 FLOOR PLAN

SCALE: 1/8" = 1'-0"

DO NOT REPRODUCE THESE DRAWINGS AND SPECIFICATIONS WITHOUT THE EXPRESSED WRITTEN PERMISSION OF THE DESIGNER. THE DRAWINGS AND SPECIFICATIONS ARE INSTRUMENTS OF THE SERVICE AND SHALL REMAIN THE PROPERTY OF THE DESIGNER. WHETHER THE PROJECT FOR WHICH THEY ARE MADE IS EXECUTED OR NOT, THESE DRAWINGS AND SPECIFICATIONS SHALL NOT BE USED BY ANYONE ON ANY OTHER PROJECTS FOR ADDITIONS TO THIS PROJECT BY OTHERS EXCEPT BY THE EXPRESSED WRITTEN PERMISSION OF THE DESIGNER.

Bighorn Consulting Engineers, Inc.
 Mechanical & Electrical Engineers
 386 Indian Road
 Grand Junction, CO 81501
 Phone: (970) 241-8709




RIVERFRONT INDUSTRIAL PARK
 MECHANICAL & PLUMBING - B3 LEVEL 2 FLOOR PLAN
 1522 SHIELD DRIVE
 STEAMBOAT SPRINGS, COLORADO

DATE:	ISSUED FOR:
09/17/2024	PERMIT



DATE:	09/06/2024
JOB NO:	24-056
DRAWN BY:	---
CHECKED BY:	---
SCALE:	AS SHOWN
SHEET NUMBER:	MP1-2

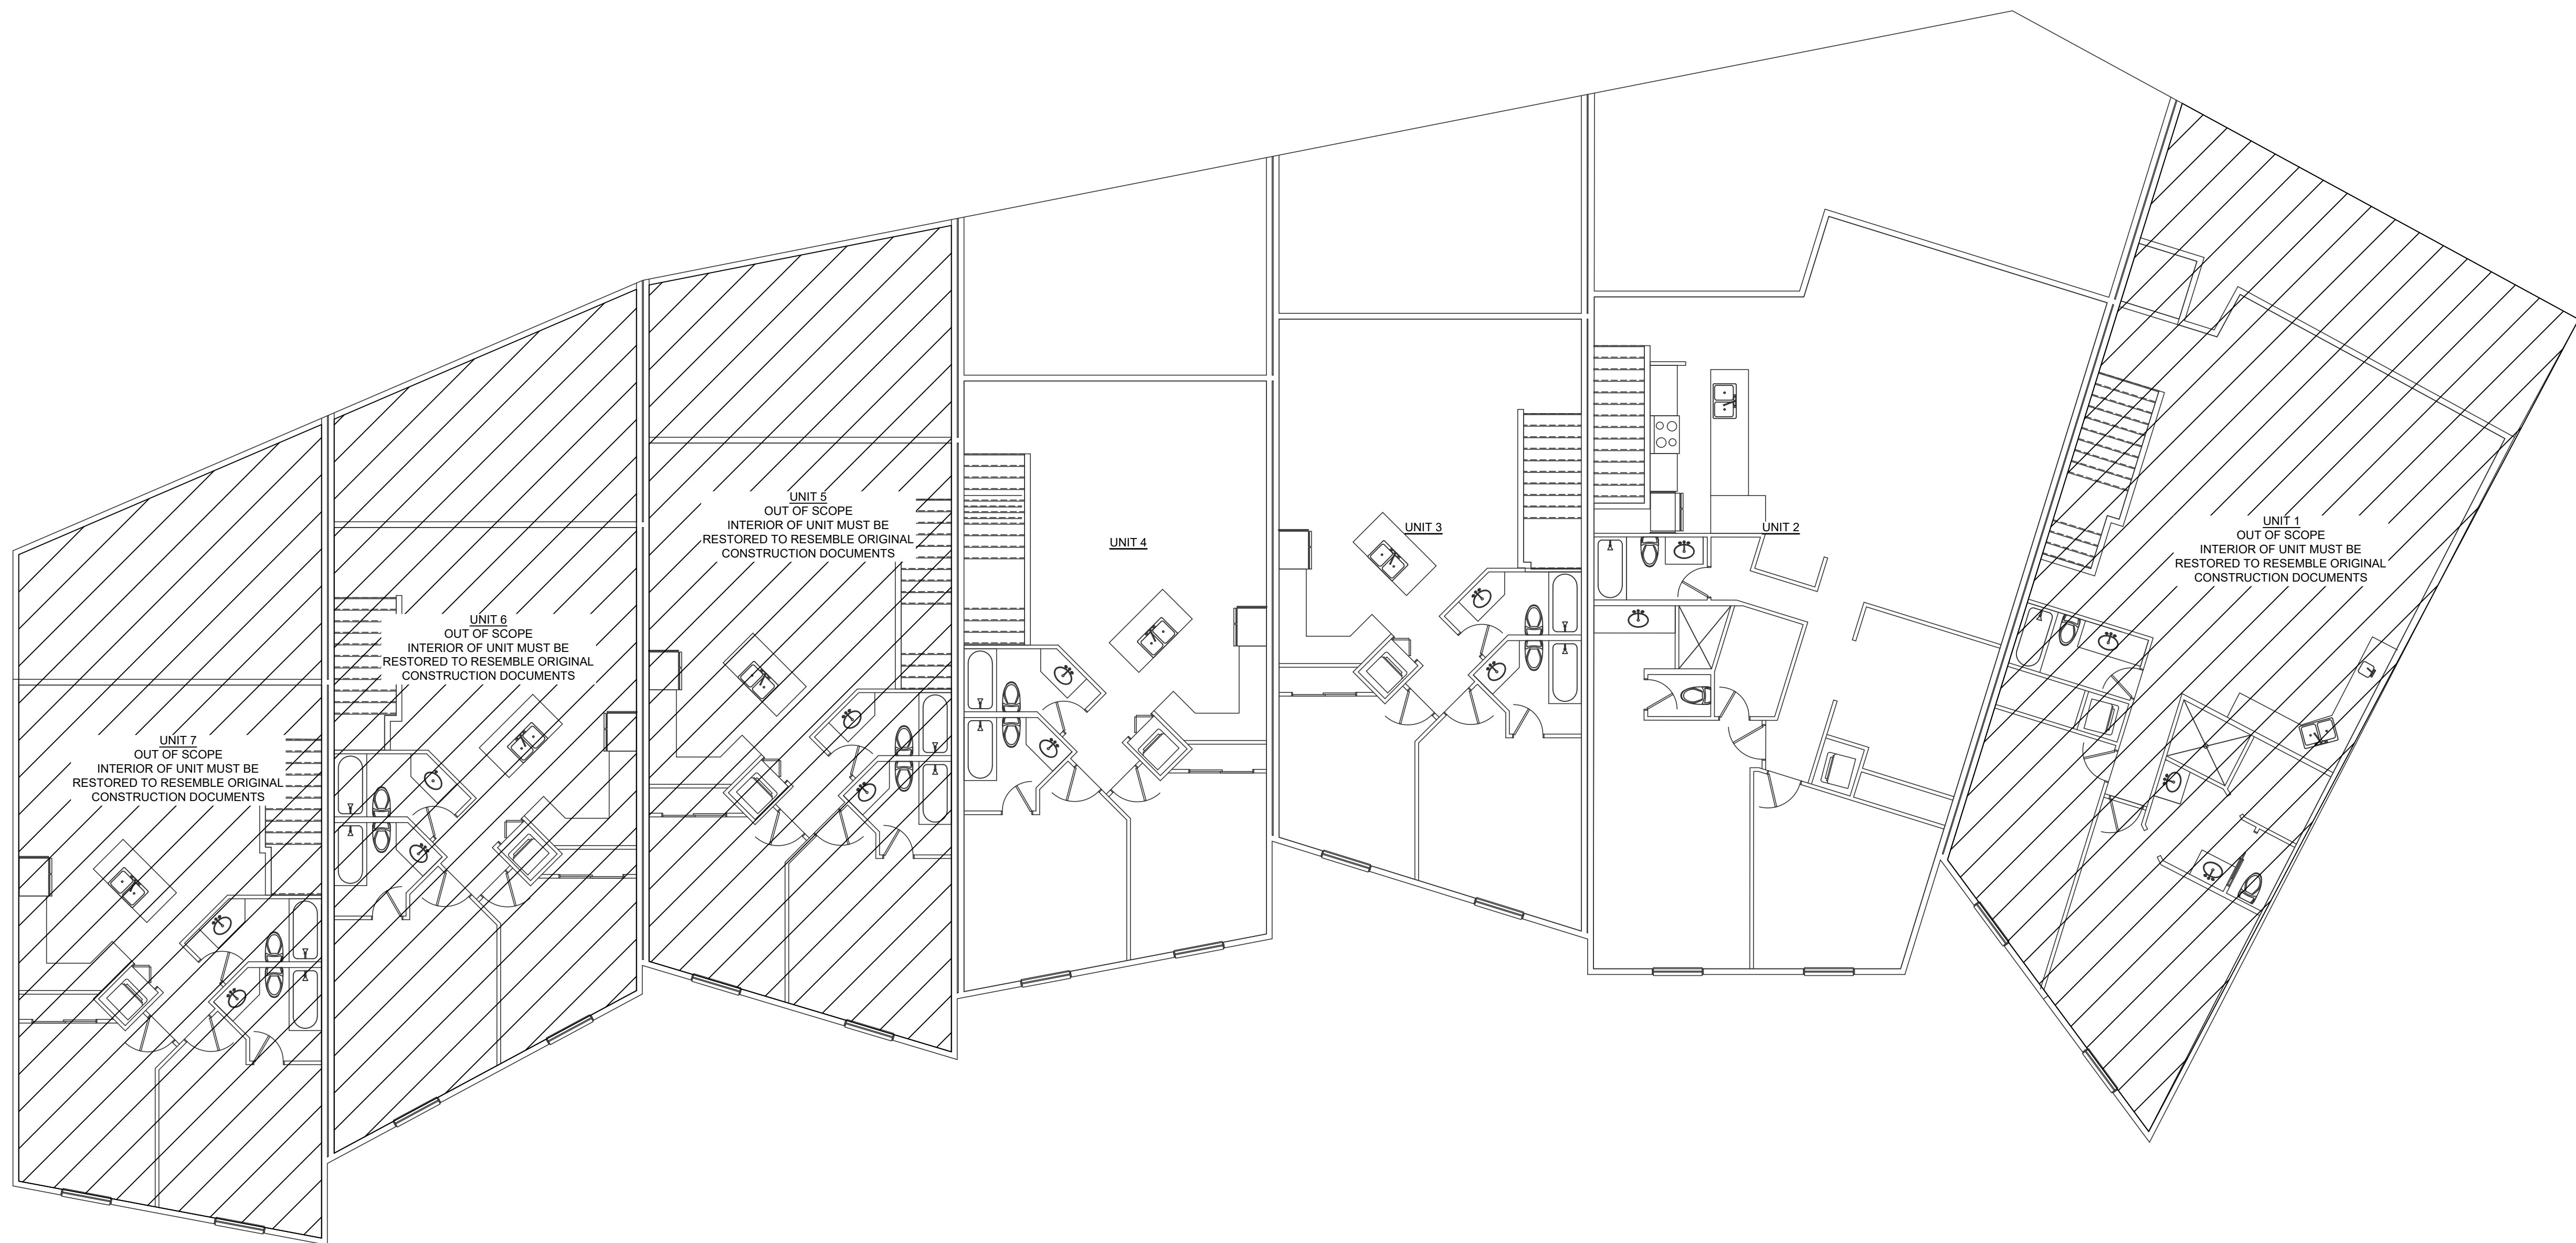


MECHANICAL & PLUMBING - B3 LEVEL 3 FLOOR PLAN

SCALE: 1/8" = 1'-0"

DO NOT REPRODUCE THESE DRAWINGS AND SPECIFICATIONS WITHOUT THE EXPRESSED WRITTEN PERMISSION OF THE DESIGNER. THE DRAWINGS AND SPECIFICATIONS ARE INSTRUMENTS OF THE SERVICE AND SHALL REMAIN THE PROPERTY OF THE DESIGNER. WHETHER THE PROJECT FOR WHICH THEY ARE MADE IS EXECUTED OR NOT, THESE DRAWINGS AND SPECIFICATIONS SHALL NOT BE USED BY ANYONE ON ANY OTHER PROJECTS FOR ADDITIONS TO THIS PROJECT BY OTHERS EXCEPT BY THE EXPRESSED WRITTEN PERMISSION OF THE DESIGNER.

Bighorn Consulting Engineers, Inc.
 Mechanical & Electrical Engineers
 386 Indian Road
 Grand Junction, CO 81501
 Phone: (970) 241-8709



RIVERFRONT INDUSTRIAL PARK
 MECHANICAL & PLUMBING - B3 LEVEL 3 FLOOR PLAN
 1522 SHIELD DRIVE
 STEAMBOAT SPRINGS, COLORADO

DATE:	ISSUED FOR:
09/17/2024	PERMIT




DATE:	09/08/2024
JOB NO:	24-056
DRAWN BY:	---
CHECKED BY:	---
SCALE:	AS SHOWN
SHEET NUMBER:	MP1-3

DO NOT REPRODUCE THESE DRAWINGS AND SPECIFICATIONS WITHOUT THE EXPRESSED WRITTEN PERMISSION OF THE DESIGNER. THE DRAWINGS AND SPECIFICATIONS ARE INSTRUMENTS OF THE SERVICE AND SHALL REMAIN THE PROPERTY OF THE DESIGNER. WHETHER THE PROJECT FOR WHICH THEY ARE MADE IS EXECUTED OR NOT, THESE DRAWINGS AND SPECIFICATIONS SHALL NOT BE USED BY ANYONE ON ANY OTHER PROJECTS FOR ADDITIONS TO THIS PROJECT BY OTHERS EXCEPT BY THE EXPRESSED WRITTEN PERMISSION OF THE DESIGNER.

Bighorn Consulting Engineers, Inc.
 Mechanical & Electrical Engineers
 386 Indian Road
 Grand Junction, CO 81501
 Phone: (970) 241-8709

RIVERFRONT INDUSTRIAL PARK
 MECHANICAL & PLUMBING - B4 LEVEL 1 FLOOR PLAN
 1522 SHIELD DRIVE
 STEAMBOAT SPRINGS, COLORADO

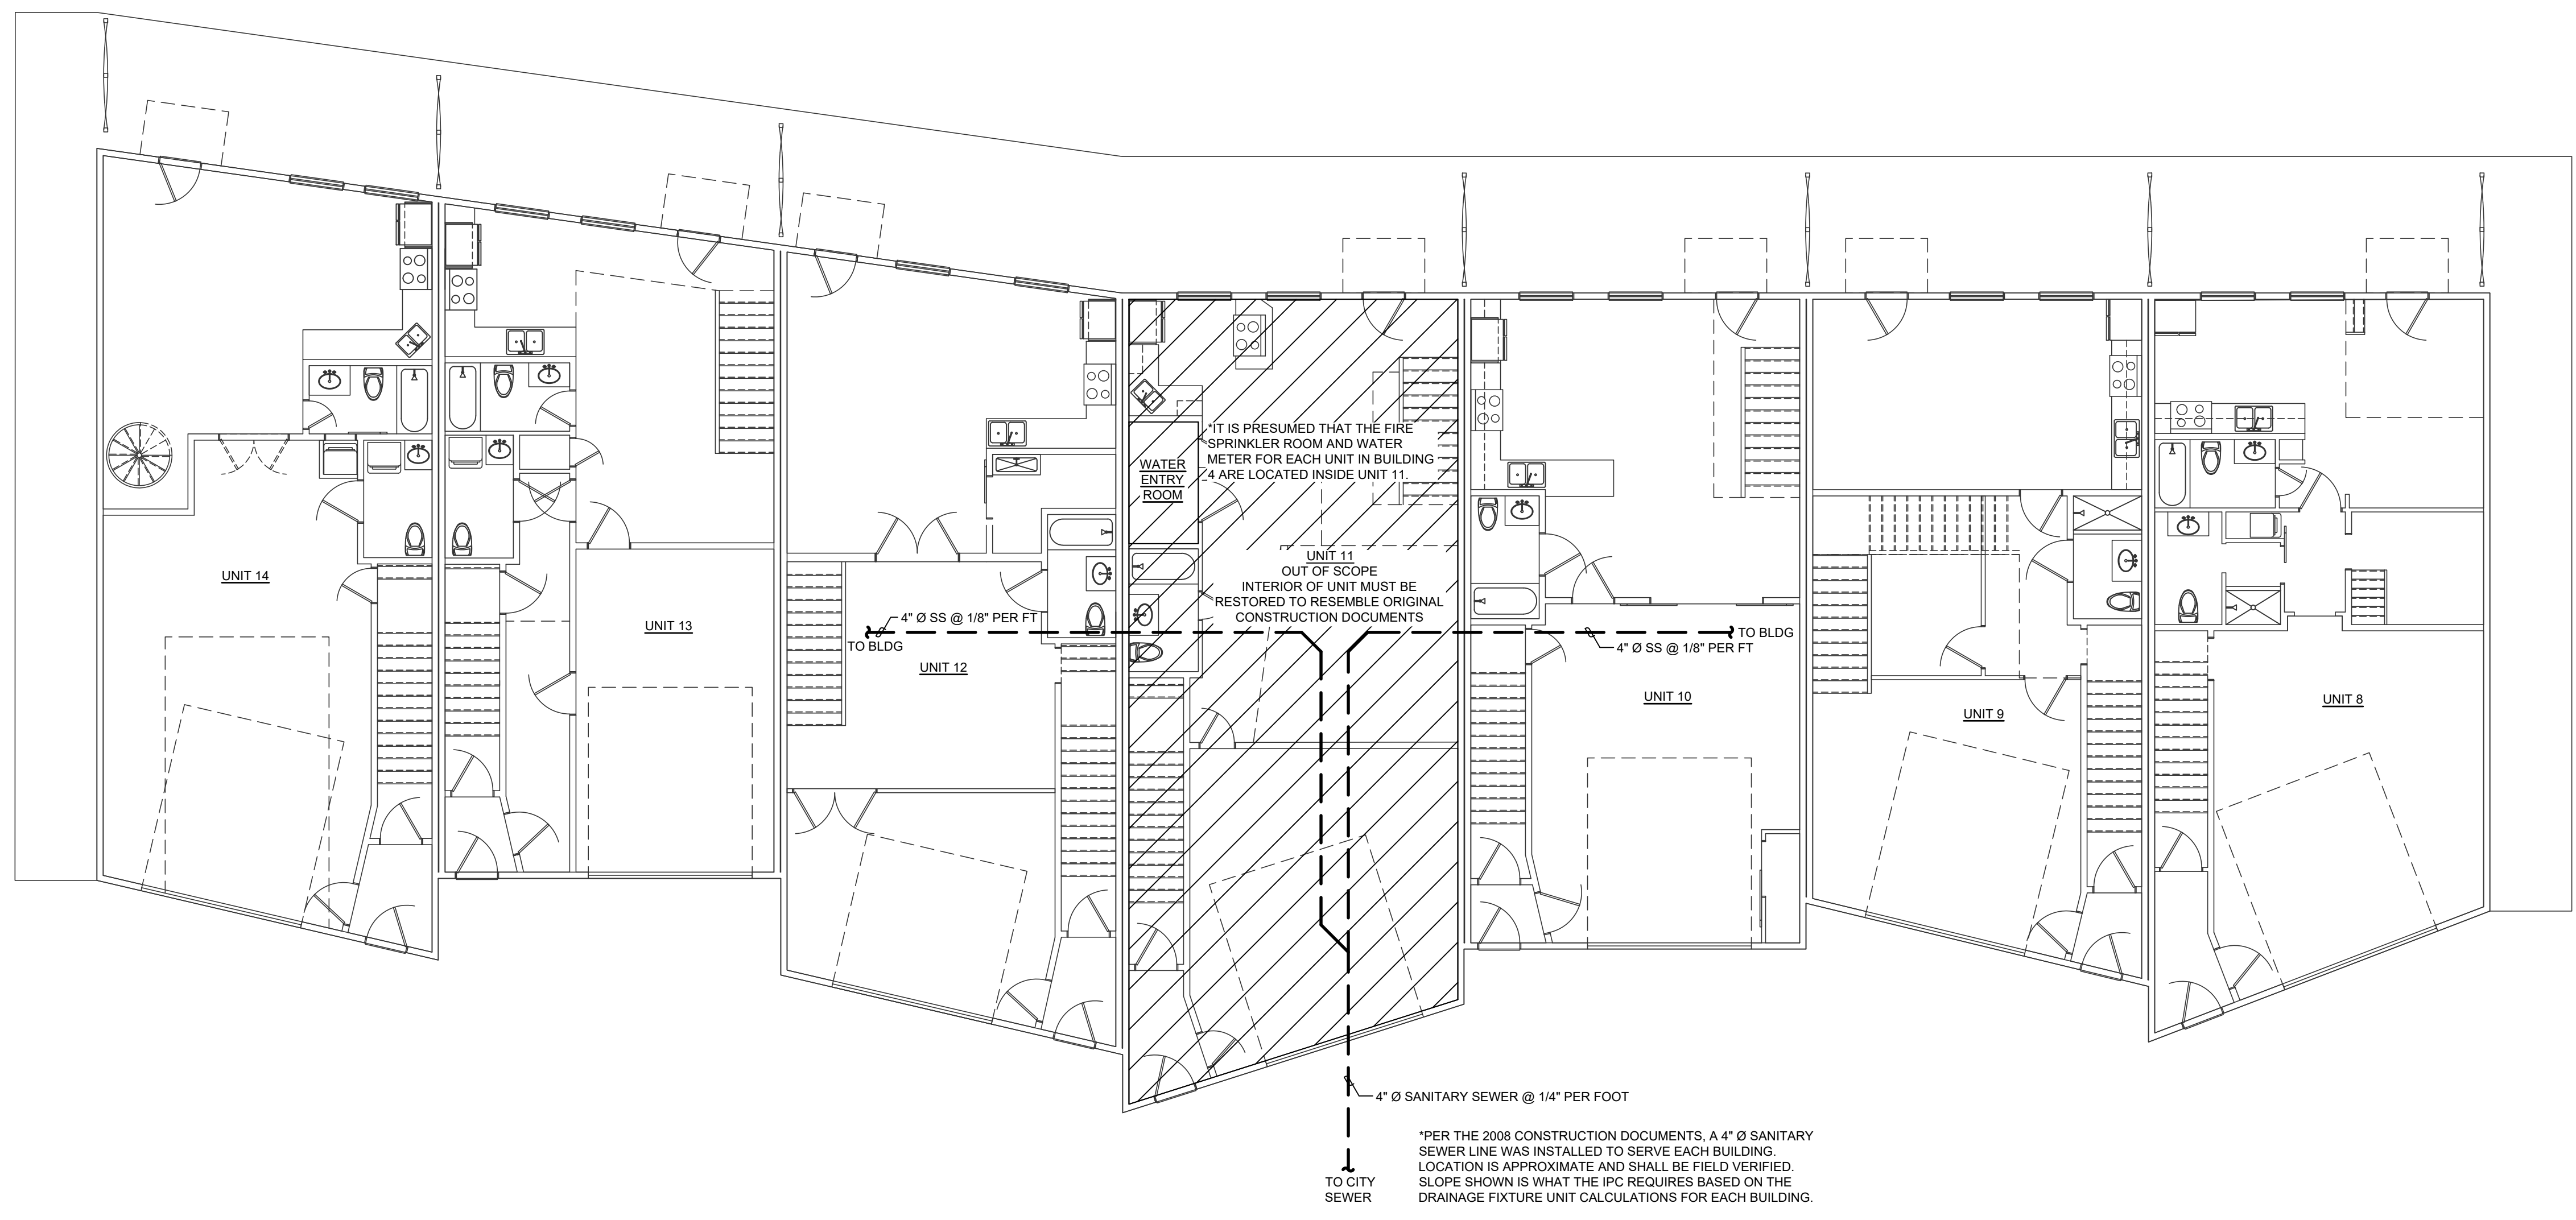


DATE:	ISSUED FOR:
09/17/2024	PERMIT



DATE:	09/08/2024
JOB NO:	24-056
DRAWN BY:	---
CHECKED BY:	---
SCALE:	AS SHOWN
SHEET NUMBER:	MP1-4

MECHANICAL & PLUMBING - B4 LEVEL 1 FLOOR PLAN
 SCALE: 1/8" = 1'-0"
 NORTH

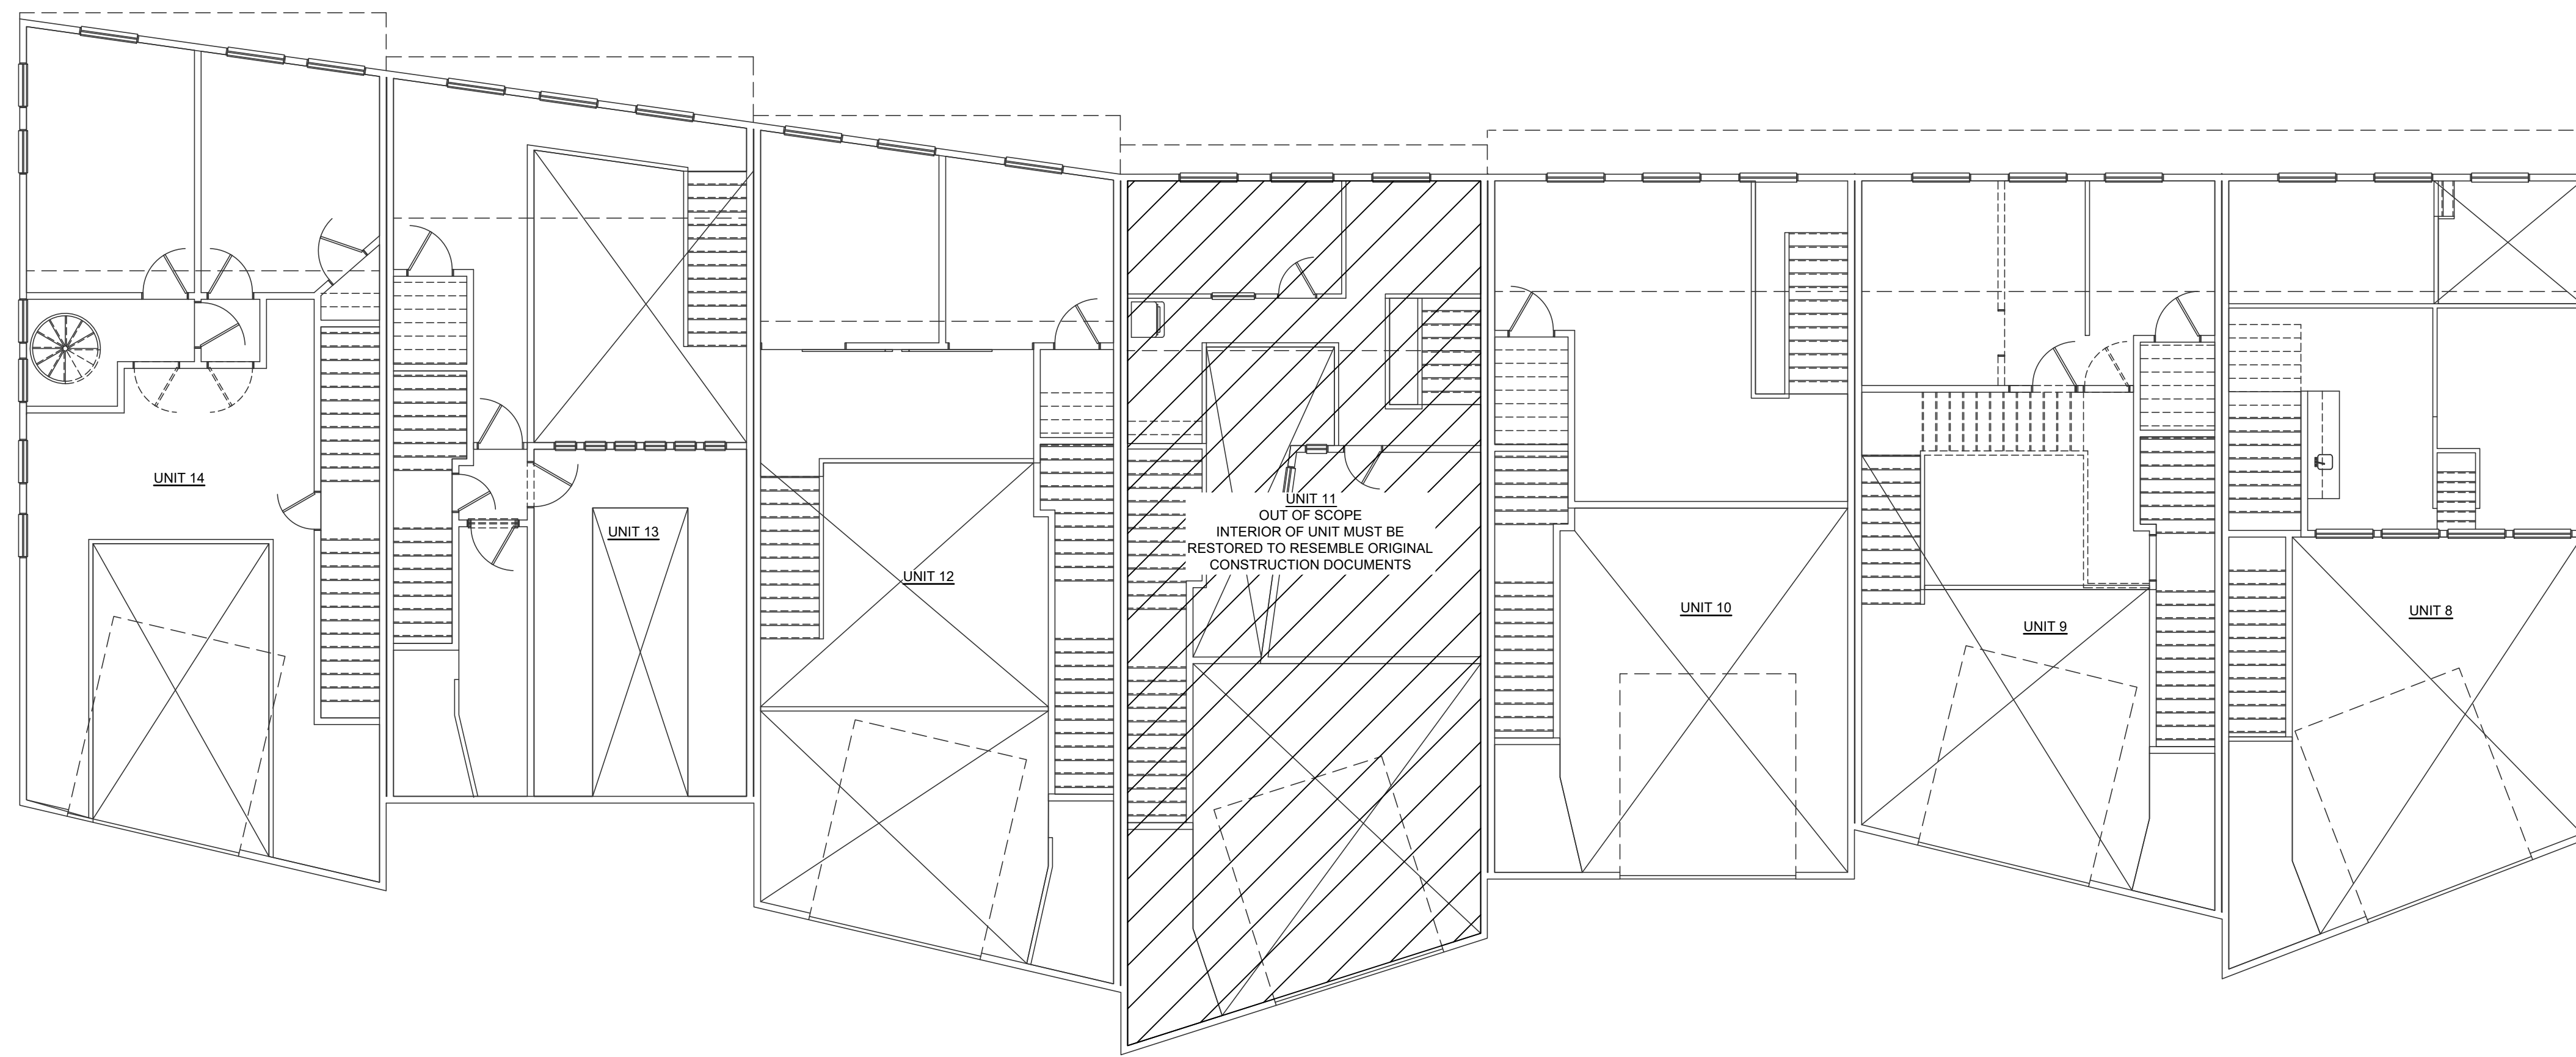

MECHANICAL & PLUMBING - B4 LEVEL 2 FLOOR PLAN
 SCALE: 1/8" = 1'-0"
 NORTH

DO NOT REPRODUCE THESE DRAWINGS AND SPECIFICATIONS WITHOUT THE EXPRESSED WRITTEN PERMISSION OF THE DESIGNER. THE DRAWINGS AND SPECIFICATIONS ARE INSTRUMENTS OF THE SERVICE AND SHALL REMAIN THE PROPERTY OF THE DESIGNER. WHETHER THE PROJECT FOR WHICH THEY ARE MADE IS EXECUTED OR NOT, THESE DRAWINGS AND SPECIFICATIONS SHALL NOT BE USED BY ANYONE ON ANY OTHER PROJECTS FOR ADDITIONS TO THIS PROJECT BY OTHERS EXCEPT BY THE EXPRESSED WRITTEN PERMISSION OF THE DESIGNER.


Bighorn Consulting Engineers, Inc.
 Mechanical & Electrical Engineers
 386 Indian Road
 Grand Junction, CO 81501
 Phone: (970) 241-8709

RIVERFRONT INDUSTRIAL PARK
 MECHANICAL & PLUMBING - B4 LEVEL 2 FLOOR PLAN
 1522 SHIELD DRIVE
 STEAMBOAT SPRINGS, COLORADO

DATE:	ISSUED FOR:
09/17/2024	PERMIT




DATE:	09/08/2024
JOB NO:	24-056
DRAWN BY:	---
CHECKED BY:	---
SCALE:	AS SHOWN
SHEET NUMBER:	MP1-5

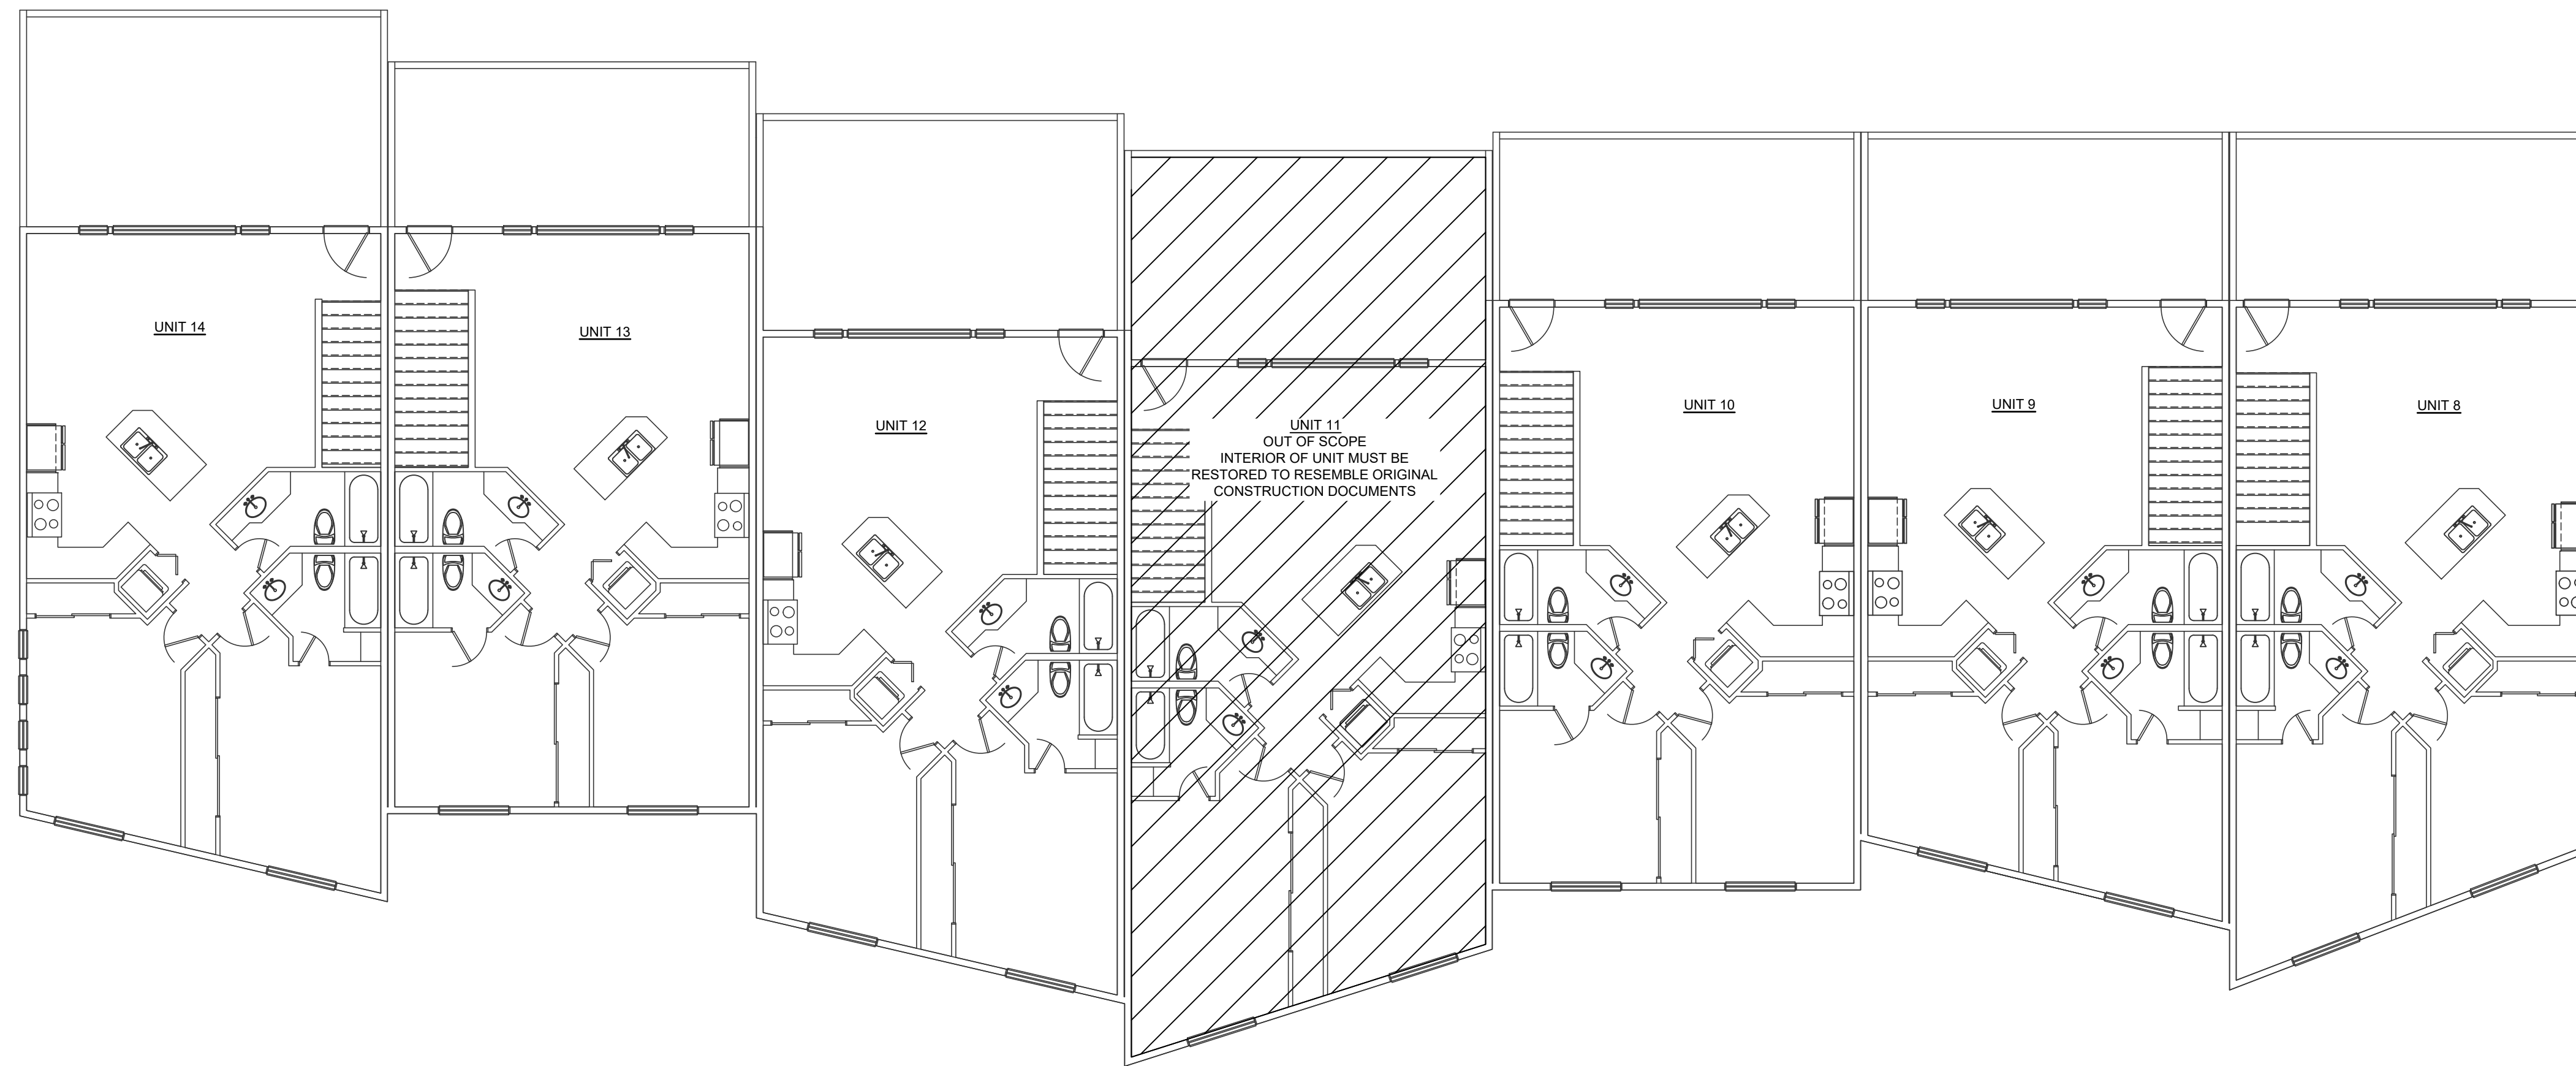

MECHANICAL & PLUMBING - B4 LEVEL 3 FLOOR PLAN
 SCALE: 1/8" = 1'-0"
 NORTH

DO NOT REPRODUCE THESE DRAWINGS AND SPECIFICATIONS WITHOUT THE EXPRESSED WRITTEN PERMISSION OF THE DESIGNER. THE DRAWINGS AND SPECIFICATIONS ARE INSTRUMENTS OF THE SERVICE AND SHALL REMAIN THE PROPERTY OF THE DESIGNER. WHETHER THE PROJECT FOR WHICH THEY ARE MADE IS EXECUTED OR NOT, THESE DRAWINGS AND SPECIFICATIONS SHALL NOT BE USED BY ANYONE ON ANY OTHER PROJECTS FOR ADDITIONS TO THIS PROJECT BY OTHERS EXCEPT BY THE EXPRESSED WRITTEN PERMISSION OF THE DESIGNER.

Bighorn Consulting Engineers, Inc.
 Mechanical & Electrical Engineers
 386 Indian Road
 Grand Junction, CO 81501
 Phone: (970) 241-8709



RIVERFRONT INDUSTRIAL PARK
 MECHANICAL & PLUMBING - B4 LEVEL 3 FLOOR PLAN
 1522 SHIELD DRIVE
 STEAMBOAT SPRINGS, COLORADO

DATE:	ISSUED FOR:
09/17/2024	PERMIT



DATE:	09/06/2024
JOB NO:	24-056
DRAWN BY:	---
CHECKED BY:	---
SCALE:	AS SHOWN
SHEET NUMBER:	MP1-6

DRAINAGE FIXTURE CALCULATIONS BASED ON 2015 IPC TABLE 709.1			
PROJECT: RIVERFRONT PARK - BUILDING 3 - EXISTING CONDITIONS		DATE: SEPTEMBER 2024	
FIXTURE TYPE	DRAINAGE FIXTURE UNIT	PLUMB FIX QNTY	TOTAL DRAINAGE FIXTURE UNITS
AUTOMATIC CLOTHES WASHERS, RESIDENTIAL	2	9	18
BATHROOM GROUP AS DEFINED IN SECTION 202 (1.6 GPF WATER CLOSET)	5	21	105
DISHWASHING MACHINE, DOMESTIC	2	7	14
KITCHEN SINK, DOMESTIC	2	1	2
KITCHEN SINK, DOMESTIC WITH FOOD WASTE DISPOSER AND OR DISHWASHER	2	11	22
LAVATORY	1	5	5
WATER CLOSET, PRIVATE (1.6 GPF)	3	5	15
	APPROXIMATE GPM	TOTAL DRAINAGE FIXTURE UNITS	
	90.50	181	


DRAINAGE FIXTURE CALCULATIONS BASED ON 2015 IPC TABLE 709.1			
PROJECT: RIVERFRONT PARK - BUILDING 3 - FIXTURES TO REMAIN AFTER PERMITTING		DATE: SEPTEMBER 2024	
FIXTURE TYPE	DRAINAGE FIXTURE UNIT	PLUMB FIX QNTY	TOTAL DRAINAGE FIXTURE UNITS
AUTOMATIC CLOTHES WASHERS, RESIDENTIAL	2	9	18
BATHROOM GROUP AS DEFINED IN SECTION 202 (1.6 GPF WATER CLOSET)	5	18	90
DISHWASHING MACHINE, DOMESTIC	2	7	14
KITCHEN SINK, DOMESTIC	2	1	2
KITCHEN SINK, DOMESTIC WITH FOOD WASTE DISPOSER AND OR DISHWASHER	2	10	20
LAVATORY	1	6	6
WATER CLOSET, PRIVATE (1.6 GPF)	3	6	18
	APPROXIMATE GPM	TOTAL DRAINAGE FIXTURE UNITS	
	84.00	168	

DRAINAGE FIXTURE CALCULATIONS BASED ON 2015 IPC TABLE 709.1			
PROJECT: RIVERFRONT PARK - BUILDING 4 - EXISTING CONDITIONS		DATE: SEPTEMBER 2024	
FIXTURE TYPE	DRAINAGE FIXTURE UNIT	PLUMB FIX QNTY	TOTAL DRAINAGE FIXTURE UNITS
AUTOMATIC CLOTHES WASHERS, RESIDENTIAL	2	12	24
BATHROOM GROUP AS DEFINED IN SECTION 202 (1.6 GPF WATER CLOSET)	5	22	110
DISHWASHING MACHINE, DOMESTIC	2	7	14
KITCHEN SINK, DOMESTIC	2	1	2
KITCHEN SINK, DOMESTIC WITH FOOD WASTE DISPOSER AND OR DISHWASHER	2	14	28
LAVATORY	1	2	2
SERVICE SINK	2	1	2
WATER CLOSET, PRIVATE (1.6 GPF)	3	2	6
	APPROXIMATE GPM	TOTAL DRAINAGE FIXTURE UNITS	
	94.00	188	

DRAINAGE FIXTURE CALCULATIONS BASED ON 2015 IPC TABLE 709.1			
PROJECT: RIVERFRONT PARK - BUILDING 4 - FIXTURES TO REMAIN AFTER PERMITTING		DATE: SEPTEMBER 2024	
FIXTURE TYPE	DRAINAGE FIXTURE UNIT	PLUMB FIX QNTY	TOTAL DRAINAGE FIXTURE UNITS
AUTOMATIC CLOTHES WASHERS, RESIDENTIAL	2	11	22
BATHROOM GROUP AS DEFINED IN SECTION 202 (1.6 GPF WATER CLOSET)	5	21	105
DISHWASHING MACHINE, DOMESTIC	2	7	14
KITCHEN SINK, DOMESTIC	2	1	2
KITCHEN SINK, DOMESTIC WITH FOOD WASTE DISPOSER AND OR DISHWASHER	2	13	26
LAVATORY	1	3	3
SERVICE SINK	2	1	2
WATER CLOSET, PRIVATE (1.6 GPF)	3	3	9
	APPROXIMATE GPM	TOTAL DRAINAGE FIXTURE UNITS	
	91.50	183	

TABLE 710.1(1) BUILDING DRAINS AND SEWERS				
DIAMETER OF PIPE (inches)	MAXIMUM NUMBER OF DRAINAGE FIXTURE UNITS CONNECTED TO ANY PORTION OF THE BUILDING DRAIN OR THE BUILDING SEWER, INCLUDING BRANCHES OF THE BUILDING DRAIN ^a			
	Slope per foot			
	1/16 inch	1/8 inch	1/4 inch	1/2 inch
1 1/4	—	—	1	1
1 1/2	—	—	3	3
2	—	—	21	26
2 1/2	—	—	24	31
3	—	36	42	50
4	—	180	216	250
5	—	390	480	575
6	—	700	840	1,000
8	1,400	1,600	1,920	2,300
10	2,500	2,900	3,500	4,200
12	3,900	4,600	5,600	6,700
15	7,000	8,300	10,000	12,000

WATER HEATER SIZING PER 2011 ASHRAE HANDBOOK: REFERENCE TABLE FOR GPH										
PROJECT: RIVERFRONT PARK - UNIT WITH LARGEST HOT WATER DEMAND						DATE: SEPTEMBER 2024				
SPECIFIC HEAT WATER (BTU/LB*F)	ENTERING WATER TEMPERATURE (F)	LEAVING WATER TEMPERATURE (F)	TEMPERATURE DIFFERENTIAL (F)	DENSITY OF WATER (LB/GAL)	BUILDING TYPE	STORAGE CAPACITY FACTOR	CORRECTED TOTAL GPH	EFFICIENCY	REQ. BTUH	REQ. KW
1	40	140	100	8.34	PRIVATE RESIDENCE					
FIXTURE	FIXTURE DEMAND GPH	QUANTITY	GPH	TOTAL GPH	DEMAND FACTOR					
BATHROOM SINK	2	5	10	215	0.4	0.7	86	100%	71724	
SHOWER	30	4	120					90%	79693	
WASHER MACHINE	20	2	40					80%	89655	
KITCHEN SINK	10	3	30					70%	102463	
DISHWASHER	15	1	15					60%	119540	
							STORAGE REQUIREMENT (GAL)			
							60.2			

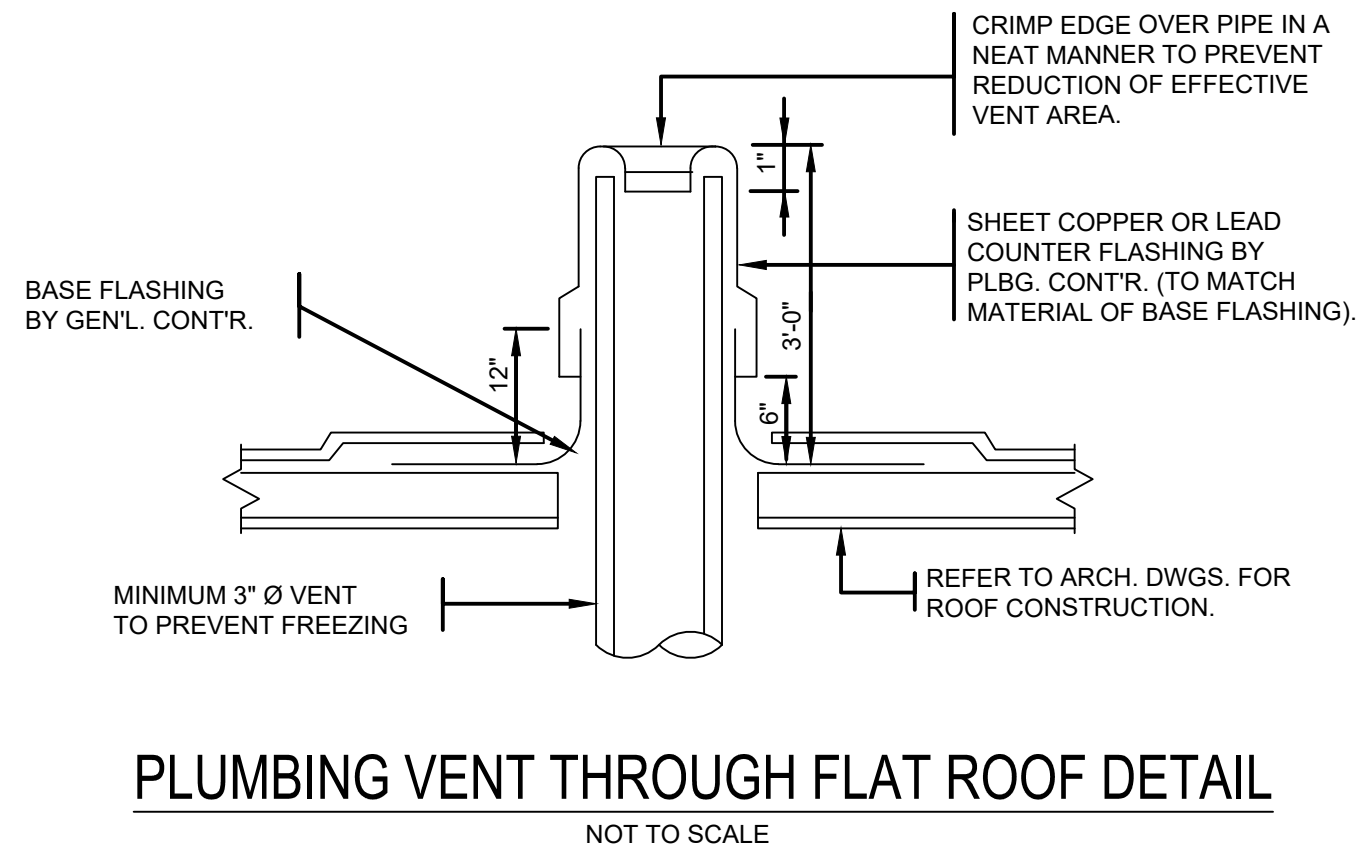

ASHRAE HVAC APPLICATIONS FIGURE 27 BOILER CALC		
PROJECT: RIVERFRONT PARK - ALL UNITS		
LOAD TYPE	BTU/HR	BOILER DEMAND FACTOR
SNOWMELT	0	0.80586451
RADIANT	98900	
DOM. HEATING	79700	
FAN COILS	0	
CORRECTION FACTOR FROM FIGURE 27	SUMMED BTU/HR	CORRECTED TOTAL AFTER DEMAND FACTOR
0.68	178600	153096
ALTITUDE (FT)	EFFICIENCY OF BOILER	TOTAL BTU/HR AFTER ELEVATION AND EFFICIENCY
6800	0.95	188078.62
EXISTING BOILER CAPACITY (BTU/HR)		110000
RECOMMENDED BOILER SIZE (BTU/HR)		199000
EXISTING WATER HEATER TANK SIZE (GAL)		35
RECOMMENDED WATER HEATER TANK SIZE (GAL)		60

386 Indian Road, Grand Junction, CO 81501 • Phone: (970) 241-8709 • www.bighorneng.com

Riverfront Park Post-Construction Permitting Process
Relevant Codes: 2021 IMC & 2021 IPC

Included Units: 2, 3, 4, 8, 9, 10, 12, 13, 14
Excluded Units: 1, 5, 6, 7, 11

"Included Units" are the individual units that are expected to show code compliance and obtain permits for modification that have already been completed. For these units to show compliance, they will have to comply with these mechanical and plumbing drawings and supplementary documents. The M&P drawings do not reflect any other changes that must be made according to other disciplines (i.e. structural or electrical).

"Excluded Units" are the individual units that are expected to restore their units to how they were originally permitted per the 2008 construction documents. Only the spaces, walls, appliances and plumbing fixtures originally shown on the drawings are permitted in these units. Generally speaking, this will mean that the typical "original" unit will comprise of a main level warehouse space with a powder room and an upper level two-bedroom and two-bathroom apartment. "Excluded Units" will not require any modification to their existing plumbing or mechanical infrastructure.

The following pertains to only the "Included Units":

No major modifications are expected to be made for the "Included Units" in terms of drainage piping. The drainage fixture calculations show that a 4" line is still satisfactory for the number of plumbing fixtures installed. It is worth noting that on Building 4, the 4" sanitary line leaving the building should be sloped at 1/4" per linear foot of drain piping (see note on drawings for explanation). All other 3" and 4" sanitary lines should be sloped at 1/8" per foot. This is the minimum per the IPC (International Plumbing Code) and while it is expected that these lines were installed under these guidelines, this should still be field verified.

All plumbing fixtures, original and added, shall be vented per the IPC.

No modifications to the floor drains in the warehouse spaces should have been made, nor are any anticipated. The 1,000-gallon sand/oil interceptor installed outside each building is sufficiently sized for its original intended purpose. It is recommended that the sand/oil interceptor be cleaned and inspected if it is not already part of the HOAs routine maintenance plan. It shall also be verified that no black waste is being routed into the sand/oil interceptor.

Total (maximum) domestic flow rate for Building 3 is 61 GPM and for Building 4 is 65 GPM. Our plumbing fixture calcs call for each building having a 2" domestic water entry with a 1-1/4" cold water line serving each "Included Unit". These sizes are what we would call for if the building were being built today, however these pipe diameters have not been field verified. If a minimum of a 2" water entry is not present in either building, a pressure and flow test must be completed in each water entry room. The test should be conducted after the pressure reducing valve, backflow preventer and water meter, but before any reduction in pipe sizes or branching off from the main line occurs. The tests should yield a minimum flowrate of 61 or 65 GPM (depending on the building) at 65 PSI. If each unit is not supplied by a 1-1/4" domestic cold water supply line, then it should be expected that tub fill times and general flow rates out of plumbing fixtures may experience a reduction in typical flow and pressure due to the pipe diameter being too small. If individual unit owners are experiencing any cases of reduced flow or feel any of their plumbing fixtures are underserved,

the size of the domestic supply line to each unit is likely the culprit. Increasing the size of the line between the water entry room and the individual unit would be the solution. Coordinating the replacement/up-sizing of the supply line shall be coordinated between the individual units' owners and a licensed plumber. Code will not require upsizing the lines to the individual units, however if the building's pressure and flow test yields less than favorable results, it may be desired by the individual unit owners to come up with a solution for increasing building water pressure and flow. If results do not meet or exceed suggested values (above) please consult with mechanical engineer.

Deck snowmelt was originally installed on the upper-level deck; however, it should have been disconnected in all 14 units and shall remain disconnected.

Each unit is heated using in-floor hydronic heat. The heat source for the radiant heat is a 110 MBH gas-fired boiler. This boiler is also responsible for generating domestic hot water via an "sidearm" indirect water heater. The tank size in each unit is only 35 gallons. Both the hot water tank and boiler are undersized for each "Included Unit" given the additional plumbing fixtures and square footage that was added in many of these units. Code will not require these boilers or water heaters be replaced. However, if unit owners find that their boilers cannot keep up with heating demand (radiant or hot water) it would be recommended they replace their current boiler with a 199 MBH boiler and their water heater with a 60-gallon indirect hot water heater. Considering the age of the existing mechanical equipment at almost 20 years old, it may be wise to consider replacement of these items in the near future.

Gas meter and line sizing is anticipated to remain untouched. Each unit should be served by a typical 250 CFH residential style low pressure gas meter. This meter is sufficient for current conditions and each unit's gas load. Increasing boiler size (as mentioned above) should not cause any issues with the gas line sizing or the meter itself. If gas pressure at any appliance (namely the boiler) is too low, it is likely the gas pressure being delivered by the meter is too low. Each meter should be delivering 8"-10" W.C. with a minimum pressure of 6" W.C. at each appliance.

An exhaust fan shall be present in all bathrooms that include either a water closet (toilet), shower or bathtub. Each exhaust fan shall be ducted to the outside and be capable of exhausting a minimum of 50 CFM. If exhaust fans are not present in any bathroom, original or added, one should be added and installed in compliance with the IMC. Panasonic's "WhisperFit" fan is a quiet and cost-effective option that is intended for retrofit applications. The exhaust fan in each restroom may be controlled by a dedicated switch, a timer, a motion-occupancy sensor or be wired to come on with the lights.

Residential kitchen exhaust must be provided in each kitchen. The IMC calls for 50 CFM of continuous ventilation or 100 CFM of intermittent ventilation. The original kitchens installed upstairs should have exhaust hoods that vent to the outside, thus satisfying this requirement. The other kitchen installed in various other locations within the "Included Units" should have an exhaust fan (similar to the recommended bathroom fan above) or a vent hood that exhausts to the exterior installed. That being said, no exhaust fans or hoods have been field verified.

As mentioned above, the individual units are slightly underserved in terms of heating. It also may be the case that added spaces do not have supplementary heat sources. Additional heat in non-original spaces may be added at the individual unit owner's request (pending available electrical capacity) to any added room(s). For open areas or rooms with exterior windows, a few feet of electric baseboard under the window should be sufficient. For bathrooms without supplementary or original heat, an electric heated towel warmer is often the best choice for getting more heat into the space as wall space is often limited in smaller restrooms.

Some units have installed mini-split air conditioning systems. These are acceptable to remain so long as the electrical capacity is available to accommodate these units.

Kyle Krauland
kyle@bighorneng.com
(970) 312-8643

Please do not hesitate to reach out with questions or if additional information is needed.

RIVERFRONT INDUSTRIAL PARK

MECHANICAL & PLUMBING - DETAILS

1522 SHIELD DRIVE

STEAMBOAT SPRINGS, COLORADO

Bighorn Consulting Engineers, Inc.
Mechanical & Electrical Engineers
386 Indian Road
Grand Junction, CO 81501
Phone: (970) 241-8709

DATE: 09/17/2024	ISSUED FOR: PERMIT

DATE: 09/06/2024
JOB NO: 24-056
DRAWN BY: ---
CHECKED BY: ---
SCALE: ---
SHEET NUMBER: MP3-1

September 17, 2024 - 5:15:20pm

MECHANICAL PROVISIONS

- 1. SCOPE OF WORK
 - A. THE CONTRACTOR IS RESPONSIBLE FOR ALL WORK, MATERIALS, AND LABOR TO SATISFY A COMPLETE WORKING SYSTEM WHETHER SPECIFIED OR IMPLIED.
 - B. ALL WORK IS TO BE PERFORMED IN STRICT COMPLIANCE WITH ALL LOCAL CODES AND ALL OTHER REGULATION GOVERNING WORK OF THIS NATURE.
 - C. THE CONTRACTOR SHALL, BEFORE SUBMITTING ANY PROPOSAL, EXAMINE THE PROPOSED SITE AND SHALL DETERMINE FOR HIMSELF THE CONDITIONS THAT MAY AFFECT THE WORK. NO ALLOWANCE SHALL BE MADE IF THE CONTRACTOR FAILS TO MAKE SUCH EXAMINATIONS.
 - D. ALL EQUIPMENT AND MATERIALS SHALL BE AS SPECIFIED OR "APPROVED EQUAL" BY THE ENGINEER OR ARCHITECT.
- 2. PERMITS
 - A. THE CONTRACTOR SHALL SECURE ALL PERMITS OR APPLICATIONS AND PAY ANY AND ALL FEES.
- 3. SHOP DRAWINGS
 - A. SUBMIT MATERIAL LIST AND SHOP DRAWINGS FOR MAJOR EQUIPMENT TO THE ARCHITECT/ENGINEER FOR APPROVAL. THE CONTRACTOR SHALL SUBMIT FIVE SETS OF SHOP DRAWINGS AND THEY SHALL BE CLEARLY LABELED.
- 4. FLEXIBLE DUCT WORK
 - A. FLEXIBLE TYPE DUCT SHALL BE OF TWO ELEMENT SPIRAL CONSTRUCTION COMPOSED OF A CORROSION RESISTANT METAL SUPPORTING SPIRAL AND COATED FABRIC WITH A MINERAL BASE. FLEXIBLE DUCT CONNECTORS SHALL BE LISTED BY U.L., CLASS 1 DUCTS, AND SHALL HAVE A FLEAME SMOKE RATING NOT EXCEEDING 25 AND A SMOKE DEVELOPED RATING NOT EXCEEDING 50.
 - B. USE OF FLEXIBLE DUCTWORK SHALL BE LIMITED TO NO MORE THAN A LINEAR FEET PER RUN.
 - C. CONTRACTOR SHALL BE CAREFUL SO AS NOT TO KINK OR COLLAPSE FLEXIBLE DUCT.
- 5. REFRIGERANT
 - A. PIPING CONTRACTOR SHALL PROVIDE AND INSTALL REFRIGERANT PIPING IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS AND IN SUCH A WAY AS TO BE INCONSPICUOUS AND FREE FROM ANY POSSIBLE CONDENSATION.
 - B. INSULATE REFRIGERANT LINES WITH ARMOUR-FLEX TYPE INSULATION, SHALL BE TYPE "K" COPPER TUBING, WITH WROUGHT COPPER SOLDER TYPE FITTINGS SUITABLE FOR CONNECTION WITH SILVER SOLDER.
- 6. DUCTWORK
 - A. THE DUCTWORK SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE "SMACNA" APPLICABLE MANUALS.
 - B. ALL DUCTWORK SHALL BE THE LOW VELOCITY TYPE, UNLESS SPECIFIED OTHERWISE.
 - C. CONTRACTOR SHALL PROVIDE AND INSTALL APPROVED FIRE DAMPERS AND ACCESS PANELS IN ANY AND ALL DUCTWORK WHICH PENETRATES A HORIZONTAL OR VERTICAL FIRE PARTITION, OR AS OTHERWISE SHOWN ON DRAWINGS.
 - D. ALL BRANCH DUCTS TO HAVE VOLUME DAMPERS. SMOOTH TURN RADIUS DUCTWORK OR TURNING VANES SHALL BE USED THROUGHOUT WHERE FLOW EXCEEDS 150 CFM.
 - E. ALL DUCT JOINTS TO BE SEALED IN ACCORDANCE WITH "SMACNA" STANDARDS AND ACCEPTED GOOD PRACTICE.
 - F. ALL DUCT DIMENSIONS SHOWN ARE NET INSIDE VALUES DIMENSIONS MAY BE CHANGED SO LONG AS THE NET FREE FACE AREA IS MAINTAINED.
 - G. ALL CONCEALED DUCTWORK SHALL BE INSULATED WITH 1-1/2" FIBERGLASS INSULATING BLANKET WITH ALUMINUM FOIL FACING.
 - H. ALL SUPPLY AND RETURN DUCTWORK 15 FEET DOWNSTREAM OF THE HVAC UNIT SHALL BE INTERNALLY LINED WITH A 1/2" ACOUSTICAL DUCT LINER UNLESS OTHERWISE NOTED ON THE DRAWINGS.
- 7. DRAINAGE PIPING
 - A. (CONDENSATE) SHALL BE SCHEDULE 40 PVC PIPE WITH SOLVENT JOINTS. PITCH HORIZONTAL LINES 1" IN 10'-0". CONDENSATE DRAINS SHALL BE ROUTED TO FLOOR DRAIN, ROOF DRAIN OR INDIRECT WASTE DRAIN.
- 8. HVAC CONTROLS
 - A. CONTRACTOR TO SUPPLY AND INSTALL ALL CONTROL WIRING AND THERMOSTATS AS REQUIRED.
- 9. ELECTRICAL
 - A. CONTRACTOR TO COORDINATE WITH ELECTRICAL CONTRACTOR FOR LOCATION OF WIRING FOR EACH HVAC UNIT.
- 10. PIPE SUPPORTS
 - A. ALL PIPE SHALL BE SUPPORTED FROM THE BUILDING STRUCTURE IN A NEAT AND WORKMANLIKE MANNER. THE USE OF WIRE OR METAL STRAP TO SUPPORT PIPES WILL NOT BE PERMITTED. SPACING OF PIPE SUPPORTS SHALL NOT EXCEED 8 FEET FOR ALL PIPING. PLASTIC PIPING TO BE SUPPORTED EVERY 4 FEET.
- 11. GAS PIPING
 - A. PIPING SHALL BE SCHEDULE 40 BLACK STEEL PIPE WITH MALLEABLE IRON FITTINGS. WHERE GAS PIPE CONNECTS TO EQUIPMENT, IT SHALL BE PROVIDED WITH A DRIP LEG THE FULL SIZE OF THE RUNOUT. A 100% SHUT-OFF VALVE AND A UNION. GAS PIPING CONTAINING PRESSURE GREATER THAN 9" W.G. SHALL BE SCHEDULE 40 BLACK STEEL PIPE WITH WELDED JOINTS.
- 12. MISCELLANEOUS
 - A. ALL EXTERIOR OPENINGS TO BE PROPERLY CAULKED AND SEALED WITH A SEALANT OF HIGH QUALITY AND LONG LIFE, TO PREVENT INFILTRATION OF OUTSIDE AIR INTO CONDITIONED SPACE. COORDINATE INSTALLATION OF ALL ROOF FLASHING AT ROOF PENETRATION.
 - B. DO NOT SCALE THIS DRAWING FOR EXACT DIMENSIONS.
 - C. VERIFY ALL FIGURES, CONDITIONS, AND DIMENSIONS AT THE JOB SITE.
 - D. THE MECHANICAL PLANS ARE INTENDED TO BE DIAGRAMMATIC AND ARE BASED ON ONE MANUFACTURER'S EQUIPMENT. THEY ARE NOT INTENDED TO SHOW EVERY ITEM IN ITS EXACT LOCATION, THE EXACT DIMENSIONS, OR ALL THE DETAILS OF THE EQUIPMENT.
 - E. THE CONTRACTOR SHALL VERIFY THE ACTUAL DIMENSIONS OF THE EQUIPMENT PROPOSED TO ENSURE THAT THE EQUIPMENT WILL FIT IN THE AVAILABLE SPACE.
 - F. PEX TUBING, IF PEX TUBING IS USED AS AN APPROVED ALTERNATE FOR APPLICATIONS WHERE METALLIC PIPING IS THE BASIS OF DESIGN. THE PEX MANUFACTURER SHALL SUBMIT SHOP DRAWINGS CLEARLY INDICATING THAT THE DESIGN HAS BEEN ANALYZED AND MODIFIED, AS REQUIRED TO MAINTAIN SCHEDULED HYDRONIC SYSTEM PARAMETERS. ANY DESIGN RESULTING IN INCREASED SYSTEM PRESSURE DROP AS A RESULT OF IMPROPER PEX SIZING OR DESIGN SHALL NOT BE PERMITTED.
- 13. TESTING AND BALANCING
 - A. THE HVAC SYSTEM SHALL BE TESTED AND BALANCED BY AN INDEPENDENT AGENCY, UNDER THE SUPERVISION OF A LICENSED PROFESSIONAL ENGINEER. A SEALED TYPE WRITTEN REPORT SHALL BE SUBMITTED TO THE ARCHITECT/ENGINEER FOR REVIEW AND APPROVAL.
- 14. GUARANTEE
 - A. MATERIALS, EQUIPMENT AND INSTALLATION SHALL BE GUARANTEED FOR A PERIOD OF ONE(1) YEAR FROM DATE OF ACCEPTANCE. DEFECTS WHICH APPEAR DURING THAT PERIOD SHALL BE CORRECTED AT THIS CONTRACTOR'S EXPENSE.
 - B. FOR THE SAME PERIOD, THE MECHANICAL CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DAMAGE TO PREMISES CAUSED BY DEFECTS IN WORKMANSHIP OR IN THE WORK OR EQUIPMENT FURNISHED AND/OR INSTALLED BY HIM.

PLUMBING SPECIFICATION

- 1. SCOPE OF WORK
 - A. THE CONTRACTOR IS RESPONSIBLE FOR ALL WORK, MATERIALS, AND LABOR TO SATISFY A COMPLETE WORKING SYSTEM WHETHER SPECIFIED OR IMPLIED.
 - B. ALL WORK IS TO BE PERFORMED IN STRICT COMPLIANCE WITH THE INTERNATIONAL PLUMBING CODE (LATEST EDITION), ALL LOCAL CODES AND ALL OTHER REGULATION GOVERNING WORK OF THIS NATURE.
 - C. THE CONTRACTOR SHALL, BEFORE SUBMITTING ANY PROPOSAL, EXAMINE THE PROPOSED SITE AND SHALL DETERMINE FOR HIMSELF THE CONDITIONS THAT MAY AFFECT THE WORK. NO ALLOWANCE SHALL BE MADE IF THE CONTRACTOR FAILS TO MAKE SUCH EXAMINATIONS.
 - D. ALL EQUIPMENT AND MATERIALS SHALL BE AS SPECIFIED OR "APPROVED AS EQUAL" BY THE ENGINEER OR ARCHITECT.
- 2. PERMITS
 - A. THE CONTRACTOR SHALL SECURE ALL PERMITS OR APPLICATIONS AND PAY ANY AND ALL FEES.
- 3. SHOP DRAWINGS
 - A. SUBMIT MATERIAL LIST AND SHOP DRAWINGS FOR MAJOR EQUIPMENT TO THE ARCHITECT/ENGINEER FOR APPROVAL. THE CONTRACTOR SHALL SUBMIT FIVE SETS OF SHOP DRAWINGS AND THEY SHALL BE CLEARLY LABELED.
- 4. DOMESTIC WATER SUPPLY PIPING
 - A. UNDERGROUND: PROVIDE TYPE "K" SOFT DRAWN COPPER TUBING WITH BRAZED CONNECTIONS.
 - B. ABOVE GROUND: PROVIDE TYPE "L" HARD DRAWN COPPER TUBING WITH 125 PSI SOLDER JOINTS, COPPER OR BRASS FITTINGS. ALL SOLDER TO BE "NO LEAD" TYPE.
 - C. ALL HOT WATER PIPING TO BE INSULATED WITH 1" FIBERGLASS INSULATION.
 - D. ALL COLD WATER PIPING TO BE INSULATED WITH 3/4" FOAM INSULATION.
- 5. SANITARY/STORM DRAINAGE AND VENT PIPING
 - A. ABOVE GRADE:
 - AA. 2" BELOW: SCHEDULE 40 GALV. STEEL PIPE WITH SCREWED ENDS OR SOLID CORE SCHEDULE 40 PVC WITH SOLVENT JOINTS OR DWV COPPER WITH SOLDER JOINTS. ALL SOLDER TO BE "NO LEAD" TYPE.
 - AB. 3" AND ABOVE: SERVICE WT. CAST IRON WITH NO-HUB OR BELL AND SPIGOT JOINTS; OR SOLID CORE SCHEDULE 40 PVC WITH SOLVENT JOINTS.
 - B. BELOW GRADE: SERVICE WT. CAST IRON WITH NO-HUB OR BELL AND SPIGOT JOINTS; OR SOLID CORE SCHEDULE 40 PVC WITH SOLVENT JOINTS.
 - C. PVC PIPING SHALL NOT BE USED IN AIR PLENUM CEILINGS AND SHALL NOT CROSS FIRE RATED WALLS, CEILINGS, OR FLOORS.
 - D. DRAINAGE PIPING SHALL BE RUN AS STRAIGHT AS POSSIBLE AND SHALL HAVE LONG TURN FITTINGS.
 - E. DRAINAGE PIPING 3" SIZE AND SMALLER SHALL RUN AT A UNIFORM GRADE OF AT LEAST 1/8" PER FOOT, AND PIPING LARGER THAN 3" SHALL BE RUN AT A GRADE OF NO LESS THAN 1/8" PER FOOT.
 - F. ALL VENT PIPING SHALL BE SLOPED TO DRAIN BACK TO FIXTURES.
 - G. CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROPER FLASHING OF THE VENT PIPING RUN THROUGH THE ROOF.
 - H. PVC USED TO BE SOLID CORE TYPE SCHEDULE 40 PVC.
- 7. PIPE SUPPORTS
 - A. ABOVE GRADE: ALL PIPE SHALL BE SUPPORTED FROM THE BUILDING STRUCTURE IN A NEAT AND WORKMANLIKE MANNER. THE USE OF WIRE AND PERFORATED METAL TO SUPPORT PIPES WILL NOT BE PERMITTED. SPACING OF PIPE SUPPORTS SHALL BE AS SPECIFIED IN INTERNATIONAL PLUMBING CODE (LATEST EDITION).
 - B. BELOW GRADE: EARTH SHALL BE EXCAVATED TO A MINIMUM DEPTH WITH AN EVEN SURFACE TO INSURE SOLID BEARING OF PIPE FOR ITS ENTIRE LENGTH.
 - BA. INTERIOR: THE PIPE SHALL BE INSTALLED (UNLESS OTHERWISE SPECIFIED) A MINIMUM OF 4 INCHES BELOW THE BOTTOM OF THE SLAB AND SHALL NOT BE IN ANY DIRECT CONTACT WITH THE CONCRETE AT ANY POINT.
 - BB. EXTERIOR: THE WATER PIPE SHALL HAVE A MINIMUM OF 60" OF COVER AND THE SANITARY WASTE PIPE SHALL HAVE A MINIMUM OF 24" OF COVER.
- 8. MISCELLANEOUS
 - A. COORDINATE INSTALLATION OF ALL ROOFS FLASHING AT ROOF PENETRATIONS.
 - B. DO NOT SCALE THIS DRAWING FOR EXACT DIMENSIONS. VERIFY ALL FIGURES, CONDITIONS AND DIMENSIONS AT THE JOB SITE.
 - C. THE PLUMBING PLANS ARE INTENDED TO BE DIAGRAMMATIC AND ARE BASED ON ONE MANUFACTURER'S EQUIPMENT. THEY ARE NOT INTENDED TO SHOW EVERY ITEM IN ITS EXACT LOCATION, THE EXACT DIMENSIONS OR ALL THE DETAILS OF THE EQUIPMENT. THE CONTRACTOR SHALL VERIFY THE ACTUAL DIMENSIONS OF THE EQUIPMENT PROPOSED TO ENSURE THAT THE EQUIPMENT WILL FIT THE AVAILABLE SPACE.
- 9. TESTING
 - A. PLUMBING SYSTEM SHALL BE FLOW AND PRESSURE TESTED IN ACCORDANCE WITH THE INTERNATIONAL PLUMBING CODE (LATEST EDITION).
- 10. GUARANTEE
 - A. MATERIALS, EQUIPMENT AND INSTALLATION SHALL BE GUARANTEED FOR A PERIOD OF ONE (1) YEAR FROM DATE OF ACCEPTANCE. DEFECTS WHICH APPEAR DURING THAT PERIOD SHALL BE CORRECTED AT THIS CONTRACTOR'S EXPENSE.
 - B. FOR THE SAME PERIOD THE PLUMBING CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DAMAGE TO PREMISES CAUSED BY DEFECTS IN WORKMANSHIP OR IN THE WORK OR EQUIPMENT FURNISHED AND/OR INSTALLED BY HIM.

PLUMBING GENERAL NOTES:


- 1. DRAWING IS DIAGRAMMATIC IN NATURE. LOCATIONS AND SIZES MAY VARY DURING FIELD COORDINATION & INSTALLATION OF MECHANICAL, PLUMBING, & ELECTRICAL. DRAWINGS DO NOT NECESSARILY INDICATE EVERY REQUIRED OFFSET, FITTING, ETC. DRAWINGS ARE NOT TO BE SCALED FOR DIMENSIONS. TAKE ALL DIMENSIONS FROM ARCHITECTURAL DRAWINGS, CERTIFIED EQUIPMENT DRAWINGS AND FROM THE STRUCTURE ITSELF BEFORE FABRICATING ANY WORK. VERIFY ALL SPACE REQUIREMENTS COORDINATING WITH OTHER TRADES, AND INSTALL THE SYSTEMS IN THE SPACE PROVIDED WITHOUT EXTRA CHARGES TO THE OWNER.
- 2. PIPE DIMENSIONS DO NOT REFLECT ADDITIONAL DIMENSIONS FOR INSULATION. ALL PIPING SHALL BE INSULATED PER 2018 IECC CODE REQUIREMENTS.
- 3. CONDENSING WATER HEATER, GAS FURNACE, AND BOILER VENT MATERIAL SHALL COMPLY WITH MANUFACTURER'S LISTED AND APPROVED MATERIALS. PVC SHALL NOT BE USED FOR FLUE/COMBUSTION AIR VENTING MATERIAL. ENGINEERS PREFERRED MATERIAL IS PRESSURE RATED, DOUBLE WALL, GASKETED, 316 STAINLESS STEEL CONDENSING FLUE VENTING MATERIAL. RECOMMENDED MANUFACTURER'S SELKIRK OR JERMAS.
- 4. ROUTE CONDENSATE FROM CONDENSING MECHANICAL EQUIPMENT TO CONDENSATE NEUTRALIZATION KITS. CONDENSATE FROM NEUTRALIZATION KITS SHALL BE DISCHARGED INDIRECTLY THROUGH AIR GAP TO NEAREST FLOOR DRAIN.
- 5. ALL PLUMBING FIXTURES WITH QUICK CLOSING VALVES ON DOMESTIC COLD/HOT WATER SHALL BE PROVIDED WITH WATER HAMMER ARRESTOR.
- 6. PROVIDE ISOLATION VALVES AT GROUP RESTROOMS. TO ALLOW FOR TOTAL ISOLATION OF THE ENTIRE RESTROOM GROUP FROM THE REST OF THE DOMESTIC COLD, HOT AND HOT RE-CIRCULATION SYSTEMS.
- 7. ALL PLUMBING FIXTURES SHALL BE VENTED BY PLUMBING CONTRACTOR PER IPC REQUIREMENTS.
- 8. CONTRACTOR SHALL CLEAN AND SERVICE ALL EXISTING EQUIPMENT/PLUMBING FIXTURES TO REMAIN. CONTRACTOR SHALL VERIFY ALL EQUIPMENT/PLUMBING FIXTURES ARE PROPERLY FUNCTIONING PRIOR TO RE-USING EQUIPMENT/FIXTURES. CONTRACTOR TO INSURE THAT FINAL PLUMBING SYSTEM WILL OPERATE AS INTENDED ON PROVIDED DRAWINGS.
- 9. ALL EXTERIOR METALLIC NATURAL GAS PIPING SHALL BE TREATED WITH CORROSIVE INHIBITOR COATING. COATING SHALL BE UV RESISTANT PER MANUFACTURER'S RECOMMENDATION SO THAT COATING MAINTAINS INTEGRITY OF GAS PIPING. COATING SHALL BE UV RESISTANT.

MECHANICAL GENERAL NOTES:

- 1. DRAWING IS DIAGRAMMATIC IN NATURE. LOCATIONS AND SIZES MAY VARY DURING FIELD COORDINATION & INSTALLATION OF MECHANICAL, PLUMBING, & ELECTRICAL. DRAWINGS DO NOT NECESSARILY INDICATE EVERY REQUIRED OFFSET, FITTING, ETC. DRAWINGS ARE NOT TO BE SCALED FOR DIMENSIONS. TAKE ALL DIMENSIONS FROM ARCHITECTURAL DRAWINGS, CERTIFIED EQUIPMENT DRAWINGS AND FROM THE STRUCTURE ITSELF BEFORE FABRICATING ANY WORK. VERIFY ALL SPACE REQUIREMENTS COORDINATING WITH OTHER TRADES, AND INSTALL THE SYSTEMS IN THE SPACE PROVIDED WITHOUT EXTRA CHARGES TO THE OWNER.
- 2. DUCT DIMENSIONS DO NOT REFLECT ADDITIONAL DIMENSIONS FOR INSULATION. ALL DUCTING SHALL BE INSULATED PER 2021 IECC CODE REQUIREMENTS. (SUPPLY AND RETURN AIR DUCTS AND PLENUMS SHALL BE INSULATED WITH NOT LESS THAN R-6 INSULATION WHERE LOCATED IN UNCONDITIONED SPACES AND WHERE LOCATED OUTSIDE THE BUILDING WITH NOT LESS THAN R-9 INSULATION IN CLIMATE ZONES 0 THROUGH 4 AND NOT LESS THAN R-12 INSULATION IN CLIMATE ZONES 5 THROUGH 8. DUCTS LOCATED UNDERGROUND BENEATH BUILDINGS SHALL BE INSULATED AS REQUIRED IN THIS SECTION OR HAVE AN EQUIVALENT THERMAL DISTRIBUTION EFFICIENCY. UNDERGROUND DUCTS UTILIZING THE THERMAL DISTRIBUTION EFFICIENCY METHOD SHALL BE LISTED AND LABELED TO INDICATE THE R-VALUE EQUIVALENCY. WHERE LOCATED WITHIN A BUILDING ENVELOPE ASSEMBLY, THE DUCT OR PLENUM SHALL BE SEPARATED FROM THE BUILDING EXTERIOR OR UNCONDITIONED OR EXEMPT SPACES BY NOT LESS THAN R-6 INSULATION IN CLIMATE ZONES 0 THROUGH 4 AND NOT LESS THAN R-12 INSULATION IN CLIMATE ZONES 5 THROUGH 8. ROUTT COUNTY IS CLIMATE ZONE 7).
- 3. COORDINATE FINAL LOCATION OF THERMOSTAT WITH OWNER PRIOR TO INSTALLATION. IF THERMOSTAT IS LOCATED ON EXTERIOR WALL PROVIDE THERMOSTAT WITH INSULATED BACKING.
- 4. CONDENSING WATER HEATER, GAS FURNACE, AND BOILER VENT MATERIAL SHALL COMPLY WITH MANUFACTURER'S LISTED AND APPROVED MATERIALS. PVC SHALL NOT BE USED FOR FLUE/COMBUSTION AIR VENTING MATERIAL. ENGINEERS PREFERRED MATERIAL IS PRESSURE RATED, DOUBLE WALL, GASKETED, 316 STAINLESS STEEL CONDENSING FLUE VENTING MATERIAL. RECOMMENDED MANUFACTURER'S SELKIRK OR JERMAS.
- 5. ROUTE CONDENSATE FROM CONDENSING MECHANICAL EQUIPMENT TO CONDENSATE NEUTRALIZATION KITS. CONDENSATE FROM NEUTRALIZATION KITS SHALL BE DISCHARGED INDIRECTLY THROUGH AIR GAP TO NEAREST FLOOR DRAIN.
- 6. MECHANICAL CONTRACTOR SHALL FIELD LOCATE EXISTING DUCTWORK PRIOR TO CONSTRUCTION. MECHANICAL CONTRACTOR SHALL COORDINATE TIE IN CONNECTION POINTS OF NEW SUPPLY DIFFUSERS WITH EXISTING DUCTWORK AS NECESSARY.
- 7. CONTRACTOR SHALL CLEAN AND SERVICE ALL EXISTING EQUIPMENT TO REMAIN. CONTRACTOR SHALL VERIFY ALL EQUIPMENT TO REMAIN IS PROPERLY FUNCTIONING PRIOR TO RE-USING EQUIPMENT. CONTRACTOR TO INSURE THAT FINAL MECHANICAL SYSTEM WILL OPERATE AS INTENDED ON PROVIDED DRAWINGS.
- 8. MECHANICAL EQUIPMENT MANUFACTURERS AS SCHEDULED ON MECHANICAL DRAWINGS ARE SUGGESTED MANUFACTURERS. UNLESS NOTED OTHERWISE DUE TO OWNER/CUENT REQUIREMENTS AND PREFERENCES, MECHANICAL CONTRACTOR CAN SUBMIT EQUIVALENT EQUIPMENT FROM MANUFACTURERS THAT DIFFER FROM SCHEDULED MECHANICAL EQUIPMENT. ALTERNATE MANUFACTURERS OF MECHANICAL EQUIPMENT WILL BE REVIEWED FOR EQUIVALENCE OF PERFORMANCE AND FUNCTIONALITY BY ENGINEER.

DO NOT REPRODUCE THESE DRAWINGS AND SPECIFICATIONS WITHOUT THE EXPRESSED WRITTEN PERMISSION OF THE DESIGNER. THE DRAWINGS AND SPECIFICATIONS ARE INSTRUMENTS OF THE SERVICE AND SHALL REMAIN THE PROPERTY OF THE DESIGNER. WHETHER THE PROJECT FOR WHICH THEY ARE MADE IS EXECUTED OR NOT. THESE DRAWINGS AND SPECIFICATIONS SHALL NOT BE USED BY ANYONE ON ANY OTHER PROJECTS FOR ADDITIONS TO THIS PROJECT BY OTHERS EXCEPT BY THE EXPRESSED WRITTEN PERMISSION OF THE DESIGNER.

Bighorn Consulting Engineers, Inc.
 Mechanical & Electrical Engineers
 386 Indian Road
 Grand Junction, CO 81501
 Phone: (970) 241-8709



RIVERFRONT INDUSTRIAL PARK

MECHANICAL & PLUMBING - GENERAL NOTES

1522 SHIELD DRIVE
 STEAMBOAT SPRINGS, COLORADO

DATE:	ISSUED FOR:
09/17/2024	PERMIT



DATE:	09/06/2024
JOB NO:	24-056
DRAWN BY:	---
CHECKED BY:	---
SCALE:	---
SHEET NUMBER:	MP3-2