



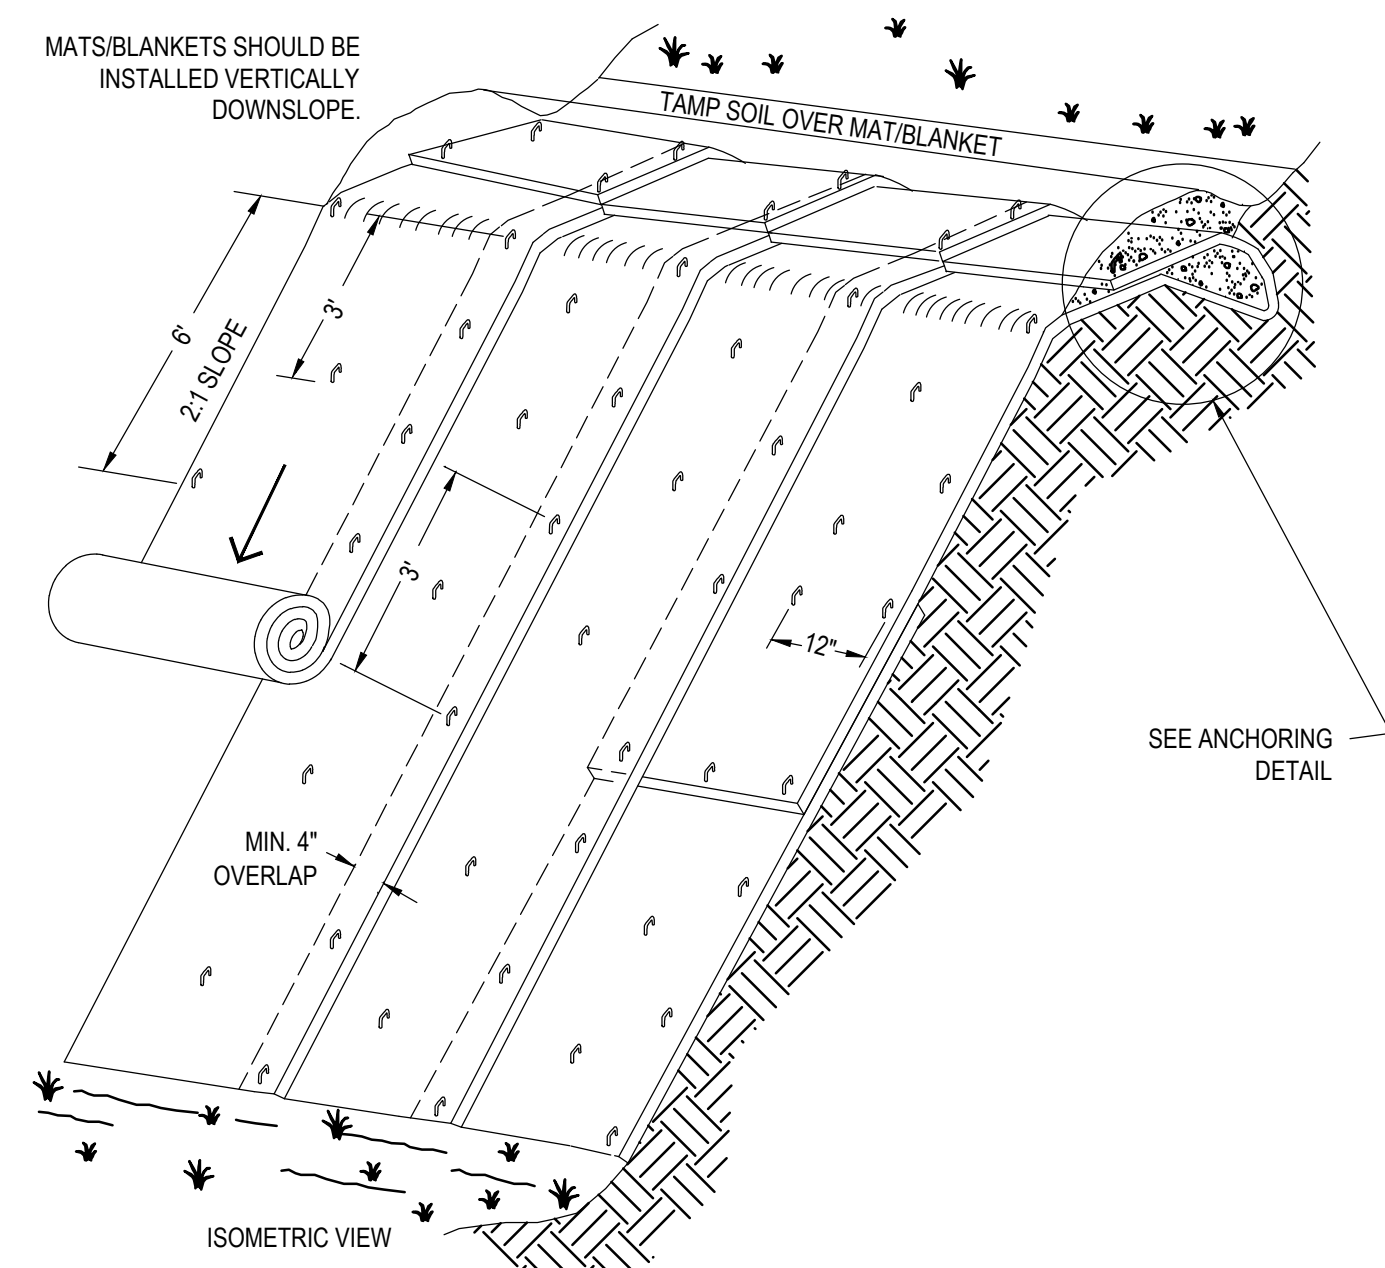


EROSION CONTROL BLANKET TYPICAL DETAILS
NOT TO SCALE

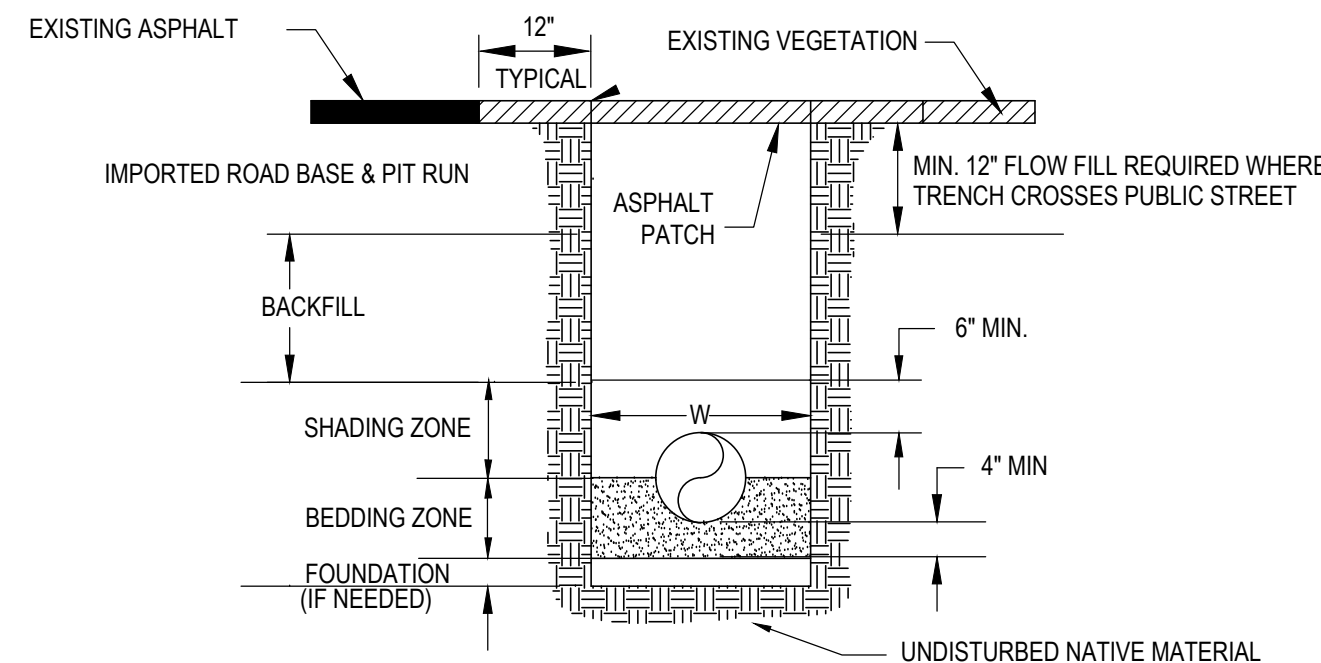

TRENCH CROSS SECTION
NOT TO SCALE

SHARED DRIVE PAVEMENT SHALL NOT BE DISTURBED DURING TRENCHING ACTIVITIES.

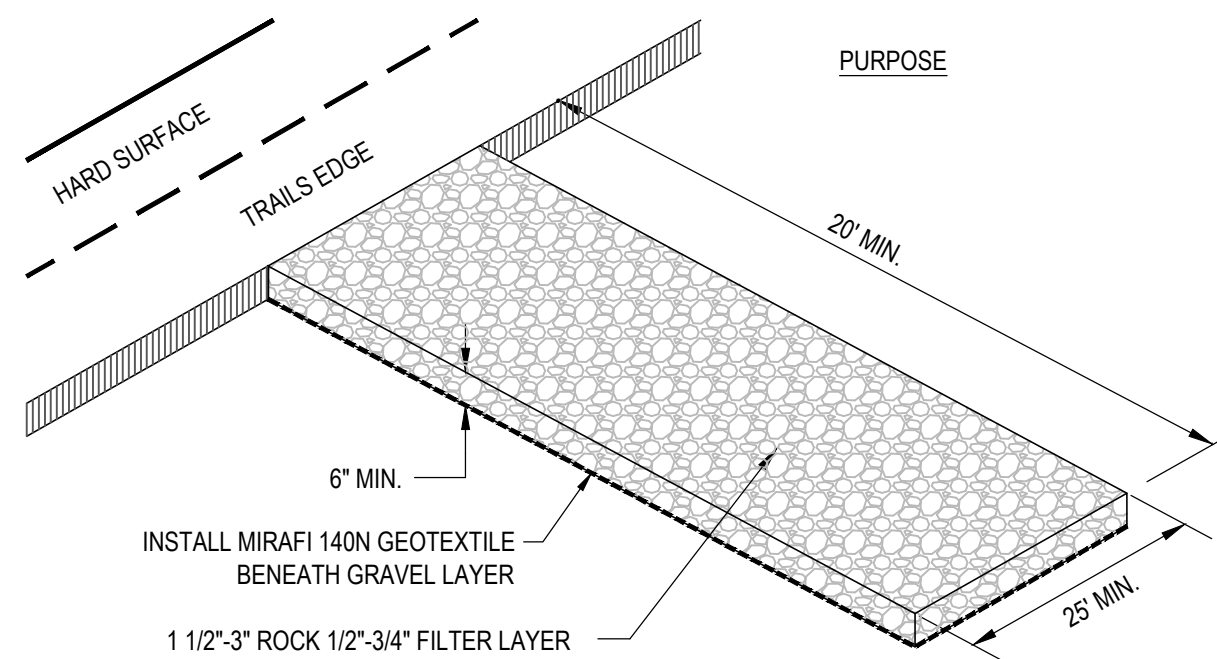

STABILIZED CONSTRUCTION ENTRANCE TYPICAL DETAIL
NOT TO SCALE

4'-6" (TYP.)


3

6" SANDY LOAM TURF


LINE WITH STRAW BLANKET, SEED, AND ESTABLISH VEGETATION

TYPICAL VEGETATED DRAINAGE SWALE DETAIL


NOT TO SCALE

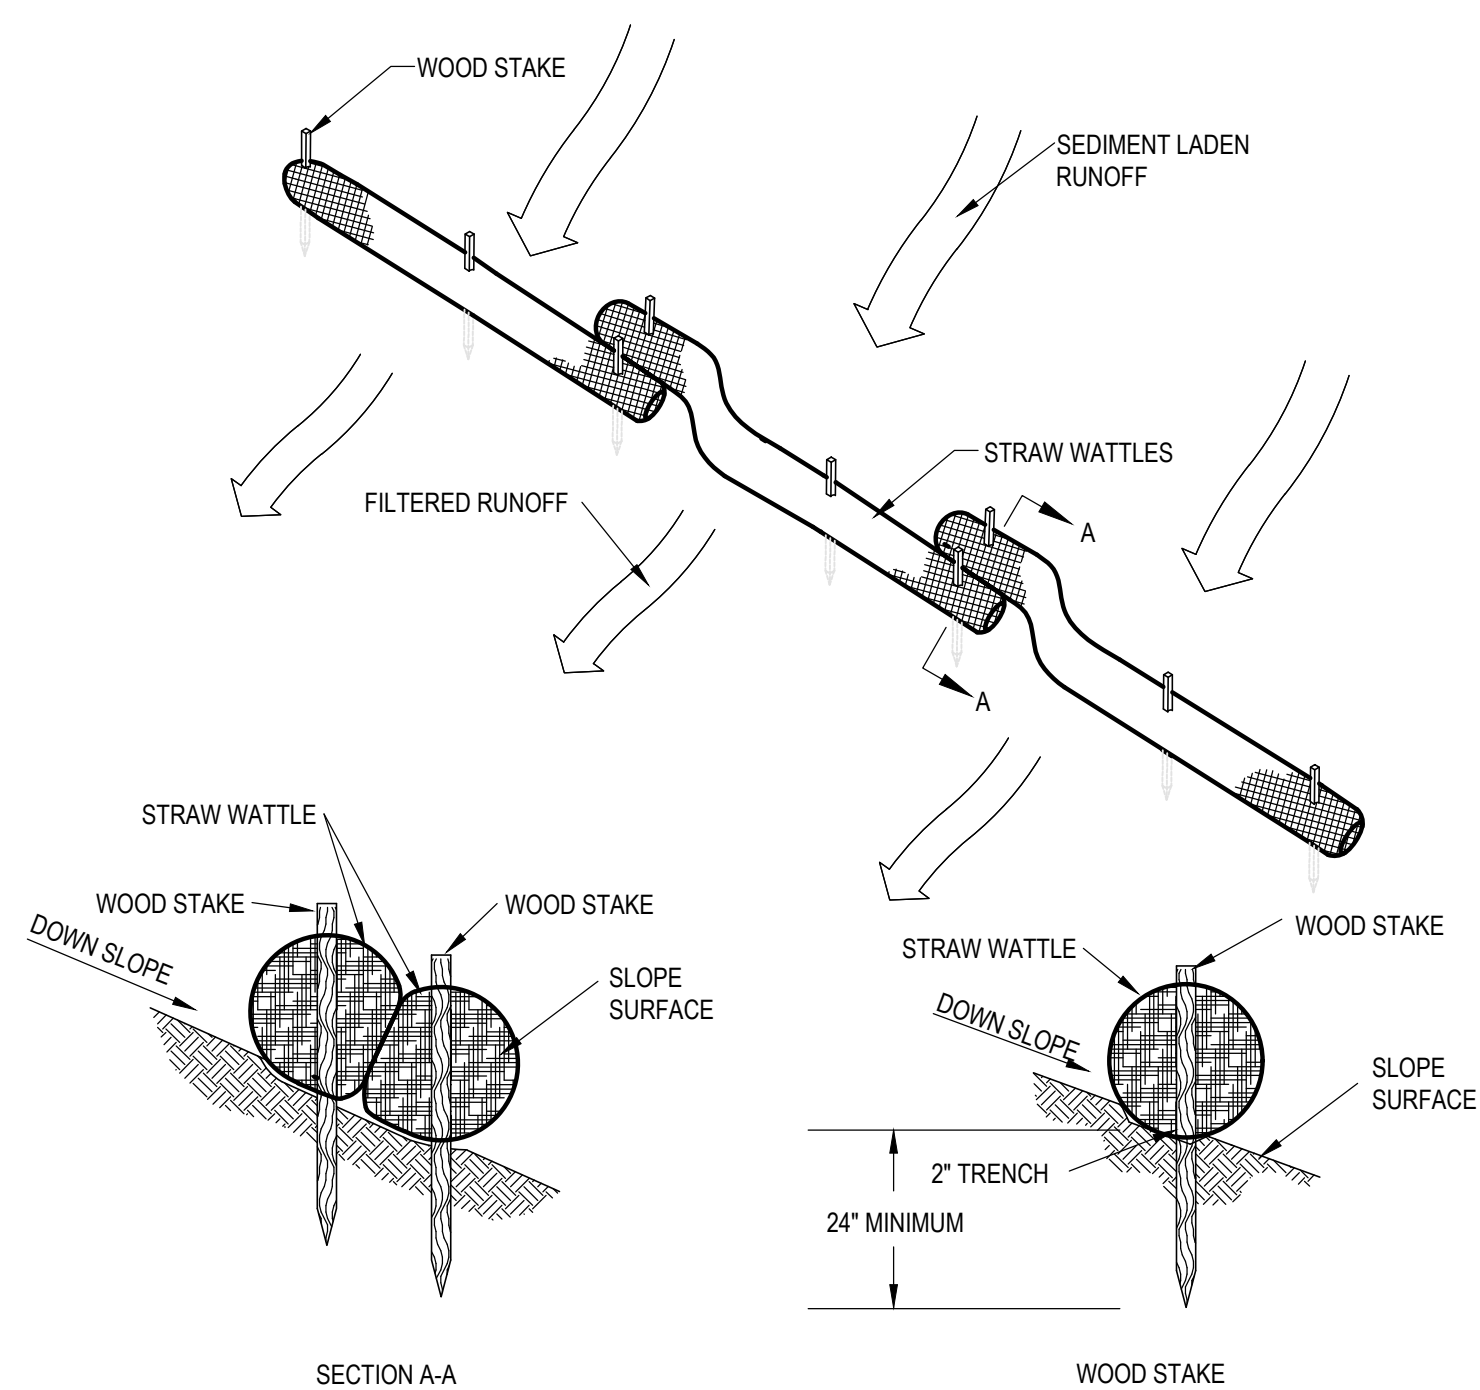


STRAW WATTLE DETAILS
NOT TO SCALE

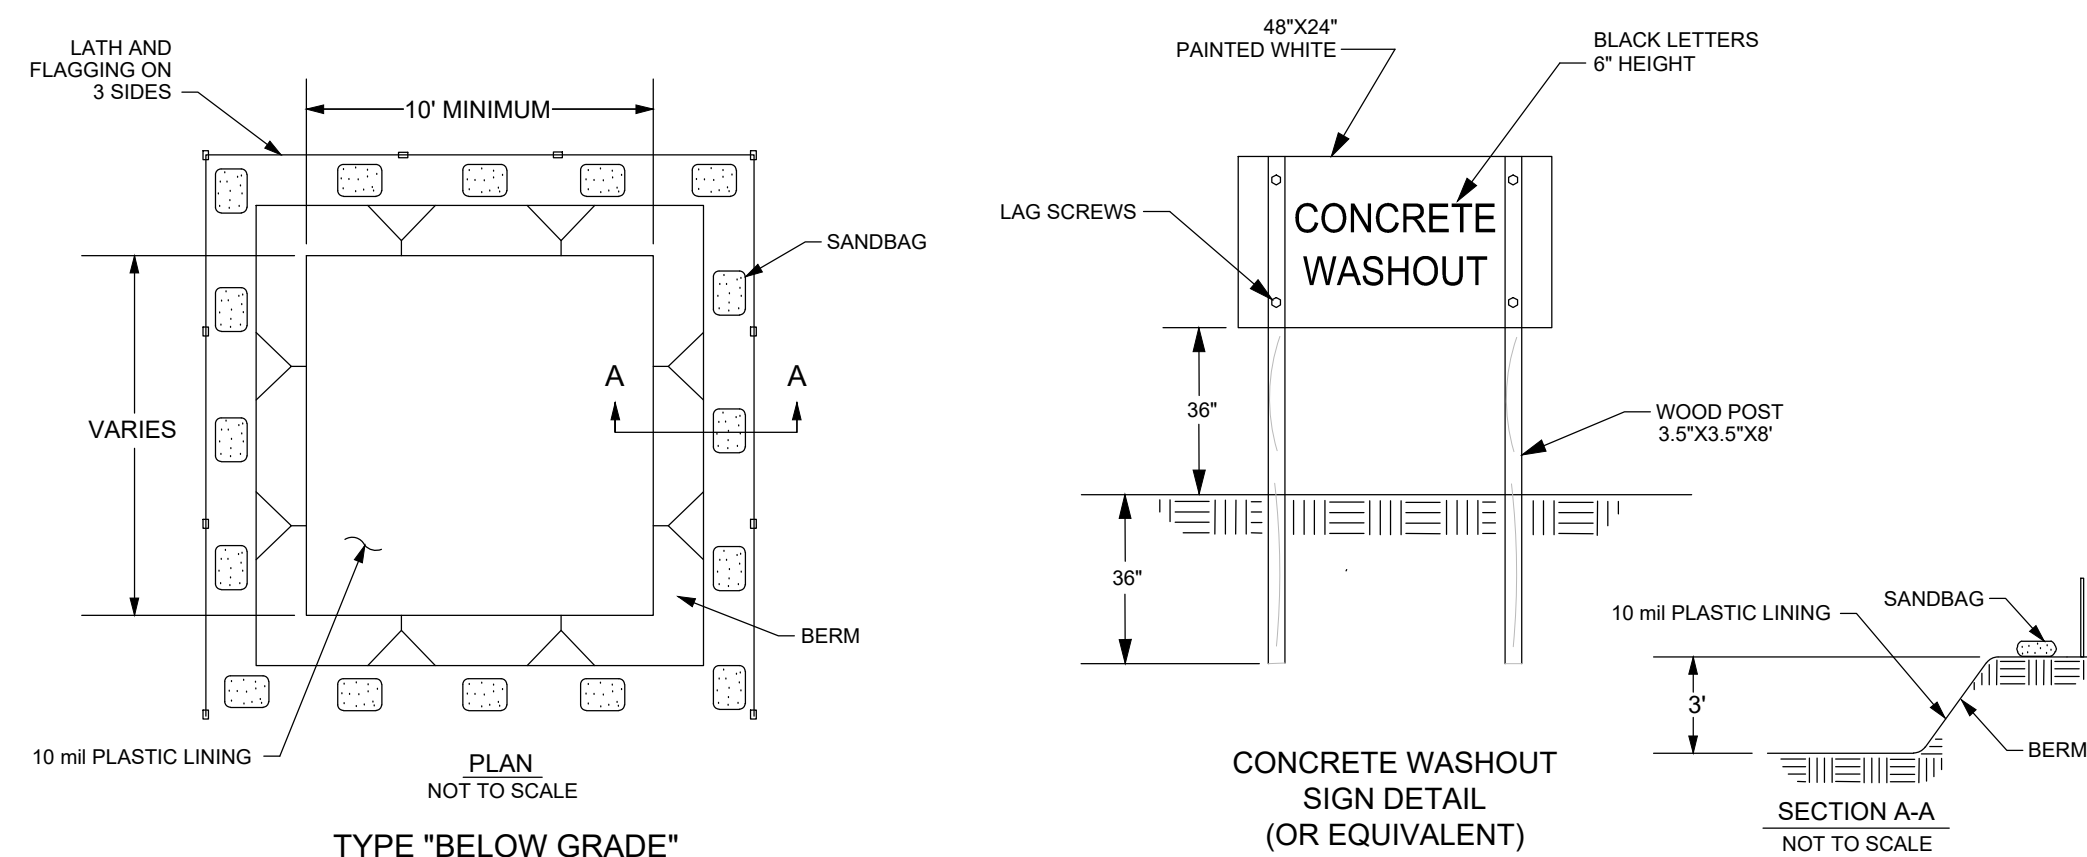


CONCRETE WASHOUT DETAILS
NOT TO SCALE

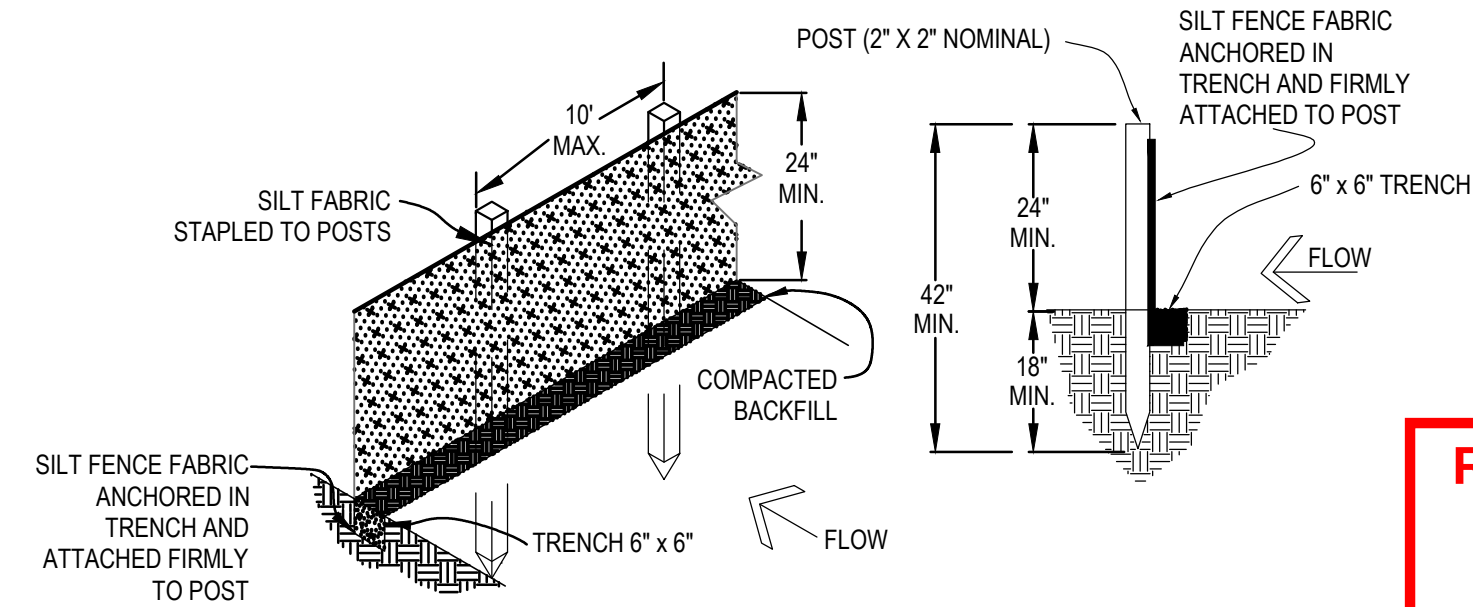

SILT FENCE TYPICAL DETAIL
NOT TO SCALE

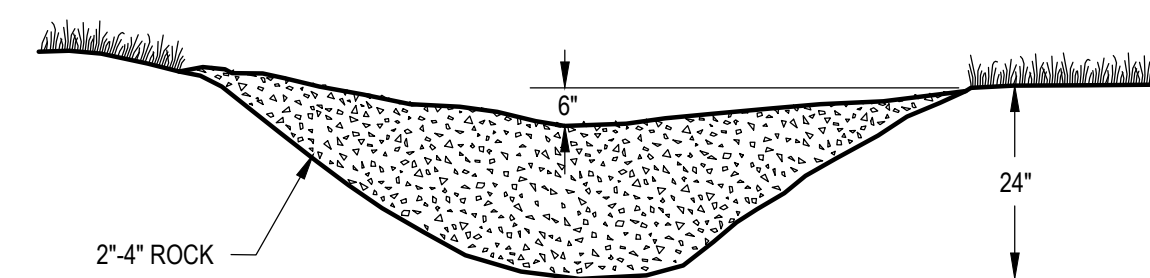

ROCK CHECK DAM DETAIL
NOT TO SCALE

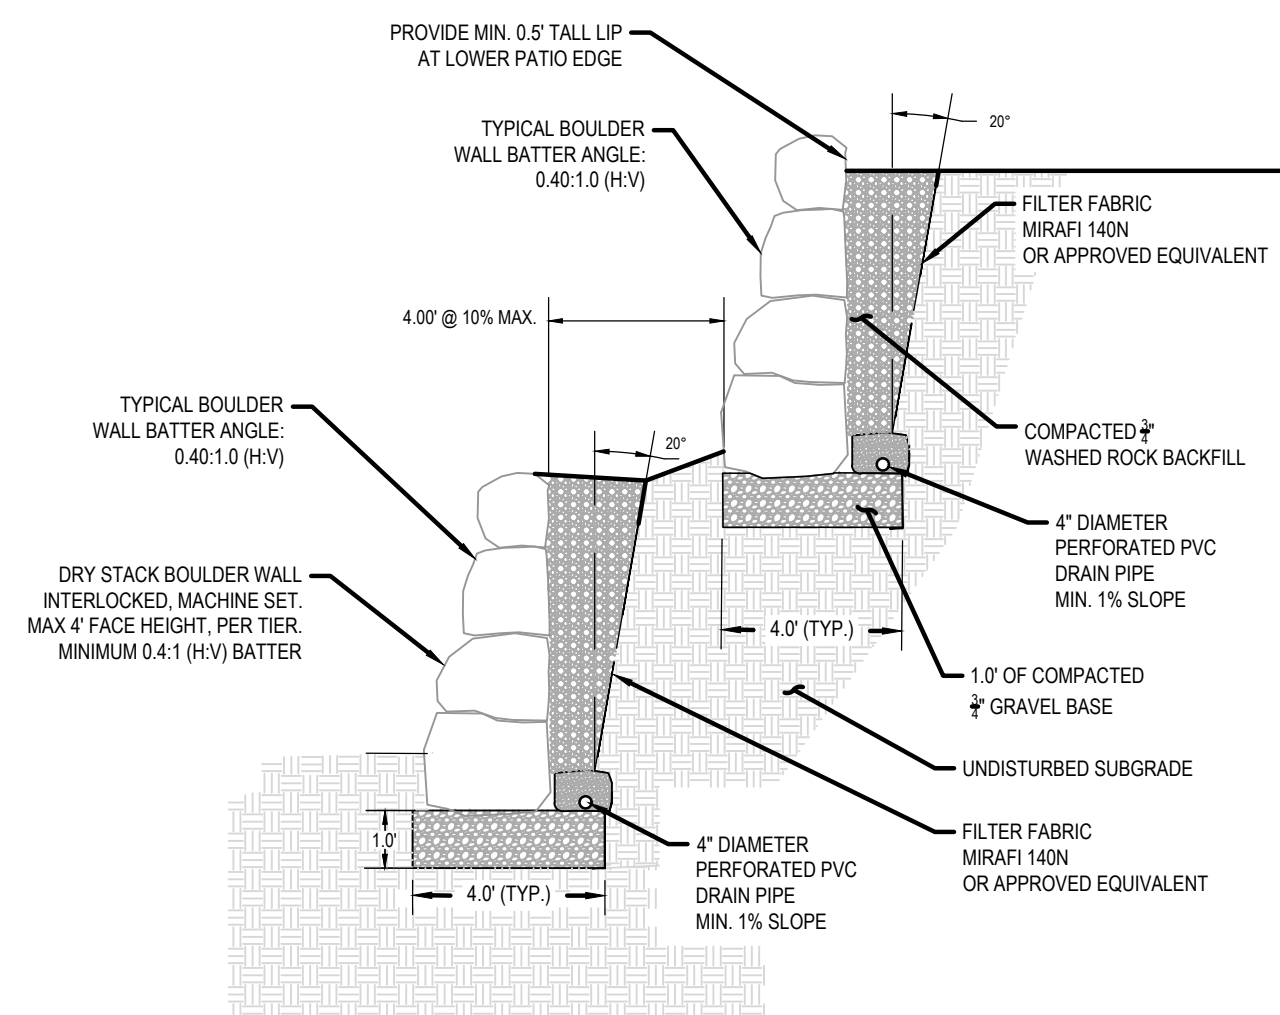

TIERED RETAINING WALL TYPICAL DETAIL
NOT TO SCALE

1. A LICENSED GEOTECHNICAL ENGINEER, REGISTERED IN THE STATE OF COLORADO, SHALL BE APPOINTED TO REVIEW THE FEASIBILITY OF THE DRY STACK BOLDER WALL ALTERNATIVE PRESENTED ON THIS PLAN SHEET.
2. COMPACT SUB-GRADE SOIL TO 95% OF THE MAXIMUM MODIFIED PROCTOR.
3. BACKFILL MATERIALS SHALL BE CAREFULLY PLACED IN UNIFORM LIFTS AT A MAXIMUM 6" DEEP LOOSE LIFTS AND COMPACTED TO AT LEAST 95% OF THE MAXIMUM STANDARD PROCTOR DENSITY AND NEAR THE OPTIMUM MOISTURE CONTENT.
4. PRIOR TO PLACEMENT ANY BACKFILL MATERIALS MUST BE SAMPLED AND RECEIVE A SOILS REPORT.
5. INSTALL MINIMALLY 140N FILTER FABRIC, OR APPROVED EQUIVALENT, TO PROTECT WASHED ROCK BACKFILL FROM NATURAL SOIL CONTAMINATION.
6. COMPACT WASHED ROCK BACKFILL WITH VIBRATORY COMPACTOR.
7. MINIMUM 22° OUTSLOPE ANGLE TO BE PROVIDED.
8. OVERALL MAXIMUM HEIGHT PER WALL TIER IS 6.0 FEET.

440 S. Lincoln Ave, Suite 4A
P.O. Box 775966
Steamboat Springs, CO 80487
(970)-871-6772
www.fourpointsse.com

[illegible]

**LOT 20 MOUNTAIN VIEW ESTATES,
FILING NO. 1
150 STEAMBOAT BOULEVARD
STEAMBOAT SPRINGS, CO**

IF THIS DRAWING IS PRESENTED IN A
FORMAT OTHER THAN 24" X 36", THE
GRAPHIC SCALE SHOULD BE UTILIZED

DRAWING:

CIVIL DETAILS

SHEET #

C7