

PROJECT INFORMATION

TYPE OF CONSTRUCTION:

- TYPE IB (EXISTING NON-SPRINKLERED BUILDING)
- TYPE IB (NEW SPRINKLERED AREA)
- TYPE IB (NEW NON-SPRINKLERED AREA)

OCCUPANCY CLASSIFICATION:

EXISTING:

- GROUP R-2 FOR DWELLING UNITS
- GROUP S-2 FOR PARKING GARAGE
- GROUP A-3 FOR EXERCISE AND SPA ROOMS
- GROUP S-1 FOR STORAGE ENTRY

NEW:

- GROUP S-2 PORTE-COCHERE
- GROUP R-2 SKI ENTRY*

* ASSEMBLY AREA ACCESSORY TO THE DWELLING UNITS PER SECTION 303.1.2(2)

ALLOWABLE FLOOR AREA/ NEW TOTAL FLOOR AREA:

ALLOWABLE IS UNLIMITED

EXISTING FLOOR AREA IS 118,500 SF +/-

	RENOVATION	ADDITION	TOTAL
PORTE-COCHERE		1,995 SF	1,995 SF
SKI ENTRY	117 SF	318 SF	435 SF
TRASH ENCLOSURE	191 SF		191 SF
TOTAL	308 SF	2,313 SF	2,621 SF

GENERAL NOTES:

1. PORTE-COCHERE: ROOF ASSEMBLY BEING ADDED, BUT THE SPACE IS TO REMAIN EXTERIOR SPACE.
2. SKI ENTRY: EXTERIOR SPACE IS BEING ENCLOSED W/ A WALL & ROOF ASSEMBLY. INTERIOR SPACE IS BEING RECONFIGURED IN CONJUNCTION WITH THE ENCLOSED EXTERIOR SPACE TO CREATE A SINGLE ENCLOSED SPACE.
3. TRASH ENCLOSURE: ROOF ASSEMBLY BEING ADDED OVER THE EXISTING TRASH ENCLOSURE WHICH WILL REMAIN AN EXTERIOR SPACE.

APPLICABLE CODES:

2015 I.B.C., 2015 I.E.B.C., 2017 N.E.C., 2006 I.C.C.E.C., 2015 I.M.C., 2015 I.P.C., 2015 I.F.G.C., 2015 I.F.C., STEAMBOAT SPRINGS FIRE SERVICES CODE AMENDMENTS, ROUTT COUNTY BUILDING CODE AMENDMENTS AND ANY OTHER APPLICABLE CODES, REGULATIONS OR RULES

ZONING DISTRICT:

RR-2, RESORT RESIDENTIAL TWO MEDIUM DENSITY

GEOTECH INVESTIGATION:

NORTHWEST COLORADO CONSULTANTS, INC., DATED APRIL 28, 2009 PROJECT NUMBER: 07-7808 AND GEOTECH REPORT BY NORTHWEST COLORADO CONSULTANTS, INC., DATED JANUARY 9, 2008, PROJECT NUMBER 07-7808 ALSO.

PERMIT AND BID SET FOR:

**BEAR CLAW II
BUILDING REMODEL**

LEGAL DESCRIPTION:
BEAR CLAW II CONDOMINIUMS

SHEET INDEX

A000	COVER SHEET
A011	PROJECT GENERAL NOTES & SPECIFICATIONS
A012	PROJECT SPECIFICATIONS
A013	PROJECT SPECIFICATIONS
A014	PROJECT SPECIFICATIONS
A015	PROJECT SPECIFICATIONS
AD101	EXISTING/DEMO - PORTE-COCHERE
AD103	EXISTING/DEMO - SKI ENTRY & BLDG. ENTRIES
AD105	EXISTING/DEMO - EXTERIOR DECKS
AD106	EXISTING/DEMO - EXTERIOR DECKS
A101	REMODEL - PORTE-COCHERE
A102	REMODEL - PORTE-COCHERE ROOF PLAN / ELEVATION
A103	REMODEL - SKI ENTRY & BLDG. ENTRIES
A104	REMODEL - TRASH ENCLOSURE
A105	REMODEL - EXTERIOR DECKS
A106	REMODEL - EXTERIOR DECKS
A111	FIRST FLOOR BUILDING LAYOUTS
A112	SECOND FLOOR BUILDING LAYOUTS
A113	THIRD FLOOR BUILDING LAYOUTS
A114	FOURTH FLOOR BUILDING LAYOUTS
A115	FIFTH FLOOR BUILDING LAYOUTS
A116	SIXTH FLOOR BUILDING LAYOUTS
A117	SEVENTH FLOOR & LOFT BUILDING LAYOUTS
A201	EXTERIOR ELEVATIONS
A202	EXTERIOR ELEVATIONS
A301	BUILDING SECTIONS - PORTE-COCHERE
A302	BUILDING SECTIONS - SKI ENTRY
A501	BUILDING ASSEMBLIES & DETAILS
A511	DOOR & WINDOW SCHEDULES & DETAILS
A512	DOOR & WINDOW DETAILS
A521	EXTERIOR DETAILS
A522	EXTERIOR DETAILS
A523	EXTERIOR DETAILS
A524	EXTERIOR DETAILS
A525	EXTERIOR DETAILS
A901	3D VIEWS - PORTE-COCHERE / SKI ENTRY
S001	STRUCTURAL COVER SHEET
S002	ABBREVIATIONS
S101	PORTE-COCHERE
S102	SKI ENTRY
S103	TRASH ENCLOSURE
S104	EXTERIOR DECKS
S105	DETAILS
E001	SYMBOLS, SCHEDULES & ONE LINE DIAGRAMS
E101	ELECTRICAL PLAN
E102	ELECTRICAL PLAN

WORK SCOPE NARRATIVE

1. Replacement of the existing Pella exterior windows and exterior glazed doors with new windows, glazed doors, related flashing's, sealants, and waterproof membranes.
2. Replacement of the interior window and patio door jambs, trim and casing to match the existing unit trim in a slightly larger size to minimize interior wall work. Provide new foam sealants around all of the new windows and patio doors.
3. Replacement of the existing wood deck boards at each exterior door with non-combustible aluminum decking, remove & replace the existing exterior deck railing. Specific decks are being extended in front of the chimney stacks.
4. Disable all existing Jen-Air appliances adjacent to the interior fireplaces and remove the exterior exhaust vents. Patch & infill any exterior holes created by the Jen-Air exhaust vents.
5. Replacement of the existing wood exterior wall siding, wood shingles and trim with a new non-combustible exterior veneer.
6. Add R-6 or R-12.6 insulated sheathing over the existing exterior wall sheathing and under new exterior veneer where existing conditions allow for it.
7. Remove the existing metal plate cap (including the supports). Fabricate and attach new metal caps to each chimney as described within Detail 20A/525. See Section 01 21 00 Allowances for an additional allowance related to the chimneys.
8. Northeast & northwest entries – Remove existing exterior doors, interior doors and adjacent sidelights to be replaced by resized units.
9. Southeast entry – Remove existing door & window assemblies and replace with new window & door assemblies.
10. Southwest entry - Remove existing door & window assemblies and the interior door assembly (between the garage and stair tower lobby [STL]). Remove the door assembly between the stair tower and the STL. Remove the south and east wall and door assembly to the "Hotrise" room. Replace the door between the garage and STL with a re-configured assembly, replace the exterior door with a re-configured assembly. Rebuild a new solid rated wall to block of the "Hotrise" room from the STL and add a new exterior door to the "Hotrise" room. Raise a portion of the lower level stair tower landing flush with the lowest tread, extend the raised floor within the STL north of the door between the stair tower and the STL, ramp down from the raised floor in the STL to the lower level within the STL, re-install the door assembly between the stair tower and the STL with a sill flush with the raised portion of the STL (i.e. raise the door opening header) & relocate the existing wall mounted mechanical unit.
11. Main south entry – Remove the exterior and interior door assemblies along with the adjacent windows. Replace the openings with automatic sliding door assemblies.
12. Main north entry - Remove the existing roof over the north entrance & remove the north entrance exterior wall including the doors and sidelights. Add a new flat roof over the entry alcove and a new exterior wall with an automatic sliding door assembly aligned near the exterior building face, add a new interior wall with an automatic sliding door assembly near the interior corridor creating an airlock.
13. Adding a porte-cochere over the south entry drive utilizing the three existing column bases south of the entry drive.
14. Adding a non-combustible roof over the existing trash enclosure area.
15. A portion of the existing low roof adjacent to trash enclosure to be modified due to frequent damage from trash trucks
16. Adding exterior signage over the north and south entrances.
17. Replacing all exterior lights with LED fixtures, adding an exterior wall mounted light within the trash enclosure, adding lights within the underside of the new porte-cochere and on the three outermost porte-cochere columns, adding lights and power as required within the enclosed ski entry area, adding signage lights.
18. Snowmelt system to be added under the existing entry drive pavers. Gas snowmelt boiler to be added to accommodate the added snowmelt area.
19. All existing soffits & downspouts to be replaced. Gutters are to remain.
20. Thermal insulation (spray-applied) added to the underside of the garage ceiling near the garage doors.
- 21.
22. Pull mulch away from finished siding, maintain positive slope away from building.
23. Repair the northeast entry sidewalk with an elastomeric topping.

ADD ATTACHE:

- A. Extend the garage insulated ceiling as described within Detail 5/A102 Garage Level - Remodel (SW Entry) & Detail 14/A524 Garage Ceiling Insulation Detail to be extended throughout the entire Garage Level ceiling within the garage. This does not apply to the Second Level Garage area.
- B. In place of applying the elastomeric coating to the exterior sidewalk at the north east corner of the building, remove & replace the existing sidewalk with new concrete and the addition of an electric snowmelt system. The power used for the current electric snowmelt system within the trash enclosure slab shall be disconnected and rerouted to the new concrete sidewalk at the northeast corner of the building. Power supply & requirements to be coordinated with the electrical engineer & contractor. The removal and replacement of the concrete sidewalk shall not include the portion of the slab that is over the enclosed garage below (see Sheets A112 & A113 for a general reference to the extent of the enclosed garage below).
- C. In place of applying the elastomeric coating to the exterior sidewalk at the north east corner of the building, repair existing concrete sidewalk using Fusion-Crete (<http://www.fusion-crete.us/>).

[illegible]

PROJECT TEAM		
OWNER: BEAR CLAW II CONDOMINIUM ASSOCIATION 2420 SKI TRAIL LANE STEAMBOAT SPRINGS, CO 80487 PHONE: 970 879-6100 CONTACT: BOB MATTEO B.MATTEO@BEAR-CLAW.COM	ARCHITECTURAL DESIGN: ERIC SMITH ASSOCIATES, P.C. 1919 SEVENTH STREET BOULDER, CO 80302 PHONE: 303-442-5458 FAX: 303-442-4745 ARCHITECT: ERIC SMITH EMAIL: ERIC@ESAPC.COM	STRUCTURAL DESIGN: ANTHEM STRUCTURAL ENGINEERING, LLC 5171 ELDORADO SPRINGS DR., SUITE M BOULDER, CO 80303 PHONE: 303-848-8497 STRUCTURAL ENGINEER: ERIC SCHULTZ ESHULTZ@ANTHEMSTRUCTURAL.COM
MECHANICAL DESIGN: -	ELECTRICAL DESIGN: WILDER ENGINEERING, LLC 1170 BLUE SAGE DRIVE STEAMBOAT SPRINGS, CO 80487 PHONE: 970-819-7848 ELECTRICAL ENGINEER: ANDREW WILDER ANDY@WILDER-ENG.COM	GEOTECHNICAL: NORTHWEST COLORADO CONSULTANTS, INC. NWCC 2580 COPPER RIDGE DRIVE STEAMBOAT SPRINGS, COLORADO 80487 PHONE: 970-879-7888 FAX: 970-879-7891 SOILS ENGINEER: HAL SCHLICHT HSCHLICHT@NWCCUSA.COM
GENERAL CONTRACTOR: --		

NOTICE: DUTY OF COOPERATION


Release of these claims contemplates further cooperation among the architect, engineer, contractor and architect-Design and construction are complex. Although the architect and his consultants have performed their services with care and diligence, they cannot guarantee perfection. Completion is imperfect and errors with materials and construction may occur. Any ambiguity or discrepancy discovered by the use of these plans shall be promptly communicated to the architect. Failure to notify the architect compounds misadventure and increases construction costs. A failure to cooperate by a simple notice to the architect shall relieve the architect of any further responsibility. No claims shall be made from the plans without the consent of the architect are hereby waived. The architect shall not be held responsible for all consequences arising out of such changes.

All design, documents and data prepared by Eric Smith Associates, P.C. as instruments of service shall remain the property of Eric Smith Associates, P.C., and shall not be copied, changed or disclosed in any form without the prior obtaining of written consent of Eric Smith Associates, P.C.

Eric Smith Associates, P.C.

[illegible]

BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, COLORADO



ERIC SMITH ASSOCIATES, P.C.
1919 SEVENTH STREET
BOULDER, COLORADO, 80302
(303) 442-5458, (303) 442-4745 FAX

Job Number:	17022
Date:	2018-11-09
Drawn By:	ESA
Checked By:	ESA

Project Phase
PERMIT REVIEW
Sheet Title
COVER SHEET
Sheet Number
A000

GENERAL NOTES (EXISTING / DEMO):

- GENERAL** - THE EXISTING ELEMENTS & CONDITIONS SHOWN WITHIN THIS SET OF PLANS ARE BASED ON PREVIOUS SETS OF DRAWINGS AND GENERAL SITE OBSERVATIONS. PLEASE NOTE THAT THERE MAY BE MODIFICATIONS AND/OR UPDATES TO THE EXISTING BUILDING THAT MAY NOT BE REPRESENTED WITHIN THIS SET OF DRAWINGS. CONTACT THE ARCHITECT AND/OR STRUCTURAL ENGINEER WITH ANY DISCREPANCIES FOUND IN THE FIELD THAT MAY HAVE AN AFFECT ON THE REMODEL AS INDICATED WITHIN THIS CD SET.
- GENERAL** - EXISTING CONSTRUCTION & CONDITIONS SHALL BE VERIFIED IN THE FIELD.
- GENERAL** - ANY AND ALL AREAS BEYOND THE SCOPE OF RECONSTRUCTION DAMAGED IN THE COURSE OF THE DEMOLITION SHALL BE REPAIRED AND FINISHED TO MATCH ADJACENT SURFACES & ELEMENTS.
- GENERAL** - DISPOSE OF ALL DEMOLISHED ITEMS IN COMPLIANCE WITH AND REQUIRED BY ANY AND ALL APPLICABLE GOVERNING AGENCIES & OFFICIALS.
- GENERAL** - ALL EXISTING JEN-AIR APPLIANCES ADJACENT TO THE FIREPLACES ARE TO BE DISCONNECTED W/ THE EXTERIOR EXHAUST VENTS TO BE REMOVED & COVERED - COORD. DISCONNECTION W/ PROPERTY MANAGEMENT IN THE FIELD.
- GENERAL** - ----
- AC CONDENSING UNITS** - ALL EXISTING WALL MOUNTED AC CONDENSERS TO BE REMOVED. WALL OPENING TO BE FILLED IN AND FINISHED TO MATCH THE INTERIOR OF THE UNIT. THE EXTERIOR OF THE INFILLED OPENING TO BE PREPPED FOR THE INSTALLATION OF THE EXTERIOR INSULATED SHEATHING AND VENEER.
- EXTERIOR DECKS** - SEE SHEETS A104 & A105 FOR KEYPLAN REFERENCING THE DECK STACK LOCATIONS RELATED TO THE OVERALL BUILDING LAYOUT.
- EXTERIOR DECKS** - EACH DECK STACK IS REPRESENTED WITH EITHER TYPICAL LAYOUT REPRESENTING ALL OR MOST OF THE DECKS IN THAT STACK AND/OR A LEVEL SPECIFIC LAYOUT REPRESENTING A SPECIFIC CONDITION NOT TYPICAL WITH THE REMAINDER OF THE STACK. DECKS REFERENCED AS SIMILAR ARE TO BE REVIEWED BY CONTRACTOR IN THE FIELD FOR ANY DISCREPANCIES.
- EXTERIOR DECKS** - ALL DIMENSIONS SHOWN ARE APPROXIMATE AND ARE TO BE VERIFIED IN THE FIELD. DIMENSIONS ARE TAKEN TO FACE OF WALL / MATERIAL.
- EXTERIOR DECKS** - CONTRACTOR TO TAKE CARE NOT TO DAMAGE THE EXISTING GAS LINES & RELATED EQUIPMENT EXTENDING THROUGH MOST OF THE EXTERIOR DECKS - FIELD VERIFY (SEE GAS LINE NOTE BELOW).
- EXTERIOR DECKS** - EXISTING DECKING TO BE REMOVED.
- EXTERIOR DECKS** - EXISTING RAILING ASSEMBLY TO BE REMOVED / CUT FROM THE EXISTING STEEL ANGLE STRUCTURE. EXISTING STEEL ANGLE TO BE FILED DOWN & PAINTED PRIOR INSTALLATION OF NEW MATERIALS / ASSEMBLIES AS INDICATED FOR THE REMODEL.
- EXTERIOR DECKS** - CONTRACTOR TO VERIFY THE NUMBER OF DECKS THAT HAVE AN EXISTING GATE FROM THEIR DECK TO THE LANDSCAPED AREA BEYOND.
- EXTERIOR DECKS** - SEE EXTERIOR FINISHES (UNIT 612 WEST FACE OF LOFT & ADJACENT WALLS) RELATED TO UNIT 612'S DECK ON THE WEST FACE OF THE LOFT.
- GAS LINES** - EXISTING GAS LINES SHALL BE DISASSEMBLED AS REQUIRED FOR THE REMOVAL OF THE EXISTING EXTERIOR VENEER & DECKS. DISASSEMBLY SHALL BE PERFORMED BY A CONTRACTOR WITH EXPERIENCE IN THE INSTALLATION OF NATURAL GAS SYSTEMS.
- GAS LINES** - EXISTING LINES SHALL BE DISASSEMBLE WITH CARE TO ALLOW FOR THE RE-USE OF AS MANY OF THE COMPONENTS AS ALLOWED BY CODE AND/OR THE CONDITION OF THE EXISTING PIECES.
- WINDOWS / GLAZED DOORS** - CONTRACTOR TO FIELD VERIFY THE TYPE (I.E. FIXED, CASEMENT, ETC...) OPERATIONAL ORIENTATION & SIZE OF ALL EXTERIOR DOORS & WINDOWS BEING REPLACED AS PART OF THIS REMODEL TO ASSIST IN THE TYPE, OPERATION ORIENTATION & SIZING OF THERE REPLACEMENTS.
- WINDOWS / GLAZED DOORS** - CONTRACTOR TO FIELD VERIFY THE EXISTENCE OF EACH AND EVERY DOOR & WINDOW BEING REPLACED ON SITE AS SOME WINDOWS MAY NOT BE CLEARLY REPRESENTED WITHIN THIS CD SET.
- EXTERIOR FINISHES** - EXISTING EXTERIOR WALL FINISHES / VENEERS AND WATERPROOF MEMBRANES / BARRIERS ARE TO BE REMOVED DOWN TO THE EXISTING WOOD SHEATHING. THE CONDITION OF THE EXISTING WOOD SHEATHING SHALL BE INSPECTED FOR ANY DAMAGED PANELS WHICH SHALL BE REPLACED PRIOR TO THE INSTALLATION OF THE NEW LAYERS / FINISHES / VENEERS, ETC.
- EXTERIOR FINISHES** - ANY EXISTING FLASHING (I.E. ROOF TO WALL, ETC...) SHALL BE REPAIRED AND/OR REPLACED IN THE COURSE OF AND COORDINATED WITH THE REMODEL.
- EXTERIOR FINISHES (UNIT 612 WEST FACE OF LOFT & ADJACENT WALLS)** - CONTRACTOR SHALL FIELD VERIFY ALL THE ELECTRONIC EQUIPMENT ATTACHED TO OR RUNNING ALONG THE SIDE OF THE EXTERIOR WALL, SOFFIT ABOVE, EAVE, FASCIA & ROOF. THE EQUIPMENT IS A PART OF BUT NOT LIMITED TO CABLE SYSTEMS, SATELLITES & COMMUNICATION RELAY STATION FOR ZIRKEL WIRELESS.
- EXTERIOR FINISHES (UNIT 612 WEST FACE OF LOFT & ADJACENT WALLS)** - EXISTING CABLES, WIRES & CONDUIT RUN THROUGH BOTH THE DECKING & RAILING OF THE EXTERIOR DECK WHICH SHALL BE THOROUGHLY REVIEWED BY THE CONTRACTOR PRIOR TO DEMOLITION. CARE SHALL BE TAKEN WHEN CUTTING THE DECKING AND RAILING OUT FROM AROUND THE EXISTING CABLES, WIRES & CONDUIT.
- EXTERIOR FINISHES (UNIT 612 WEST FACE OF LOFT & ADJACENT WALLS)** - THE CONTRACTOR SHALL COORDINATE DIRECTLY WITH ZIRKEL WIRELESS (CONTACT INFORMATION PROVIDED BELOW) TO HAVE ONE OF THEIR REPRESENTATIVES ON SITE DURING THE REMOVAL AND REPLACEMENT OF THEIR EQUIPMENT.
- PORTE-COCHERE** - THE LOCATIONS, SIZE & ELEVATION OF THE EXISTING FOUNDATION PEDESTALS ALONG GRIDLINE A-06 SHALL BE FIELD VERIFIED.
- PORTE-COCHERE** - THE LOCATIONS, SIZE & ELEVATION OF THE EXISTING FOUNDATION PEDESTALS (IF THEY EVEN EXIST) ALONG GRIDLINE A-04 SHALL BE FIELD VERIFIED.
- PORTE-COCHERE** - THE CONSTRUCTION & CONDITION OF THE EXISTING STONE VENEERED WALL ALONG GRIDLINE 16 NEAR GRIDLINE A-04 SHALL BE FIELD VERIFIED FOR THE FOR THE CONNECTION OF THE PROPOSED PORTE-COCHERE COLUMN AT GRIDLINES A-04/16. DURING THE COURSE OF DEMOLITION OF THIS AREA, THE CONTRACTOR SHALL HAVE THE STRUCTURAL ENGINEER (AND POSSIBLY THE ARCHITECT) ON SITE TO REVIEW THE EXISTING CONDITIONS TO EITHER VERIFY THE CURRENT COLUMN SUPPORT DESIGN AND/OR MODIFY THE DESIGN AS REQUIRED DUE TO THE EXISTING CONDITIONS.
- ENTRY PAVERS** - EXISTING ENTRY DRIVE PAVERS SHALL BE REMOVED WITH CARE AS THEY WILL BE REINSTALLED IN THEIR EXISTING LOCATION ONCE THE ADDED SNOWMELT SYSTEM IS INSTALLED.

ZIRKEL WIRELESS CONTACT INFO:

ZIRKEL WIRELESS, LLC
CONTACT: ALAN BELVO
PHONE: 970-946-8060
EMAIL: ALAN@ZIRKEL.US

GENERAL NOTES (REMODEL / REPAIR):

- GENERAL** - THE EXISTING ELEMENTS & CONDITIONS SHOWN WITHIN THIS SET OF PLANS ARE BASED ON PREVIOUS SETS OF DRAWINGS AND GENERAL SITE OBSERVATIONS. PLEASE NOTE THAT THERE MAY BE MODIFICATIONS AND/OR UPDATES TO THE EXISTING BUILDING THAT MAY NOT BE REPRESENTED WITHIN THIS SET OF DRAWINGS. CONTACT THE ARCHITECT AND/OR STRUCTURAL ENGINEER WITH ANY DISCREPANCIES FOUND IN THE FIELD THAT MAY HAVE AN AFFECT ON THE REMODEL AS INDICATED WITHIN THIS CD SET.
- GENERAL** - CONSTRUCTION SHALL CONFORM TO THE CURRENT BUILDING CODES ADOPTED BY ROUTT COUNTY AND THE STATE OF COLORADO.
- GENERAL** - DO NOT SCALE DRAWINGS.
- GENERAL** - DETAILS SHOWN WITHIN THIS SET ARE FOR GENERAL REPRESENTATION ONLY. CONTRACTOR SHALL FOLLOW ANY AND ALL APPLICABLE MANUFACTURERS SPECIFICATIONS AND WARRANTY AND ANY APPLICABLE CODE OR STANDARD HAVING JURISDICTION OVER THIS PROJECT. CONTACT THE ARCHITECT IF THERE ARE ANY CONFLICTS BETWEEN THE MANUFACTURERS SPECIFICATIONS AT ADJACENT OR OVERLAPPING MATERIALS.
- GENERAL** - ----
- GENERAL** - PULL LANDSCAPING MULCH AWAY FROM FINISHED SIDING AND/OR VENEER. MAINTAIN POSITIVE SLOPE AWAY FROM THE EXISTING FOUNDATION FOR DRAINAGE.
- GENERAL** - UOI - UNLESS OTHERWISE INDICATED
- AC CONDENSING UNITS** - UNITS ARE SHOWN WITHIN THE CD SET FOR GENERAL REPRESENTATION ONLY. THE SYSTEMS ARE TO BE INSTALLED ON A UNIT BY UNIT BASIS AT THE DIRECTION OF THE INDIVIDUAL UNIT OWNERS AT THEIR EXPENSE EITHER DURING THE COURSE OF THIS REMODEL AND ADDITION PROJECT OR INDEPENDENTLY AT A LATER DATE.
- EXTERIOR DECKS** - EACH DECK STACK (SEE KEYPLAN ON SHEETS A104 & A105) IS REPRESENTED; HOWEVER, SIMILAR DECKS ARE SHOWN WITHIN A SINGLE LAYOUT AND UNIQUE DECKS ARE REPRESENTED WITH THEIR OWN LAYOUT. DECKS REFERENCED AS SIMILAR ARE TO BE REVIEWED BY CONTRACTOR IN THE FIELD FOR ANY DISCREPANCIES.
- EXTERIOR DECKS** - CONTRACTOR TO VERIFY THE NUMBER OF DECKS THAT HAVE AN EXISTING GATE FROM THEIR DECK TO THE LANDSCAPED AREA BEYOND.
- EXTERIOR DECKS** - ALL DIMENSIONS SHOWN ARE APPROXIMATE AND ARE TO BE VERIFIED IN THE FIELD. DIMENSIONS ARE TAKEN TO FACE OF WALL / MATERIAL.
- EXTERIOR DECKS** - EACH DECK THAT HAD A GATE PRIOR TO THE REMODEL SHALL HAVE A GATE IN THE SAME GENERAL SIZE AND CONFIGURATION UPON COMPLETION OF THE REMODEL. CONTRACTOR SHALL COORD. WITH THE FABRICATOR THE INSTALLATION OF THE GATE & ALL ASSOCIATED HARDWARE FOR THE SMOOTH OPERATION OF THE GATE.
- EXTERIOR DECKS** - DECKING BASIS OF DESIGN: VERSADECK COMMERCIAL ALUMINUM DECKING C-60. INSTALL PER MFR. SPEC. & WARRANTY.
- EXTERIOR DECKS** - THE EXISTING & NEW STEEL ANGLES / STRUCTURE ARE TO BE CLEAN, SANDED AND OTHERWISE PREPPED FOR THE APPLICATION OF EXTERIOR POWDER COATING - RE: MATERIAL COLORS.
- EXTERIOR DECKS** - GUARDRAILS SHALL BE POWDER COATED - RE: MATERIAL COLORS.
- EXTERIOR DECKS** - EITHER ALL OR MOST OF THE DECKS HAVE A GAS LINE OR RELATED EQUIPMENT RUNNING THROUGH THE DECK WHICH SHALL BE FIELD VERIFIED. MATERIALS ARE INSTALLED WITHOUT DAMAGING OR OTHERWISE INTERFERING WITH THE EXISTING GAS RELATED UTILITIES.
- EXTERIOR DECKS** - SEE EXTERIOR FINISHES (UNIT 612 WEST FACE OF LOFT & ADJACENT WALLS) RELATED TO UNIT 612'S DECK ON THE WEST FACE OF THE LOFT.
- GAS LINES** - EXISTING GAS LINES SHALL BE DISASSEMBLED BY A CONTRACTOR WITH EXPERIENCE IN THE INSTALLATION OF NATURAL GAS SYSTEMS. INSTALLATION SHALL BE IN STRICT COMPLIANCE WITH ALL APPLICABLE CODES & GOVERNING ENTITIES HAVING JURISDICTION OVER THIS PROJECT.
- GAS LINES** - GAS LINES THAT ARE REQUIRED TO TRAVERSE THE LENGTH OF THE DECK SHALL BE INCORPORATED WITHIN THE DECK ASSEMBLY PER DETAIL 3A223 EXT. DECK & RAIL DETAILS-1.
- GAS LINES** - REDESIGN AND ROUTING OF GAS LINES DUE TO REMODELED CONDITIONS SHALL BE COORDINATED IN THE FIELD BY THE MECHANICAL CONTRACTOR.
- WINDOWS / GLAZED DOORS** - CONTRACTOR TO FIELD VERIFY THE TYPE (I.E. FIXED, CASEMENT, ETC...) OPERATIONAL ORIENTATION & SIZE OF ALL EXTERIOR DOORS & WINDOWS BEING REPLACED AS PART OF THIS REMODEL TO ASSIST IN THE TYPE, OPERATION ORIENTATION & SIZING OF THERE REPLACEMENTS.
- WINDOWS / GLAZED DOORS** - CONTRACTOR TO FIELD VERIFY THE EXISTENCE OF EACH AND EVERY DOOR & WINDOW BEING REPLACED ON SITE AS SOME WINDOWS MAY NOT BE CLEARLY REPRESENTED WITHIN THIS CD SET.
- WINDOWS / GLAZED DOORS** - REPLACEMENT DOORS & WINDOWS SHALL COMPLY WITH CURRENTLY ADOPTED ENERGY CODE REQUIREMENTS.
- WINDOWS / GLAZED DOORS** - REPLACEMENT DOORS & WINDOWS SHALL BE INSTALLED IN STRICT CONFORMANCE WITH THE MANUFACTURERS SPECIFICATIONS & WARRANTY AND SHALL BE COORDINATED WITH THE INSTALLATION OF ADJACENT MATERIALS / FINISHES (I.E. FLASHING, POSITIVE OVERLAP, EXTERIOR INSULATED SHEATHING, INTERIOR TRIM, ETC.)
- WINDOWS / GLAZED DOORS** - REFER TO GENERAL DOOR & WINDOW NOTES ON SHEET A511 FOR MORE SPECIFIC INFORMATION RELATED TO THE DOORS & WINDOWS NOT INCLUDED WITHIN THESE NOTES.
- RATED DOORS** - ANY RATED ASSEMBLY BEING REMOVED THAT IS LABELED SHALL BE REPLACED WITH A RATED ASSEMBLY THAT IS EQUAL TO OR GREATER THAN THE ASSEMBLY IT IS REPLACING. CONTACT ARCHITECT IF THERE IS AN EXISTING DOOR ASSEMBLY WITH AN ILLEGIBLE LABEL OR MISSING AND SHOULD BE LABELED.
- EXTERIOR FINISHES** - ALL EXTERIOR VENEERS SHALL BE INSTALLED IN STRICT CONFORMANCE WITH THE MANUFACTURERS SPECIFICATIONS & WARRANTY AND SHALL BE COORDINATED WITH THE INSTALLATION OF ADJACENT MATERIALS / FINISHES (I.E. WATERPROOFING, FLASHING, INSULATED SHEATHING, TRIM, ETC...)
- EXTERIOR FINISHES** - THE INSTALLATION OF ZIP SYSTEM R-SHEATHING (INSULATED SHEATHING) ON THE EXTERIOR WALL HAS BEEN PRE-APPROVED BY THE ROUTT COUNTY BUILDING DEPARTMENT AS PART OF THE REMODEL SPECIFIED WITHIN THIS CD SET.
- EXTERIOR FINISHES** - ZIP R-SHEATHING PANEL TYPES R-6 & R-12 SHALL BE INSTALLED IN STRICT CONFORMANCE WITH THE MANUFACTURERS SPECIFICATIONS, WARRANTY & ICC-ES REPORT NO. ESR-3373 (INCLUDING OTHER REFERENCED REPORTS).
- EXTERIOR FINISHES** - ZIP R-SHEATHING PANEL SHALL BE INSTALLED WITH ZIP SYSTEM SEAM / FLASHING TAPE AND ZIP SYSTEM FLEXIBLE FLASHING TAPE PER THE MANUFACTURERS SPECIFICATIONS, WARRANTY & REFERENCE ICC-ES REPORTS.
- EXTERIOR FINISHES** - THE INSTALLATION OF THE NEW INSULATED SHEATHING AND EXTERIOR VENEER SHALL BE COORDINATED IN THE FIELD WITH THE MANUFACTURER'S SPECIFICATIONS & WARRANTY RELATED TO ANY EXISTING ELEMENTS INCLUDING BUT NOT LIMITED TO THROUGH PENETRATIONS, ROOF/WALL FLASHING, EAVES & SOFFITS, ETC.
- EXTERIOR FINISHES (UNIT 612 WEST FACE OF LOFT & ADJACENT WALLS)** - THE ORIGINAL EQUIPMENT REMOVED AS REQUIRED FOR THE REMODEL SHALL BE REPLACED / INSTALLED AS IT WAS ORIGINALLY LAID OUT.
- EXTERIOR FINISHES (UNIT 612 WEST FACE OF LOFT & ADJACENT WALLS)** - A GAP SHALL BE PROVIDED BETWEEN THE COMPLETED WALL AND THE NEW RAILING ALONG WITH THE NEW DECKING TO ACCOUNT FOR THE EXISTING CABLES, WIRES & CONDUIT.
- EXTERIOR FINISHES (UNIT 612 WEST FACE OF LOFT & ADJACENT WALLS)** - THE CONTRACTOR SHALL COORDINATE DIRECTLY WITH ZIRKEL WIRELESS (CONTACT INFORMATION PROVIDED BELOW) TO HAVE ONE OF THEIR REPRESENTATIVES ON SITE DURING THE REMOVAL AND REPLACEMENT OF THEIR EQUIPMENT.
- PORTE-COCHERE** - ROOF ASSEMBLY BASED ON UL DESIGN NO. P546 (1-HR. RATED) OR EQUAL.
- PORTE-COCHERE** - THE EXTENSION OF THE BUILDINGS EXISTING AUTOMATIC FIRE SPRINKLER SYSTEM UNDER THE PORTE-COCHERE TO BE COORDINATED BETWEEN THE CONTRACTOR AND THE FIRE SPRINKLER CONSULTANT.
- SKI ENTRY** - ROOF ASSEMBLY BASED ON UL DESIGN NO. P510 (1-HR. RATED) OR EQUAL.
- SKI ENTRY** - EXISTING EXTERIOR SLAB ASSEMBLY (BETWEEN GRIDLINES 14-15 & GRIDLINES E-G) TO REMAIN AS CURRENTLY SLOPED WHEN THE SPACE IS CONVERTED INTO THE SKI ENTRY AREA. A LEVEL SURFACE FLUSH WITH THE EXISTING INTERIOR SPACE MAY BE PROVIDED BASED ON A SITE REVIEW OF THE EXISTING STRUCTURAL SYSTEM (INCLUDING ALL ANCILLARY SYSTEMS AND TRADES EITHER IN OR RUNNING THROUGH THE FLOOR/CEILING ASSEMBLY) AND THE CONSTRUCTION OF ADDITIONAL REINFORCEMENT SUPPORT DESIGNED BY THE STRUCTURAL ENGINEER SEPARATELY.
- SKI ENTRY** - THE EXTENSION OF THE BUILDINGS EXISTING AUTOMATIC FIRE SPRINKLER SYSTEM INTO THE SKI ENTRY AREA TO BE COORDINATED BETWEEN THE CONTRACTOR AND THE FIRE SPRINKLER CONSULTANT.
- ENTRY PAVERS / SNOWMELT SYSTEM** - THE EXISTING ENTRY DRIVE PAVERS SHALL BE REINSTALLED OVER THE ADDED SNOWMELT SYSTEM.
- ENTRY PAVERS / SNOWMELT SYSTEM** - A NEW GAS HEATED SNOWMELT BOILER TO BE INSTALLED IN AN EXTERIOR LOCATION. SIZING AND INSTALLATION REQUIREMENTS INCLUDING BUT NOT LIMITED TO ELECTRICAL POWER, GAS LINES, PLACEMENT SHALL BE COORDINATED IN THE FIELD.
- AUTOMATIC SLIDING DOOR ASSEMBLIES** - PORTE-COCHERE ENTRANCE, EXTERIOR ASSEMBLY: OPERATED BY MOTION SENSOR DURING NORMAL BUSINESS HOURS (TO BE DETERMINED BY MANAGEMENT), AND AFTER BUSINESS HOURS, OPERATED VIA AN ADA COMPLIANT PUSH PAD.
- AUTOMATIC SLIDING DOOR ASSEMBLIES** - PORTE-COCHERE ENTRANCE, INTERIOR ASSEMBLY: OPERATED BY MOTION SENSOR DURING NORMAL BUSINESS HOURS (TO BE DETERMINED BY MANAGEMENT), AND AFTER BUSINESS HOURS, OPERATED VIA AN ACCESS CONTROLLED DEVICE (I.E. ELECTRONIC KEY FOB EVERY OWNER / RESIDENT WILL HAVE) AND/OR THE CURRENT CALL BOX CONNECTED TO EACH UNIT TO BE BUZZED IN.
- AUTOMATIC SLIDING DOOR ASSEMBLIES** - SKI ENTRY, EXTERIOR ASSEMBLY: OPERATED FROM THE OUTSIDE VIA KEY FOB CARPIED BY THE INSIDE FIRE FIGHTER VIA MOTION SENSOR.
- AUTOMATIC SLIDING DOOR ASSEMBLIES** - SKI ENTRY, INTERIOR ASSEMBLY: OPERATED VIA MOTION SENSOR ON BOTH SIDES.
- EXTERIOR SIDEWALK** - THE SPALLING CONCRETE ON THE EXTERIOR SIDEWALK LEADING TO THE BEAR CLAW I BUILDING TO BE COATED WITH AN AUTOMATIC SNOWMELT SYSTEM. THE CONCRETE SHALL BE REPAIRED, REMOVED AND PREPPED AS REQUIRED BY COATING MANUFACTURER'S SPECIFICATIONS. SEE WORK SCOPE NARRATIVE FOR AN ADD ALTERNATE OPTION FOR THIS SIDEWALK.

DIVISION 00 - CONDITIONS OF THE CONTRACT

00 11 16 - INVITATION TO BID

SCOPE OF WORK

THE BEAR CLAW II REMODEL AND MINOR ADDITION SHALL BE IN ACCORDANCE WITH THE CONTRACT DOCUMENTS PREPARED BY ERIC SMITH ASSOCIATES, P.C., AND ASSOCIATED CONSULTANTS.

QUALIFICATION OF BIDDERS

BIDS WILL BE RECEIVED ONLY FROM INVITED BIDDERS. IN SUBMITTING A PROPOSAL, A BIDDER THEREBY REPRESENTS THAT HE IS FULLY QUALIFIED, PROPERLY LICENSED, STAFFED, AND EQUIPPED TO PROPERLY PERFORM THE WORK.

THE CONSTRUCTION MUST BE DONE BY COMPETENT, EXPERIENCED WORKMEN WHO ARE KNOWLEDGEABLE IN THE APPLICATION AND USE OF ALL OF THE MATERIALS, PLUS HAVE CARE AND CONCERN FOR THE WORK, AND PAY ATTENTION TO DETAILS.

00 21 13 - INSTRUCTION TO BIDDERS

COORDINATION OF BIDDING

GENERAL CONTRACTOR TO BE RESPONSIBLE FOR DISTRIBUTION OF CONSTRUCTION DOCUMENTS AND COORDINATION OF ALL PRICING SUBMITTED FROM BIDDERS.

EXAMINATION OF CONTRACT DOCUMENTS

BEFORE SUBMITTING PROPOSALS, BIDDERS SHALL CAREFULLY EXAMINE THE CONTRACT DOCUMENTS, INCLUDING THE DRAWINGS AND SPECIFICATIONS, AND SHALL BRING ANY DISCREPANCIES TO THE ATTENTION OF THE ARCHITECT.

CONDITIONS OF THE WORK

EACH BIDDER SHALL INFORM HIMSELF FULLY OF THE CONDITIONS RELATING TO CONSTRUCTION OF THE PROJECT AND THE EMPLOYMENT OF LABOR THEREFOR. FAILURE TO DO SO WILL NOT RELIEVE A SUCCESSFUL BIDDER OF HIS OBLIGATION TO FURNISH ALL MATERIAL AND LABOR NECESSARY TO CARRYOUT THE PROVISIONS OF THE CONTRACT.

LAWS AND REGULATIONS

EACH BIDDER SHALL FAMILIARIZE HIMSELF WITH ALL APPLICABLE STATE LAWS, CODES, MUNICIPAL ORDINANCES AND THE RULES AND REGULATIONS OF ALL AUTHORITIES HAVING JURISDICTION OVER THE CONSTRUCTION OF THE PROJECT. THESE LAWS AND REGULATIONS APPLY TO THE CONTRACT THROUGHOUT AND THEY WILL BE DEEMED TO BE INCLUDED IN THE CONTRACT THE SAME AS IF WRITTEN THEREIN IN FULL.

EXAMINATION OF PREMISES

BEFORE SUBMITTING PROPOSALS FOR HIS WORK, EACH BIDDER WILL BE HELD TO HAVE MADE HIMSELF AWARE OF EXISTING CONDITIONS AND SATISFIED HIMSELF AS TO THE CONDITIONS UNDER WHICH HE WILL BE OBLIGATED TO OPERATE OR THAT WILL IN ANY MANNER AFFECT THE WORK UNDER THIS CONTRACT. SUBCONTRACTORS AND MATERIAL SUPPLIERS SHOULD ALSO FAMILIARIZE THEMSELVES WITH THE EXISTING CONDITIONS AND EXISTING MATERIALS.

ADDENDA

IF ANY BIDDER IS IN DOUBT AS TO THE MEANING OF ANY PART OF THE PLANS, SPECIFICATIONS OR OTHER PROPOSED CONTRACT DOCUMENTS, THEY MAY SUBMIT TO THE ARCHITECT A WRITTEN REQUEST FOR AN INTERPRETATION THEREOF. REQUESTS MUST BE RECEIVED IN ARCHITECT'S OFFICE BEFORE NOON, FIVE (5) CALENDAR DAYS PRIOR TO THE BID CLOSING TIME. THE PERSON SUBMITTING THE REQUEST WILL BE HELD RESPONSIBLE FOR ITS DELIVERY.

ALL QUESTIONS, INQUIRIES OR REQUESTS FOR ADDITIONAL INFORMATION SHALL BE MADE DIRECTLY TO THE ARCHITECT. ANSWERS TO ALL QUESTIONS, INQUIRIES, OR REQUEST FOR ADDITIONAL INFORMATION WILL BE ISSUED IN THE FORM OF ADDENDA, AND COPIES OF EACH ADDENDUM WILL BE ISSUED TO ALL PROSPECTIVE BIDDERS. ALSO, PROSPECTIVE BIDDERS MAY, DURING THE BIDDING PERIOD, BE ADVISED BY ADDENDUM OF ADDITIONS TO, DELETIONS FROM OR CHANGES IN THE REQUIREMENTS OF THE CONTRACT DOCUMENTS. THE ARCHITECT AND THE OWNER WILL NOT BE RESPONSIBLE FOR THE AUTHENTICITY OR CORRECTNESS OR ORAL INTERPRETATIONS OF THE CONTRACT DOCUMENTS OR FOR INFORMATION OBTAINED IN ANY OTHER MANNER THAN THROUGH THE MEDIA OF ADDENDA. RECEIPT OF EACH ADDENDUM SHALL BE ACKNOWLEDGED BY BIDDERS IN THE PROPOSALS AND EACH ADDENDUM SHALL BE CONSIDERED A PART OF THE CONTRACT DOCUMENTS. FAILURE TO ACKNOWLEDGE RECEIPT OF ANY ADDENDA ISSUED MAY INVALIDATE A PROPOSAL AS INCOMPLETE.

SUBSTITUTION OF MATERIAL

REFER TO DIVISION 1, SECTION 01 62 00 - PRODUCT OPTIONS AND SUBSTITUTIONS.

AWARD OF CONTRACT

THE OWNER RESERVES THE RIGHT TO ACCEPT ANY OF THE BID PROPOSALS SUBMITTED OR TO REJECT ANY OR ALL PROPOSALS AND TO WAIVE ANY IRREGULARITIES OR INFORMALITIES IN ANY PROPOSAL, AS HIS INTERESTS ARE BEST SERVED.

THE CONTRACTOR MUST BE EXPERIENCED AND AWARE OF BOTH THE ARCHITECT'S AND MANUFACTURER'S SPECIFICATIONS FOR THE APPLICATIONS OR NON-APPLICATIONS OF PRODUCTS IN ADVERSE WEATHER CONDITIONS.

00 72 00 - GENERAL CONDITIONS

THE CONTRACT DOCUMENTS CONSIST OF THE AGREEMENT BETWEEN OWNER AND CONTRACTOR, THE GENERAL CONDITIONS OF THE CONTRACT (AIA DOCUMENT A-201), THE DRAWINGS AND SPECIFICATIONS INCLUDING ALL MODIFICATIONS THEREOF INCORPORATED IN THE DOCUMENTS BEFORE THEIR EXECUTION. THESE FORM THE CONTRACT.

ALL WORK PERFORMED UNDER THIS CONTRACT SHALL BE IN ACCORDANCE WITH THE GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION (AIA DOCUMENT A-201), WHICH DOCUMENT IS HEREBY MADE, BY REFERENCE, A PART OF EACH DIVISION OF THIS PROJECT MANUAL AS IF HEREIN WRITTEN IN FULL.

THE CONTRACTOR IS HEREBY SPECIFICALLY DIRECTED, AS A CONDITION OF THE CONTRACT, TO OBTAIN THE NECESSARY NUMBER OF COPIES OF AIA DOCUMENT A-201, TO ACQUAINT HIMSELF WITH THE ARTICLES CONTAINED THEREIN AND TO NOTIFY AND APPRIIZE ALL SUBCONTRACTORS, SUPPLIERS, AND ANY OTHER PARTIES TO THE CONTRACT OR INDIVIDUALS OR AGENCIES ENGAGED ON THE WORK, THAT IT IS A PART OF THIS CONTRACT AND THAT THEY ARE AWARE OF ITS CONTENTS. NO CONTRACTUAL ADJUSTMENTS SHALL BE DONE OR BECOME EXIGENT AS A RESULT OF FAILURE ON THE PART OF THE CONTRACTOR TO FULLY ACQUAINT HIMSELF AND ALL OTHER PARTIES TO THE CONTRACT WITH THE CONDITIONS OF AIA DOCUMENT A-201. COPIES OF AIA DOCUMENT A-201, AS WELL AS ALL OTHER AIA DOCUMENTS, MAY BE OBTAINED FROM MOST ARCHITECTS AND ENGINEERS' SUPPLY STORES, AMERICAN INSTITUTE OF ARCHITECTS (AIA) REGIONAL OFFICES, OR ERIC SMITH ASSOCIATES, P.C. THE FORM OF AGREEMENT SHALL BE EXECUTED ON THE AIA DOCUMENT A-101, STANDARD FORM OF AGREEMENT BETWEEN OWNER AND CONTRACTOR, 2017 EDITION.

DIVISION 01 - GENERAL REQUIREMENTS

01 11 00 - SUMMARY OF WORK

PROJECT LOCATION: 2420 SKI TRAIL LANE STEAMBOAT SPRINGS, CO 80467

OWNER: BEAR CLAW II CONDOMINIUM ASSOCIATION

ASSOCIATION MANAGEMENT:

BREO, INC.
C/O BOB MATTEO
2420 SKI TRAIL LANE STEAMBOAT SPRINGS, CO 80467

THE WORK CONSISTS PRIMARILY OF THE REMODEL AND MINOR ADDITION TO AN EXISTING SIX STORY CONDOMINIUM BUILDING INCLUDING, BUT NOT LIMITED TO REFACING THE EXTERIOR, NEW DOORS & WINDOWS, NEW PORTE-COCHERE, NEW SKI ENTRY AREA & NEW ROOF OVER EXISTING TRASH ENCLOSURE.

PROJECT INCLUDES: ARCHITECTURAL, STRUCTURAL, MECHANICAL, PLUMBING, FIRE PROTECTION, HVAC, ELECTRICAL AND LANDSCAPING REPAIR.

CONTRACT DOCUMENTS: THE CONTRACT DOCUMENTS CONSIST OF THE AGREEMENT BETWEEN OWNER AND CONTRACTOR, THE GENERAL CONDITIONS OF THE CONTRACT, THE DRAWINGS AND SPECIFICATIONS, INDICATED ON DRAWING INDEX SHEET AND INCLUDING ALL MODIFICATIONS THEREOF INCORPORATED IN THE DOCUMENTS BEFORE THEIR EXECUTION. THESE FORM THE CONTRACT.

DRAWINGS ARE INTENDED TO SHOW THE GENERAL ARRANGEMENT, DESIGN AND EXTENT OF THE WORK AND ARE PARTLY DIAGRAMMATIC. THE ORGANIZATION OF THE DRAWINGS AND SPECIFICATIONS INTO TYPES, SECTIONS, AND ARTICLES AND THE ARRANGEMENT OF THE DRAWINGS SHALL NOT CONTROL THE CONTRACTOR IN DIVIDING THE WORK AMONG SUBCONTRACTORS OR IN ESTABLISHING THE EXTENT OF WORK TO BE PERFORMED BY ANY TRADE. THEY ARE NOT INTENDED TO BE SCALED FOR ROUGH IN MEASUREMENTS OR TO SERVE AS SHOP DRAWINGS. FIELD VERIFY EXISTING CONDITIONS AND IF DISCREPANCIES EXIST, NOTIFY THE ARCHITECT IN WRITING.

ITEMS TO BE PAID IN ADDITION TO THE CONTRACT AMOUNT AND TO BE PAID DIRECTLY BY OWNER:

- SPECIAL INSPECTIONS AS REQUIRED BY LOCAL BUILDING OFFICIAL
- BUILDING PERMIT FEES

COPIES FURNISHED: UNLESS OTHERWISE STATED IN THE CONTRACT DOCUMENTS, THE CONTRACTOR WILL BE FURNISHED, AT COST TO THE OWNERS, ADEQUATE SETS OF DRAWINGS AND SPECIFICATIONS FOR THE EXECUTION OF THE WORK AS DETERMINED AND AGREED TO BY OWNERS AND CONTRACTOR.

MATERIALS, APPLIANCES, EMPLOYEES: UNLESS OTHERWISE STIPULATED, THE CONTRACTOR SHALL PROVIDE AND PAY FOR ALL MATERIALS, LABOR, TOOLS, EQUIPMENT, TRANSPORTATION AND OTHER FACILITIES NECESSARY FOR THE EXECUTION AND COMPLETION OF THE WORK.

DIVISION 01 - GENERAL REQUIREMENTS (CONT)

01 11 00 - SUMMARY OF WORK (CONT)

ITEM SPECIFICATION FORM: THE SPECIFICATIONS FROM HERE ON MAY BE WRITTEN IN IMPERATIVE AND ABBREVIATED FORM. SUPPLY OMITTED WORDS BY INFERENCE. EXCEPT AS WORDED TO THE CONTRARY, PERFORM ALL INDICATED REQUIREMENTS, WHETHER STATED IMPERATIVELY OR OTHERWISE. THE WORD "PROVIDE" MEANS "SUPPLY, PAY FOR AND INSTALL." SEPARATION OF SPECIFICATIONS INTO DIVISIONS AND SECTIONS IS FOR CONVENIENCE AND DOES NOT ESTABLISH LIMITS OF WORK.

LATEST DOCUMENTS: PERFORM ALL WORK FROM THE LATEST CONTRACT DOCUMENTS, SHOP DRAWINGS AND OTHER INSTRUCTIONS. CONTRACTOR IS RESPONSIBLE FOR DISTRIBUTION TO HIS SUBCONTRACTORS AND OTHER INVOLVED PARTIES. CONTRACTOR SHALL PROVIDE A SET OF THE LATEST CONTRACT DOCUMENTS ON SITE IN ONE LOCATION THROUGHOUT THE PROJECT. CONTRACTOR SHALL APPLY FOR AND OBTAIN ALL PERMITS REQUIRED FOR THE WORK. OWNER SHALL PAY FOR ALL PERMITS AND USE TAXES.

PERMIT

COMPLY WITH ALL APPLICABLE BUILDING CODES AND RULES OF OTHER GOVERNING REGULATORY AGENCIES. SUBMIT TWO COPIES EACH OF PERMITS, INSPECTION REPORTS, AND CERTIFICATES OF COMPLIANCE TO OWNER AND ARCHITECT.

VERIFY FIELD DIMENSIONS BEFORE ORDERING FABRICATIONS OR PRODUCTS TO FIT IN PLACE. NOTIFY ARCHITECT OF EXISTING CONDITIONS AND DIMENSIONS THAT DIFFER FROM THOSE SHOWN IN THE DRAWINGS.

UNLESS NOTED OTHERWISE, THE SUBJECT OF ALL IMPERATIVE SENTENCES IN THE SPECIFICATIONS IS THE CONTRACTOR. FOR EXAMPLE, "PROVIDE AND INSTALL . . ." MEANS, "CONTRACTOR SHALL PROVIDE AND INSTALL . . ."

01 14 00 - WORK RESTRICTION (PARTIAL OCCUPANCY)

CONTRACTOR AGREES TO THE USE AND OCCUPANCY OF PORTIONS OF THE PROJECT BEFORE FORMAL ACCEPTANCE BY THE OWNER UNDER THE FOLLOWING CONDITIONS:

- A CERTIFICATE OF SUBSTANTIAL COMPLETION SHALL BE PREPARED AND EXECUTED AS PROVIDED IN THE GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION (AIA DOCUMENT A-201), EXCEPT THAT WHEN, IN THE OPINION OF THE OWNER, THE CONTRACTOR IS CHARGEABLE WITH UNWARRANTED DELAY THE COMPLETION OF THE WORK OR OTHER CONTRACT REQUIREMENTS WITH THE SIGNATURE OF THE CONTRACTOR WILL NOT BE REQUIRED. THE CERTIFICATE OF SUBSTANTIAL COMPLETION SHALL BE ACCOMPANIED BY A WRITTEN ENDORSEMENT OF THE CONTRACTOR'S INSURANCE CARRIER AND SURETY PERMITTING OCCUPANCY BY THE OWNER DURING THE REMAINING PERIOD OF PROJECT WORK.
- OCCUPANCY BY THE OWNER SHALL NOT BE CONSTRUED BY THE CONTRACTOR AS BEING AN ACCEPTANCE OF THAT PART OF THE PROJECT TO BE OCCUPIED.
- THE CONTRACTOR SHALL NOT BE HELD RESPONSIBLE FOR ANY DAMAGE TO THE OCCUPIED PART OF THE PROJECT RESULTING FROM THE OWNER'S OCCUPANCY.
- OCCUPANCY BY THE OWNER SHALL NOT BE DEEMED TO CONSTITUTE A WAIVER OF EXISTING CLAIMS IN BEHALF OF THE OWNER OR CONTRACTOR AGAINST EACH OTHER.

EXCEPT AS SPECIFIED ABOVE, USE AND OCCUPANCY BY THE OWNER PRIOR TO PROJECT ACCEPTANCE DOES NOT RELIEVE THE CONTRACTOR OF HIS RESPONSIBILITY TO MAINTAIN INSURANCE AND BONDS REQUIRED OF THE CONTRACTOR UNDER THE CONTRACT, UNTIL THE PROJECT IS COMPLETED AND ACCEPTED BY THE OWNER.

01 21 00 - ALLOWANCES

SUMMARY

ALLOWANCE SHALL BE FOR MATERIALS AND EQUIPMENT AT CONTRACTOR'S COST. ALLOWANCE SHALL NOT COVER OVERHEAD, PROFIT, LABOR AND INSTALLATION. THESE ITEMS SHALL BE INCLUDED IN THE BASE CONTRACT SUM.

IF REQUESTED BY ARCHITECT, CONTRACTOR SHALL SUPPLY COMPLETE COST ITEMIZATION OF THE ALLOWANCE. NOTIFY ARCHITECT IN AMPLE TIME WHEN A DECISION ON AN ALLOWANCE ITEM IS REQUIRED TO AVOID A DELAY IN CONSTRUCTION, TYPICALLY 1 - 2 WEEKS. CERTIFY THAT QUANTITIES OF PRODUCTS PURCHASED ARE WHAT ARE NEEDED WITH REASONABLE ALLOWANCE FOR WASTE AND SPARE MAINTENANCE SUPPLIES FOR THE OWNER.

SCHEDULE
PROVIDE LUMP SUM ALLOWANCES FOR:

- TILE (INTERIOR) AT \$5.00 S.F. (MATERIAL COST FOR THE TILE ONLY).
- BRICK VENTILATION REPAIR EXISTING BRICK, TUCKPOINT AND PROVIDE FLASHING AS REQUIRED. THIS IS WORK ABOVE AND BEYOND THE SCOPE DESCRIBED IN THE WORK SCOPE NARRATIVE ON SHEET A000. PROVIDE AN ALLOWANCE OF ONE THOUSAND DOLLARS (\$1,000) PER BRICK CHIMNEY FOR THIS SCOPE.

THE ALLOWANCE DOES NOT INCLUDE THE LABOR FOR INSTALLATION OR THE MISCELLANEOUS MATERIALS REQUIRED TO INSTALL THE TILE. THESE ITEMS SHALL BE INCLUDED IN THE CONTRACT.

01 23 00 - ALTERNATES

SUMMARY

THE CONTRACTOR SHALL STATE IN PROPOSAL THE AMOUNT ADDED TO OR DEDUCTED FROM HIS BASE PROPOSAL FOR THE INCLUSION OF THE REQUESTED ALTERNATES.

INCLUDE THE COST OF MODIFICATIONS TO OTHER WORK TO ACCOMMODATE EACH ALTERNATE. INCLUDE COSTS SUCH AS OVERHEAD, FEE AND PROFIT.

THE OWNER WILL DETERMINE WHICH ALTERNATES WILL BE INCLUDED IN THE CONTRACT.

COORDINATE ALTERNATES WITH RELATED WORK TO ENSURE THAT WORK AFFECTED BY EACH SELECTED ALTERNATE IS PROPERLY EXECUTED.

01 26 63 - CHANGE ORDER PROCEDURES

SUMMARY

CHANGES IN THE WORK MAY BE REQUIRED WHICH WILL BE AUTHORIZED BY A CHANGE ORDER.

CHANGE ORDERS, SIGNED BY THE OWNER AND ARCHITECT, TO AUTHORIZE CHANGES IN THE WORK WILL INCLUDE EQUIVALENT CHANGES IN THE CONTRACT SUM AND/OR TIME OF COMPLETION.

CHANGE ORDERS WILL BE NUMBERED IN SEQUENCE AND DATED.

THE FOLLOWING PROCEDURES SHALL APPLY TO THE GENERAL CONTRACTOR, ALL SUBCONTRACTORS, ALL SUB-SUBCONTRACTORS, AND TO ANY OTHER PERSON OR COMPANY PERFORMING ANY WORK ON OR FOR THIS PROJECT.

PRIOR TO COMMENCING OF ANY CHANGE ORDER WORK, AUTHORIZATION MUST BE RECEIVED FROM THE OWNER. CONTRACTOR TO SUBMIT PROPOSAL REQUEST, AIA FORM G709. WORK THAT IS REQUIRED AS A RESULT OF AN EMERGENCY IS EXCLUDED. IN ANY EMERGENCY, THE OWNER AND ARCHITECT ARE TO BE NOTIFIED IMMEDIATELY BY THE CONTRACTOR THE DAY OF THE EMERGENCY.


PRIOR TO PAYMENT OF ANY CHANGE ORDER, AIA FORM G701 MUST BE SUBMITTED AND EXECUTED BY THE CONTRACTOR, ARCHITECT AND OWNER. A SEPARATE FORM MUST BE SUBMITTED FOR EACH CHANGE.

CHANGE ORDER SUBMITTALS MUST BE SUBMITTED IN THE PAYMENT PERIOD IN WHICH THE EXECUTION OF THE CHANGE OCCURS.

THE VALUE OF THE CHANGE ORDER WILL BE DETERMINED BY EITHER: (1) A GUARANTEED BID PRICE, OR (2) THE COST OF THE WORK, PLUS A FEE. WHEN THE "COST OF THE WORK PLUS A FEE" METHOD IS USED, ALL COSTS SHALL BE:

- LISTED INDIVIDUALLY ON AIA FORM G701.
- SUBSTANTIATED (PRIOR TO PAYMENT) BY SUBMITTING COPIES OF EACH MATERIALS INVOICE AND/OR INDIVIDUAL TIME CARDS.
- LABOR AND MATERIAL COSTS MUST BE SEPARATED.
- LABOR COSTS WILL BE DETERMINED AND BILLED BY TAKING THE NUMBER OF HOURS WORKED TIMES THE WORKERS HOURLY WAGE, WHICH INCLUDES FEDERAL AND STATE WITHHOLDING TAXES, SOCIAL SECURITY TAXES AND VALID EMPLOYEE BENEFIT PLANS. IT DOES NOT INCLUDE ANY MARKUP FOR ANY OVERHEAD OR PROFIT.
- SUBCONTRACTORS MAY CHARGE ON OVERHEAD AND PROFIT FEE THAT HAS BEEN IN JOINT AGREEMENT WITH THE OWNER AND CONTRACTOR.

A REQUEST FOR ESTIMATES FOR POSSIBLE CHANGES IS NOT A CHANGE ORDER OR A DIRECTION TO PROCEED WITH THE PROPOSED CHANGES. THAT CAN ONLY BE AUTHORIZED THROUGH A SIGNED CHANGE ORDER.

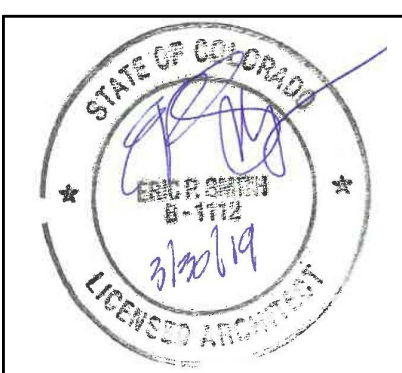

NOTICE: DUTY OF COOPERATION
Release of these plans contemplates further cooperation among the owner, its consultant and the architect. Design and construction are complex. Although the architect and his consultants have performed their services with due care and diligence, they cannot guarantee perfection. Communication is important and every contingency cannot be anticipated. Any ambiguity or discrepancy discovered by the use of these plans will be reported immediately to the architect. Failure to notify the architect constitutes misrepresentation and increases construction costs. A failure to cooperate by a single entity to the architect shall relieve the architect from responsibility for the consequences. Changes made from the plans without consent of the architect are unauthorized and shall relieve the architect of responsibility for all consequences arising out of such changes.

All design, documents and data prepared by Eric Smith Associates, P.C., as instruments of service shall remain the property of Eric Smith Associates, P.C., and shall not be copied, changed or disclosed in any form, whatsoever without first obtaining the express written consent of Eric Smith

DIVISION 01 – GENERAL REQUIREMENTS (CONT)

01 29 73 - SCHEDULE OF VALUES

SUMMARY

UNLESS OTHERWISE STATED IN THE AGREEMENT, PROVIDE A DETAILED BREAKDOWN OF THE CONTRACT SUM AS A SCHEDULE OF VALUES THAT ARE ALLOCATED TO EACH PART OF THE WORK.

BEFORE SUBMITTING THE FIRST APPLICATION FOR PAYMENT, SUBMIT A PROPOSED SCHEDULE OF VALUES TO THE OWNER.

PROVIDE COPIES OF SUBCONTRACTS AND OTHER DATA ACCEPTABLE TO THE OWNER TO SUBSTANTIATE THE SUMS DESCRIBED.

APPLICATIONS FOR PAYMENT

THE CONTRACTOR SHALL SUBMIT HIS MONTHLY REQUEST FOR PAYMENT ON AIA FORM G702, FULLY COMPLETED, EXECUTED, AND NOTARIZED. SUBMIT THREE (3) COPIES, INCLUDING ATTACHMENT OF WAIVERS OR LIEN RELEASES FROM SUBCONTRACTORS AND SUPPLIERS. APPLICATIONS FOR PAYMENT SHALL BE PROCESSED IN ACCORDANCE WITH THE TERMS OF THE GENERAL CONDITIONS OF THE CONTRACT (AIA DOCUMENT A201) AND THE SUPPLEMENTARY CONDITIONS, AND AS MUTUALLY AGREED TO BY OWNER, ARCHITECT AND CONTRACTOR. PRIOR TO INITIAL PAYMENT, THE CONTRACTOR SHALL SUBMIT TO THE ARCHITECT:

- LIST OF PRINCIPAL SUBCONTRACTORS AND SUPPLIERS
- SCHEDULE OF VALUES
- PROGRESS SCHEDULE
- COPIES OF BUILDING PERMITS AND START-UP AUTHORIZATIONS
- EVIDENCE OF INSURANCE COVERAGE
- EVIDENCE OF BOND COVERAGE (IF REQUIRED)
- SUBMITTAL SCHEDULE - SHOP DRAWINGS, PRODUCT DATA, SAMPLES, ETC.

01 30 00 - ADMINISTRATIVE REQUIREMENTS

SUMMARY

PROVIDE ADMINISTRATIVE COORDINATION OF ALL WORK, INCLUDING TRAINED, QUALIFIED EMPLOYEES AND SUBCONTRACTORS AND SUPERVISORY PERSONNEL.

ARRANGE AND CONDUCT PRECONSTRUCTION AND CONSTRUCTION MEETINGS WITH DESIGN PRINCIPALS, CONSULTANTS AND CONSTRUCTION TRADES WHEN REQUIRED.

SUBMIT PROGRESS SCHEDULE, BAR-CHART TYPE, UPDATED MONTHLY. PROVIDE SUBMITTAL SCHEDULE COORDINATED WITH PROGRESS SCHEDULE. SUBMIT SCHEDULE OF REQUIRED TESTS INCLUDING PAYMENT AND RESPONSIBILITY.

SUBMIT SCHEDULE OF VALUES.

SUBMIT PAYMENT REQUEST PROCEDURES.

PROVIDE TO THE ARCHITECT AND POST AT THE CONSTRUCTION SITE, A PHONE AND ADDRESS LIST OF INDIVIDUALS TO BE CONTACTED IN CASE OF EMERGENCY.

MAINTAIN AND UPDATE RECORD DRAWINGS AND SPECIFICATIONS AS WORK PROGRESSES. SUBMIT A COMPLETE, UPDATED SET OF RECORD DOCUMENTS UPON CONCLUSION OF THE WORK.

KEEP ALL WORK CLEAN AND WELL PROTECTED FROM DIRT, WEATHER, THEFT AND DAMAGE.

01 31 13 - PROJECT COORDINATION

SUMMARY

SUBSTRATE CONDITIONS

EACH TRADE WHOSE MATERIAL IS TO BE INSTALLED OVER, OR IN CONJUNCTION WITH, OTHERS' PREVIOUSLY INSTALLED WORK IS TO EXAMINE SUCH WORK AND REPORT ANY DEFECTS TO THE CONTRACTOR. ALL DEFECTS SHALL BE CORRECTED PRIOR TO SUBSEQUENT WORK BEING PERFORMED OR MATERIALS APPLIED.

MATERIALS PENETRATING WALLS, FLOORS AND CEILINGS

WHEREVER ANY PIPE, CONDUIT, STEEL MEMBERS, BRACKETS OR EQUIPMENT, INCLUDING ANY MATERIALS PENETRATING THROUGH A WALL, CEILING OR FLOOR, THE VOIDS IN THE CONSTRUCTION SHALL BE COMPLETELY SEALED WITH CEMENT GROUT, PLASTER OR A FIRE- RESISTANT MATERIAL, EMBEDDING THE SEALING MATERIAL THE FULL THICKNESS OF THE WALL, CEILING OR FLOOR. WHERE SURFACES ARE EXPOSED, FINISH WITH SAME MATERIALS SPECIFIED OR MATERIAL THAT IS ON CONSTRUCTED SURFACES. PROVIDE ALL REQUIRED FIRE BLOCKING. PROVIDE ALL FIRE-RESISTANT ASSEMBLIES/MATERIALS PER U.L. OR OTHER APPROVED TESTING AGENCY.

CONTRACTOR'S MEASUREMENTS/JOB - PLAN DISCREPANCIES

BEFORE ORDERING ANY MATERIAL OR DOING ANY WORK, CONTRACTOR OR SUBCONTRACTOR SHALL TAKE OR VERIFY ALL MEASUREMENTS AT THE BUILDING AS MAY BE REQUIRED FOR THE PROPER FITTING OF HIS WORK TO THE BUILDING OR OTHER ADJOINING WORK. HE SHALL BE RESPONSIBLE FOR THE CORRECTNESS OF HIS FIGURES AND SATISFACTORILY CORRECT, WITHOUT CHARGE, ANY WORK WHICH DOES NOT FIT AND FURNISH NEW WORK AND MATERIALS, IF NECESSARY. NO EXTRA CHARGE WILL BE ALLOWED ON ACCOUNT OF DIFFERENCES IN ACTUAL DIMENSIONS AND THE MEASUREMENTS INDICATED ON THE DRAWINGS. FIELD VERIFY ALL DOOR, WINDOW AND CABINET SIZES AND MECHANICAL SPACE REQUIREMENTS. ALSO, VERIFY ALL PRODUCT SPECIFICATIONS FOR CONFORMANCE WITH PRODUCT CUT SHEETS. ANY DIFFERENCE WHICH MAY BE FOUND SHALL BE SUBMITTED TO THE ARCHITECT IN WRITING FOR HIS CONSIDERATION BEFORE PROCEEDING WITH THE WORK.

01 31 19 - PROJECT MEETINGS

SUMMARY

CONTRACTOR SHALL SCHEDULE AND ADMINISTER PRE-CONSTRUCTION MEETINGS, PERIODIC PROGRESS MEETINGS, AND SPECIALLY CALLED MEETINGS THROUGHOUT PROGRESS OF THE WORK. FOR SAID MEETINGS, THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE FOLLOWING:

1. PREPARE AGENDA FOR MEETINGS.
2. DISTRIBUTE WRITTEN NOTICE OF EACH MEETING FOUR (4) DAYS IN ADVANCE OF MEETING DATE.
3. MAKE PHYSICAL ARRANGEMENTS FOR MEETINGS.
4. PRESIDE AT MEETINGS.
5. RECORD THE MINUTES, INCLUDING SIGNIFICANT PROCEEDINGS AND DECISIONS.
6. REPRODUCE AND DISTRIBUTE COPIES OF MINUTES WITHIN FIVE (5) DAYS AFTER EACH MEETING.
- A. TO PARTICIPANTS IN THE MEETING.
2. TO PARTIES AFFECTED BY DECISIONS MADE AT THE MEETINGS.
- C. FURNISH A COPY OF THE MEETING MINUTES TO THE ARCHITECT.

REPRESENTATIVES OF CONTRACTORS, SUBCONTRACTORS, AND SUPPLIERS ATTENDING MEETINGS SHALL BE QUALIFIED AND AUTHORIZED TO ACT ON BEHALF OF THE ENTITY EACH REPRESENTS.

ARCHITECT/ENGINEER MAY ATTEND MEETINGS TO ASCERTAIN THAT WORK IS EXPEDITED CONSISTENT WITH CONTRACT DOCUMENTS AND CONSTRUCTION SCHEDULES.

SUGGESTED MEETING AGENDA

1. REVIEW, APPROVAL OF MINUTES OF PREVIOUS MEETING.
2. REVIEW OF WORK PROGRESS SINCE PREVIOUS MEETING.
3. FIELD OBSERVATIONS, PROBLEMS, CONFLICTS.
4. PROBLEMS WHICH MAY IMPEDE CONSTRUCTION SCHEDULE.
5. REVIEW OF OFF-SITE FABRICATION, DELIVERY SCHEDULES.
6. CORRECTIVE MEASURES AND PROCEDURES TO REGAIN PROJECTED SCHEDULE.
7. REVISIONS TO CONSTRUCTION SCHEDULE.
8. PROGRESS SCHEDULE, DURING SUCCEEDING WORK PERIOD.
9. COORDINATION OF SCHEDULES.
10. REVIEW SUBMITTAL SCHEDULES; EXPEDITE AS REQUIRED.
11. MAINTENANCE OF QUALITY STANDARDS.
12. PENDING CHANGES AND SUBSTITUTIONS.
13. REVIEW PROPOSED CHANGES FOR:
 - A. EFFECT ON CONSTRUCTION SCHEDULE AND ON COMPLETION DATE.
 - B. EFFECT ON OTHER CONTRACTS OF THE PROJECT.
14. OTHER BUSINESS.

01 33 00 – SUBMITTAL PROCEDURES

SUMMARY

THIS SECTION INCLUDES ADMINISTRATIVE AND PROCEDURAL REQUIREMENTS FOR SUBMITTALS REQUIRED FOR PERFORMANCE OF THE WORK, INCLUDING SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

COORDINATE SUBMITTALS WITH CONSTRUCTION SCHEDULE AND ACTUAL WORK PROGRESS. EACH ITEM SUBMITTED SHALL BEAR THE CONTRACTOR'S STAMP, BE DATED AND SIGNED, CERTIFYING THAT HE HAS REVIEWED AND APPROVED THE SUBMITTAL. ALLOW TWO (2) WEEKS FOR ARCHITECT'S/ENGINEER'S PROCESSING OF SHOP DRAWINGS AND PRODUCT DESCRIPTIONS REQUIRING REVIEW AND RETURN.

SUBMITTALS TO BE MADE IN FULL CONFORMANCE WITH GENERAL CONDITIONS OF THE CONTRACT (AIA DOCUMENT A201) AND THE SUPPLEMENTARY CONDITIONS.

SHOP DRAWING SUBMITTALS ARE TO BE MADE DIGITALLY AND ARE TO INCLUDE A LETTER OF TRANSMITTAL CONTAINING PROJECT NAME, CONTRACTOR'S NAME, SUPPLIER'S NAME, AND NAME OF SUBCONTRACTOR RESPONSIBLE FOR THE INSTALLATION, TITLE AND OTHER PERTINENT DATA. SHOP DRAWINGS SHALL BE SUBMITTED FOR FABRICATION, ERECTION, LAYOUT AND SETTING, AND SUCH OTHER DRAWINGS AS REQUIRED UNDER VARIOUS SECTIONS OF THE SPECIFICATIONS, UNTIL FINAL APPROVAL IS OBTAINED.

SAMPLES ARE TO MAILED (OR HAND DELIVERED) TO ARCHITECT. THEY ARE TO INCLUDE A LETTER OF TRANSMITTAL CONTAINING PROJECT NAME, CONTRACTOR'S NAME, SUPPLIER'S NAME, AND NAME OF SUBCONTRACTOR RESPONSIBLE FOR THE INSTALLATION, NUMBER OF DRAWINGS AND/OR SAMPLES, TITLE AND OTHER PERTINENT DATA. SAMPLES SHALL BE SUBMITTED UNTIL FINAL APPROVAL IS OBTAINED.

DIVISION 01 – GENERAL REQUIREMENTS (CONT)

01 33 00 – SUBMITTAL PROCEDURES (CONT)

ALONG WITH DIGITAL SHOP DRAWING SUBMITTAL, SUBMIT MANUFACTURER'S DESCRIPTIVE DATA INCLUDING CATALOG OUT SHEETS FOR MATERIALS, EQUIPMENT AND FIXTURES, SHOWING DIMENSIONS, PERFORMANCE CHARACTERISTICS AND CAPACITIES, WIRING DIAGRAMS, AND CONTROLS, SCHEDULES, AND OTHER PERTINENT INFORMATION AS REQUIRED. WHERE PRINTED MATERIALS DESCRIBE MORE THAN ONE PRODUCT OR MODEL, CLEARLY IDENTIFY WHICH IS TO BE FURNISHED.

SUBMITTALS SCHEDULE

WHEN SUBMITTALS ARE TO BE REVIEWED BY CONSULTANTS, SUBMIT DIRECTLY TO THE ARCHITECT. CONSULTANTS WILL RETURN REVIEWED SUBMITTALS THROUGH THE ARCHITECT. THE ARCHITECT WILL REQUIRE FIELD APPROVAL OF SAMPLE MATERIALS, WHERE INDICATED, PRIOR TO START OF ACTUAL WORK.

WITHIN TWO WEEKS OF CONTRACT DATE, SUBMIT TO ARCHITECT A SUBMITTALS SCHEDULE. PREPARE SCHEDULE IN CHRONOLOGICAL SEQUENCE OF "FIRST SUBMITTALS." SHOW CATEGORY OF SUBMITTAL, NAME OF SUBCONTRACTOR, GENERIC DESCRIPTION OF WORK COVERED, RELATED SECTION NUMBERS, ACTIVITY OR EVENT NUMBER ON PROGRESS SCHEDULE, SCHEDULED DATE FOR FIRST SUBMISSION, AND BLANK COLUMNS FOR ACTUAL DATE OF SUBMITTAL, RESUBMITTAL, AND FINAL RELEASE OF APPROVAL BY ARCHITECT OR ENGINEER. NOTE ANY CRITICAL DATES.

PROVIDE RE-SUBMITTALS WHEN SUBMITTALS ARE NOT APPROVED. SAMPLES AND SHOP DRAWINGS SHALL BE PREPARED SPECIFICALLY FOR THIS PROJECT. SHOP DRAWINGS SHALL INCLUDE DIMENSIONS AND DETAILS, INCLUDING ADJACENT CONSTRUCTION AND RELATED WORK.

NOTE SPECIAL COORDINATION REQUIRED. NOTE ANY DEVIATIONS FROM REQUIREMENTS OF THE CONTRACT DOCUMENTS.

PROVIDE WARRANTIES AS SPECIFIED. WARRANTIES SHALL BE SIGNED BY SUPPLIER OR INSTALLER RESPONSIBLE FOR PERFORMANCE. WARRANTIES SHALL NOT LIMIT LIABILITY FOR NEGLIGENCE OR NON-COMPLIANCE WITH DOCUMENTS.

01 41 00 - REGULATORY REQUIREMENTS

SUMMARY

THE CONTRACTOR SHALL GIVE ALL NOTICES AND COMPLY WITH ALL LAWS, ORDINANCES, RULES AND REGULATIONS BEARING ON THE CONDUCT OF THE WORK AS DRAWN AND SPECIFIED. IF THE CONTRACTOR OBSERVES THAT THE DRAWINGS AND SPECIFICATIONS ARE AT VARIANCE THERewith, HE SHALL PROMPTLY NOTIFY THE ARCHITECT IN WRITING AND ANY NECESSARY CHANGES SHALL BE ADJUSTED AS PROVIDED IN THE CONTRACT FOR CHANGES IN THE WORK. IF THE CONTRACTOR PERFORMS ANY WORK KNOWING IT TO BE CONTRARY TO SUCH LAWS, ORDINANCES, RULES AND REGULATIONS, AND WITHOUT SUCH NOTICE TO THE ARCHITECT, HE SHALL BEAR ALL COSTS ARISING THERE FROM. THESE REGULATIONS APPLY TO THE CONTRACT THROUGHOUT AND THEY WILL BE DEEMED TO BE INCLUDED IN THE CONTRACT THE SAME AS IF WRITTEN THEREIN IN FULL.

PERMITS AND FEES

ALL WORK SHALL CONFORM WITH THE 2015 INTERNATIONAL CODE COUNCIL (ICC) CODE SYSTEM INCLUDING BUT NOT LIMITED TO THE IBC, IEBC, IECC, IMC, IPC AND NEC ADOPTED BY ROUTT COUNTY INCLUDING THEIR CODE AMENDMENTS, 2015 IFC ADOPTED BY THE STEAMBOAT SPRINGS FIRE SERVICES INCLUDING THEIR CODE AMENDMENTS, ICC A117.7-2009, 2010 ADA AND ALL OTHER GOVERNING CODES OR REGULATIONS HAVING JURISDICTION OVER THIS PROJECT.

ALL BUILDING AND RELATED CONSTRUCTION PERMITS NECESSARY FOR THE WORK SHALL BE SECURED BY THE CONTRACTOR AND PAID FOR BY THE OWNER. THE CONTRACTOR SHALL SECURE AND PAY FOR ALL LICENSES NECESSARY FOR THE WORK, AS WELL AS THE COST OF ANY CONNECTIONS.

PROVIDE PUBLIC NOTICES AND COMPLY WITH LAWS, ORDINANCES, RULES AND REGULATIONS AND ORDERS OF ANY PUBLIC AUTHORITY BEARING ON THE PERFORMANCE OF THE WORK. IF THE CONTRACTOR OBSERVES THAT THE DRAWINGS AND SPECIFICATIONS ARE AT VARIANCE THERewith, HE SHALL PROMPTLY NOTIFY THE ARCHITECT IN WRITING AND ANY NECESSARY CHANGES SHALL BE ADJUSTED AS PROVIDED IN THE CONTRACT FOR CHANGES IN THE WORK. IF THE CONTRACTOR PERFORMS ANY WORK KNOWING IT TO BE CONTRARY TO SUCH LAWS, ORDINANCES, RULES AND REGULATIONS, AND WITHOUT SUCH NOTICE TO THE ARCHITECT, HE SHALL BEAR ALL COSTS ARISING THEREFROM.

BURIED UTILITIES

THE INFORMATION PROVIDED ON THE DRAWING IS VERY GENERAL AS TO THE DESCRIPTION, NATURE AND LOCATION OF UNDERGROUND FACILITIES.

IT SHALL BE THE RESPONSIBILITY OF THE EXCAVATOR TO MAINTAIN ADEQUATE AND ACCURATE INFORMATION ON THE LOCATION OF ANY UNDERGROUND FACILITY THROUGHOUT THE EXCAVATION PERIOD (IF ANY IS REQUIRED). NO PERSON SHALL MOVE OR BEGIN EXCAVATION WITHOUT FIRST NOTIFYING THE STATEWIDE NOTIFICATION ASSOCIATION OF OWNERS AND OPERATORS OF UNDERGROUND FACILITIES.

THE CONTRACTOR SHALL OBTAIN AND PAY FOR ALL CODE CHECKS, INSPECTIONS AND LABORATORY INVESTIGATIONS REQUIRED BY ORDINANCES, CODES, RULES AND REGULATIONS, BUILDING INSPECTORS, CITY ENGINEERS, ETC., IN ADDITION TO THE LABORATORY WORK INCLUDED IN THESE SPECIFICATIONS. SOILS, CONCRETE, FIREPROOFING, WELDING AND OTHER SPECIAL TESTING WILL BE PAID FOR AND PROVIDED BY OWNER.

WHEREVER THE LAW OF THE PLACE OF BUILDING REQUIRES A SALES, CONSUMER, USE OR OTHER SIMILAR TAX, THE CONTRACTOR SHALL PAY SUCH A TAX (AS PART OF THE CONTRACT COSTS) WITH THE EXCEPTION OF THE COUNTY USE TAX PAID AT THE TIME OF BUILDING PERMIT APPLICATION TO BE PAID FOR BY OWNER.

01 42 00 – REFERENCES (DEFINITIONS AND STANDARDS)

SUMMARY

ACRONYMS OR ABBREVIATIONS ARE DEFINED TO MEAN THE INDUSTRY-RECOGNIZED NAME OF PRODUCT OR PROCEDURE. REFER TO THE APPROPRIATE TRADE ASSOCIATION OR GOVERNING AUTHORITY FOR ACCEPTED MEANING OR TO THE ARCHITECT. CURRENT APPLICABLE STANDARDS OF CONSTRUCTION INDUSTRY ARE HEREBY MADE A PART OF THESE CONTRACT DOCUMENTS, AS IF WRITTEN HEREIN.

01 45 00 – QUALITY CONTROL (INSPECTION)

SUMMARY

ALL MATERIALS AND WORKMANSHIP SHALL BE SUBJECT OF INSPECTION BY THE OWNER AT ALL TIMES. THESE INSPECTIONS SHALL NOT RELIEVE THE CONTRACTOR FROM THE OBLIGATION TO PROVIDE MATERIALS AND TO PERFORM WORK ACCORDING TO ALL REQUIREMENTS OF THE CONTRACT DOCUMENTS AND MATCHING APPROVED SAMPLES. THE CONTRACTOR WILL PROMPTLY CORRECT ANY DEFICIENCIES REPORTED AND WILL CARRY OUT HIS OWN QUALITY CONTROL MEASURES FOR ALL MATERIALS WHETHER INSPECTED OR NOT.

THE CONTRACTOR WILL BE SUBJECT TO PERIODIC INSPECTIONS BY THE OWNER OR REPRESENTATIVES OF THE OWNER. NO TESTING, INSPECTION, REVIEW ACTION OR INACTION OF THE OWNER'S REPRESENTATIVES OR THE OWNER SHALL RELIEVE THE CONTRACTOR OF ANY OF THEIR OBLIGATIONS UNDER THE CONTRACT DOCUMENTS.

01 45 29 - TESTING LABORATORY SERVICES

SUMMARY

WHERE NOT INDICATED SPECIFICALLY AS OWNER'S RESPONSIBILITY, THE CONTRACTOR IS TO PROVIDE AND PAY FOR REQUIRED TESTING AND INSPECTION SERVICES SPECIFIED TO BE PERFORMED BY INDEPENDENT AGENCIES. CONTRACTOR TO BE RESPONSIBLE FOR COORDINATION OF ALL TESTING.

OWNER TO PAY FOR:

1. CONCRETE TESTING
2. WELD INSPECTIONS
3. SPECIAL INSPECTIONS
4. BOLT INSPECTIONS
5. FIRE PROTECTION INSPECTIONS

01 50 00 - TEMPORARY FACILITIES

SUMMARY

ALL PRECAUTIONS AGAINST FIRE SHALL BE IN FULL COMPLIANCE WITH THE REQUIREMENTS OF THE OWNER'S AND CONTRACTOR'S INSURANCE POLICIES, IN ADDITION TO THE REQUIREMENTS OF THE GENERAL CONDITIONS.

FIRE EXTINGUISHERS IN SUFFICIENT NUMBERS ON EACH FLOOR FOR THE PROTECTION OF THE WORK SHALL BE PROVIDED AND MAINTAINED BY THE CONTRACTOR. EXTINGUISHERS SHALL BE TYPE ABC, PRETESTED, RECORDED, AND BE BY AN APPROVED MANUFACTURER WITH AN APPROVED CAPACITY. NO GASOLINE, BENZINE NOR OTHER HAZARDOUS, COMBUSTIBLE OR EXPLOSIVE MATERIALS SHALL BE STORED WITHIN THE BUILDING. EMPTY CONTAINERS AND ALL OILY OR PAINT-SOAKED RAGS SHALL BE REMOVED FROM THE BUILDING AT THE CLOSE OF EACH DAYS WORK. WELDING AND FLAME CUTTING EQUIPMENT SHALL BE APPROVED, FIRST QUALITY MATERIALS, AND SUBJECT TO CODE.

PROTECTION OF PUBLIC AND PRIVATE ROADS, STREETS, WALKS, WALKWAYS AND OTHER ADJACENT OCCUPIED OR USED FACILITIES. PROTECT ALL PUBLIC AND PRIVATE ROADS, STREETS, WALKS, WALKWAYS AND OTHER ADJACENT OCCUPIED OR USED FACILITIES DURING CONSTRUCTION. ALL PROTECTION DEVICES SHALL BE APPROVED AND/OR PERMITTED BY ALL AUTHORITIES HAVING JURISDICTION OVER PROTECTION DEVICES.

DO NOT CLOSE OR OBSTRUCT WALKWAYS, WALKS, ROADS AND STREETS WITHOUT PERMISSION FROM THE OWNER AND AUTHORITIES HAVING JURISDICTION. ENSURE SAFE PASSAGE OF PERSONS AROUND AREA OF WORK.

DIVISION 01 – GENERAL REQUIREMENTS (CONT)

01 50 00 - TEMPORARY FACILITIES (CONT)

PROTECTION OF EXISTING TREES AND VEGETATION

PROTECT EXISTING TREES AND OTHER VEGETATION REMAINING IN PLACE AGAINST UNNECESSARY CUTTING, BREAKING OR SKINNING OF ROOTS, SKINNING AND BRUISING OF BARK, SMOTHER OF TREES BY STOCKPILING CONSTRUCTION MATERIALS OR EXCAVATED MATERIALS WITHIN DRIP LINE, EXCESS FOOT OR VEHICULAR TRAFFIC, OR PARKING OF VEHICLES WITHIN DRIP LINE. PROVIDE TEMPORARY ROPED AREAS FOR STAGING.

AT THE CONTRACTOR'S EXPENSE, REPAIR OR REPLACE TREES AND VEGETATION THAT ARE DAMAGED BY CONSTRUCTION OPERATIONS, IN A MANNER ACCEPTABLE TO THE ARCHITECT.

CONSTRUCTION EQUIPMENT

ALL SCAFFOLDS SHALL BE BUILT IN ACCORDANCE WITH THE REQUIREMENTS OF ALL STATE AND LOCAL LAWS AND REGULATIONS AND THE "MANUAL OF ACCIDENT PREVENTION IN CONSTRUCTION" OF THE ASSOCIATED GENERAL CONTRACTORS OF AMERICA.

ALL OTHER CONSTRUCTION APPARATUS, MACHINERY AND EQUIPMENT SHALL BE DESIGNED AND CONSTRUCTED IN CONFORMITY WITH THE BEST PRACTICE AND SO AS TO CONTRIBUTE TO EFFICIENCY, RELIABILITY AND SAFETY OF OPERATION. THEIR RATINGS AND CAPACITIES SHALL CONFORM TO THE CODES AND STANDARDS OF THE RESPECTIVE NATIONAL ENGINEERING AND TECHNICAL SOCIETIES, AND ALL PERFORMANCE TESTS SHALL BE MADE IN ACCORDANCE WITH THE TEST CODES OF THESE SOCIETIES. ALL CAPACITIES, SIZES, WEIGHTS AND GUARANTEES ARE SPECIFIED AS MINIMUM AND MAY BE INCREASED AT THE OPTION OF THE CONTRACTOR. CONTRACTOR AT ALL TIMES SHALL HAVE FULL CONTROL OF THE AFORESAID APPARATUS, MACHINERY AND EQUIPMENT.

POWER, HEAT, SANITARY FACILITIES

THE CONTRACTOR SHALL PROVIDE AND PAY FOR TEMPORARY POWER, TEMPORARY HEAT AND OTHER REQUIRED TEMPORARY FACILITIES AS REQUIRED DURING CONSTRUCTION AS PART OF THE CONSTRUCTION COSTS. THE CONTRACTOR SHALL FURNISH, INSTALL AND MAINTAIN AMPLY SANITARY FACILITIES FOR THE WORKERS.

01 53 00 - TEMPORARY CONSTRUCTION

RELATED DOCUMENTS

A. DRAWINGS AND GENERAL PROVISIONS OF THE CONTRACT, INCLUDING GENERAL AND SUPPLEMENTARY CONDITIONS.

SUMMARY

A. THIS SECTION INCLUDES TEMPORARY SUPPORT AND PROTECTION OF ALL EXCAVATIONS AND STRUCTURES. B. RELATED SECTIONS INCLUDE THE FOLLOWING:

1. DIVISION 1 SECTION 01500, "TEMPORARY FACILITIES".
2. DIVISION 2 EXISTING CONDITIONS.
3. DIVISION 3 CONCRETE.
4. DIVISION 6 SECTION 06 10 00, "ROUGH CARPENTRY" FOR SHEATHING AND BRACING.

PERFORMANCE REQUIREMENTS

A. THE CONTRACTOR SHALL SOLELY BE RESPONSIBLE FOR AND HAVE CONTROL OVER CONSTRUCTION MEANS, METHODS, SEQUENCES OR TECHNIQUES OR PROCEDURES NECESSARY FOR PERFORMING, SUPERINTENDING OR COORDINATING ALL PORTIONS OF THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS OR THE REQUIREMENTS OF REGULATORY AGENCIES FURTHER, THE CONTRACTOR SHALL BE RESPONSIBLE FOR INITIATING, MAINTAINING AND SUPERVISING ALL SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH PERFORMANCE OF THE CONTRACT.

B. THE CONTRACTOR SHALL AVAIL HIMSELF OF ANY AND ALL MEANS NECESSARY, INCLUDING BUT NOT LIMITED TO HIS OWN BEST SKILL, ATTENTION, KNOWLEDGE AND EXPERIENCE OR APPLICABLE INDUSTRY STANDARDS. IN THE EVENT THAT THESE MEASURES PROVE TO BE INADEQUATE OR THE SITUATION IS 'BEYOND THE EXPERTISE OF THE CONTRACTOR, AN ENGINEER SHALL BE ENGAGED TO ASSIST THE CONTRACTOR.

C. THE CONTRACTOR SHALL TAKE REASONABLE PRECAUTIONS FOR SAFETY OF, AND SHALL PROVIDE REASONABLE PROTECTION TO PREVENT DAMAGE, INJURY OR LOSS TO:

1. EMPLOYEES ON THE WORK AND OTHER PERSONS WHO MAY BE AFFECTED THEREBY: THE WORK AND MATERIALS AND EQUIPMENT TO BE INCORPORATED THEREIN, WHETHER IN STORAGE ON OR OFF THE SITE, UNDER CARE, CUSTODY OR CONTROL OF THE CONTRACTOR OR THE CONTRACTOR'S SUBCONTRACTORS OR SUB-SUBCONTRACTORS AND
2. OTHER PROPERTY AT THE SITE OR ADJACENT THERETO, SUCH AS TREES, SHRUBS, LAWN, WALKS, PAVEMENTS, ROADWAYS, STRUCTURES AND UTILITIES NOT DESIGNATED FOR REMOVAL, RELOCATION OR REPLACEMENT IN THE COURSE OF CONSTRUCTION.

E. THE CONTRACTOR SHALL GIVE NOTICES AND COMPLY WITH APPLICABLE LAWS, ORDINANCES, RULES, REGULATIONS AND LAWFUL ORDERS OF PUBLIC AUTHORITIES BEARING ON SAFETY OF PERSONS OR PROPERTY OR THEIR PROTECTION, DAMAGE OR LOSS. THE CONTRACTOR SHALL ERECT AND MAINTAIN, AS REQUIRED BY EXISTING CONDITIONS AND PERFORMANCE OF THE CONTRACT, REASONABLE SAFEGUARDS FOR SAFETY AND PROTECTION, INCLUDING POSTING DANGER SIGNS AND OTHER WARNINGS AGAINST HAZARDS, PROMULGATING SAFETY REGULATIONS AND NOTIFYING OWNERS AND USERS OF ADJACENT SITES AND UTILITIES.

F. THE CONTRACTOR SHALL NOT LOAD OR PERMIT ANY PART OF THE CONSTRUCTION OR SITE TO BE LOADED SO AS TO ENDANGER SAFETY.

QUALITY ASSURANCE

A. CODES AND STANDARDS: COMPLY WITH INDUSTRY STANDARDS AND APPLICABLE LAWS AND REGULATIONS OF AUTHORITIES HAVING JURISDICTION INCLUDING, BUT NOT LIMITED TO:

1. OSHA, OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION
2. NFPA 241 "STANDARD FOR SAFEGUARDING CONSTRUCTION, ALTERATIONS, AND DEMOLITION OPERATIONS"
3. ANSI A10 "SAFETY REQUIREMENTS FOR CONSTRUCTION AND DEMOLITION"
4. 2015 ICC BUILDING CODES ADOPTED BY ROUTT COUNTY.

B. PROFESSIONAL ENGINEER QUALIFICATIONS: THE ENGINEER ENGAGED SHALL BE LEGALLY QUALIFIED TO PRACTICE IN THE JURISDICTION WHERE THE PROJECT IS LOCATED AND WHO IS EXPERIENCED IN PROVIDING DESIGN SERVICES FOR THE TYPE OF WORK AT HAND.

PROJECT CONDITIONS

A. MONITORING: SURVEY THE PROJECT, ADJACENT STRUCTURES AND IMPROVEMENTS EMPLOYING A QUALIFIED PROFESSIONAL ENGINEER OR SURVEYOR TO ESTABLISH EXACT ELEVATIONS AND OTHER POINTS OF REFERENCE TO ACT AS BENCHMARKS. CLEARLY IDENTIFY BENCHMARKS AND RECORD EXISTING DATA. REGULARLY RESURVEY BENCHMARKS, MAINTAINING AN ACCURATE LOG OF SURVEYED INFORMATION FOR COMPARISON WITH ORIGINAL DATA.

B. SPECIAL ISSUES: NOTE THE FOLLOWING ITEMS AS BEING OF PARTICULAR CONCERN, ALBEIT NOT THE ONLY CONCERNS.

01 58 00 - PROJECT IDENTIFICATION

SUMMARY

PROVIDE PROJECT SIGNAGE INCLUDING PROJECT NAME AND NAME OF GENERAL CONTRACTOR, OWNER (UNLESS OWNER DOES NOT REQUEST THIS INFORMATION) AND ARCHITECT. COORDINATE LOCATION OF SIGNAGE AND SIGN INFORMATION WITH ARCHITECT. MAINTENANCE OF PROJECT SIGNAGE BY GENERAL CONTRACTOR.

01 62 00 - PRODUCT OPTIONS AND SUBSTITUTIONS

PROVIDE ENTIRE REQUIRED QUANTITIES OF EACH PRODUCT FROM A SINGLE SOURCE. WHEN NOT POSSIBLE, MATCH SEPARATE PROCUREMENTS.

SPECIFIC MATERIALS AND "ACCEPTED SUBSTITUTES"

ALL BIDDERS MAY SUBSTITUTE AND INCLUDE IN THEIR BID PRICE A MATERIAL OR PRODUCT OTHER THAN THOSE SPECIFIED BY NAME OR BRAND, PROVIDED THAT REQUESTS ARE SUBMITTED AND ACCEPTED BY THE ARCHITECT AND OWNER, AS DESCRIBED IN THE SUPPLEMENTARY CONDITIONS.

PROPRIETARY PRODUCTS

SPECIFYING OF PROPRIETARY PRODUCTS IS NOT MEANT TO EXCLUDE COMPETITION, BUT IS INTENDED TO SET A MINIMUM STANDARD. THE WORDS "OR ACCEPTED SUBSTITUTE" ARE IMPLIED AFTER ANY PROPRIETARY NAME. SUBSTITUTIONS WILL BE CONSIDERED ACCORDING TO SPECIFIED SUBSTITUTION PROCEDURES.

DIVISION 01 – GENERAL REQUIREMENTS (CONT)

01 73 00 - EXECUTION

SUMMARY

EACH CONTRACTOR AND SUBCONTRACTOR SHALL BE RESPONSIBLE FOR ALL DAMAGE TO WORK INSTALLED BY OTHERS THAT IS CAUSED BY HIS WORK OR ANY OF HIS EMPLOYEES. CUTTING, PATCHING AND REPAIRING OF DAMAGED WORK SHALL BE DONE BY THE CONTRACTOR OR SUBCONTRACTOR WHO ORIGINALLY INSTALLED THE DAMAGED WORK AND THE COST SHALL BE PAID BY THE CONTRACTOR OR SUBCONTRACTOR WHO IS RESPONSIBLE FOR THE DAMAGE.

THE CONTRACTOR SHALL BE HELD RESPONSIBLE FOR ALL DAMAGED, BROKEN OR SCRATCHED GLASS, BEFORE FINAL ACCEPTANCE OF THE WORK, HE SHALL REPLACE, AT HIS OWN EXPENSE, ALL SUCH GLASS, EXCEPT DAMAGED GLASS PRESENTLY IN PLACE IN EXISTING STRUCTURE.

01 73 29 - CUTTING AND PATCHING

SUMMARY

CUTTING AND PATCH AS REQUIRED TO COMPLETE THE WORK FOR: VISUAL QUALITY AS DIRECTED BY THE ARCHITECT. PLUMBING, HVAC, ELECTRICAL, AND COMMUNICATION SYSTEMS. FIRE RESISTANCE RATINGS. INSPECTION, PREPARATION, AND PERFORMANCE.

CUT AND PATCH WITH CARE TO AVOID DAMAGE TO WORK, SAFETY HAZARDS, VIOLATION OF WARRANTY REQUIREMENTS, BUILDING CODE VIOLATIONS, OR MAINTENANCE PROBLEMS.

MATERIALS

MATCH EXISTING MATERIALS WITH NEW MATERIALS SO THAT PATCHING WORK IS UNDETECTABLE.

INSTALLATION

INSPECT FIELD CONDITIONS TO IDENTIFY ALL WORK REQUIRED.

NOTIFY OWNER AND SCHEDULE ACCORDINGLY, WORK THAT MIGHT DISRUPT BUILDING OPERATIONS.

PERFORM WORK WITH WORKMEN SKILLED IN THE TRADES INVOLVED. PREPARE SAMPLE AREA OF EACH TYPE OF WORK FOR APPROVAL. PROTECT ADJACENT WORK FROM DAMAGE AND DIRT. FOR CUTTING WORK, USE PROPER CUTTING TOOLS, NOT CHOPPING TOOLS. MAKE NEAT HOLES. MINIMIZE DAMAGE TO ADJACENT WORK. CHECK FOR CONCEALED UTILITIES AND STRUCTURE BEFORE CUTTING.

MAKE PATCHES, SEAMS, AND JOINTS DURABLE AND INCONSPICUOUS. TOLERANCES FOR PATCHING SHALL BE THE SAME AS FOR NEW WORK.

CLEAN WORK AREAS AND AREAS AFFECTED BY CUTTING AND PATCHING OPERATIONS AS DESCRIBED IN SECTION 01800 ON CLEANING.

01 74 23 – FINAL CLEANING

SUMMARY

THE CONTRACTOR SHALL TAKE WHATEVER STEPS NECESSARY TO PREVENT THE SPREAD OF DUST AND DEBRIS AS A RESULT OF CONSTRUCTION THROUGHOUT THE DAY, AND CLEAN THESE UP AS NECESSARY.

WHEN DIRECTED AND BEFORE THE FINAL INSPECTION, THE ENTIRE EXTERIOR AND INTERIOR OF THE BUILDING AND THE SURROUNDING AREAS SHALL BE CLEARED OF ALL RUBBISH AND THOROUGHLY PROFESSIONALLY CLEANED INCLUDING THE FOLLOWING:

1. ALL NEW FINISHED SURFACES AND ALL SURFACES SOILED BY OPERATIONS HEREUNDER WITHIN THE
2. BUILDING SHALL BE SWEEP, VACUUMED, DUSTED, WASHED AND POLISHED. THIS INCLUDES CLEANING
3. OF THE WORK OF ALL FINISHING TRADES WHERE NEEDED, WHETHER OR NOT CLEANING FOR SUCH
4. TRADES IS INCLUDED IN THEIR RESPECTIVE SPECIFICATIONS.
5. ACCESS SPACES SHALL BE LEFT THOROUGHLY CLEAN.
6. CLEAN ALL EXTERIOR GLASS, AND WINDOW AND DOOR FRAMES.
7. ALL CONSTRUCTION EQUIPMENT, TOOLS, ETC. BE REMOVED OFF SITE.
8. FIELD OFFICE AND CONSTRUCTION RESTROOMS CLEARED OF CONTRACTOR'S ITEMS, CLEANED AND REMOVED AS REQUIRED.
9. TEMPORARY ELECTRICAL DISCOUNTED AND REMOVED OFF-SITE. EXISTING BUILDING ELECTRICAL REINSTALLED AT TEMPORARY ELECTRICAL HOOK-UP LOCATIONS.
10. CLEAN AND REMOVAL OF CONSTRUCTION DUST, ALL DEBRIS AT ALL MECHANICAL DUCT WORK AND AT ALL MECHANICAL EQUIPMENT.

THE CONTRACTOR SHALL BE RESPONSIBLE FOR BREAKAGE OF EXISTING MATERIALS. HE SHALL REPLACE ALL BROKEN OR DAMAGED NEW OR EXISTING MATERIALS AND DELIVER THE BUILDING WITH ALL MATERIALS INTACT AND CLEAN.

THE CONTRACTOR SHALL KEEP THE PREMISES CLEAN AND CLEAR OF ALL GARBAGE, REFUSE AND WASTE MATTERS OF ANY NATURE WHICH MIGHT ATTRACT OR FOSTER RODENTS OR VERMIN, AND SHALL PROVIDE EXTERMINATION SERVICE OF REQUIRED TO KEEP THE PREMISES FREE FROM SUCH PESTS, SHOULD THIS BE REQUIRED.

AT THE END OF EACH WORK DAY, THE CONTRACTOR SHALL CLOSE AND LOCK ALL WINDOWS, DOORS OR EXTERIOR OPENINGS.

THE CONTRACTOR SHALL BE RESPONSIBLE FOR TURNING LIGHTS OFF AND TURNING HEAT DOWN IN HIS AREAS OF WORK AT THE END OF EACH WORKDAY. TAKE INTO ACCOUNT ANY AIR CONDITIONING TEMPERATURE REQUIREMENTS OF ALL TRADES.

01 77 00 – CLOSEOUT PROCEDURES

SUMMARY

FINAL REQUEST FOR PAYMENT AND RELEASE OF RETAINAGE MAY BE SUBMITTED UPON COMPLETION AND SUBMITTAL TO THE OWNER OF THE FOLLOWING:

1. FINAL PUNCHLIST COMPLETED.
2. FINAL CLEANING COMPLETE IN JUDGMENT OF ARCHITECT AND OWNER.
3. ALL TEMPORARY FACILITIES AND CONTRACTOR'S EQUIPMENT AND TOOLS ARE REMOVED FROM SITE.
4. PERMITS, CERTIFICATES OF INSPECTION AND OCCUPANCY, AND/OR ANY OTHER APPROVALS REQUIRED BY GOVERNING AUTHORITIES FOR OWNER'S OCCUPANCY AND USE OF THE PROJECTS.
5. ALL WARRANTIES AND GUARANTEE CERTIFICATES.
6. THE CONTRACTOR SHALL DELIVER TO THE ARCHITECT, FOR APPRO

DIVISION 07 - THERMAL AND MOISTURE PROTECTION (CONT)

07 50 00 MEMBRANE ROOFING:

MEMBRANE ROOFING SYSTEM
LOCATION - NEW PORTE-COCHERE AND SKI ENTRY ADDITIONS.

COMPATIBILITY: PROVIDE PRODUCTS RECOMMENDED BY MANUFACTURERS TO BE FULLY COMPATIBLE WITH INDICATED SUBSTRATES. PROVIDE SEPARATION OF MATERIALS AS REQUIRED TO ELIMINATE CONTACT BETWEEN INCOMPATIBLE MATERIALS.

GENERAL: ETHYLENE PROPYLENE DIENE MONOMERS FORMED INTO UNIFORM, FLEXIBLE SHEETS COMPLYING WITH ASTM D 4837, TYPE 1.

CLASS A: MINIMUM
PROVIDE FULLY ADHERED 60 MIL EPDM.
EXPOSED FACE COLOR: BLACK
FULLY ADHERED WITH MECHANICALLY ATTACHED INSULATION (OR AS REQUIRED BY ROOFING MANUFACTURER)

MANUFACTURERS
SUBJECT TO COMPLIANCE WITH REQUIREMENTS, PROVIDE PRODUCTS OF ONE OF THE FOLLOWING:
CARLSLE (OR OTHER SPECIFIED ROOFING MEMBRANE INDICATED WITHIN THE SPECIFIED ASSEMBLIES THAT IS APPROVED)

MEMBRANE:
60-MIL EPDM IN THE LARGEST SHEET POSSIBLE WITH 3" OR 6" FACTORY-APPLIED TAP (FAT).
THE MEMBRANE TO CONFORM TO MINIMUM PHYSICAL PROPERTIES OF ASTM D4637.

INSULATION:
INSULATION TO BE CARLSLE HP-H POLYUM PER UL ASSEMBLY. PROVIDE R-35 MINIMUM
INSULATING VALUE OVER SKI ENTRY.

AUXILIARY MATERIALS
SHEET SEAMING SYSTEM: MANUFACTURER'S STANDARD MATERIALS FOR SEALING LAPPED JOINTS, INCLUDING EDGE SEALER TO COVER EXPOSED SPICED EDGES AS RECOMMENDED BY MEMBRANE MANUFACTURER.
CAWT STRIPS, TAPERED EDGE STRIPS AND FLASHING ACCESSORIES: TYPES RECOMMENDED BY MEMBRANE MANUFACTURER, INCLUDING ADHESIVES, TAPES, FLASHING AND SEALANTS.
FLASHING MATERIAL: MANUFACTURER'S STANDARD FLASHING SYSTEM COMPATIBLE WITH ROOFING SYSTEM.
SLIP SHEET: TYPE RECOMMENDED BY MEMBRANE MANUFACTURER FOR PROTECTING MEMBRANE FROM INCOMPATIBLE SUBSTRATES.
PIPE BOOT: PROVIDE EPDM TYPE PIPE BOOT(S). ROOF MANUFACTURER'S STANDARD, PIPE BOOTS TO BE USED FOR VENT AND PIPE ROOF PENETRATIONS AS WELL AS FOR CONDENSING UNIT LINES AND OTHER PENETRATIONS INTO THE BUILDING.
INSULATING MATERIALS: PROVIDE TAPERED POLYSOCYANURATE TAPERED BOARD ROOF INSULATION SLOPING TO DRAIN. FABRICATE WITH TAPER OF 1/4 TO 1/2" PER FOOT, UNLESS OTHERWISE INDICATED. SEE ALSO THERMAL INSULATION IN DIVISION 7.
MECHANICAL ANCHORS: CORROSION-RESISTANT TYPE AS RECOMMENDED BY INSULATION MANUFACTURER AND APPROVED BY MEMBRANE MANUFACTURER FOR DECK TYPE AND COMPLYING WITH FIRE AND INSURANCE WIND-UPLIFT RATING REQUIREMENTS.
ACCESSORIES: PROVIDE REQUIRED ACCESSORIES INCLUDING BUT NOT LIMITED TO: FASTENERS, METAL FLASHING, SECUREDE COPING, DRIP EDGE, TERMINATION BARS, EXPANSION JOINT COVER AS NOTED ON THE DRAWINGS.

WARRANTY - PROVIDE 25 - YEAR TOTAL ROOF SYSTEM WARRANTY COVERING BOTH LABOR AND MATERIALS.

SUBMITTALS
SUBMIT PRODUCT DATA, INSTALLATION INSTRUCTIONS AND GENERAL RECOMMENDATIONS FROM MANUFACTURER OF TYPES OF ROOFING REQUIRED. INCLUDE DATA SUBSTANTIATING THAT MATERIALS COMPLY WITH REQUIREMENTS.

SAMPLES OF FINISHED ROOFING SHEETS INCLUDING T-SHAPED SIDE-END-LAP SEAMS.

CERTIFICATION THAT MATERIALS COMPLY WITH LOCAL VOC LIMITATIONS.

INSTALL PER MANUFACTURES RECOMMENDATIONS.

07 60 00 FLASHING AND SHEET METAL:

SUMMARY: ROOF FLASHING, DRIP EDGE, FASCIA, METAL CAP FLASHING, COUNTER FLASHING, BASE FLASHING, ROOF TO WALL CONNECTIONS, OVER DOOR AND WINDOW HEADS, AT WALL PENETRATIONS, MISCELLANEOUS SHEET METAL ACCESSORIES, ETC.

BASIS OF DESIGN: PREFINISHED METAL PAC-CLAD FLASHING AND TRIM BY PETERSEN ALUMINUM OR APPROVED EQUAL.

PROVIDE ALL EXPOSED FLASHING AND TRIM FINISHES (DRIP EDGES, FASCIAS, FLASHING, ETC.) WITH PAC-CLAD PETERSEN ALUMINUM GALVANIZED STEEL. PIECES WITH PAC-CLAD KYNAR 500 TOP FINISH AND POLYESTER WEATHER COAT BOTTOM FINISH IN 22-GA STEEL.

PAC-CLAD FLASHING AND TRIM IN KYNAR 500 CUSTOM COLORS TO BE SELECTED BY OWNER/ARCHITECT FROM STANDARD COLORS.

SHEET METAL FLASHING AND TRIM MATERIALS: ZINC-COATED STEEL: COMMERCIAL QUALITY WITH 0.20 PERCENT COPPER, G90 HOT-DIP GALVANIZED, MILL PHOSPHATIZED FIELD PAINTED, 20-GA, EXCEPT AS NOTED OTHERWISE.

INSTALL ALL FLASHING AND SHEET METAL IN STRICT ACCORDANCE WITH SMAGNA REQUIREMENTS, MANUFACTURER'S RECOMMENDATIONS AND IN ACCORDANCE WITH REQUIREMENTS OF ADJACENT MATERIALS AND SYSTEMS.

PLASTIC SHEET FLASHING AND SELF-ADHERING SHEET FLASHING: MANUFACTURES TO INCLUDE FORTIFIBER BUILDING PRODUCTS OR PROTECTO WRAP COMPANY OR APPROVED EQUAL.
20 MIL "FLEX" FLEXIBLE FLASHING PLASTIC SHEET FLASHING AND SELF-ADHERING SHEET FLASHING: MANUFACTURES TO INCLUDE FORTIFIBER BUILDING PRODUCTS OR PROTECTO WRAP COMPANY OR APPROVED EQUAL.

20 MIL "FLEX-GUARD" PVC FLEXIBLE MASONRY FLASHING BY WR MEADOWS OR APPROVED EQUAL.

07 71 00 ROOF SPECIALTIES:

DOWNSPOUTS: MILL FINISH ALUMINUM

THICKNESS: EQUAL TO OR GREATER THAN THE DOWNSPOUTS BEING REMOVED.

COLOR: PROVIDE PAC-CLAD PETERSON ALUMINUM PRE-FINISHED IN KYNAR 500 IN 22-GA THICKNESS, COLOR(S) TO MATCH EXISTING.

DOWNSPOUTS TO BE PLACED IN THE SAME LOCATIONS AS THE DOWNSPOUTS BEING REMOVED.

RETAIN EXISTING HEAT TRACE, REPAIR ANY DAMAGED COMPONENTS AS REQUIRED.

INSTALL PER MANUFACTURER'S REQUIREMENTS.

07 80 00 FIRE AND SMOKE PROTECTION:

FIREPROOFING:
CONCEALED SPRAYED-ON FIREPROOFING MATERIALS

GENERAL: FOR CONCEALED APPLICATIONS OF SPRAYED-ON FIRE PROOFING PROVIDED MANUFACTURER'S STANDARD PRODUCTS COMPLYING WITH THE REQUIREMENTS INDICATED IN THIS ARTICLE FOR MATERIAL COMPOSITION AND PHYSICAL PROPERTIES REPRESENTATIVE OF INSTALLED PRODUCT.

THE FIREPROOFING MATERIALS LISTED ARE PER THE UNDERWRITERS LABORATORIES, INC. SEE THE FIRE RATED ASSEMBLIES IN THE DOCUMENTS AND THE UL DESIGN PUBLISHED DIRECTORY FOR THE COMPLETE ASSEMBLIES AND REQUIREMENTS.

PROVIDE PRODUCT CERTIFICATES FROM FIREPROOFING MANUFACTURERS THAT EACH SPRAYED-ON FIREPROOFING PRODUCT INDICATED FOR PROJECT COMPLIES WITH SPECIFIED REQUIREMENTS INCLUDING THOSE FOR FIRE-TEST-RESPONSE CHARACTERISTICS AND COMPATIBILITY WITH ADHESIVES, PRIMERS, AND OTHER SURFACE COATINGS ON SUBSTRATES INDICATED TO RECEIVE FIREPROOFING.

AUXILIARY FIREPROOFING MATERIALS

GENERAL: PROVIDE AUXILIARY FIREPROOFING MATERIALS THAT ARE COMPATIBLE WITH SPRAYED-ON FIREPROOFING PRODUCTS AND SUBSTRATES AND ARE APPROVED BY UL OR ANOTHER TESTING AND INSPECTING AGENCY ACCEPTABLE TO AUTHORITIES HAVING JURISDICTION FOR USE IN THE FIRE-RESISTIVE DESIGNS INDICATED.

DIVISION 07 - THERMAL AND MOISTURE PROTECTION (CONT)

07 84 13 PENETRATION FIRESTOPPING:

CONTRACTOR TO SUBMIT UL FIRE ASSEMBLIES FOR REVIEW FOR SCOPE OF PENETRATIONS AS LISTED BELOW.

THIS SECTION INCLUDES FIRESTOPPING AT THE FOLLOWING SYSTEMS:
- PENETRATIONS IN EXISTING FLOOR SYSTEMS (120-MIN RATED)
- THROUGH NEW AND EXISTING RATED WALLS (60-MIN & 120-MIN RATED)
- THROUGH ROOF (60-MIN RATED)

THIS SECTION INCLUDES FIRESTOPPING FOR THE FOLLOWING PENETRATIONS:
- BOTH EMPTY OPENINGS AND OPENINGS CONTAINING CABLES, PIPES, DUCTS, CONDUITS AND OTHER PENETRATING ITEMS
- SEALANT JOINTS IN FIRE-RESISTANCE-RATED CONSTRUCTION.

BASIS OF DESIGN: HILTI OR 3M FIRESTOP SYSTEMS AND 3M FIRESAFE PRODUCTS OR APPROVED EQUAL.

FIRESTOP SYSTEM INSTALLATION MUST MEET REQUIREMENTS OF ASTM E 814, UL 1479 OR UL 2079 TESTED ASSEMBLIES THAT PROVIDE A FIRE RATING EQUAL TO THAT OF THE CONSTRUCTION BEING PENETRATED.

SUBMITTALS:

PRODUCT DATA - MANUFACTURER'S SPECIFICATIONS AND TECHNICAL DATA FOR EACH MATERIAL INCLUDING THE COMPOSITION AND LIMITATIONS, DOCUMENTATION OF QUALIFIED FIRESTOP SYSTEMS TO BE USED AND MANUFACTURER'S INSTALLATION INSTRUCTIONS. ALL FIRE STOP PENETRATIONS THAT ARE PROPOSED BY THE CONTRACTOR PER FIELD VERIFICATION ARE TO PROVIDE A UL LISTED ASSEMBLY DETAIL THAT APPLIES TO THE PROPOSED LOCATION REQUIREMENTS.

CERTIFICATION BY FIRESTOPPING MFR THAT PRODUCTS SUPPLIED COMPLY WITH LOCAL REGULATIONS FOR USE OF LOW VOLATILE ORGANIC COMPOUNDS (VOCs) AND ARE NONTOXIC TO BUILDING OCCUPANTS.

INSTALLER QUALIFICATIONS - ENGAGE AN EXPERIENCED INSTALLER WHO HAS COMPLETED FIRESTOPPING THAT IS SIMILAR IN MATERIAL, DESIGN AND EXTENT TO THAT INDICATED FOR PROJECT AND HAS PERFORMED SUCCESSFULLY.

MATERIALS:

PROVIDE FIRESTOPPING COMPOSED OF COMPONENTS THAT ARE COMPATIBLE WITH EACH OTHER, THE SUBSTRATES FORMING OPENINGS, AND THE ITEMS, IF ANY, PENETRATING THE FIRESTOPPING UNDER CONDITIONS OF SERVICE AND APPLICATION, AS DEMONSTRATED BY THE FIRESTOPPING MANUFACTURER BASED ON TESTING AND FIELD EXPERIENCE.

PRODUCTS:

COMPATIBILITY: PROVIDE FIRESTOPPING COMPOSED OF COMPONENTS THAT ARE COMPATIBLE WITH EACH OTHER, THE SUBSTRATES FORMING OPENINGS, AND THE ITEMS, IF ANY, PENETRATING THE FIRESTOPPING UNDER CONDITIONS OF SERVICE AND APPLICATION, AS DEMONSTRATED BY FIRESTOPPING MANUFACTURER BASED ON TESTING AND FIELD EXPERIENCE.

ACCESSORIES: PROVIDE COMPONENTS FOR EACH FIRESTOPPING SYSTEM THAT ARE NEEDED TO INSTALL FILL MATERIALS. USE ONLY COMPONENTS SPECIFIED BY THE FIRESTOPPING MANUFACTURER AND APPROVED BY THE QUALIFIED TESTING AND INSPECTING AGENCY FOR THE DESIGNATED FIRE-RESISTANCE-RATED SYSTEMS.

APPLICATIONS: PROVIDE FIRESTOPPING SYSTEMS COMPOSED OF MATERIALS SPECIFIED IN THIS SECTION THAT COMPLY WITH SYSTEM PERFORMANCE AND OTHER REQUIREMENTS.

FILL MATERIALS FOR THROUGH-PENETRATION FIRESTOP SYSTEMS

CERAMIC-FIBER SEALANT: SINGLE-COMPONENT FORMULATION OF CERAMIC FIBERS AND INORGANIC BINDERS.

ENDOTHERMIC LATEX SEALANT: SINGLE-COMPONENT, ENDOTHERMIC, LATEX FORMULATION.

INTUMESCENT LATEX SEALANT: SINGLE-COMPONENT, INTUMESCENT, LATEX FORMULATION.

INTUMESCENT PUTTY: NONHARDENING, DIELECTRIC, WATER-RESISTANT PUTTY CONTAINING NO SOLVENTS, INORGANIC FIBERS OR SILICONE COMPOUNDS.

INTUMESCENT WRAP STRIPS: SINGLE-COMPONENT, ELASTOMERIC SHEET WITH ALUMINUM FOIL ON ONE SIDE.

JOB-MIXED VINYL COMPOUND: PREPACKAGED VINYL-BASED POWDER PRODUCT FOR MIXING WITH WATER A PROJECT SITE TO PRODUCE A PAINTABLE COMPOUND, PASSING ASTM E 136, WITH FLAME-SPREAD AND SMOKE-DEVELOPED RATINGS OF ZERO PER ASTM E 84.

SILICONE SEALANT: MOISTURE-CURING, SINGLE-COMPONENT, SILICONE-BASED, NEUTRAL-CURING ELASTOMERIC SEALANT OF GRADE INDICATED BELOW:

GRADE: POURABLE (SELF-LEVELING) FORMULATION FOR OPENINGS IN FLOORS AND OTHER HORIZONTAL SURFACES AND NONSAG FORMULATION FOR OPENINGS IN VERTICAL AND OTHER SURFACES REQUIRING A NONSLUMPING/GUNNABLE SEALANT, UNLESS INDICATED FIRESTOP SYSTEM LIMITS USE TO NONSAG GRADE FOR BOTH OPENING CONDITIONS.

AVAILABLE PRODUCTS: SUBJECT TO COMPLIANCE WITH REQUIREMENTS, PRODUCTS THAT MAY BE INCORPORATED IN THE WORK INCLUDE, BUT ARE NOT LIMITED TO, THE FOLLOWING:

CERAMIC-FIBER SEALANT: METACALKUL 525, THE RECTORSEAL CORPORATION.

ENDOTHERMIC LATEX SEALANT: FYRE-SHIELD, TREMCO, INC.

INTUMESCENT LATEX SEALANT: METACAULK 950, THE RECTORSEAL CORPORATION.
FS611A INTUMESCENT FIRESTOP SEALANT, HILTI CONSTRUCTION CHEMICALS, INC.

INTUMESCENT PUTTY: PENISIL 500 INTUMESCENT PUTTY, GENERAL ELECTRIC COMPANY.
FLAME-SAFE FSP1000 PUTTY, INTERNATIONAL PROTECTIVE COATINGS CORPORATION.

INTUMESCENT WRAP STRIPS: GS2420 INTUMESCENT WRAP, HILTI CONSTRUCTION CHEMICALS, INC.

JOB-MIXED VINYL COMPOUND: USG FIRECODE COMPOUND, UNITED STATES GYPSUM COMPANY.
FS635 TROWELABLE FIRESTOP COMPOUND, HILTI CONSTRUCTION CHEMICAL, INC

SILICONE SEALANTS: PENISIL 100 FIRESTOP SEALANT, GENERAL ELECTRIC COMPANY
CS240 FIRESTOP SEALANT, HILTI CONSTRUCTION CHEMICALS, INC.
METACAULK 835, THE RECTORSEAL CORPORATION.
METACAULK 880, THE RECTORSEAL CORPORATION.
FYRE-SIL, TREMCO, INC.
FYRE-SIL S/L, TREMCO, INC.

INSTALL FIRESTOP MATERIALS IN ACCORDANCE WITH UL FIRE RESISTANCE DIRECTORY. COMPLY WITH MANUFACTURER INSTRUCTIONS FOR INSTALLATION FOR ALL FIRESTOPPING MATERIALS.

DIVISION 07 - THERMAL AND MOISTURE PROTECTION (CONT)

07 90 00 JOINT PROTECTION:

PROVIDE THE FOLLOWING SEALANT TYPES WHERE INDICATED ON THE DRAWINGS AND AT OTHER TYPICAL LOCATION, INCLUDING BUT NOT LIMITED TO:

- EXTERIOR JOINTS IN VERTICAL SURFACES INCLUDING PERIMETER JOINTS AND AROUND DISSIMILAR MATERIALS.
- EXTERIOR JOINTS IN HORIZONTAL TRAFFIC SURFACES INCLUDING CONTROL, EXPANSION AND ISOLATION JOINT IN CAST-IN-PLACE CONCRETE SLABS FOR FLOORS AND DECKS.
- INTERIOR JOINTS IN HORIZONTAL TRAFFIC SURFACES INCLUDING PERIMETER JOINTS OF EXTERIOR OPENINGS, TILE CONTROL AND EXPANSION JOINTS, PERIMETER JOINTS B/W INTERIOR WALL SURFACES AND FRAMES OF INTERIOR DOORS, WINDOWS, INTERIOR TRIM LOCATIONS.
- INTERIOR JOINTS IN HORIZONTAL TRAFFIC SURFACES INCLUDING CONTROL AND EXPANSION JOINTS IN CAST-IN-PLACE CONCRETE SLABS.
- AT ALL DISSIMILAR MATERIAL INTERSECTIONS.

MATERIALS:

PROVIDE JOINT SEALERS, JOINT FILLERS AND OTHER RELATED MATERIALS THAT ARE COMPATIBLE WITH ONE ANOTHER AND WITH JOINT SUBSTRATES UNDER CONDITIONS OF SERVICE AND APPLICATION, AS DEMONSTRATED BY SEALANT MANUFACTURER BASED ON TESTING AND FIELD EXPERIENCE.

EXTERIOR AND INTERIOR:

- DAP 50 YEAR "ALEX ULTRA 230 PREMIUM INDOOR/OUTDOOR SEALANT WITH MICROBAN ANTIMICROBIAL PRODUCT PROTECTION" OR APPROVED EQUAL.

MULTI-PART POURABLE URETHANE SEALANT:

- POLYURETHANE COMPLYING WITH USE AT HORIZONTAL JOINTS IN CONCRETE FLATWORK. "VULKEM 245 MAMECO WATERPROOFING SEALANT" AND "PECORA CORPORATION - NR-200 URESPAN" OR APPROVED EQUAL.

LATEX JOINT SEALANT - INTERIOR TINTED/COLORED CAULK:

- SPECTRUM MFG. CORP. "SPECTRUM 2000", TEC "ACCUCOLOR" OR APPROVED EQUAL SILICONIZED ACRYLIC LATEX CAULK.

JOINT SEALANT BACKING:

- POLYETHYLENE FOAM COMPRESSIVE ROD STOCK. PROVIDE BACKER ROD AT ALL JOINTS AS REQUIRED.

ALL PIPING, CONDUIT, PHONE-DATA LINES AND OTHER WIRING PENETRATIONS AT FIRE RATED ASSEMBLIES SHALL BE SEALED PER REQUIRED UL ASSEMBLIES.

INTERIOR ACOUSTICAL SEALANTS:

- ACOUSTICAL SEALANT TO BE LOCATED ABOVE AND BELOW WALL PLATES AT WALL BETWEEN RESTAURANT AND OFFICE/KITCHEN AND AT INTERSECTIONS OF ACOUSTIC LID AND WALLS.

FINISH:

COLORS TO MATCH ADJACENT MATERIALS. SUBMIT COLOR SAMPLES FOR FINAL SELECTION.

PROVIDE APPROPRIATE TYPE OF SEALANT FOR GIVEN APPLICATION. INSTALL PER MANUFACTURER REQUIREMENTS.

DIVISION 08 - OPENINGS

08 12 00 METAL FRAMES:

DOOR LOCATIONS IS INDICATED ON DRAWINGS AND IN SCHEDULE.

BASIS-OF-DESIGN FOR HOLLOW METAL DOORS & FRAMES
CECO DOOR (ASSA ABLOY) OR APPROVED EQUAL
WWW.CECORDOOR.COM; 888-264-7474

PRODUCT:

FIRE RATED AND NON FIRE RATED STEEL FRAMES
SERIES SJ STEEL FRAMES (UNEQUAL RABBIT)
FOR 1 3/4" THICK DOORS
STANDARD WALL APPLICATION. HANDED
KNOCK DOWN CORNER AT EXISTING WALLS, WELDED CORNERS AT NEW WALLS
16 GA STEEL, FACTORY PRIMED.

SUBMITTALS:

- PRODUCT DATA: DOOR MANUFACTURER'S TECHNICAL DATA FOR EACH TYPE OF FRAME.

- SHOP DRAWINGS: SUBMIT SHOP DRAWINGS INDICATING LOCATION AND SIZE OF EACH DOOR, FRAME, ELEVATION OF EACH KIND OF DOOR, HAND OF EACH COMPONENT, DETAILS OF CONSTRUCTION, LOCATION AND EXTENT OF HARDWARE BLOCKING, FIRE RATINGS, REQUIREMENTS FOR FACTORY FINISHING AND OTHER PERTINENT DATA.

WARRANTY

LIFETIME LIMITED.

08 13 00 METAL DOORS:

DOOR LOCATIONS IS INDICATED ON DRAWINGS AND IN SCHEDULE.

BASIS-OF-DESIGN FOR HOLLOW METAL DOORS & FRAMES
CECO DOOR (ASSA ABLOY) OR APPROVED EQUAL
WWW.CECORDOOR.COM
888-264-7474

PRODUCT:

FIRE RATED AND NON FIRE RATED SOLID METAL DOORS
REGENT (RI) OR OMEGA (OI) HONEYCOMB CORE DOORS
(FLUSH AND EMBOSSED PANEL STEEL DOORS, BEVELED LOCK EDGE)
SIZE: 1 3/4" THICK
18 GA STEEL DOOR PANEL FACE, FACTORY PRIME.
PREP DOOR FOR HARDWARE

STYLE AND RAIL DOORS

THRULITE DOOR BY CECO
(INSULATED TUBULAR STYLE AND RAIL CONSTRUCTION WITH FULL LITE AND FLUSH SEAMLESS DESIGN)
SIZE: 1 3/4" THICK
5 5/8" STANDARD STILES AND TOP RAIL
12" STANDARD BOTTOM RAIL
16 GA STEEL DOOR PANEL
PREP DOOR FOR HARDWARE

SUBMITTALS:

- PRODUCT DATA: DOOR MANUFACTURER'S TECHNICAL DATA FOR EACH TYPE OF DOOR, INCLUDING DETAILS OF CORE AND EDGE CONSTRUCTION, TRIM FOR OPENINGS AND FACTORY FINISHING SPECIFICATIONS.
- SHOP DRAWINGS: SUBMIT SHOP DRAWINGS INDICATING LOCATION AND SIZE OF EACH DOOR, ELEVATION OF EACH KIND OF DOOR, HAND OF EACH COMPONENT, DETAILS OF CONSTRUCTION, LOCATION AND EXTENT OF HARDWARE BLOCKING, FIRE RATINGS, REQUIREMENTS FOR FACTORY FINISHING AND OTHER PERTINENT DATA.

PROVIDE TEMPERED GLASS AS REQUIRED BY CODE, AND ALL WEATHER-STRIPPING, JAMB EXTENSIONS, ADJUSTABLE THRESHOLDS, NAILING FINIS, DRIP CAPS, ETC. ATTACH DOOR UNITS AS RECOMMENDED BY MANUFACTURER. DOORS SHALL BE HUNG AND SHIMMED, PLUMB AND SQUARE, PROVIDING SMOOTH OPERATION AND EVEN CLOSING.

WARRANTY

LIFETIME LIMITED.

08 14 23 CLAD WOOD DOORS:

DOOR LOCATIONS INDICATED ON DRAWINGS AND IN SCHEDULE.

BASIS OF DESIGN - PELLA, 450 SERIES, ALUMINUM-CLAD OR APPROVED EQUAL
SEMCO WINDOWS & DOORS AND SIERRA PACIFIC WINDOWS WILL BE ACCEPTED AS EQUAL.

STYLE - SLIDING PATIO DOORS.

EXTERIOR - ALUMINUM ENDURACLAD FINISH; COLOR TO BE STANDARD "BROWN" - VERIFY FINISH WITH OWNER.

INTERIOR - UNFINISHED PINE.
FINAL INTERIOR DOOR FINISH TO BE DETERMINED BY EXISTING FINISHES INSIDE EACH UNIT.

GLAZING - ADVANCEDCOMFORT LOW-E NON-ARGON INSULATING GLASS.
(MINIMUM U-0.77, MINIMUM SHGC = 0.45 (S.E, W SIDES), SHGC = NO REQUIREMENT (NORTH SIDE))

JAMB EXTENSIONS - PROVIDE AS REQUIRED DUE TO INCREASED EXTERIOR WALL ASSEMBLY THICKNESS.

PROVIDE SLIDING SCREEN DOOR.

HARDWARE - STYLE AND FINISH TO BE SELECTED BY OWNER. PROVIDE SAMPLES FOR REVIEW.
PROVIDE MULTI-POINT LOCKING SYSTEM.

SUBMIT SHOP DRAWINGS, INSTALLATION DETAILS, TECHNICAL INFORMATION AND ROUGH OPENINGS FOR APPROVAL BY ARCHITECT PRIOR TO ORDERING.

INSTALL PER MANUFACTURER'S RECOMMENDATIONS.

WARRANTY - LIMITED LIFETIME WARRANTY

DIVISION 08 - OPENINGS (CONT)

08 44 00 CURTAIN WALL AND GLAZED ASSEMBLIES:

BASIS OF DESIGN MANUFACTURER:

KAWNEER COMPANY INC
1600UT SYSTEM 1 CURTAIN WALL
2 1/2" X 6" FRAME; OUTSIDE GLAZED PRESSURE PLATE FORMAT.
TESTED TO AAMA 501.05 AND TAS 202
1", INSULATED, LOW - E 366-189 DOUBLE PANE GLASS.
PANES TO BE 1/4" CLEAR GLASS. VERIFY TINTING COLOR AND SURFACE COATING WITH OWNER.
(MINIMUM U-0.77, MINIMUM SHGC = 0.45 (S.E, W SIDES) SHGC = NO REQUIREMENT (NORTH SIDE))

FACTORY FINISHING:

KAWNEER PERMANODIC, ARCHITECTURAL CLASS 1 COLOR ANODIC COATING (COLOR ANODIZED DARK BRONZE)

PERFORMANCE:
WINDLOAD DESIGN PRESSURE = 45 LBS/SF

REFER TO DRAWINGS FOR SIZES AND CONFIGURATIONS. CONTRACTOR TO PROVIDE ROUGH OPENING PER MANUFACTURER'S APPROVED SHOP DRAWINGS.

HARDWARE OPTIONS AND FINISH TO BE DETERMINED BY ARCHITECT / OWNER.

PROVIDE TEMPERED GLASS AS REQUIRED BY CODE, AND PROVIDE ALL JAMB EXTENSIONS, NAILING FINIS, DRIP CAPS, ETC. INSTALL UNITS AS RECOMMENDED BY MANUFACTURER, AND ADJUST FOR PROPER OPERATION.

PROVIDE DEFLECTORS AT ALL HORIZONTAL MULLIONS.

SUBMITTALS:

SHOP DRAWINGS: INCLUDE PLANS, ELEVATIONS, SECTIONS, DETAILS, HARDWARE, AND ATTACHMENTS TO OTHER WORK, OPERATIONAL CLEARANCES AND INSTALLATION DETAILS.

SAMPLES FOR INITIAL SELECTION: FOR UNITS WITH FACTORY-APPLIED COLOR FINISHES INCLUDING SAMPLES OF HARDWARE AND ACCESSORIES INVOLVING COLOR SELECTION.

SAMPLES FOR VERIFICATION: FOR ALUMINUM-FRAMED STOREFRONT SYSTEM AND COMPONENTS REQUIRED.

GLAZING: PROVIDE PRODUCT INFORMATION AND SAMPLES FOR GLAZING.

MOCK UP: PROVIDE MOCK-UP FOR WORKMANSHIP COMPARISON THROUGHOUT PROJECT. INCLUDED IN MOCK UP SHOULD BE EXTERIOR FINISHES, CURTAIN WALL SYSTEM, GLAZING SAMPLES, METAL FLASHING, ETC.

CLEAN WINDOWS AND GLAZING AT COMPLETION OF PROJECT AND RETURN TO PROJECT ONE MONTH AFTER OCCUPANCY AND ADJUST HARDWARE FOR PROPER OPERATION AND FUNCTION.

INSTALLATION TO COMPLY WITH MANUFACTURE'S WRITTEN INSTRUCTIONS AND CODE REQUIREMENTS.

WARRANTY:

PROVIDE MANUFACTURER'S STANDARD WARRANTY TWO (2) YEARS FROM DATE OF SUBSTANTIAL COMPLETION.

08 42 29.23 SLIDING AUTOMATIC ENTRANCES:

BASIS OF DESIGN MANUFACTURER

ASSA ABLOY ENTRANCE SYSTEMS
877-SPEC-123.

WWW.ASSAABLOYENTRANCE.USWWW.ASSAABLOYENTRANCE.US
SUBSTITUTIONS: IN COMPLIANCE WITH PROCEDURES OUTLINED IN "SUBSTITUTION PROCEDURES".

SLIDING AUTOMATIC ENTRANCES

BESAM SL500 EXC DOOR OR AUTOMATIC SLIDING ENTRANCE (BASIS OF DESIGN):
BI-PARTING, FULL BREAKOUT, DOOR SYSTEM.
BI-PARTING, FIXED SIDELITE, DOOR SYSTEM.
COMPLIANCE WITH ANSI/BHMA A156.10 AMERICAN NATIONAL STANDARD FOR POWER OPERATED PEDESTRIAN DOORS.

ENTRANCE COMPONENTS:

VERTICAL STILES: NARROW STILE 2-1/8 INCH.
BOTTOM RAILS: 10 INCH.
WEATHER-STRIPPING: ECODOOR SEALS.
U-FACTOR DOOR PACKAGE: EVALUATED IN COMPLIANCE WITH NFRC 100-2010, NFRC 200-2010, NFRC 500-2010, AND ASTM 283E-2010.
U-FACTOR RATING: MINIMUM 0.77 BTU/(H OF FT2) OR BETTER.
AIR INFILTRATION RATING: 0.93 CUFT/MIN/SQFT 0.28X3/MX2/MIN.

GLAZING:

EXTERIOR ENTRANCE GLAZING: 1" PPG SOLARBAN 60 CLEAR INSULATING GLASS UNIT; INTERIOR AND EXTERIOR LITES TO BE 14 INCH CLEAR TEMPERED GLASS.
INTERIOR ENTRANCE GLAZING: 1" INSULATED GLASS UNIT; INTERIOR AND EXTERIOR LITES TO BE 1/4 INCH CLEAR TEMPERED GLASS.

VERTICAL JAMBS: 1-3/4 INCHES BY 4-1/2 INCHES.
HEADER: 4-1/2 INCHES WIDE BY 7 INCHES HIGH WITH CONTINUOUS HINGED COVER.

HARDWARE:

BREAKAWAY ARMS AND BOTTOM PIVOT ASSEMBLIES.
HYDRAULIC CLOSER(S) TO RETURN BREAKOUT DOOR AND SIDELITE PANELS TO THE CLOSED POSITION WITH MAGNETIC CATCH(S) TO RETAIN PANELS IN THE CLOSED POSITION.

LOCKING HARDWARE SHALL BE PROVIDED ON FULL BREAKOUT ENTRANCES AS INDICATED.
ELECTRIFIED SLIDE LOCK SHALL AUTOMATICALLY LOCK THE SLIDING FUNCTION OF DOOR PANELS.
SURFACE MOUNTED EXIT DEVICES SHALL LOCK THE BREAKOUT FUNCTION WHILE ALLOWING EMERGENCY EGRESS AT ALL TIMES.

GUIDE TRACK/THRESHOLD: MANUFACTURER'S THRESHOLD AS INDICATED.
EXTERIOR ENTRANCE THRESHOLD: 1/2 INCH (12.7 MM) HIGH ALUMINUM THRESHOLD WITH INTEGRAL TRACK, RECESSED MOUNTED.
INTERIOR FULL BREAKOUT ENTRANCE: RECESSED FLOOR MOUNTED GUIDE TRACK(S).
INTERIOR FIXED SIDELITE ENTRANCE: GUIDE TRACK INTEGRATED IN BOTTOM OF SIDELITE.

DOOR OPERATOR AND CONTROLLER:


ELECTRO-MECHANICAL, ENERGY EFFICIENT DC MOTOR, MAXIMUM OF 3 AMP CURRENT DRAW.

MICROPROCESSOR CONTROL BOX:


FACTORY-ADJUSTED, CLOSING SPEEDS SET TO ANSI/BHMA A156.10 REQUIREMENTS.
KEYED MODE SELECTOR CONTROL TO ALLOW SELECTION OF THE INDICATED FUNCTIONS:
"OFF", "EXIT ONLY" ONE WAY TRAFFIC WITH AUTOMATIC OPERATION FROM THE INTERIOR, "TWO WAY TRAFFIC" AUTOMATIC OPERATION FROM EXTERIOR AND INTERIOR, "PARTIAL OPENING" ENERGY SAVING DOOR POSITION ALLOWS DOOR TO AUTOMATICALLY ADJUST OPENING WIDTH BASED ON AMOUNT OF USAGE, "HOLD OPEN" DOORS HELD IN THE FULL OPEN POSITION.

ACTIVATION AND SAFETY CONTROL DEVICES:

GENERAL: ACTIVATION AND SAFETY DEVICES IN ACCORDANCE WITH ANSI/BHMA STANDARDS.
COMBINATION ACTIVATION MOTION SENSOR/SAFETY PRESENCE SENSOR: SLIDING DOOR SENSOR UTILIZING K-BAND MICROWAVE TECHNOLOGY TO DETECT MOTION AND FOCUSED ACTIVE INFR

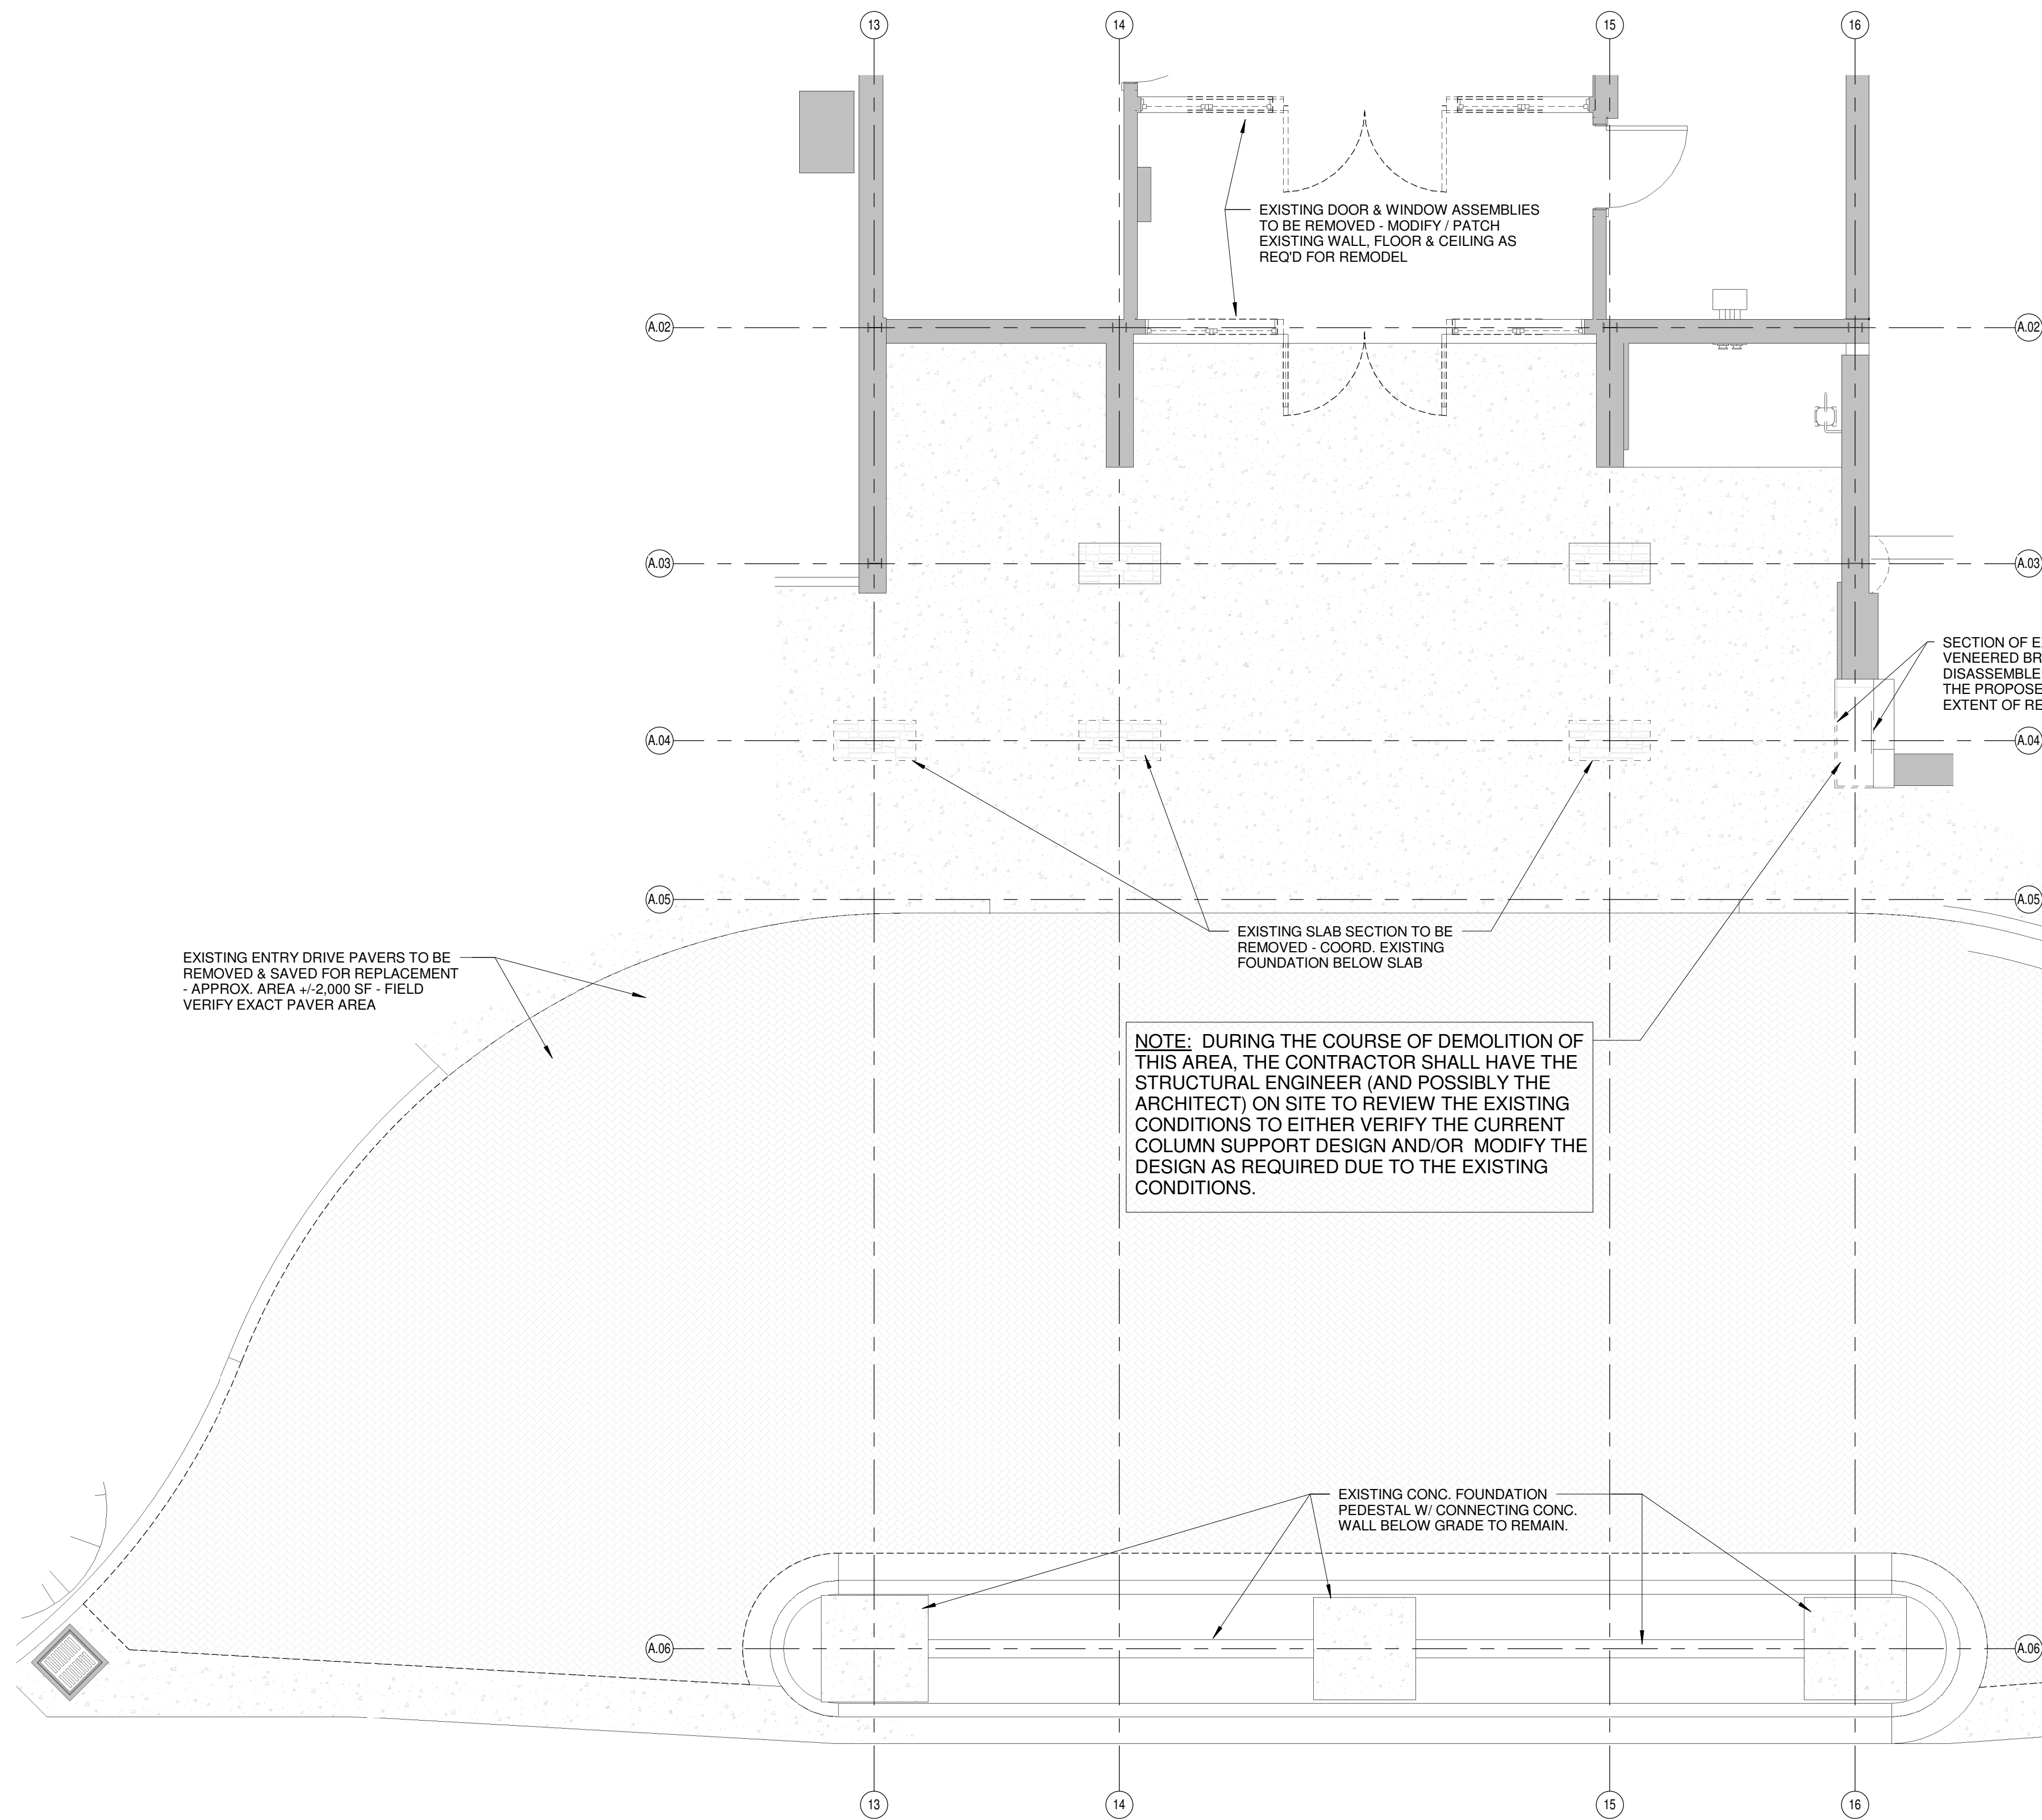

1 FIRST LEVEL - EXISTING/DEMO (PORTE COCHERE)
AD101 1/4" = 1'-0"

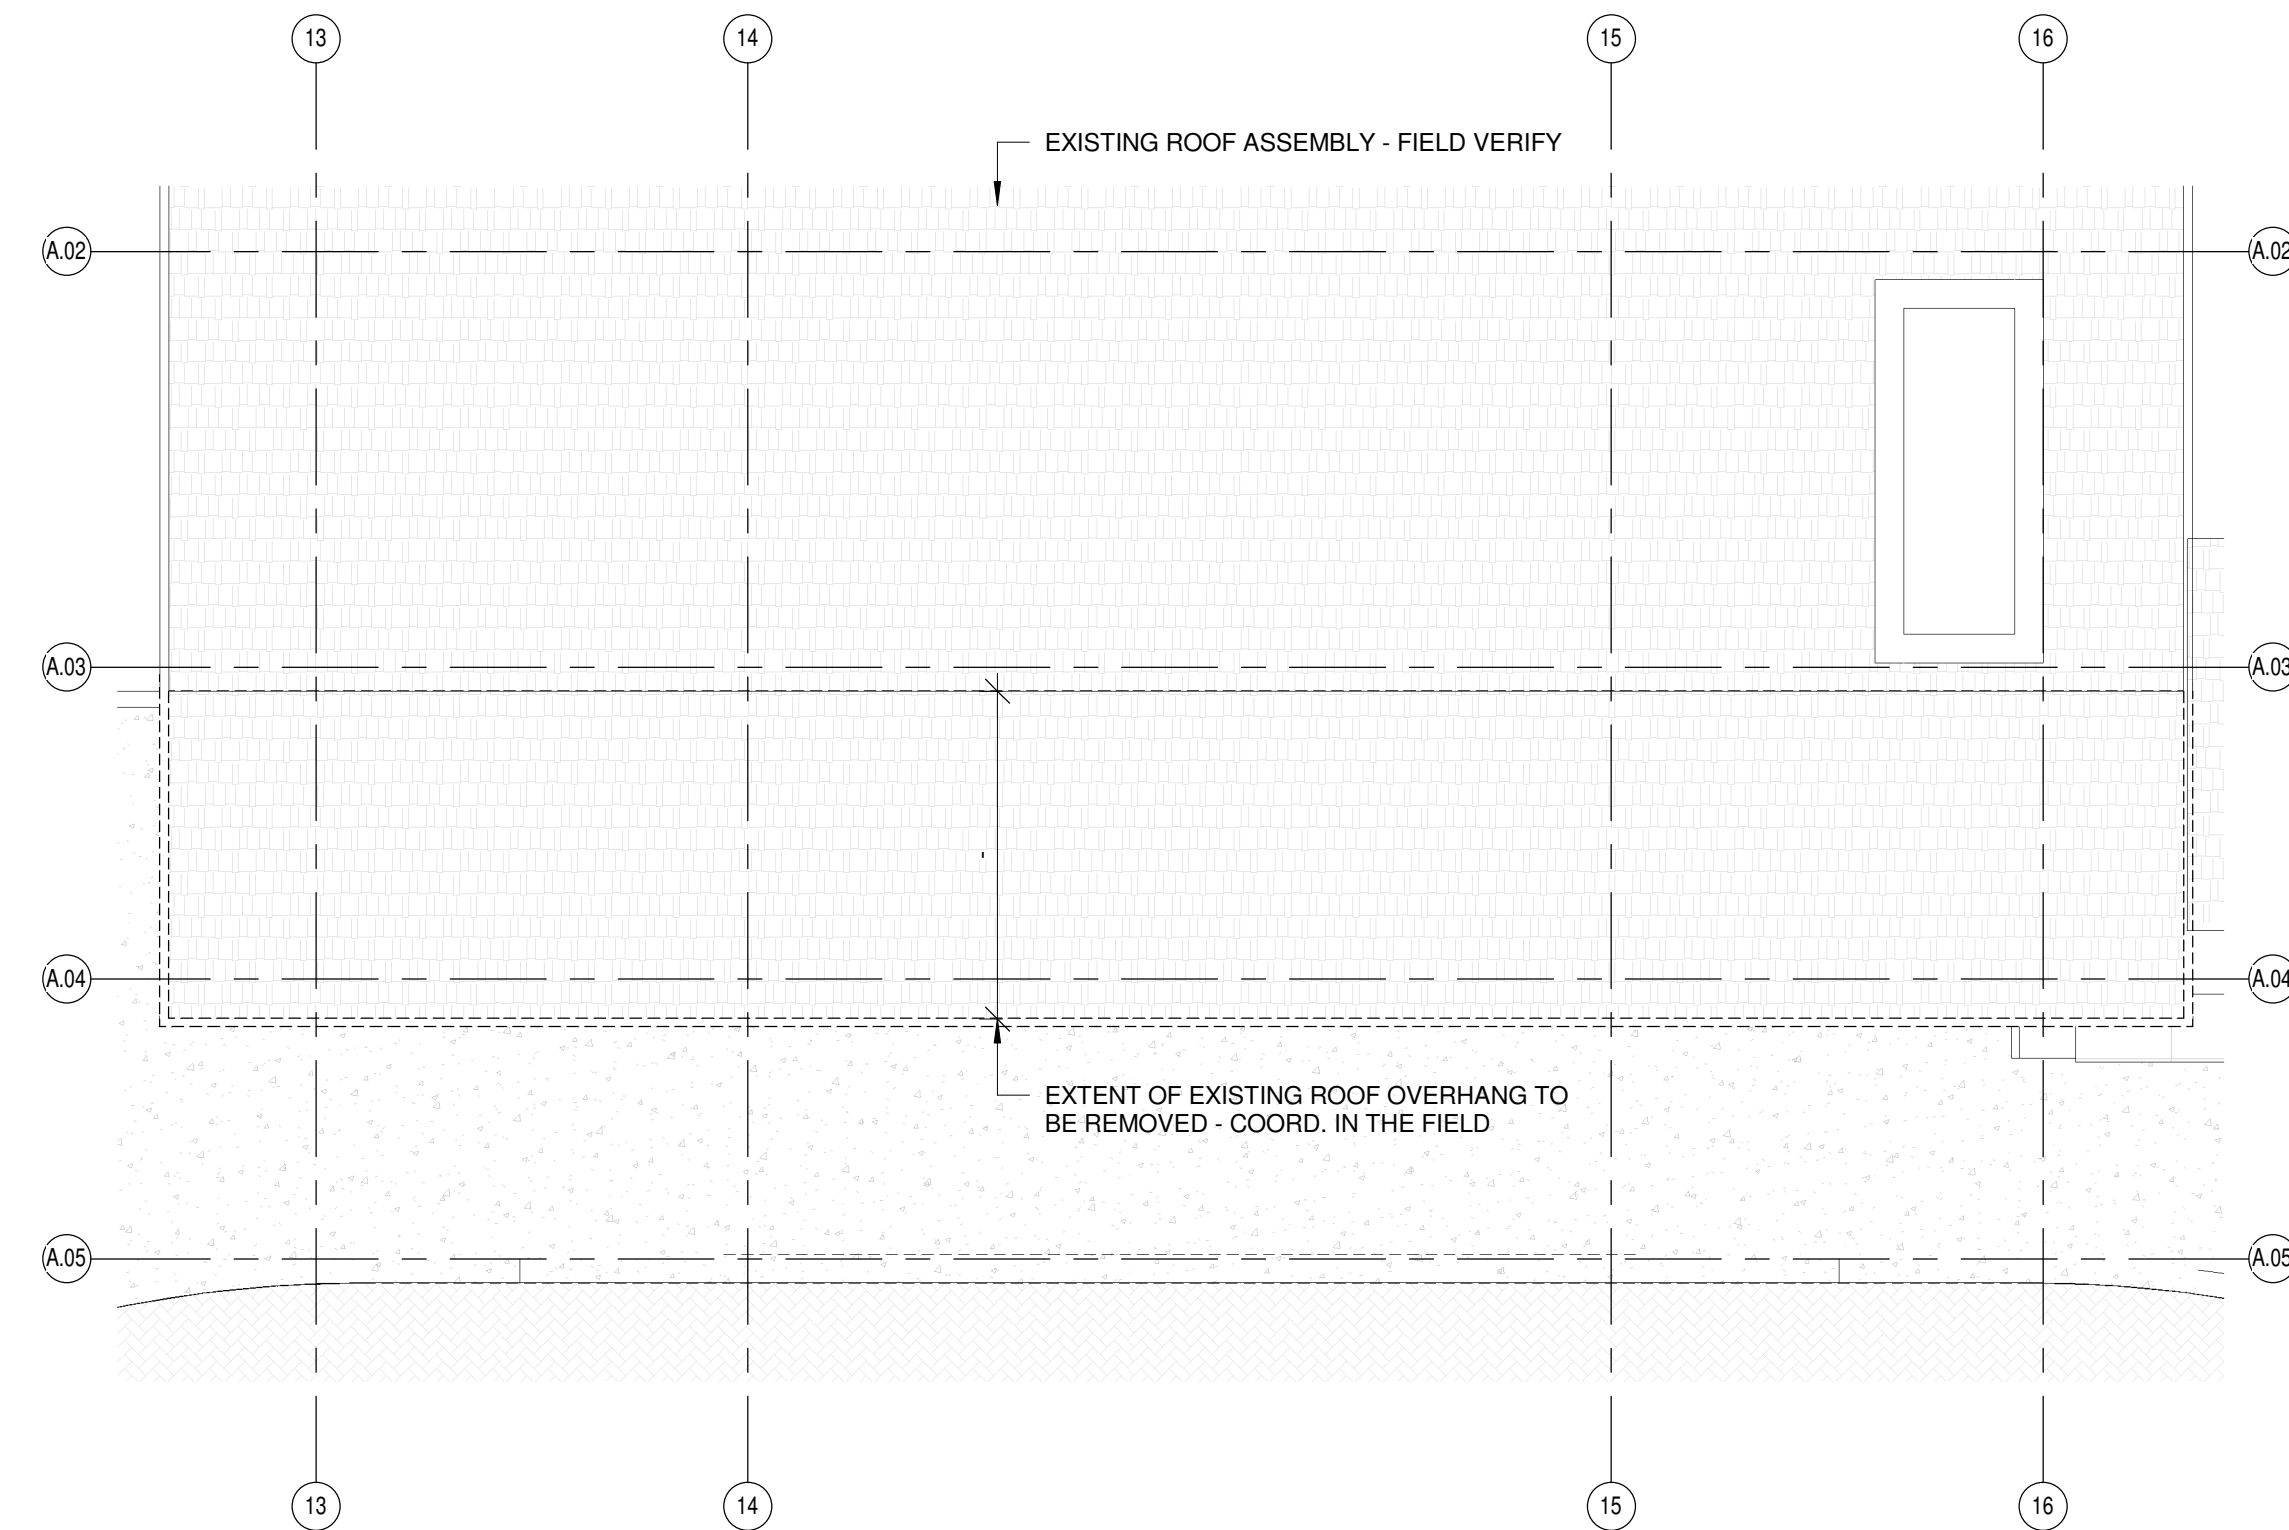

2 ROOF PLAN - EXISTING/DEMO (PORTE COCHERE)
AD101 1/4" = 1'-0"



NOTICE: DUTY OF COOPERATION

Release of these plans comprises full cooperation among the owner, his contractor and the architect. Design and construction are complex. Although the architect and his consultants have performed their services with due care and diligence, they cannot guarantee perfection. Communication is imperfect and errors or omissions may occur. In the event of any ambiguity or discrepancy discovered by the use of these plans shall be reported immediately to the architect. Failure to notify the architect compounds misunderstanding and increases construction costs. A failure to cooperate by a simple notice to the architect shall relieve the architect from liability for any errors or omissions that may arise from the plans without consent of the architect are unauthorized and shall relieve the architect of responsibility for all consequences arising out of such changes.

All design, documents and data prepared by Eric Smith Associates, P.C. as instruments of service shall remain property of Eric Smith Associates, P.C. and shall not be copied, changed or disclosed in any form whatsoever without first obtaining the express written consent of Eric Smith Associates, P.C.

Eric Smith Associates, P.C.

[illegible]










BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, COLORADO



ERIC SMITH ASSOCIATES, P.C.
1919 SEVENTH STREET
BOULDER, COLORADO, 80302
(303) 442-5458, (303) 442-4745 FAX

Job Number:	17022
Date:	2018-11-09
Drawn By:	Author
Checked By:	Checker

Project Phase
PERMIT REVIEW
Sheet Title
EXISTING/DEMO - PORTE-COCHERE
Sheet Number
AD101

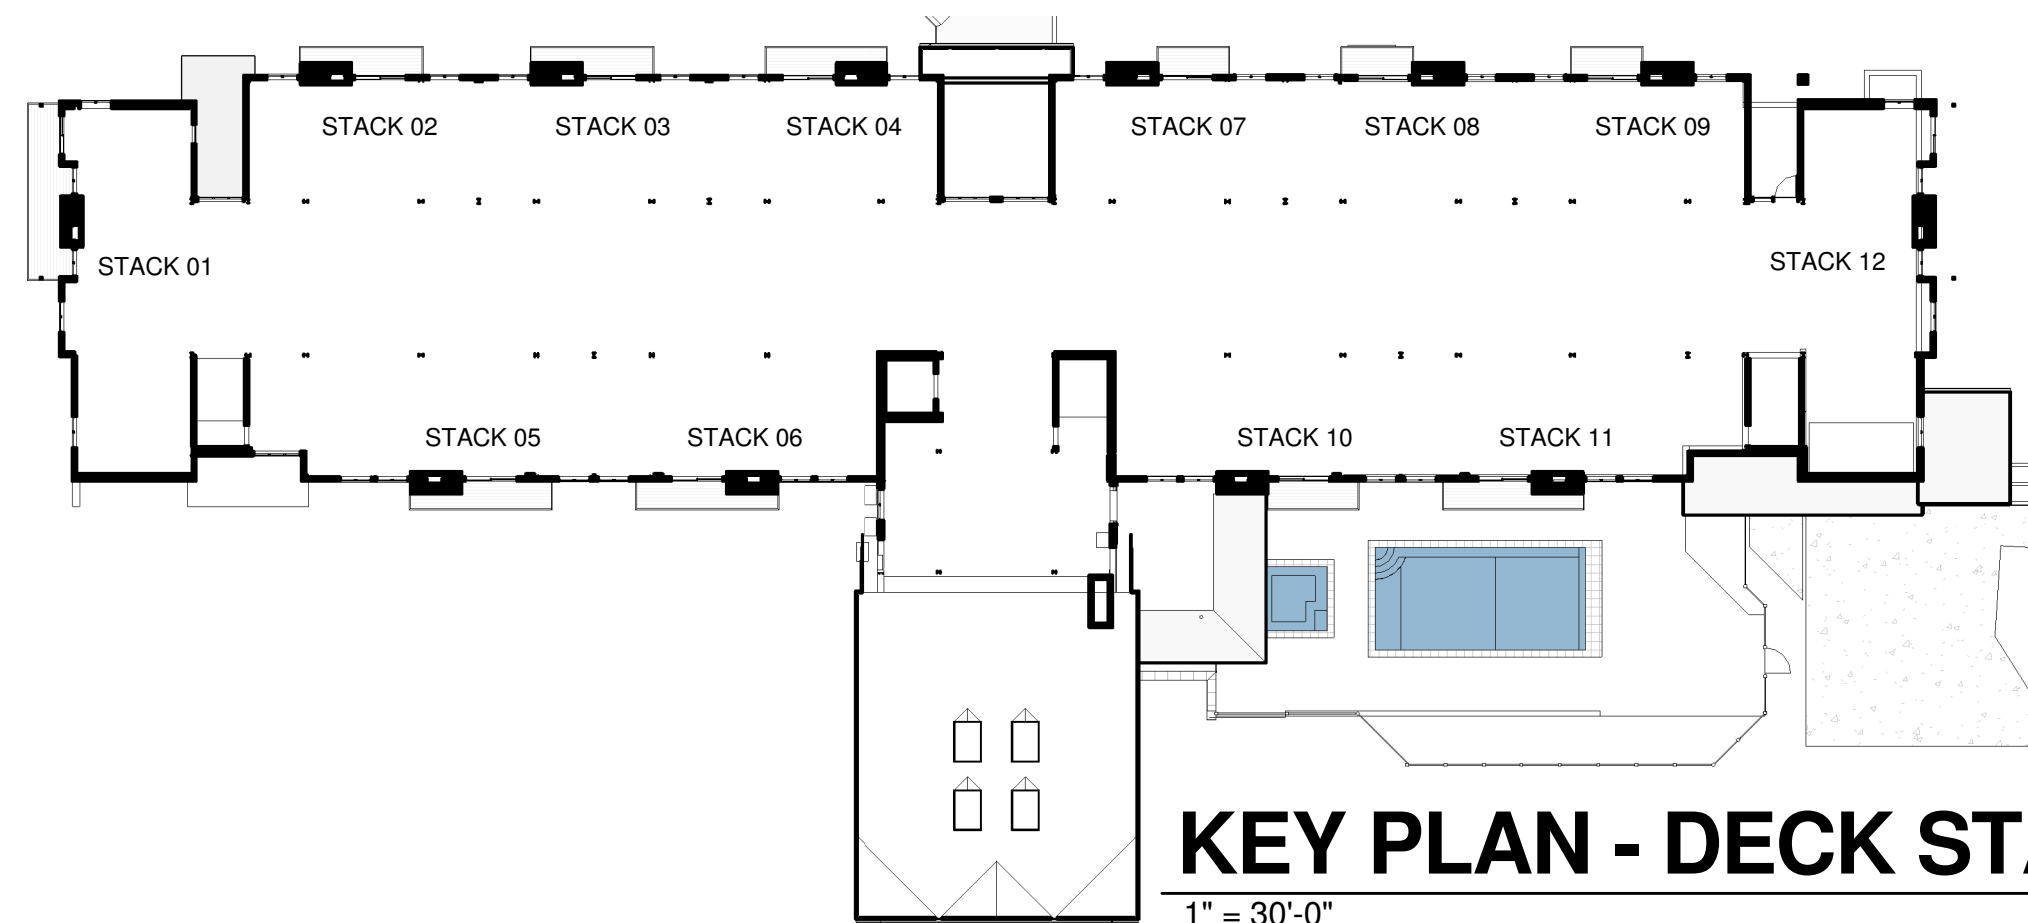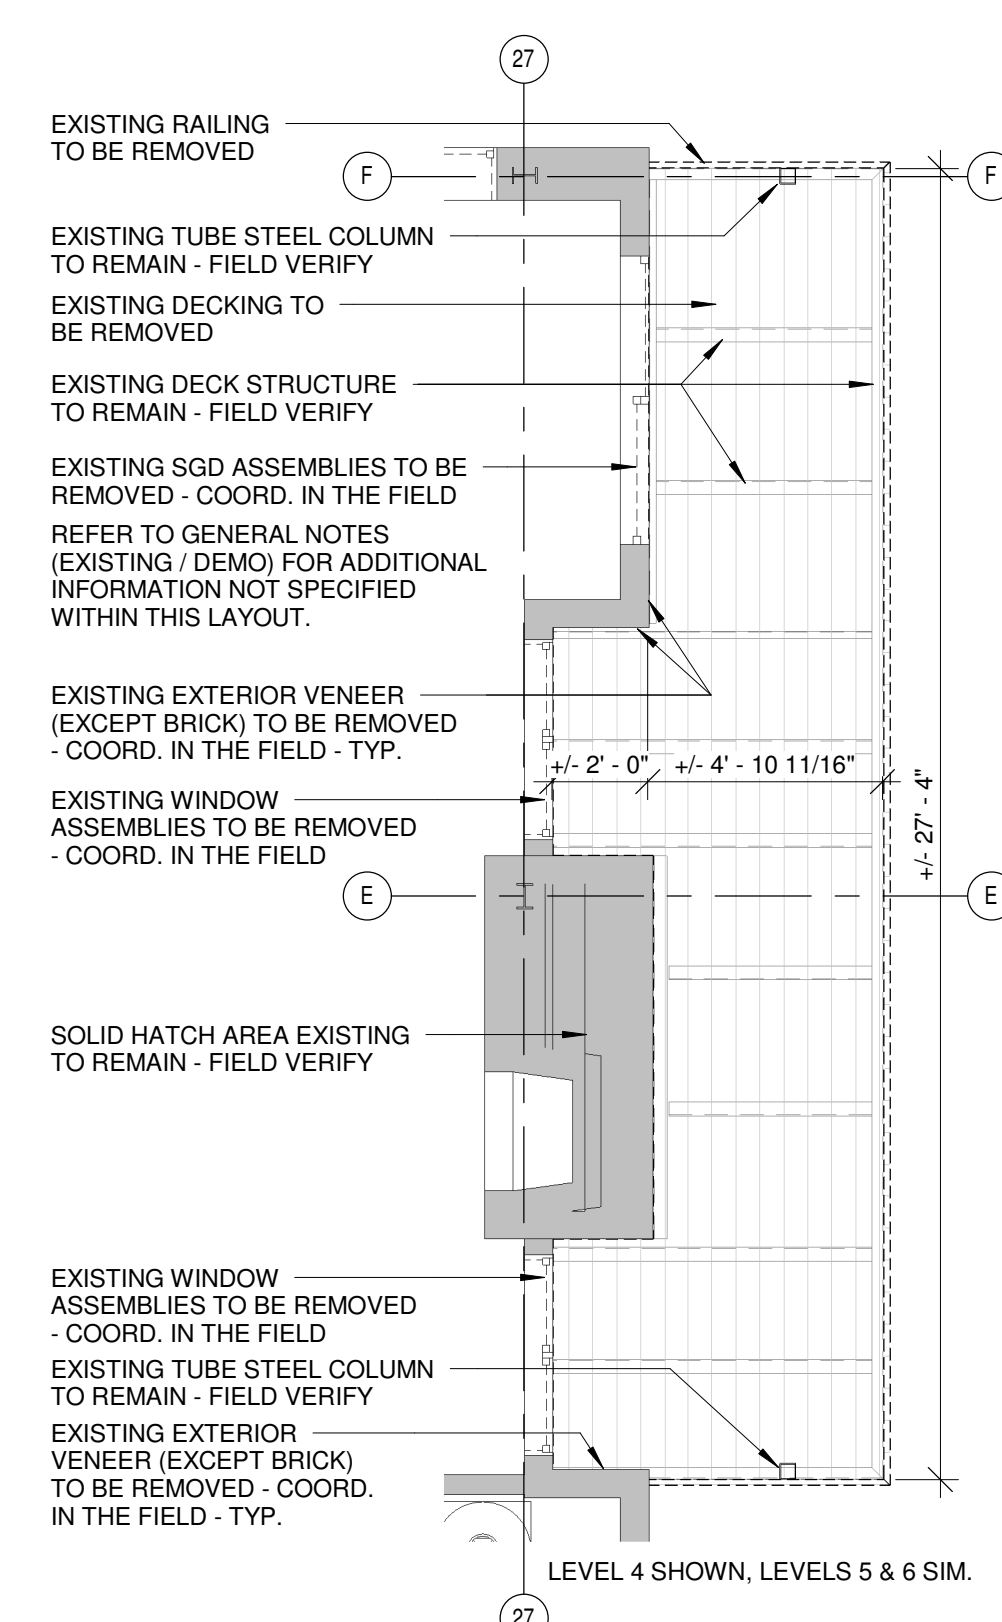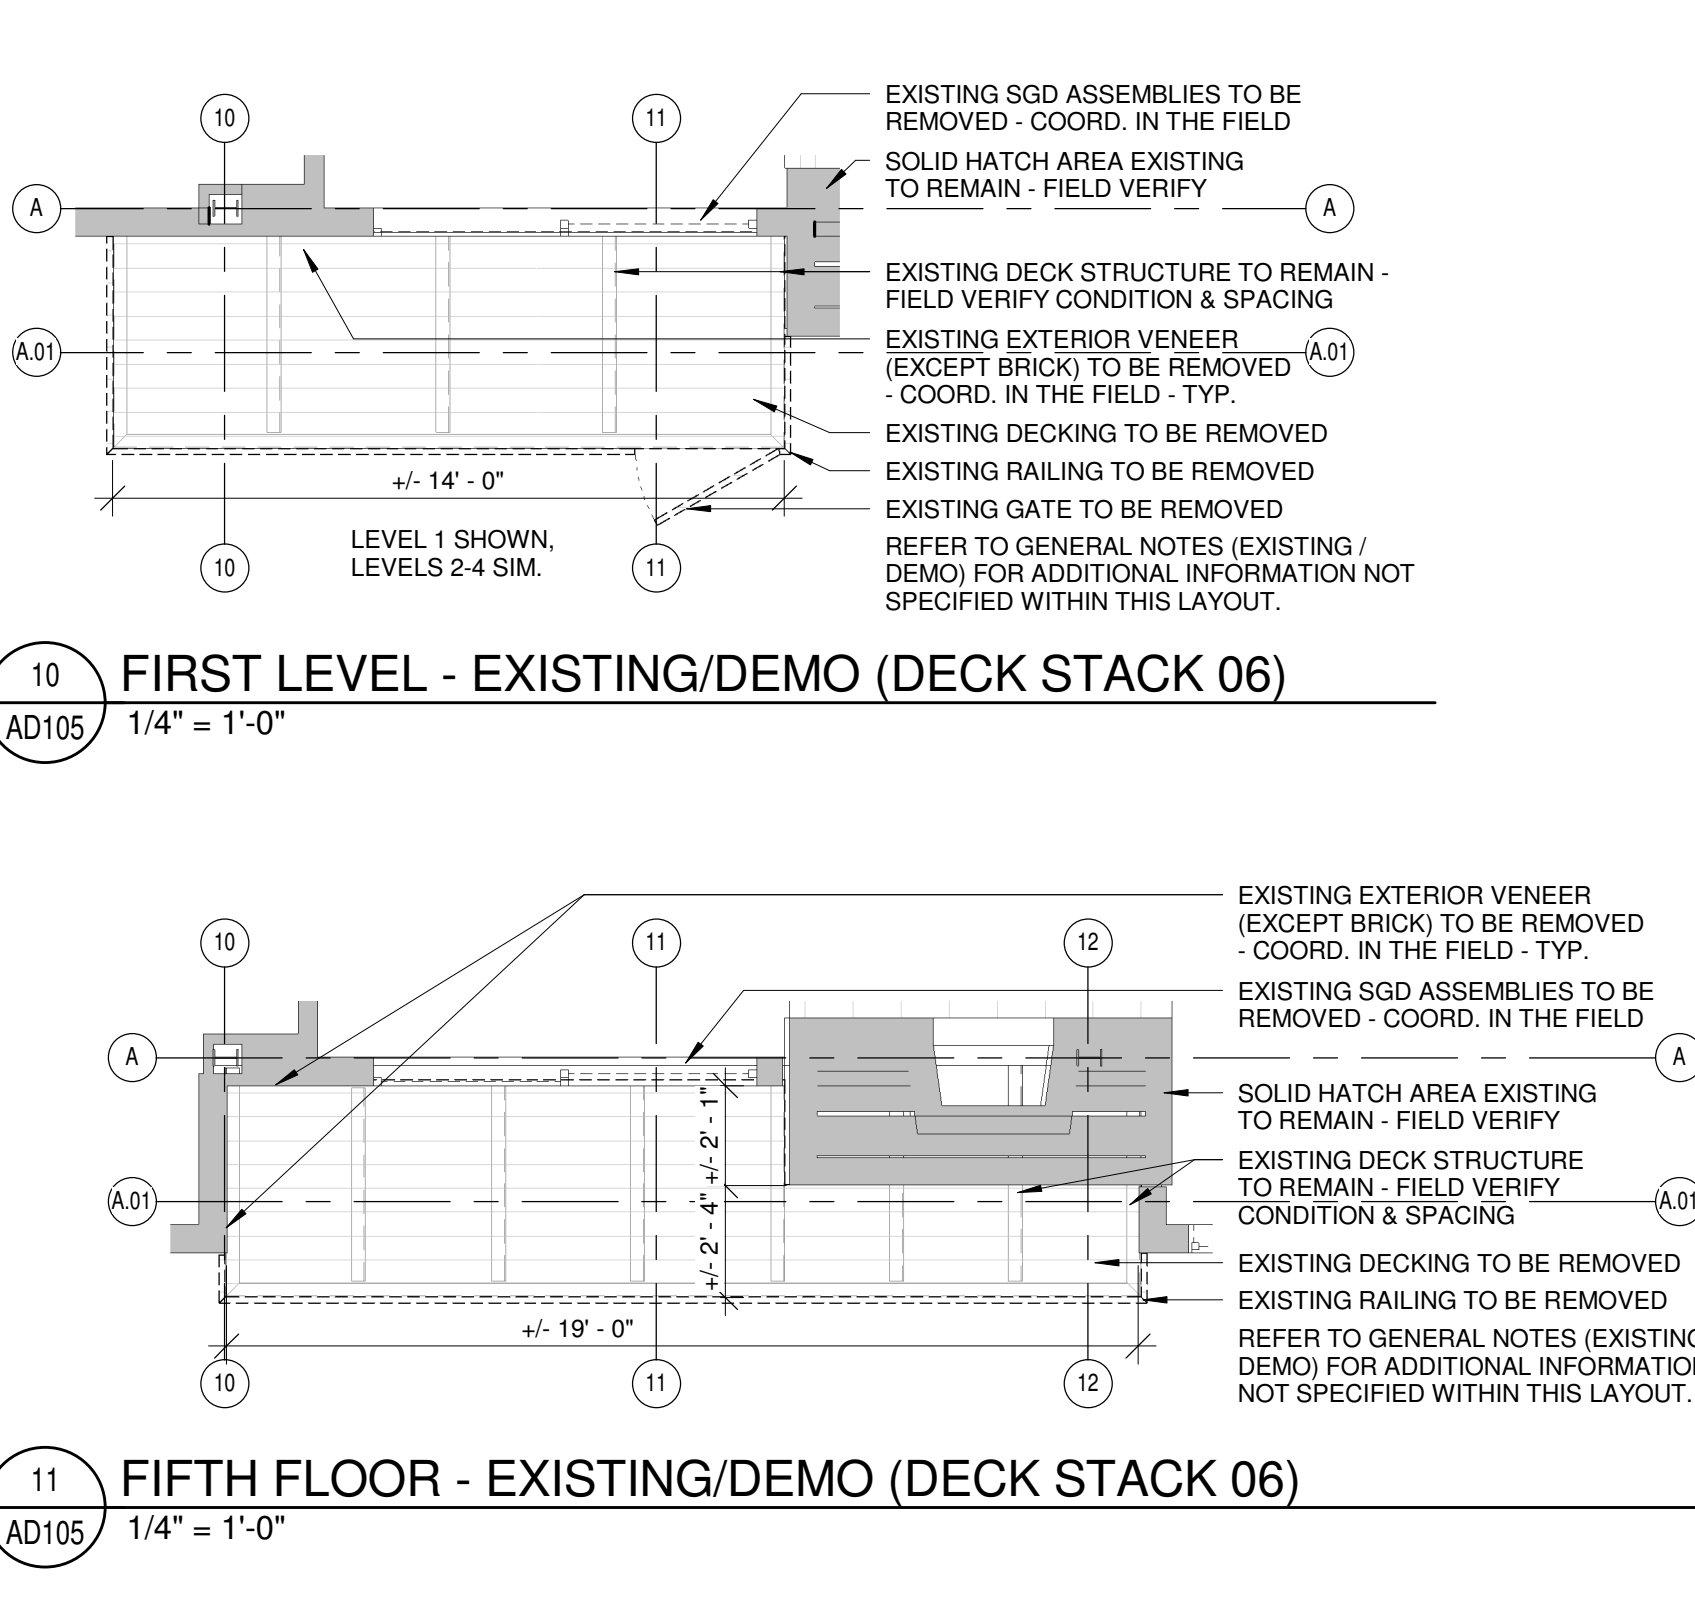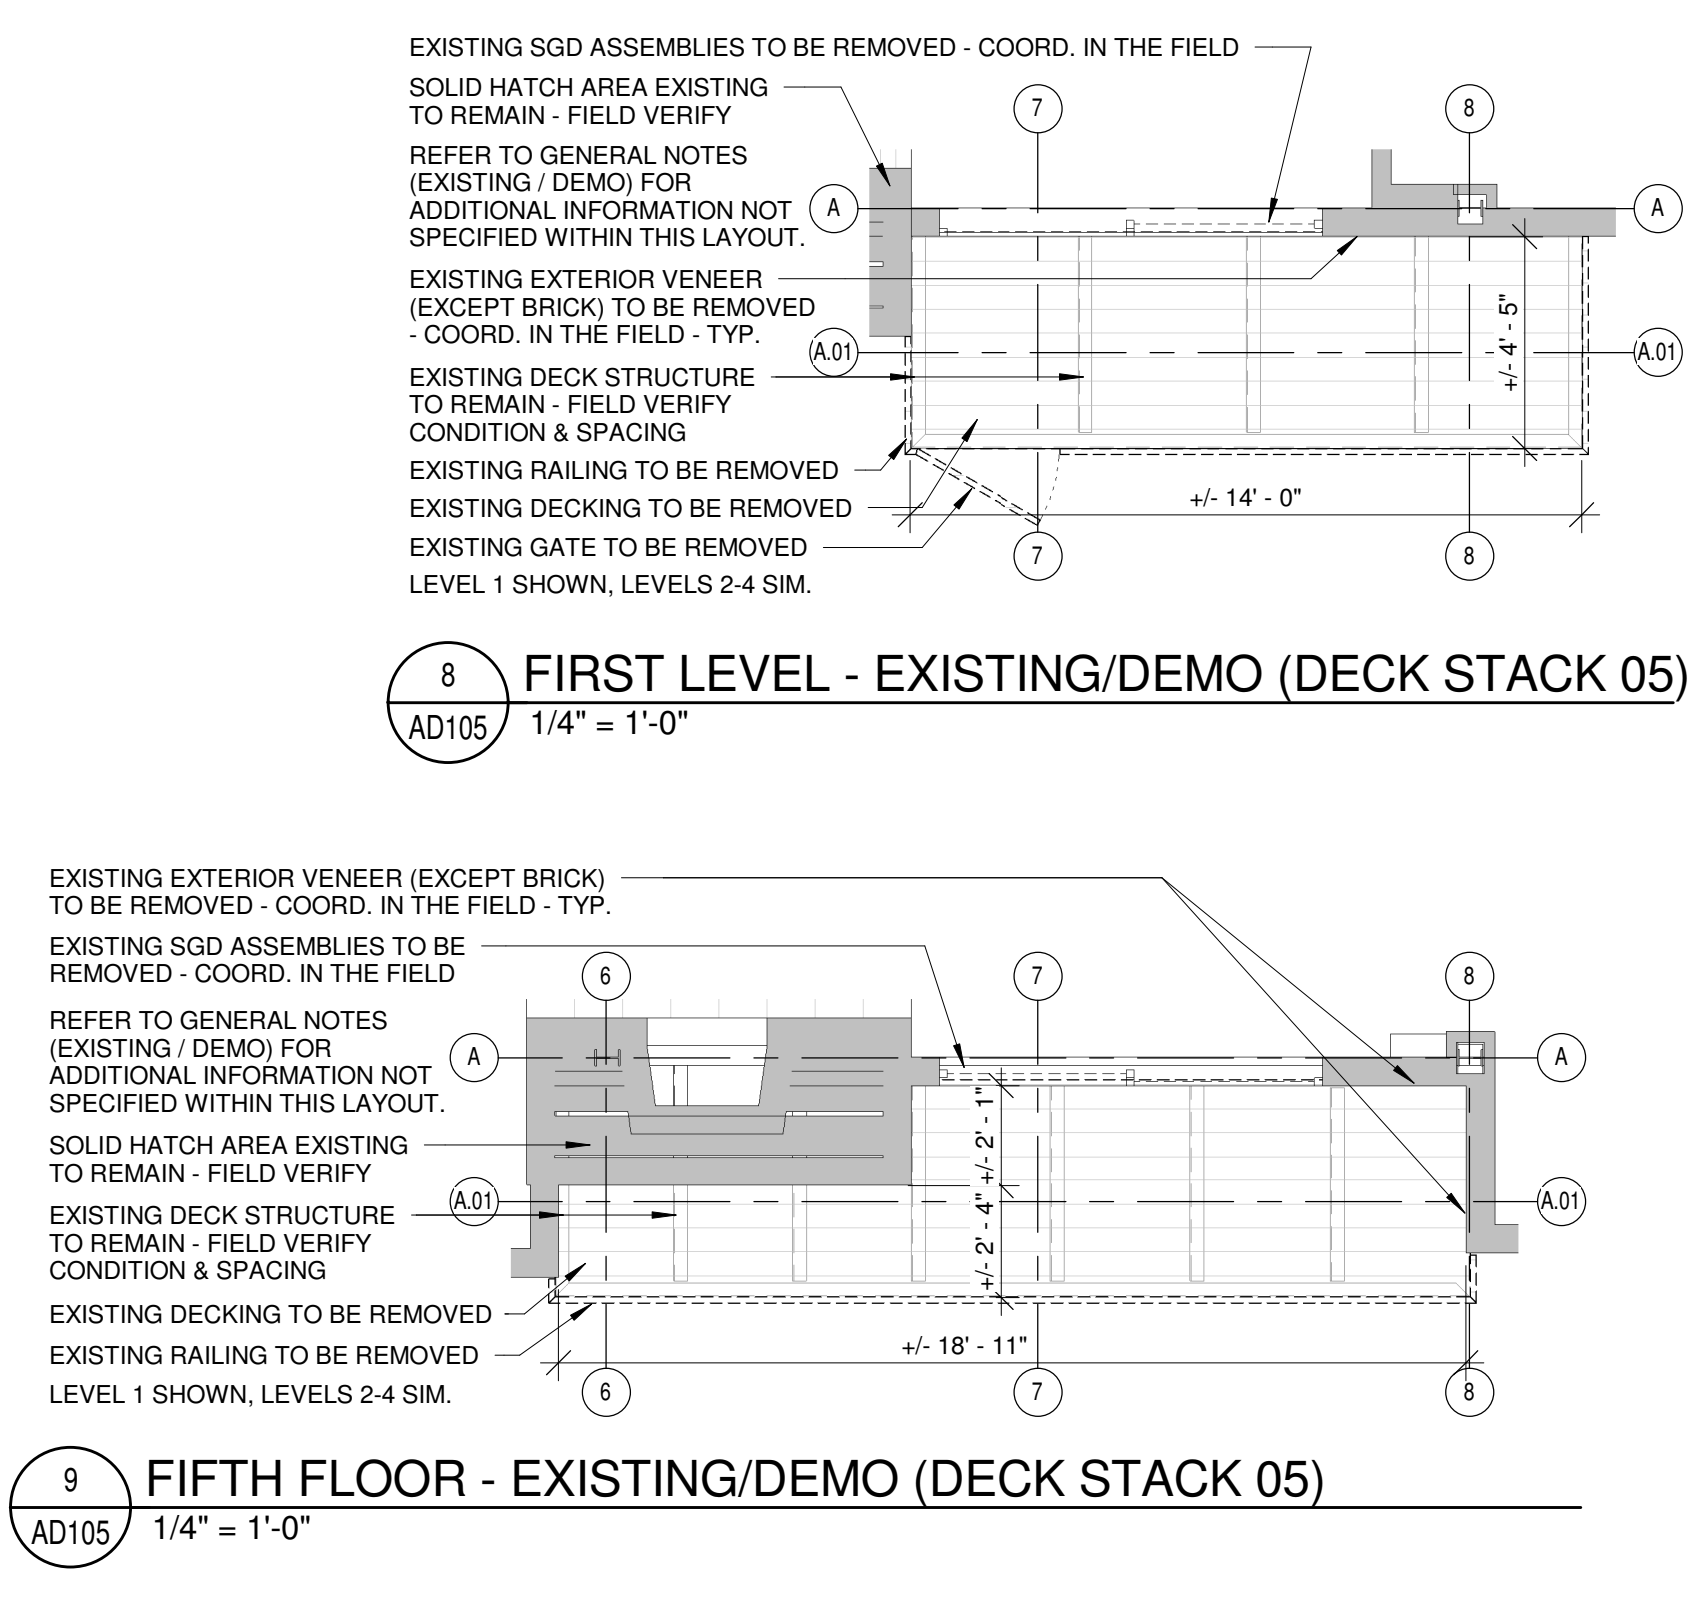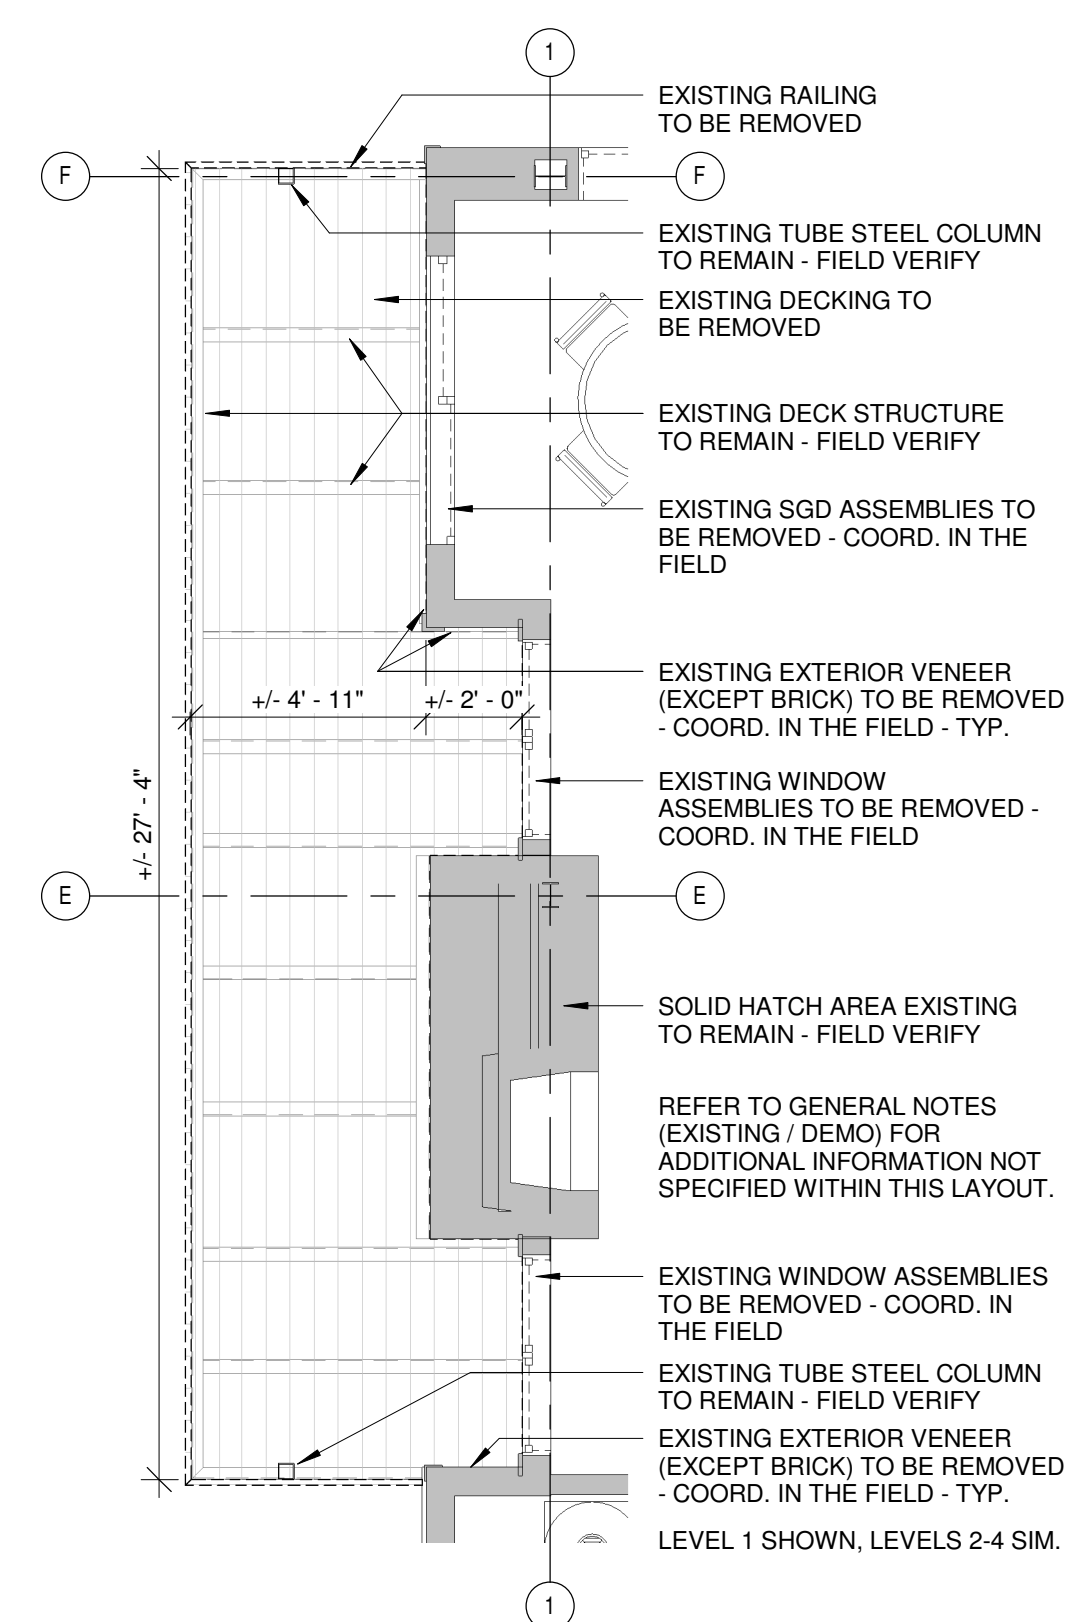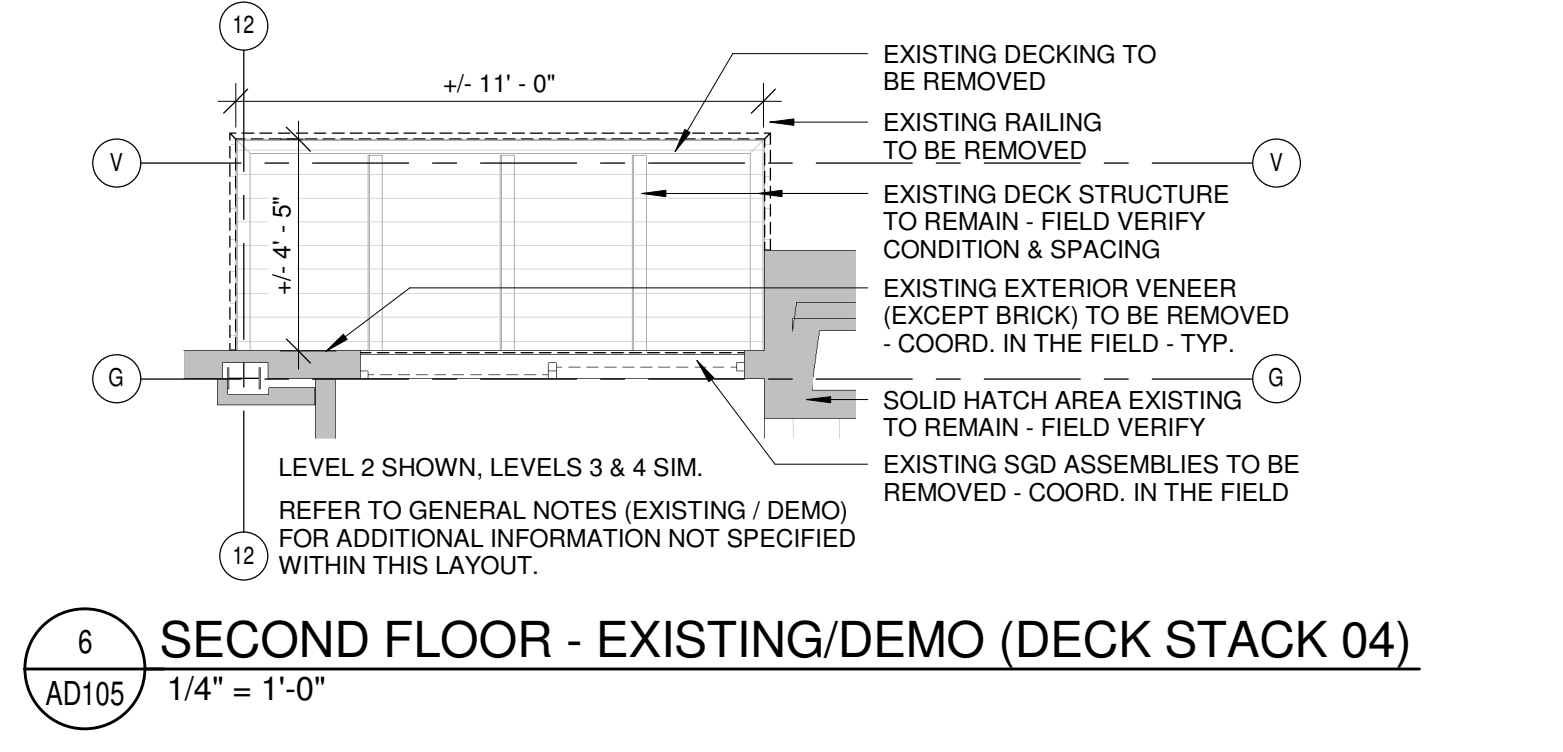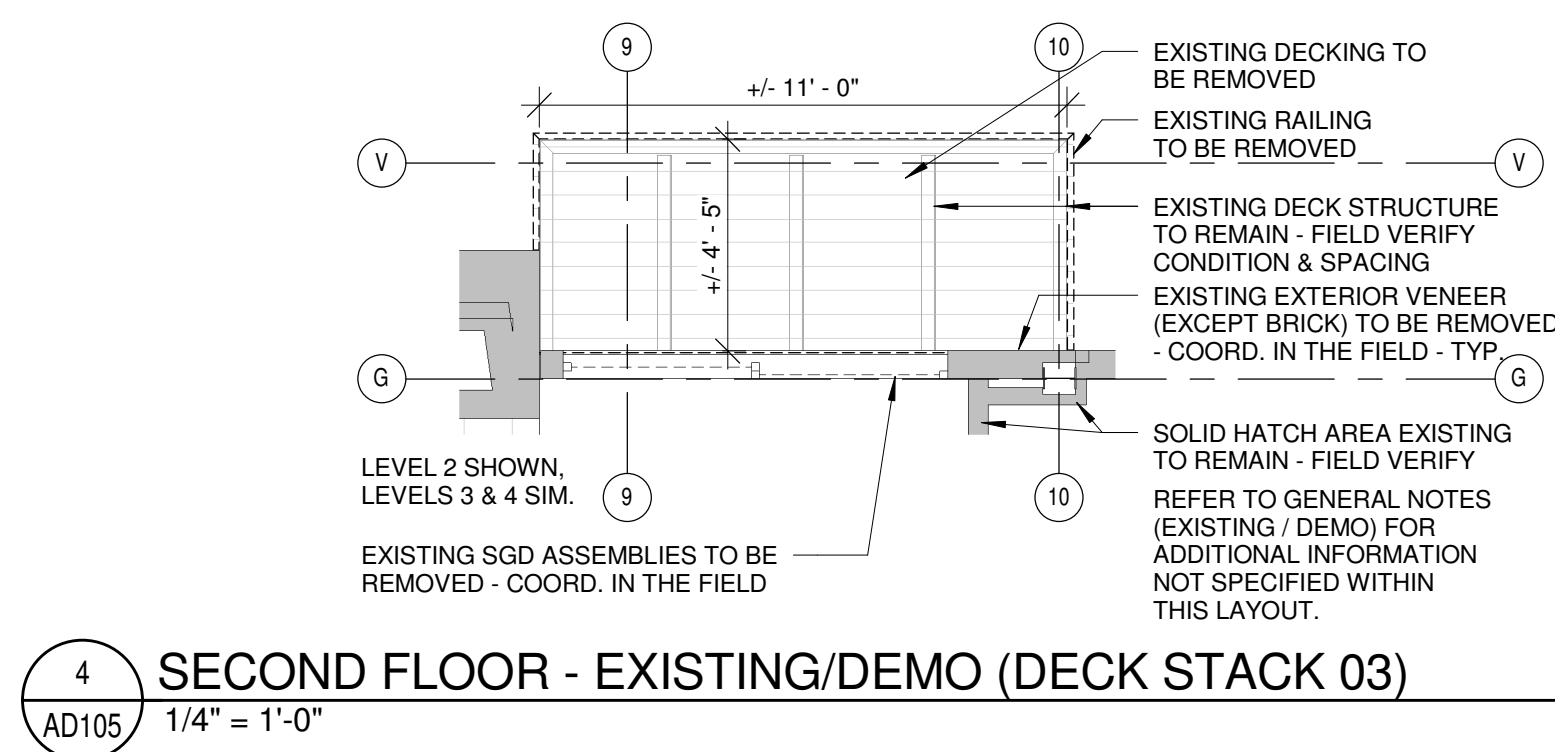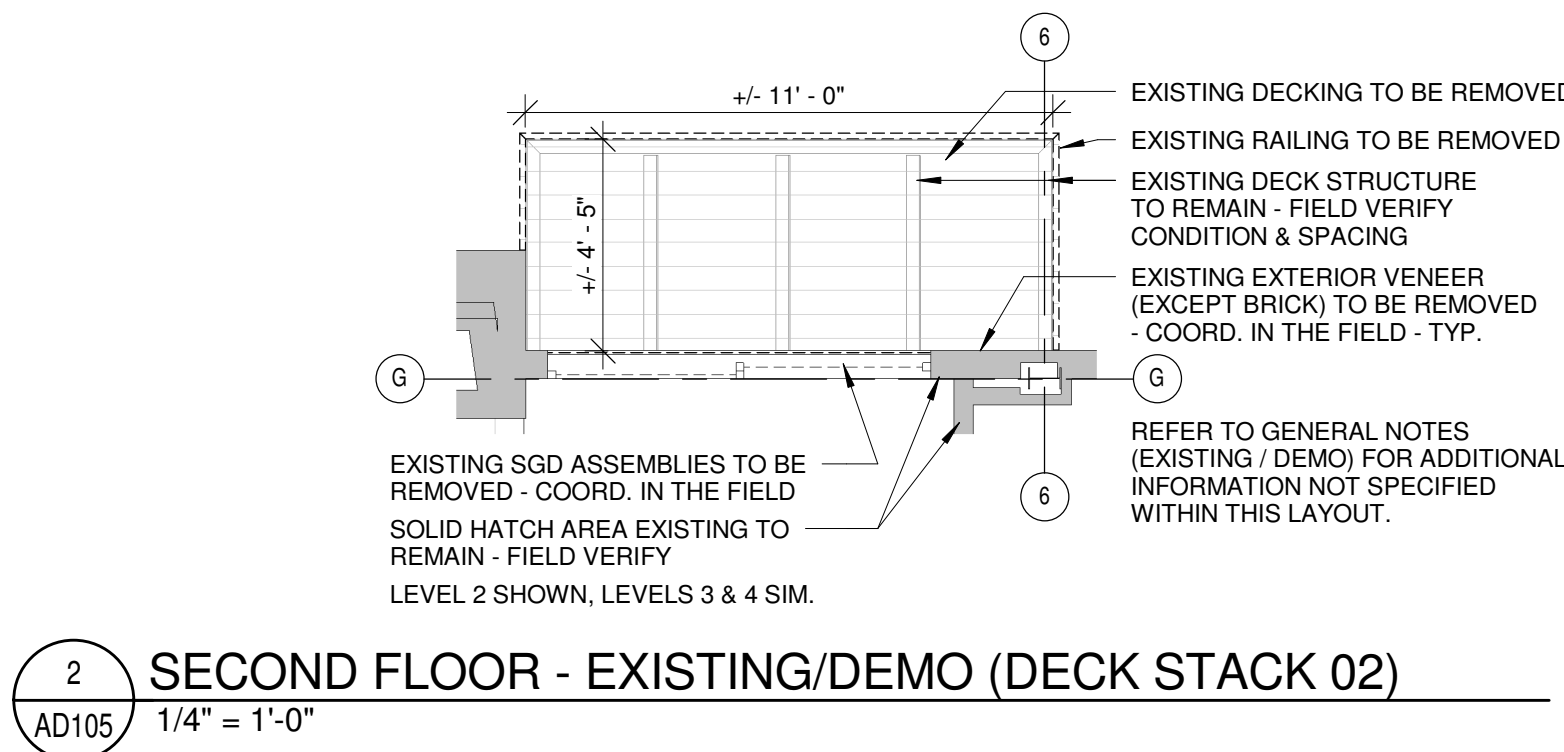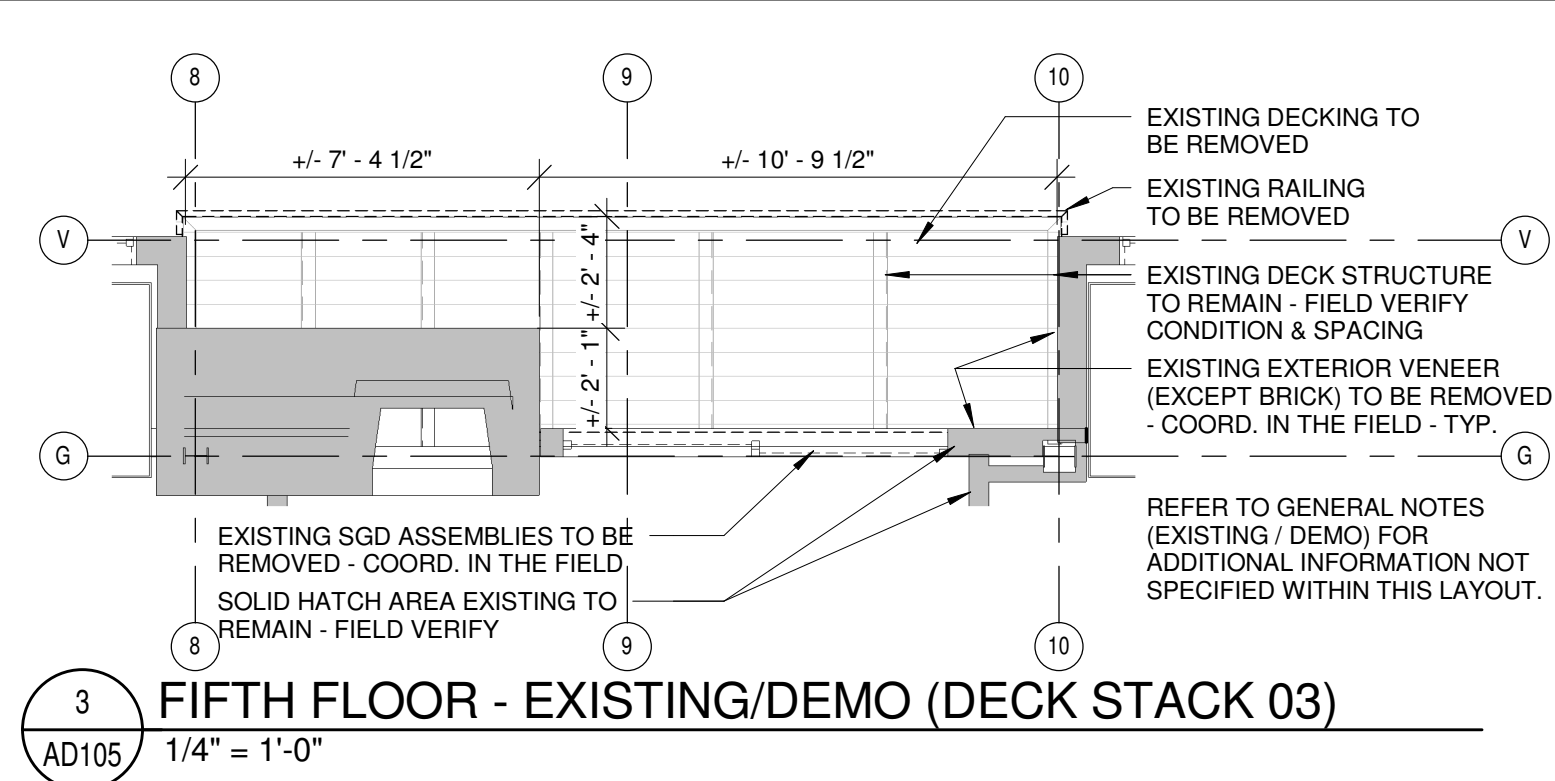

A circular professional engineer seal for the State of Colorado. The outer ring contains the text "STATE OF COLORADO" at the top and "LICENSED ENGINEER" at the bottom, separated by two stars. The center of the seal contains the name "ERIC R. SMITH" and the license number "8-1112". A handwritten signature is scrawled across the center, and the date "3/20/19" is handwritten below the license number.

All design, documents and data prepared by Eric Smith Associates, P.C. as instruments of service shall remain property of Eric Smith Associates, P.C. and shall not be copied, changed or disclosed in any form whatsoever without first obtaining the express written consent of Eric Smith Associates, P.C.

Eric Smith Associates, P.C.



[illegible]

BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, COLORADO




Job Number:	17022
Date:	2018-11-09
Drawn By:	Author
Checked By:	Checker


Project Phase
PERMIT REVIEW
Sheet Title
EXISTING/DEMO - EXTERIOR DECKS
Sheet Number
AD105

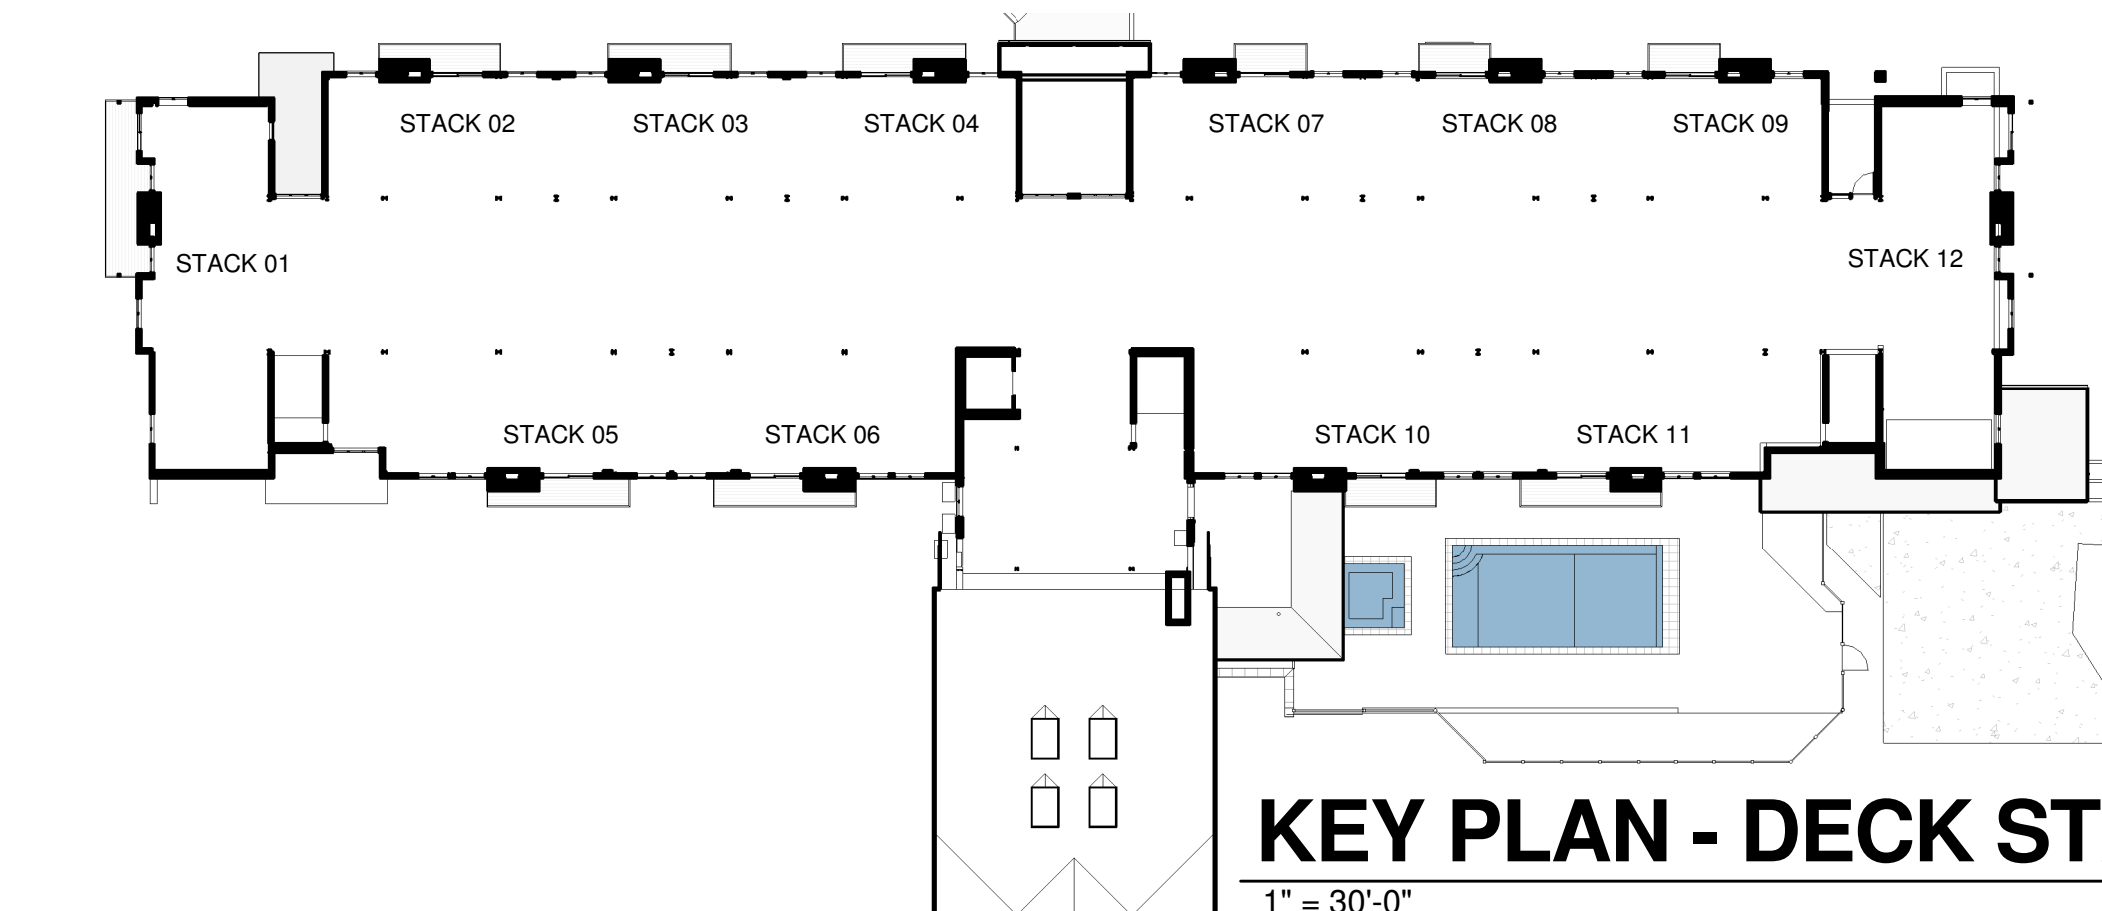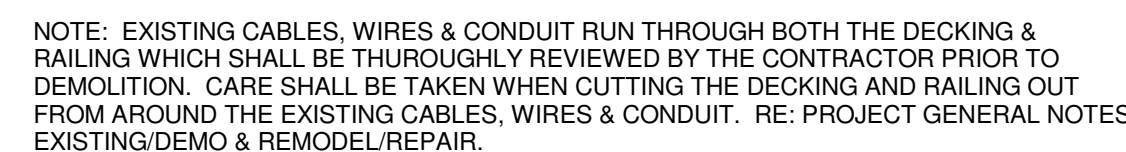

KEY PLAN - DECK STACKS

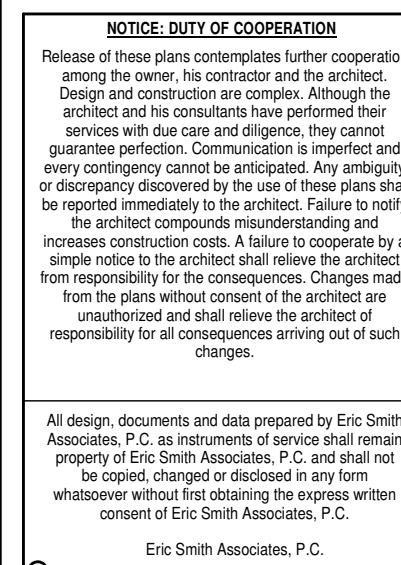[illegible]

BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, COLORADO

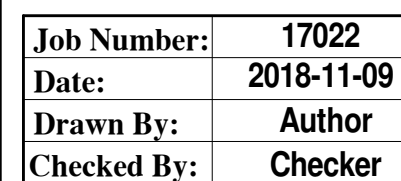


Project Phase
PERMIT REVIEW


Sheet Title
EXISTING/DEMO -

Sheet Number

AD106

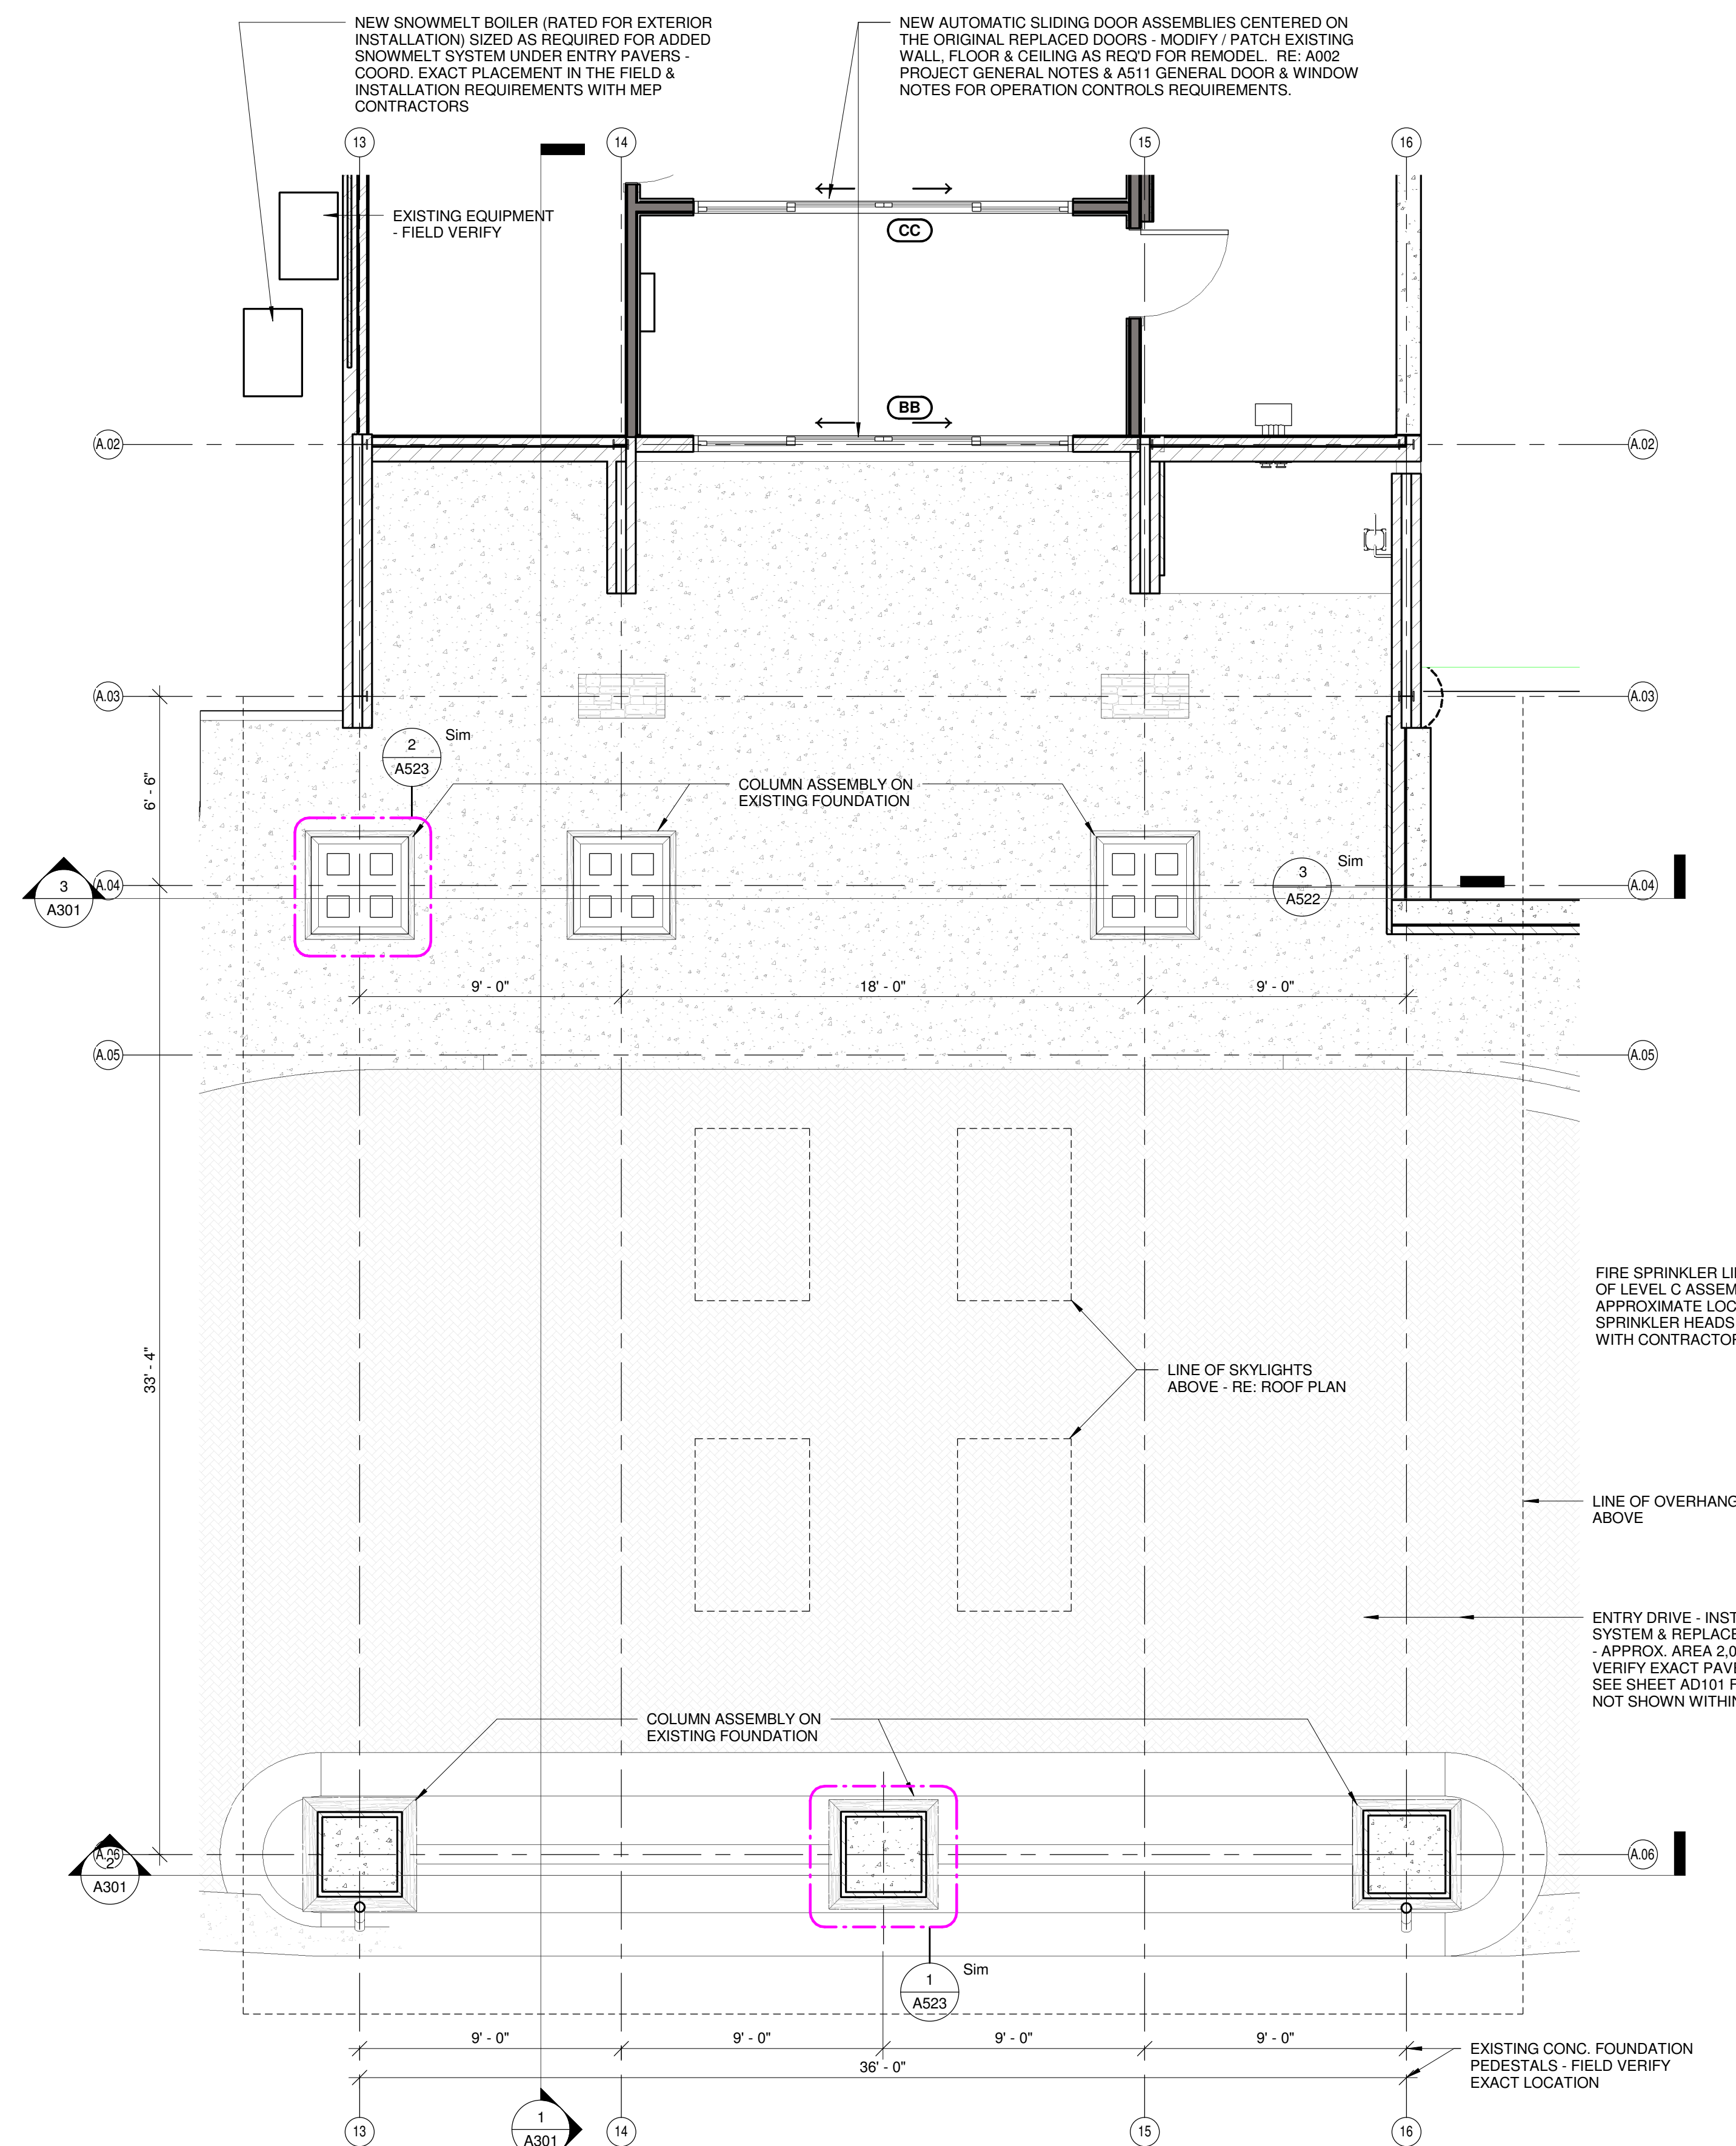

1
A101 02 FIRST LEVEL - REMODEL (PORTE COCHERE)
1/4" = 1'-0"

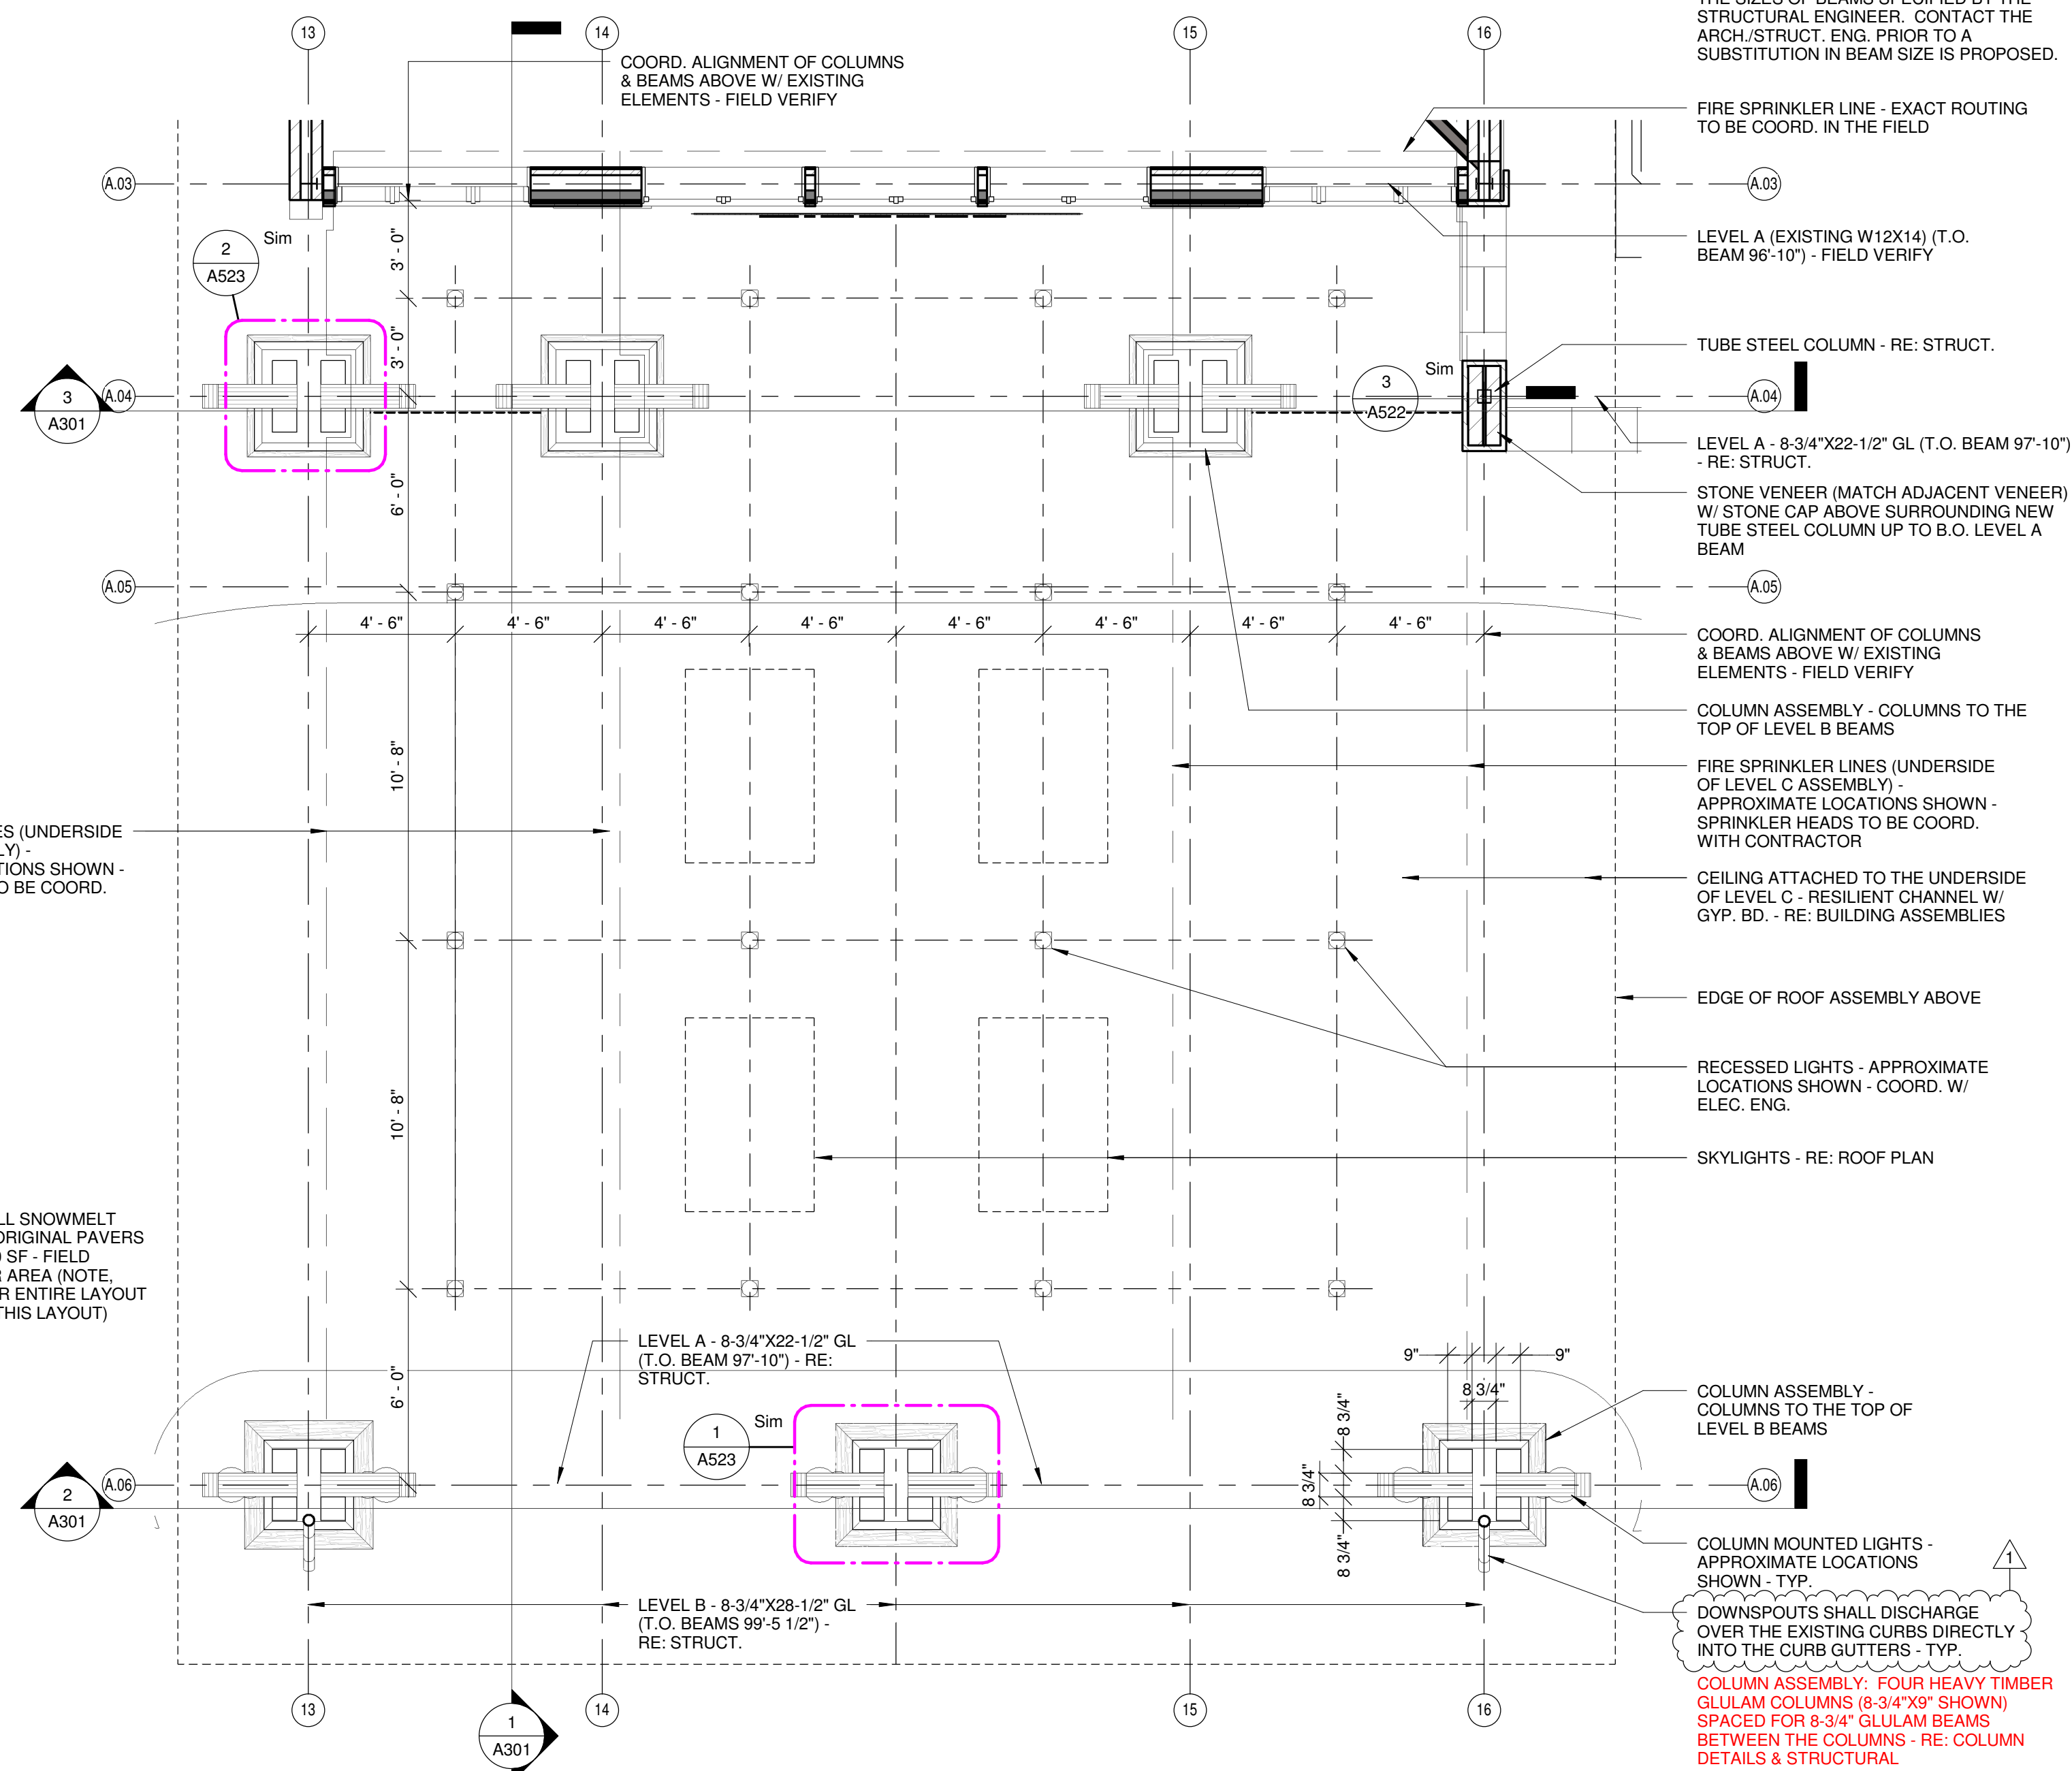

2 SECOND FLOOR
A101 1/4" = 1'-0"

A circular notary seal for Eric R. Smith, a Notary Public in the State of Colorado. The seal features the text "STATE OF COLORADO" at the top and "LICENSED NOTARY PUBLIC" at the bottom. In the center, it reads "ERIC R. SMITH" and "B-11172". The date "3/20/19" is handwritten in the lower center. The seal is stamped over a signature and a blue checkmark.

NOTICE: DUTY OF COOPERATION


Release of these plans constitutes further cooperation among the owner, the contractor and the architect. The design and construction of a complex, although the architect and its consultants have performed their services with due care and diligence, they cannot guarantee perfection. Communication is imperfect and every contingency cannot be anticipated. Any ambiguity or discrepancy discovered by the use of these plans must be reported immediately to the architect. Failure to notify the architect compounds misunderstanding and increases construction costs. A failure to cooperate by simple notice to the architect shall relieve the architect of its responsibility for the use of these plans and the plans without consent of the architect are unauthorized and shall relieve the architect of responsibility for all consequences arising out of such changes.

All design, documents and data prepared by Eric Smith Associates, P.C. as instruments of service shall remain property of Eric Smith Associates, P.C. and shall not be copied, changed or disclosed in any form whatsoever without first obtaining the express written consent of Eric Smith Associates, P.C.

Eric Smith Associates, P.C.


[illegible]

BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, COLORADO

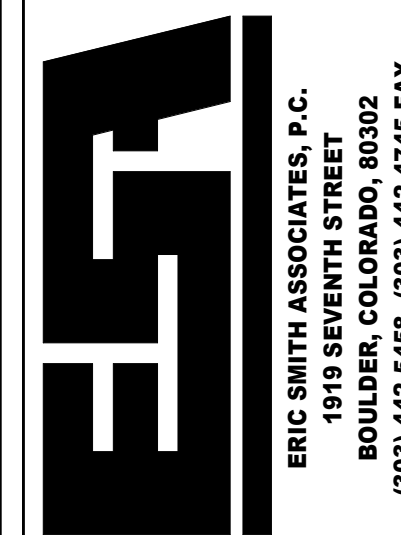


Job Number:	17022
Date:	2018-11-09
Drawn By:	Author
Checked By:	Checker

Project Phase
PERMIT REVIEW
Sheet Title
REMODEL - PORTE-COCHERE
Sheet Number
A101

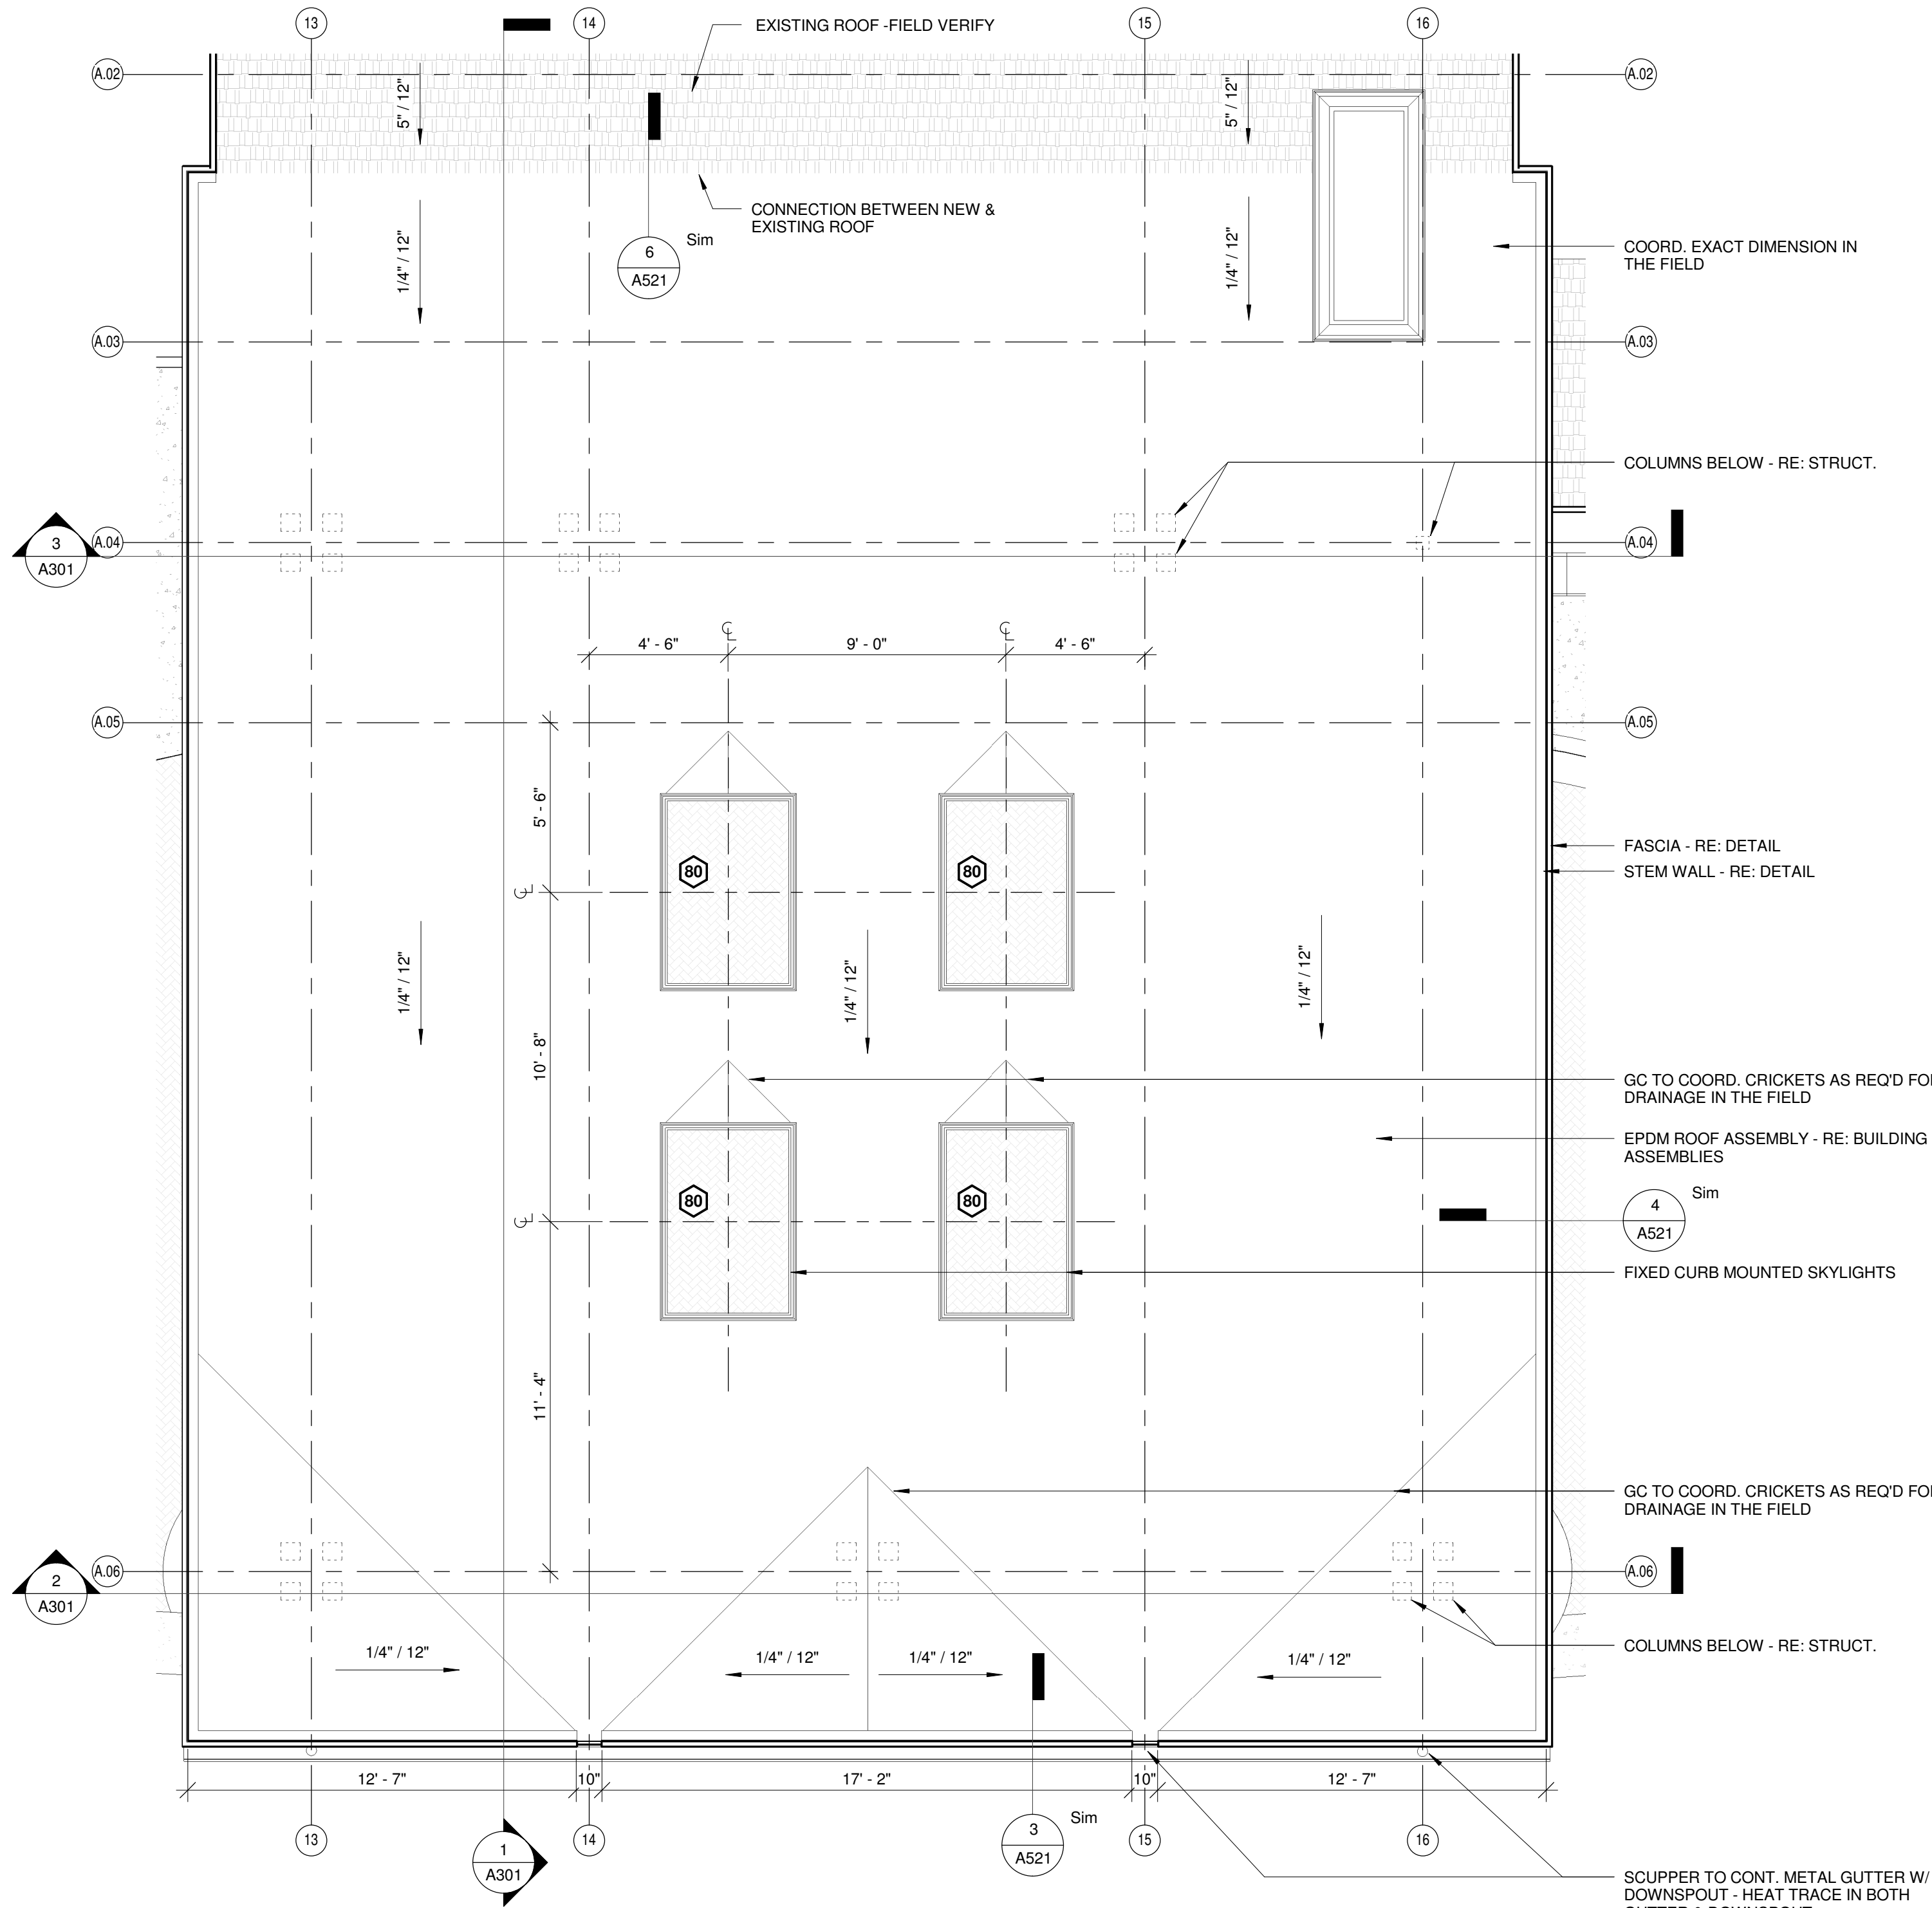

1 ROOF PLAN - REMODEL (PORTE COCHERE)
A102 1/4" = 1'-0"

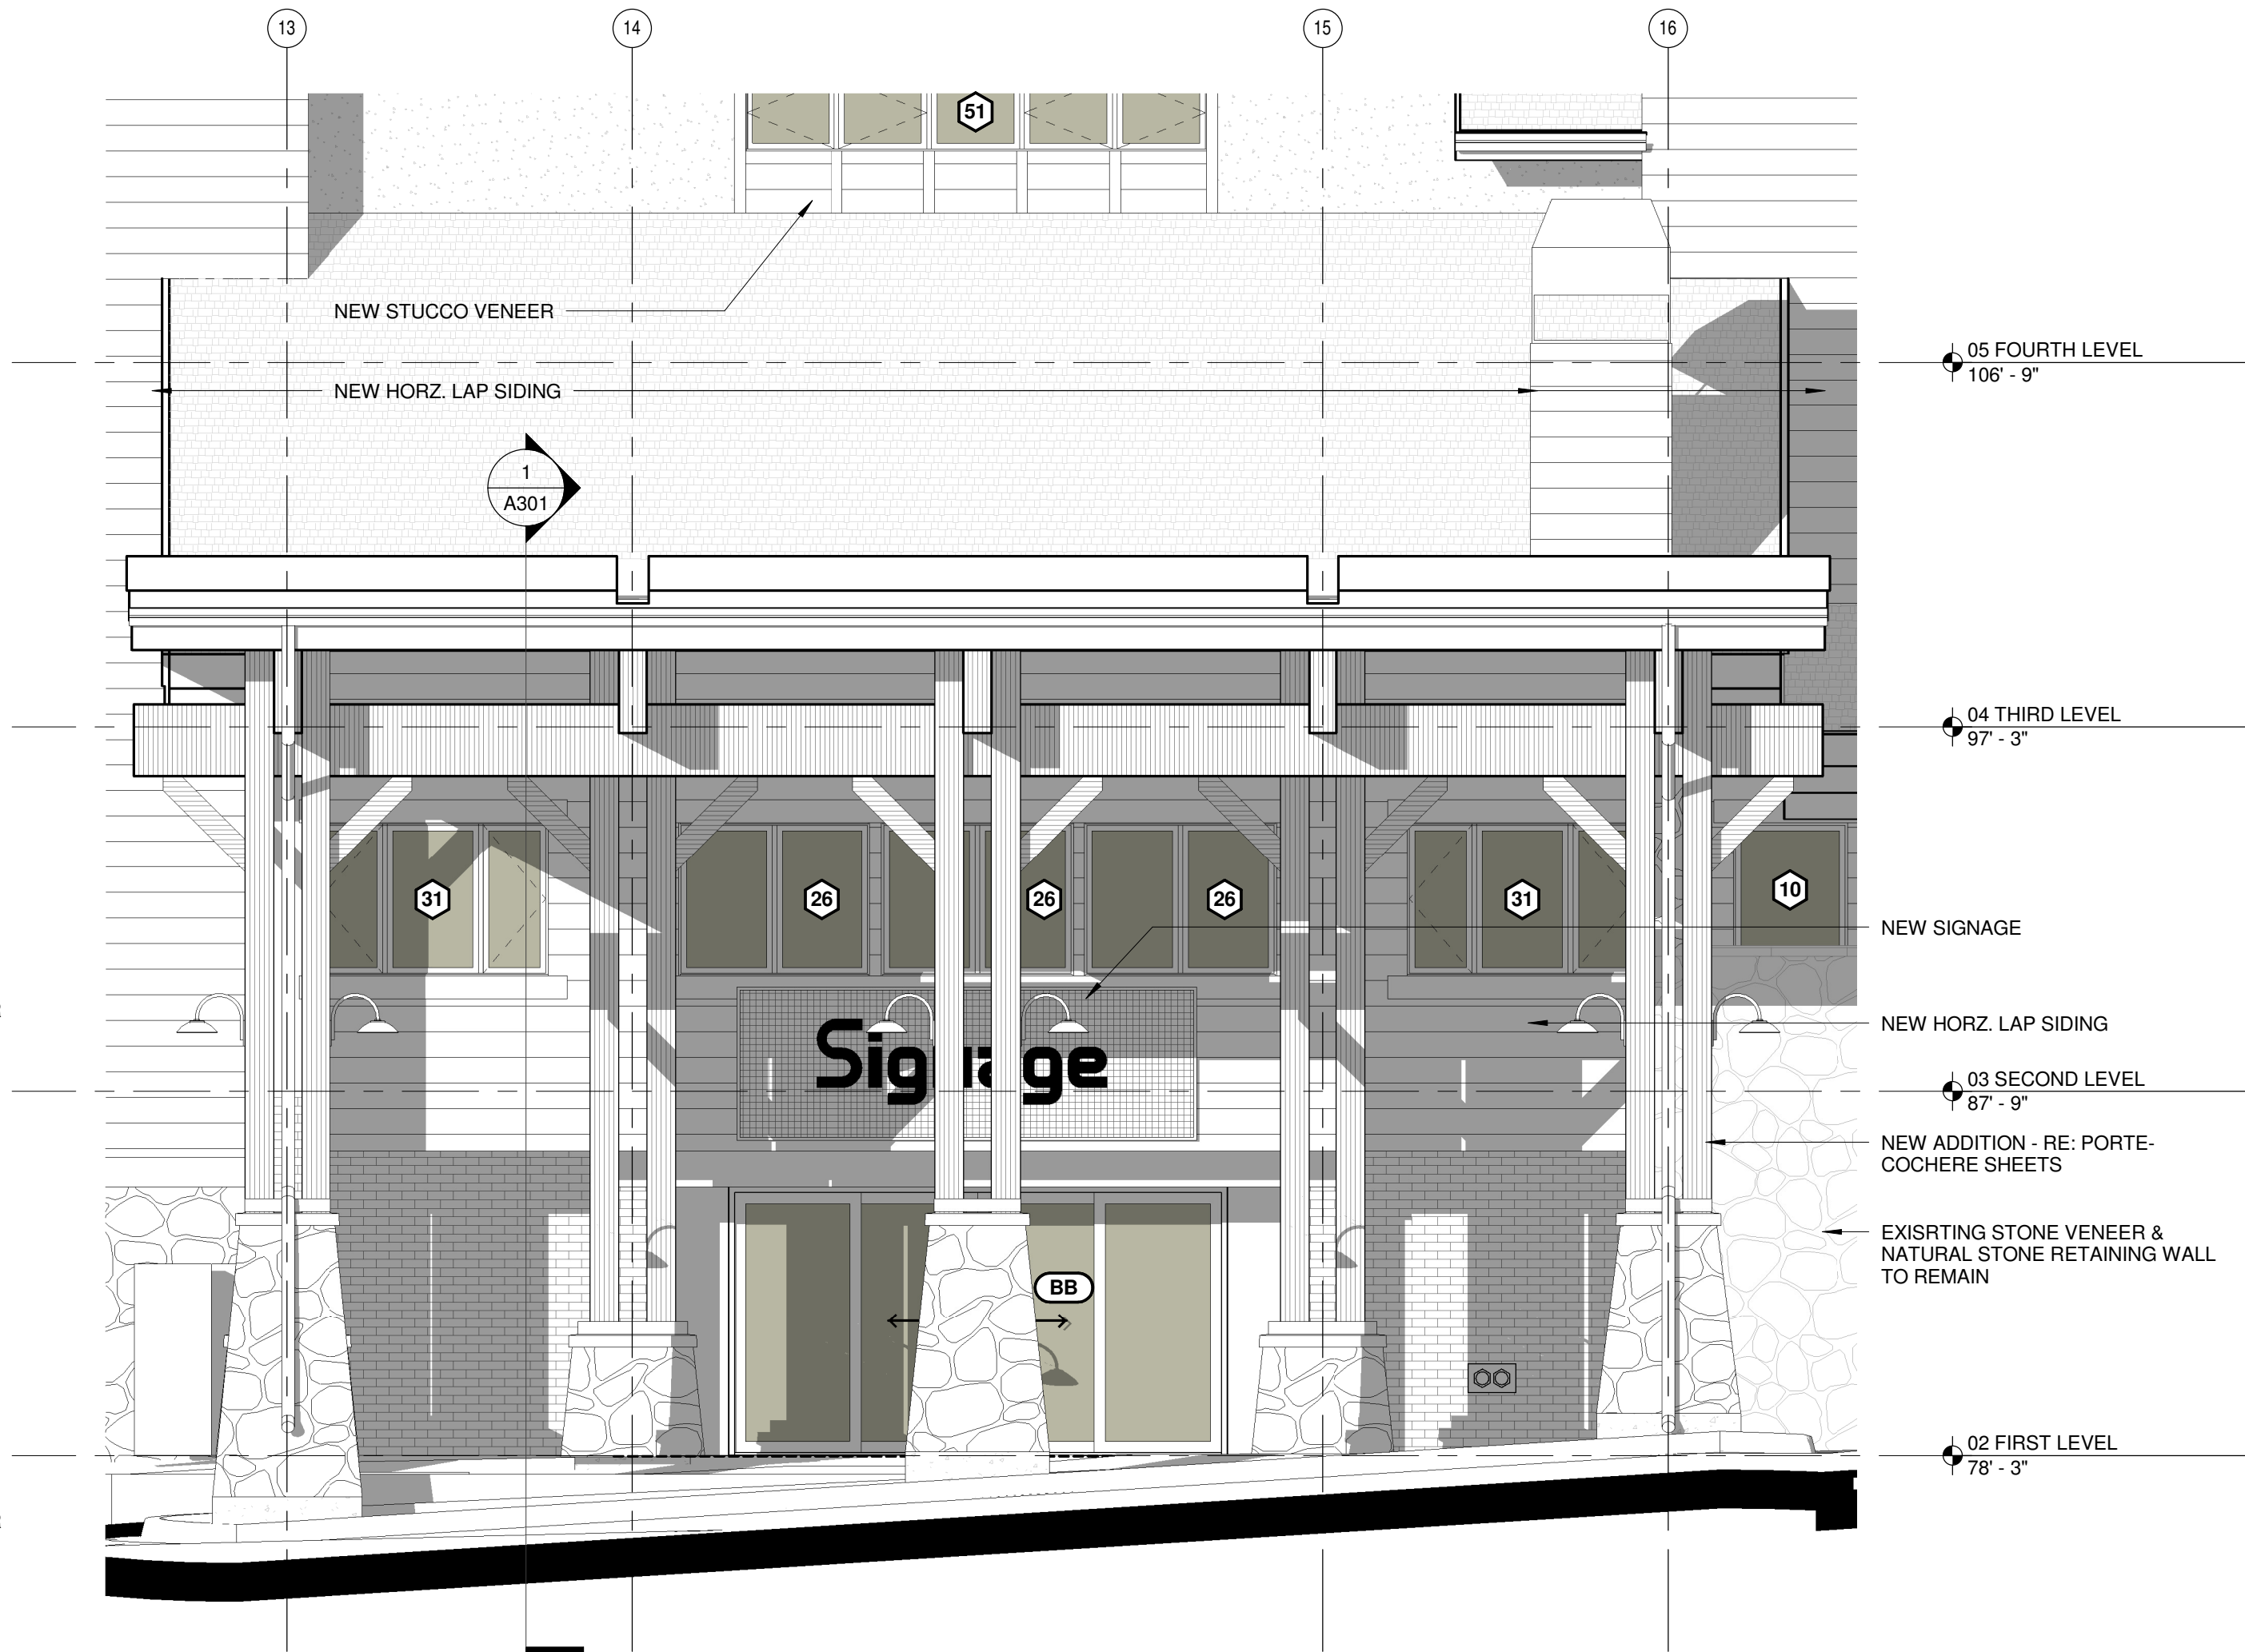

2 SOUTH ELEVATION (PORTE-COCHERE)
A102 1/4" = 1'-0"



NOTICE: DUTY OF COOPERATION
Release of these plans contemplates further cooperation among the owner, its consultant and the architect. Design and construction are complex. Although the architect and his consultants have performed their services with due care and diligence, they cannot guarantee perfection. Communication is imperative and every contingency cannot be anticipated. Any ambiguity or discrepancy discovered by the use of these plans shall be reported immediately to the architect. Failure to notify the architect compounds misunderstanding and increases construction costs. A failure to cooperate by a single entity to the architect shall relieve the architect from responsibility for the consequences. Changes made from the plans without consent of the architect are unauthorized and shall relieve the architect of responsibility for all consequences arising out of such changes.

All design, documents and data prepared by Eric Smith Associates, P.C., as instruments of service shall remain the property of Eric Smith Associates, P.C., and shall not be copied, changed or disclosed in any form whatsoever without first obtaining the express written consent of Eric Smith Associates, P.C.
Eric Smith Associates, P.C.


No.	Description	Date

BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, COLORADO







Job Number: 17022
Date: 2018-11-09
Drawn By: Author
Checked By: Checker

Project Phase
PERMIT REVIEW
Sheet Title
REMODEL -
PORTE-COCHERE ROOF
PLAN / ELEVATION
Sheet Number
A102

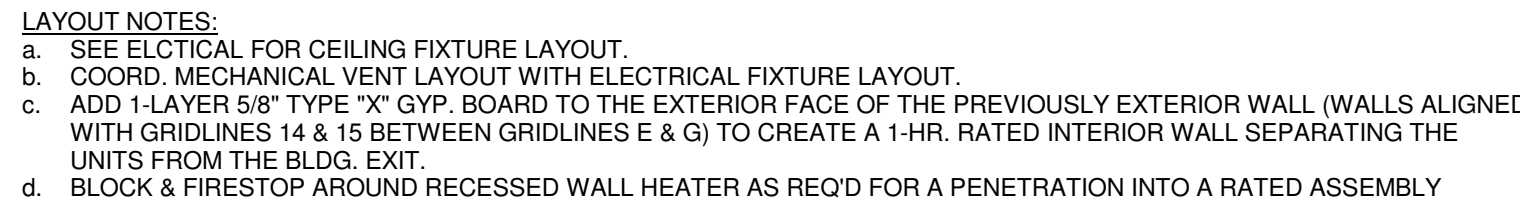

1 SECOND LEVEL - REMODEL (SKI ENTRY)
A103 1/4" = 1'-0"



2STN = 2" INSULATED SHEATHING WITH STONE
1STN = 1" INSULATED SHEATHING WITH STONE
0STN = NO INSULATED SHEATHING UNDER STONE
2STC = 2" INSULATED SHEATHING WITH STUCCO
1STC = 1" INSULATED SHEATHING WITH STUCCO
0STC = NO INSULATED SHEATHING UNDER STUCCO
2HL = 2" INSULATED SHEATHING WITH HORZ. LAP
1HL = 1" INSULATED SHEATHING WITH HORZ. LAP
0HL = NO INSULATED SHEATHING UNDER HORZ. LAP
2VB = 2" INSULATED SHEATHING WITH VERT. B&B
1VB = 1" INSULATED SHEATHING WITH VERT. B&B
0VB = NO INSULATED SHEATHING UNDER VERT. B&B
EB = EXISTING BRICK TO REMAIN
ESTN = EXISTING STONE

- a. 2" INSULATION REFERS TO R-12.6 INSULATED SHEATHING
- b. 1" INSULATION REFERS TO R-6.6 INSULATED SHEATHING
- c. SEE BUILDING ASSEMBLY NOTES (SHEET A501) FOR ADDITIONAL INFORMATION RELATED TO THE INSULATED SHEATHING





[illegible]

BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, COLORADO


EF


ERIC SMITH ASSOCIATES, P.C.
1919 SEVENTH STREET
BOULDER, COLORADO, 80302
(303) 442-5458, (303) 442-4745 FAX

Project Phase
PERMIT REVIEW
Sheet Title
REMODEL - SKI ENTRY & BLDG. ENTRIES
Sheet Number
A103

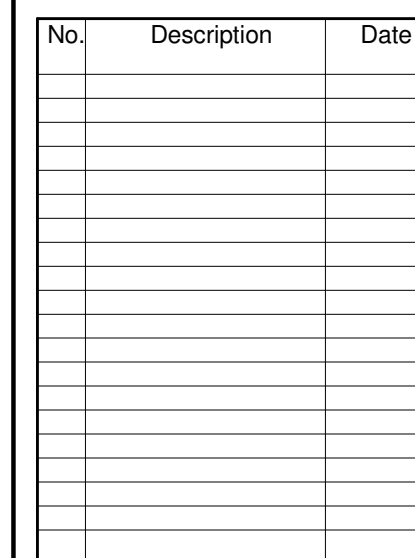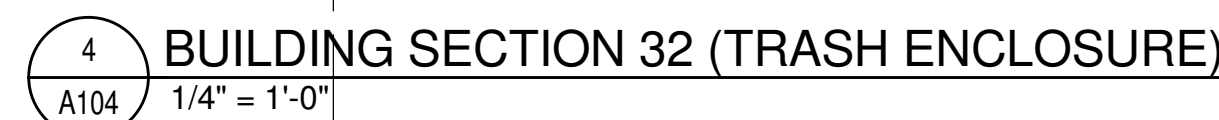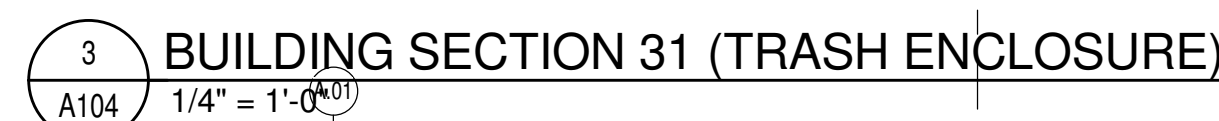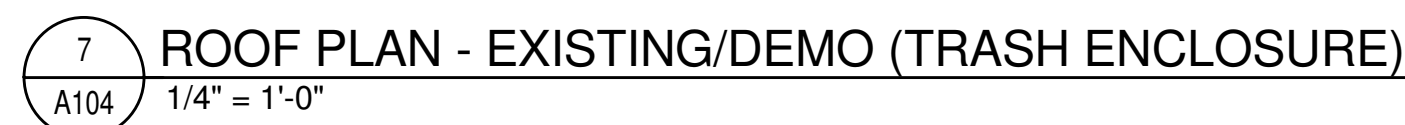

BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, COLORADO

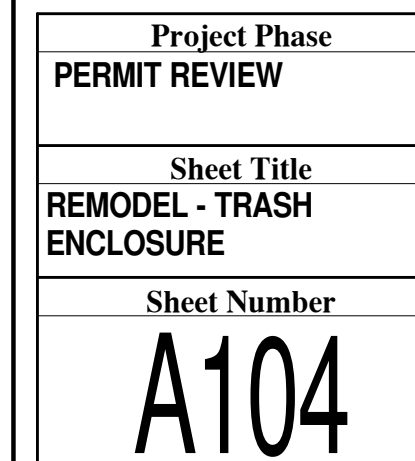

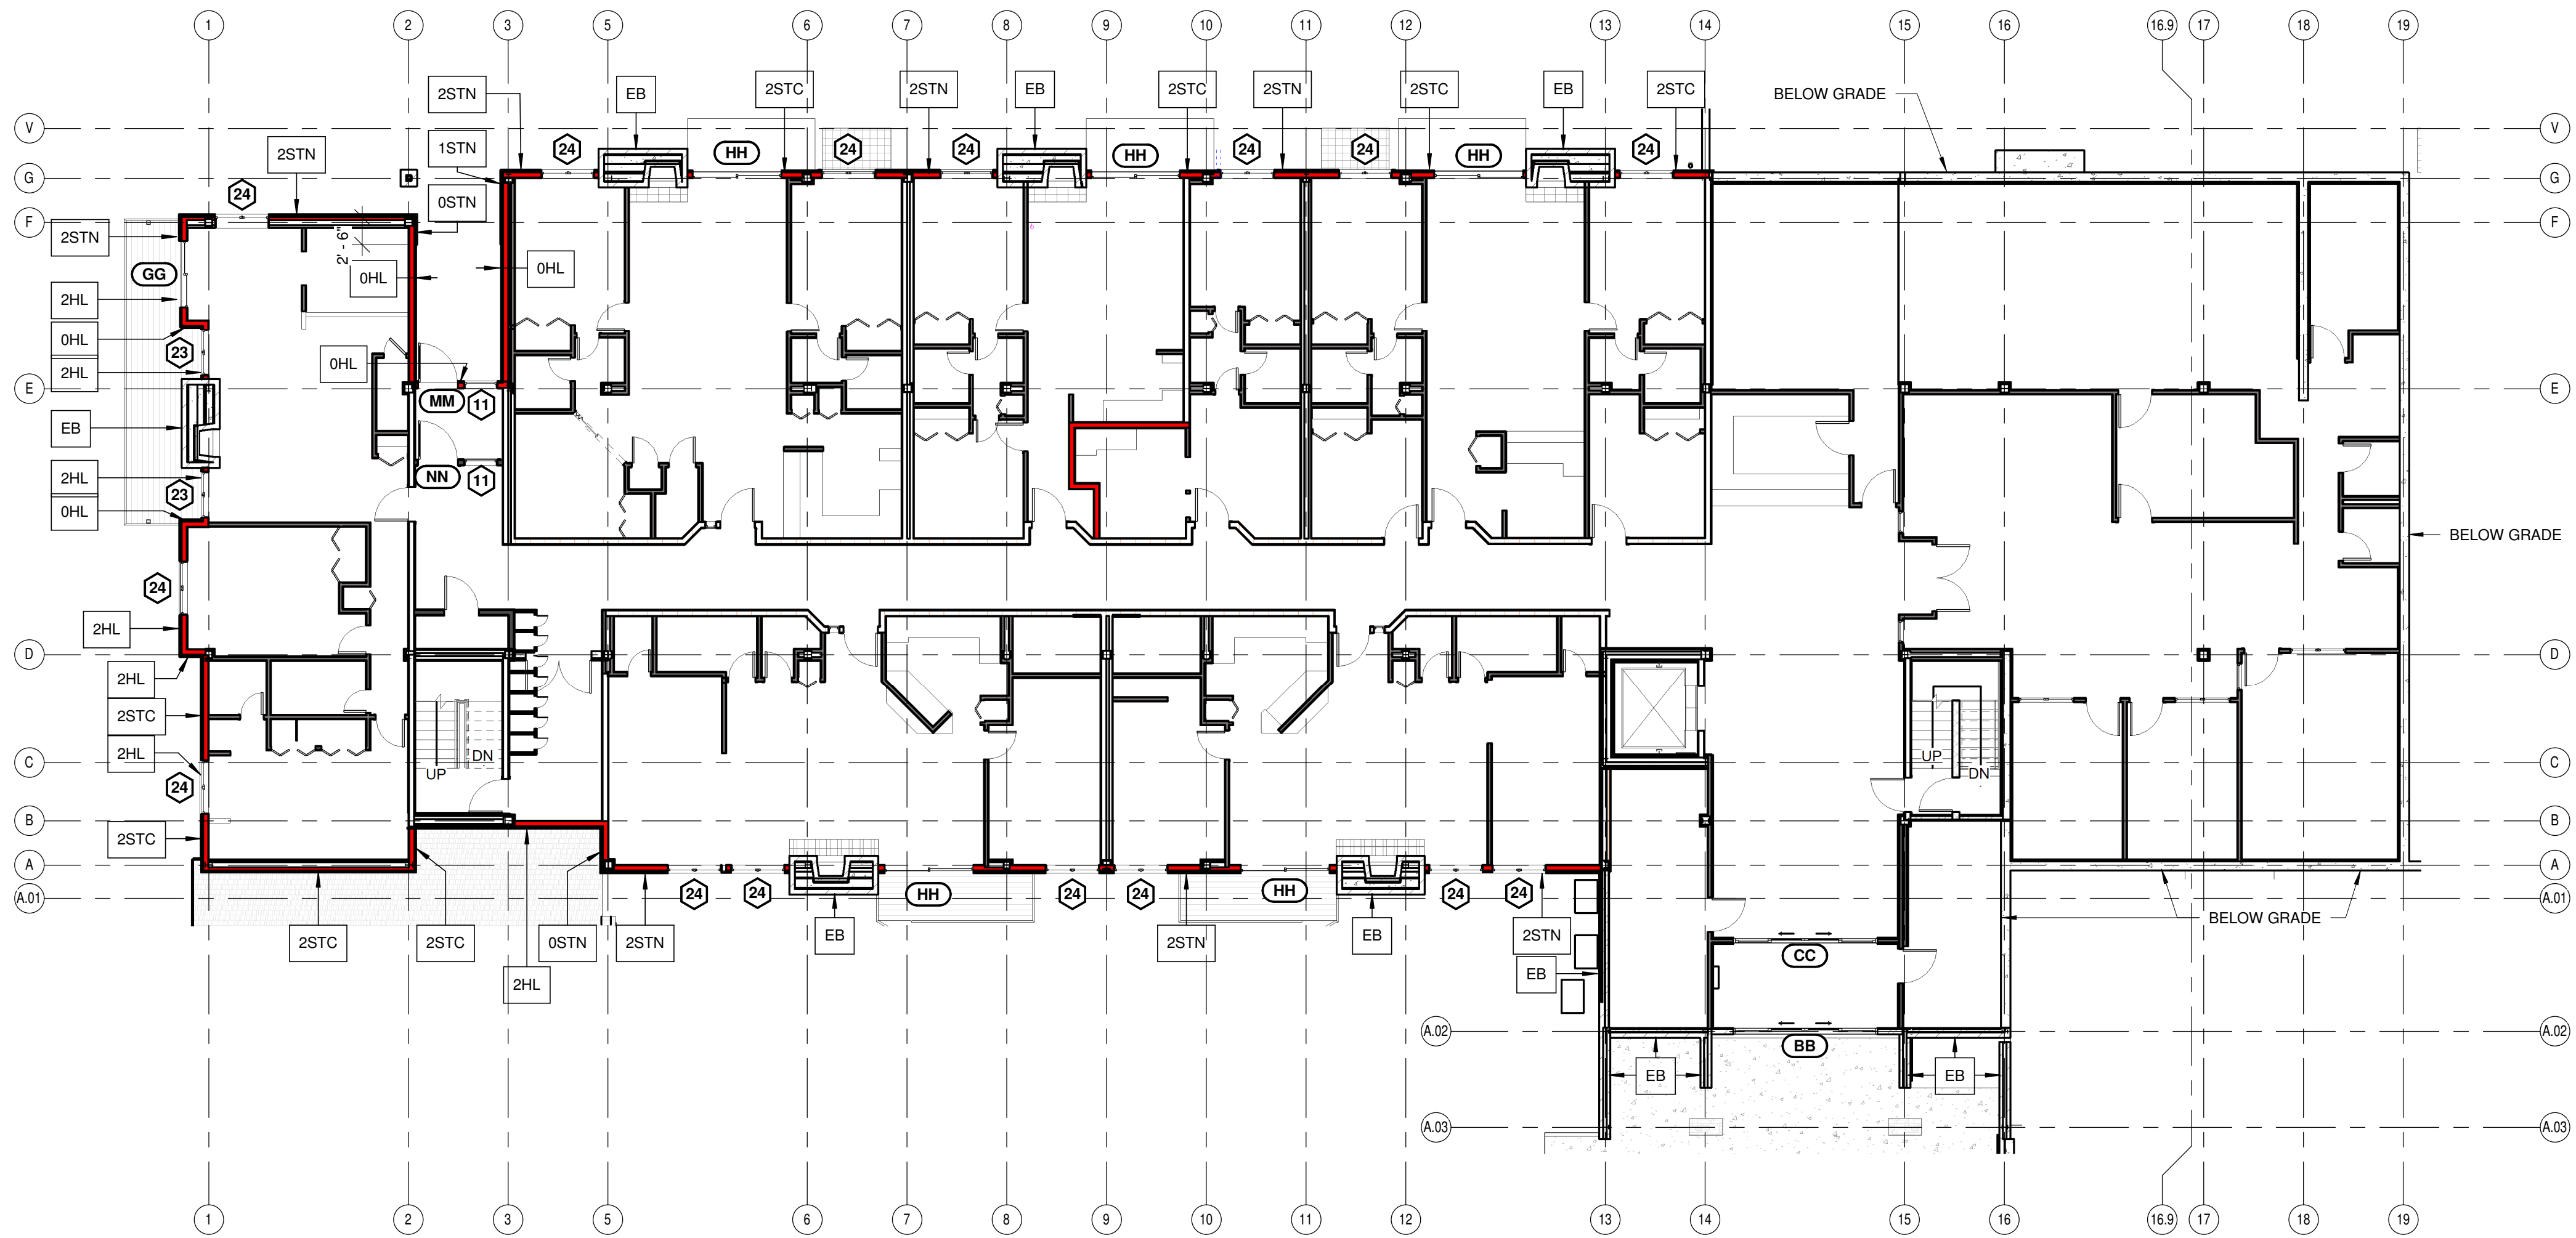

1 FIRST FLOOR - BUILDING LAYOUT
A111 $\frac{3}{32}'' = 1'-0''$


INSULATED SHEATHING LEGEND (BUILDING LAYOUTS):

2STN = 2" INSULATED SHEATHING WITH STONE
1STN = 1" INSULATED SHEATHING WITH STONE
0STN = NO INSULATED SHEATHING UNDER STONE
2STC = 2" INSULATED SHEATHING WITH STUCCO
1STC = 1" INSULATED SHEATHING WITH STUCCO
0STC = NO INSULATED SHEATHING UNDER STUCCO
2HL = 2" INSULATED SHEATHING WITH HORZ. LAP
1HL = 1" INSULATED SHEATHING WITH HORZ. LAP
0HL = NO INSULATED SHEATHING UNDER HORZ. LAP
2VBV = 2" INSULATED SHEATHING WITH VERT. B&B
1VBV = 1" INSULATED SHEATHING WITH VERT. B&B
0VBV = NO INSULATED SHEATHING UNDER VERT. B&B
EB = EXISTING BRICK TO REMAIN
ESTN = EXISTING STONE

GENERAL NOTE:

- a. 2" INSULATION REFERS TO R-12.6 INSULATED SHEATHING
- b. 1" INSULATION REFERS TO R-6.6 INSULATED SHEATHING
- c. SEE BUILDING ASSEMBLY NOTES (SHEET A501) FOR ADDITIONAL INFORMATION RELATED TO THE INSULATED SHEATHING

DATE: 2019-03-29 PERMIT REVIEW

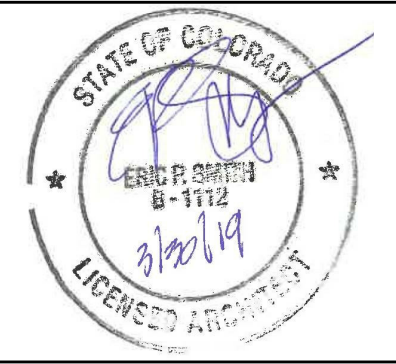


NOTICE: DUTY OF COOPERATION

Release of the plans contemplates further cooperation among the owner, his contractor and the architect. Design and construction are complex. Although the architect and his consultants have performed their services with due care and diligence, they cannot guarantee perfection. Communication is imperfect and every contingency cannot be anticipated. Any ambiguity or discrepancy discovered by the use of these plans shall be reported immediately to the architect. Failure to notify the architect compounds misunderstanding and increases construction costs. A failure to cooperate by a simple notice to the architect shall relieve the architect from responsibility for the consequences. Changes made from the plans without consent of the architect are unauthorized and shall relieve the architect of responsibility for all consequences arising out of such changes.

All design, documents and data prepared by Eric Smith Associates, P.C. as instruments of service shall remain property of Eric Smith Associates, P.C. and shall not be copied, changed or disclosed in any form whatsoever without first obtaining the express written consent of Eric Smith Associates, P.C.

[illegible]

BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, COLORADO

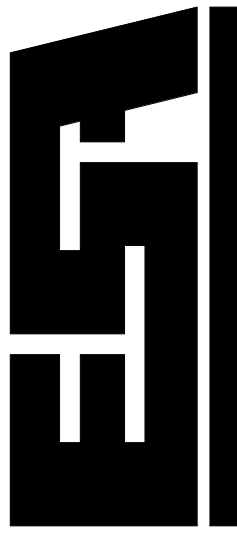


ERIC SMITH ASSOCIATES, P.C.
1919 SEVENTH STREET
BOULDER, COLORADO, 80302
(303) 442-5458, (303) 442-4745 FAX



Job Number:	17022
Date:	2018-11-09
Drawn By:	Author
Checked By:	Checker

Project Phase
PERMIT REVIEW
Sheet Title
FIRST FLOOR BUILDING LAYOUTS

Sheet Number
A111

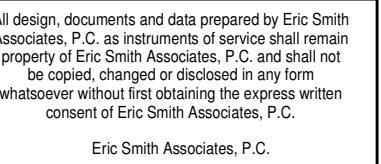


BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, COLORADO

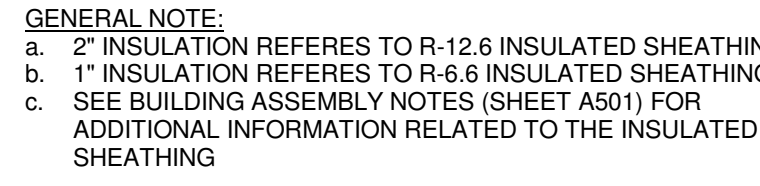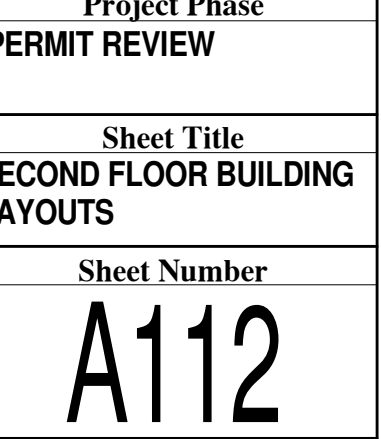

3/29/2019 2:07:31 PM 17022 BEARCLAW II SET_R16

DATE: 2019-03-29 PERMIT REVIEW

JOB CODE & REVIT FILE: 17022 - Bear Claw II CD Set_R16.m

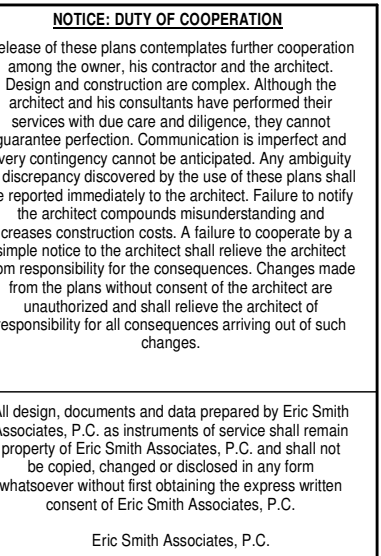
[illegible]

BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, COLORADO



Job Number:	17022
Date:	2018-11-09
Drawn By:	Author
Checked By:	Checker

Project Phase
PERMIT REVIEW
Sheet Title
THIRD FLOOR BUILDING LAYOUTS
Sheet Number
A113

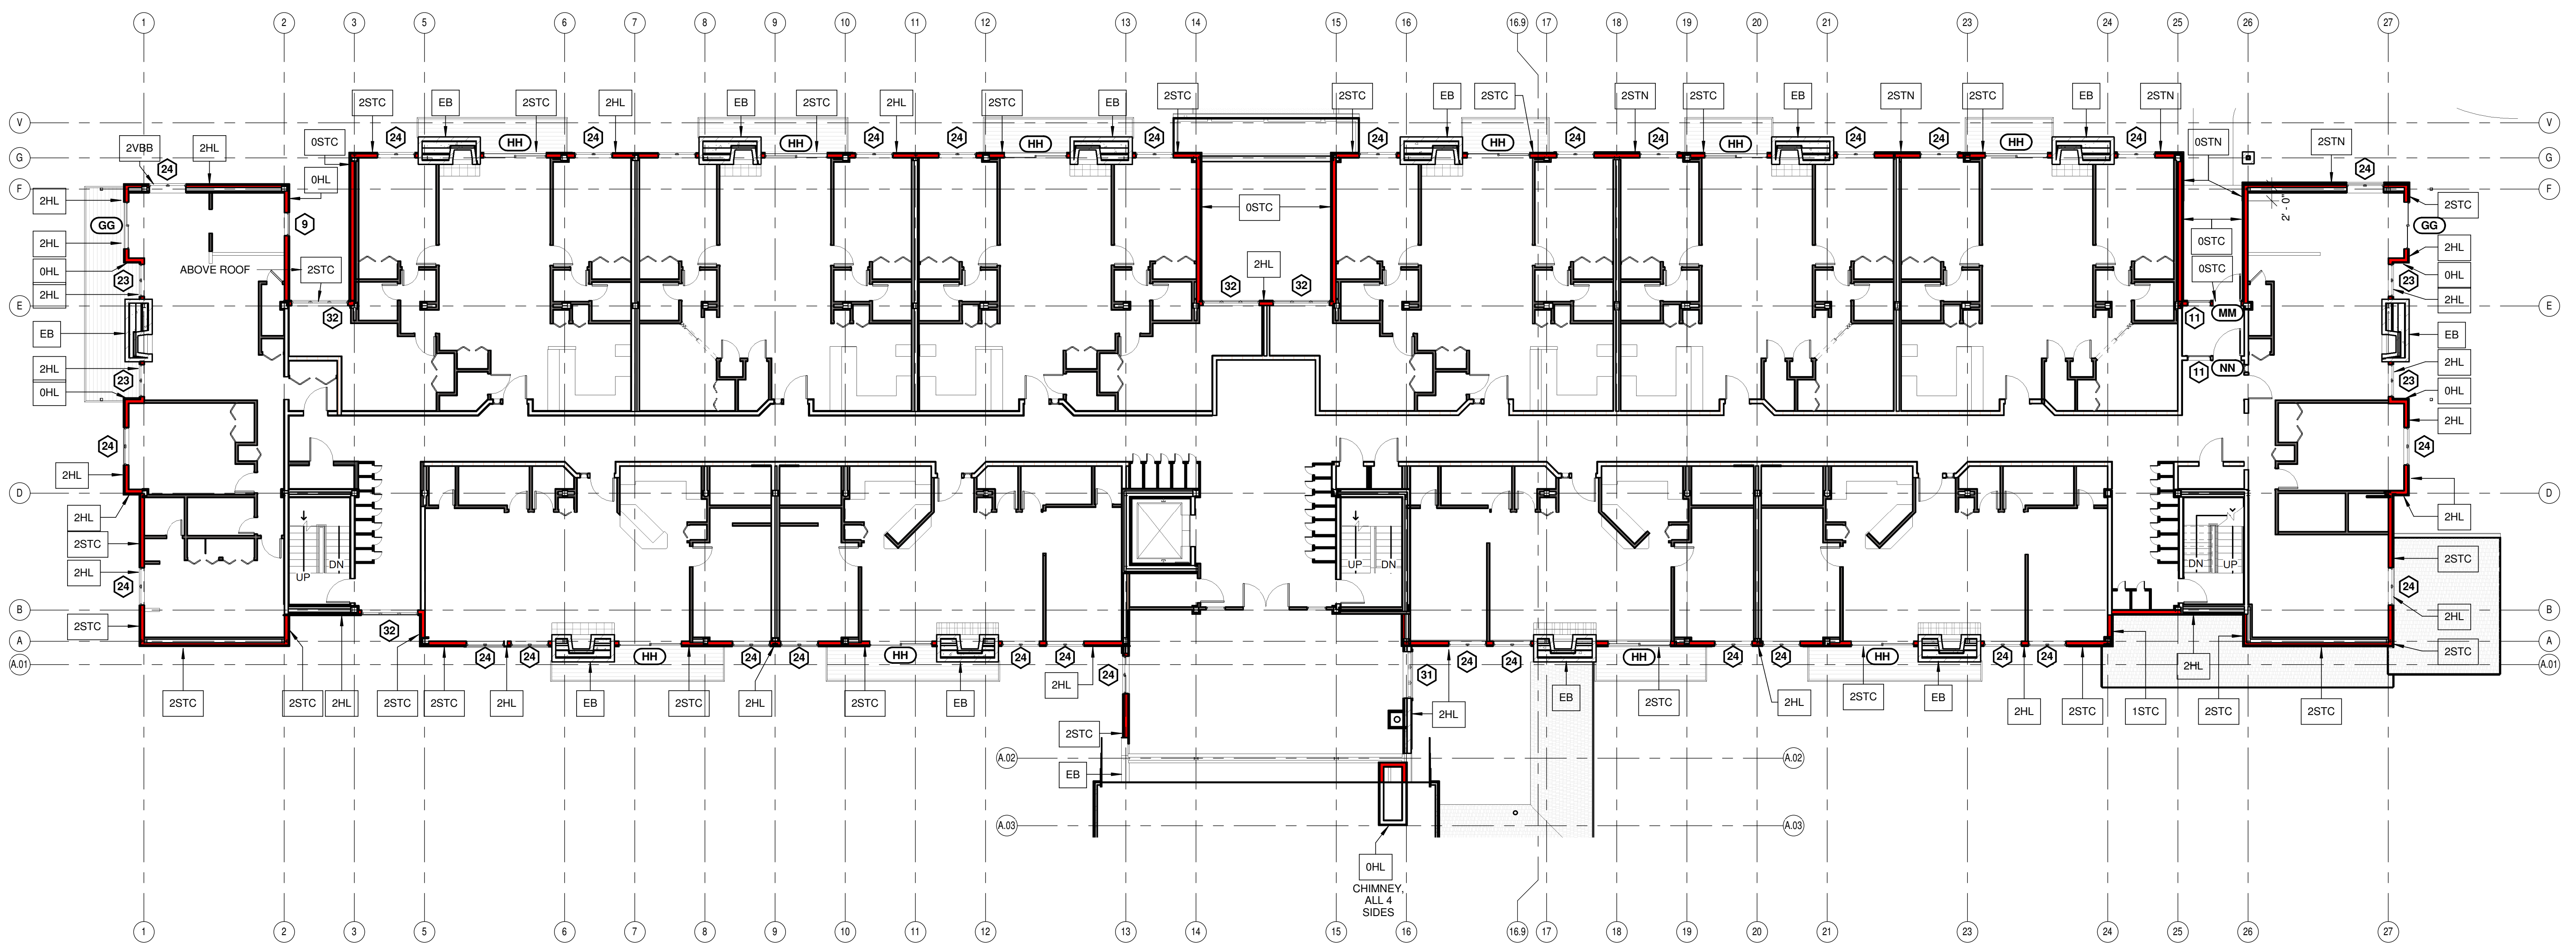

1 THIRD FLOOR - BUILDING LAYOUT
A113 $3/32" = 1'-0"$

INSULATED SHEATHING LEGEND (BUILDING LAYOUTS):


2STN	= 2" INSULATED SHEATHING WITH STONE
1STN	= 1" INSULATED SHEATHING WITH STONE
2STC	= 2" INSULATED SHEATHING WITH STUCCO
1STC	= 1" INSULATED SHEATHING WITH STUCCO
0STC	= NO INSULATED SHEATHING UNDER STUCCO
2HL	= 2" INSULATED SHEATHING WITH HORZ. LAP
1HL	= 1" INSULATED SHEATHING WITH HORZ. LAP
0HL	= NO INSULATED SHEATHING UNDER HORZ. LAP
2VB	= 2" INSULATED SHEATHING WITH VERT. B.&B
1VB	= 1" INSULATED SHEATHING WITH VERT. B.&B
0VB	= NO INSULATED SHEATHING UNDER VERT. B.&B
EB	= EXISTING BRICK TO REMAIN
ESTN	= EXISTING STONE

GENERAL NOTE:


- a. 2" INSULATION REFERS TO R-12.6 INSULATED SHEATHING
- b. 1" INSULATION REFERS TO R-6.6 INSULATED SHEATHING
- c. SEE BUILDING ASSEMBLY NOTES (SHEET A501) FOR ADDITIONAL INFORMATION RELATED TO THE INSULATED SHEATHING

DATE: 2019-03-29 PERMIT REVIEW

JOB CODE & REVIT FILE: 17022 - Bear Claw II CD Set_R16.m

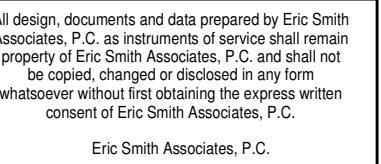
[illegible]

BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, COLORADO

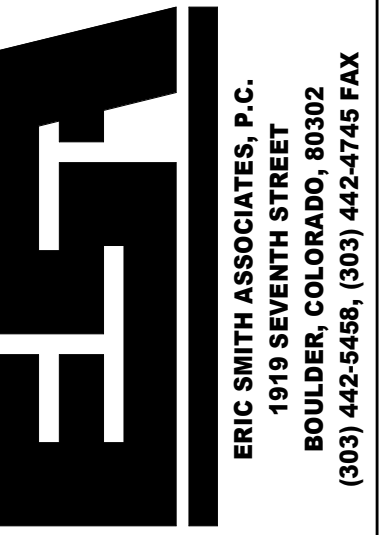

Job Number:	17022
Date:	2018-11-09
Drawn By:	Author
Checked By:	Checker

Project Phase	PERMIT REVIEW
Sheet Title	FOURTH FLOOR BUILDING LAYOUTS
Sheet Number	A114

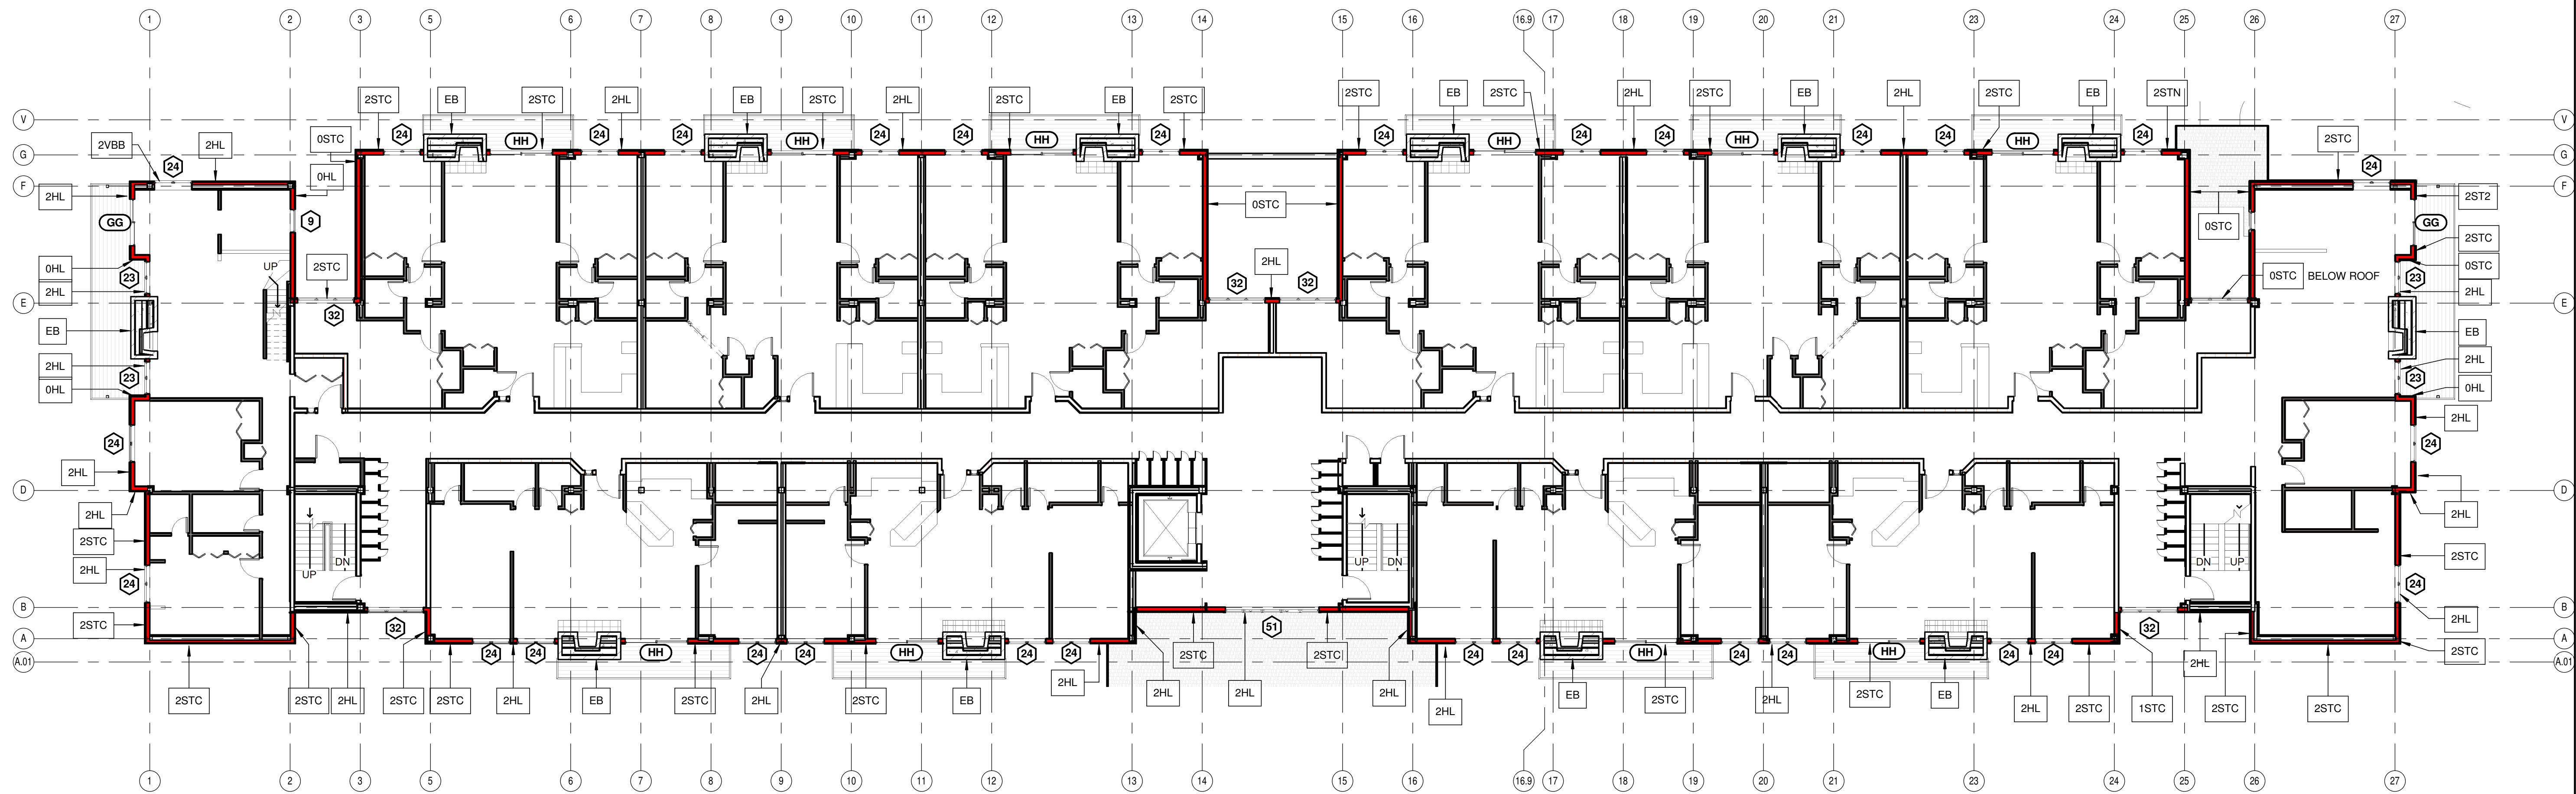

1 FOURTH FLOOR - BUILDING LAYOUT
A114 3/32" = 1'-0"

INSULATED SHEATHING LEGEND (BUILDING LAYOUTS):

25TN = 2" INSULATED SHEATHING WITH STONE
15TN = 1" INSULATED SHEATHING WITH STONE
05TN = 0" INSULATED SHEATHING UNDER STONE
25ST = 2" INSULATED SHEATHING WITH STUCCO
15ST = 1" INSULATED SHEATHING WITH STUCCO
05ST = 0" INSULATED SHEATHING UNDER STUCCO
2HL = 2" INSULATED SHEATHING WITH HORZ. LAP
1HL = 1" INSULATED SHEATHING WITH HORZ. LAP
0HL = 0" INSULATED SHEATHING UNDER HORZ. LAP
2VB = 2" INSULATED SHEATHING WITH VERT. B&B
1VB = 1" INSULATED SHEATHING WITH VERT. B&B
0VB = 0" INSULATED SHEATHING UNDER VERT. B&B
EB = EXISTING BRICK TO REMAIN
ESTN = EXISTING STONE


GENERAL NOTE:

- a. 2" INSULATION REFERS TO R-12.6 INSULATED SHEATHING
- b. 1" INSULATION REFERS TO R-6.6 INSULATED SHEATHING
- c. SEE BUILDING ASSEMBLY NOTES (SHEET A501) FOR ADDITIONAL INFORMATION RELATED TO THE INSULATED SHEATHING


DATE: 2019-03-29 PERMIT REVIEW

3/29/2019 2:08:11 PM 17022 BEAR CLAW II SET_R16

JOB CODE & REVIT FILE: 17022 - Bear Claw II CD Set R16.rvt

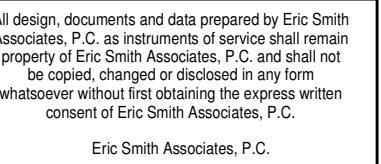


BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, COLORADO

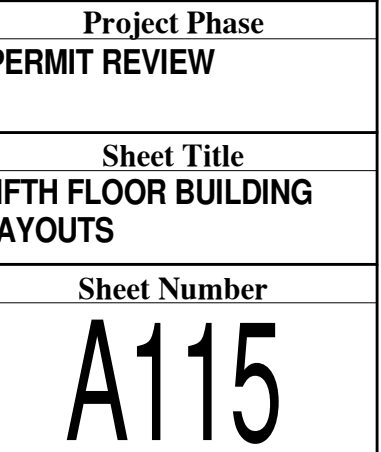

1STN =2' INSULATED SHEATHING WITH STONE
 1STN =2' INSULATED SHEATHING WITH STONE
 0STN =NO INSULATED SHEATHING UNDER STONE
 2STC =2' INSULATED SHEATHING WITH STUCCO
 1STC =1' INSULATED SHEATHING WITH STUCCO
 0STC =NO INSULATED SHEATHING UNDER STUCCO
 2HL =2' INSULATED SHEATHING WITH HORZ. LAP
 1HL =1' INSULATED SHEATHING WITH HORZ. LAP
 0HL =NO INSULATED SHEATHING UNDER HORZ. LAP
 2VB8 =2' INSULATED SHEATHING WITH VERT. B&B
 1VB8 =1' INSULATED SHEATHING WITH VERT. B&B
 0VB8 =NO INSULATED SHEATHING UNDER VERT. B&B
 EB =EXISTING BRICK TO REMAIN
 ESTN =EXISTING STONE

GENERAL NOTE:


- a. 2" INSULATION REFERS TO R-12.6 INSULATED SHEATHING
- b. 1" INSULATION REFERS TO R-6.6 INSULATED SHEATHING
- c. SEE BUILDING ASSEMBLY NOTES (SHEET A501) FOR ADDITIONAL INFORMATION RELATED TO THE INSULATED SHEATHING



2STN	= 2" INSULATED SHEATHING WITH STONE
1STN	= 1" INSULATED SHEATHING WITH STONE
0STN	= NO INSULATED SHEATHING UNDER STONE
2STC	= 2" INSULATED SHEATHING WITH STUCCO
1STC	= 1" INSULATED SHEATHING WITH STUCCO
0STC	= NO INSULATED SHEATHING UNDER STUCCO
2HL	= 2" INSULATED SHEATHING WITH HORIZ. LAP
1HL	= 1" INSULATED SHEATHING WITH HORIZ. LAP
0HL	= NO INSULATED SHEATHING UNDER HORIZ. LAP
2VB	= 2" INSULATED SHEATHING WITH VERT. B&B
1VB	= 1" INSULATED SHEATHING WITH VERT. B&B
0VB	= NO INSULATED SHEATHING UNDER VERT. B&B
EB	= EXISTING BRICK TO REMAIN
ESTN	= EXISTING STONE



GENERAL NOTE:

- a. 2" INSULATION REFERS TO R-12.6 INSULATED SHEATHING
- b. 1" INSULATION REFERS TO R-6.6 INSULATED SHEATHING
- c. SEE BUILDING ASSEMBLY NOTES (SHEET A501) FOR ADDITIONAL INFORMATION RELATED TO THE INSULATED SHEATHING

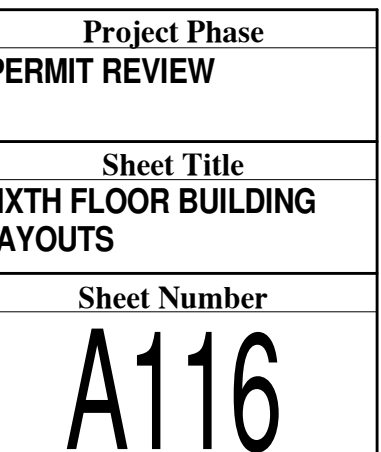

DATE: 2019-03-29 PERMIT REVIEW

JOB CODE & REVIT FILE: 17022 - Bear Claw II CD Set_R16.rvt

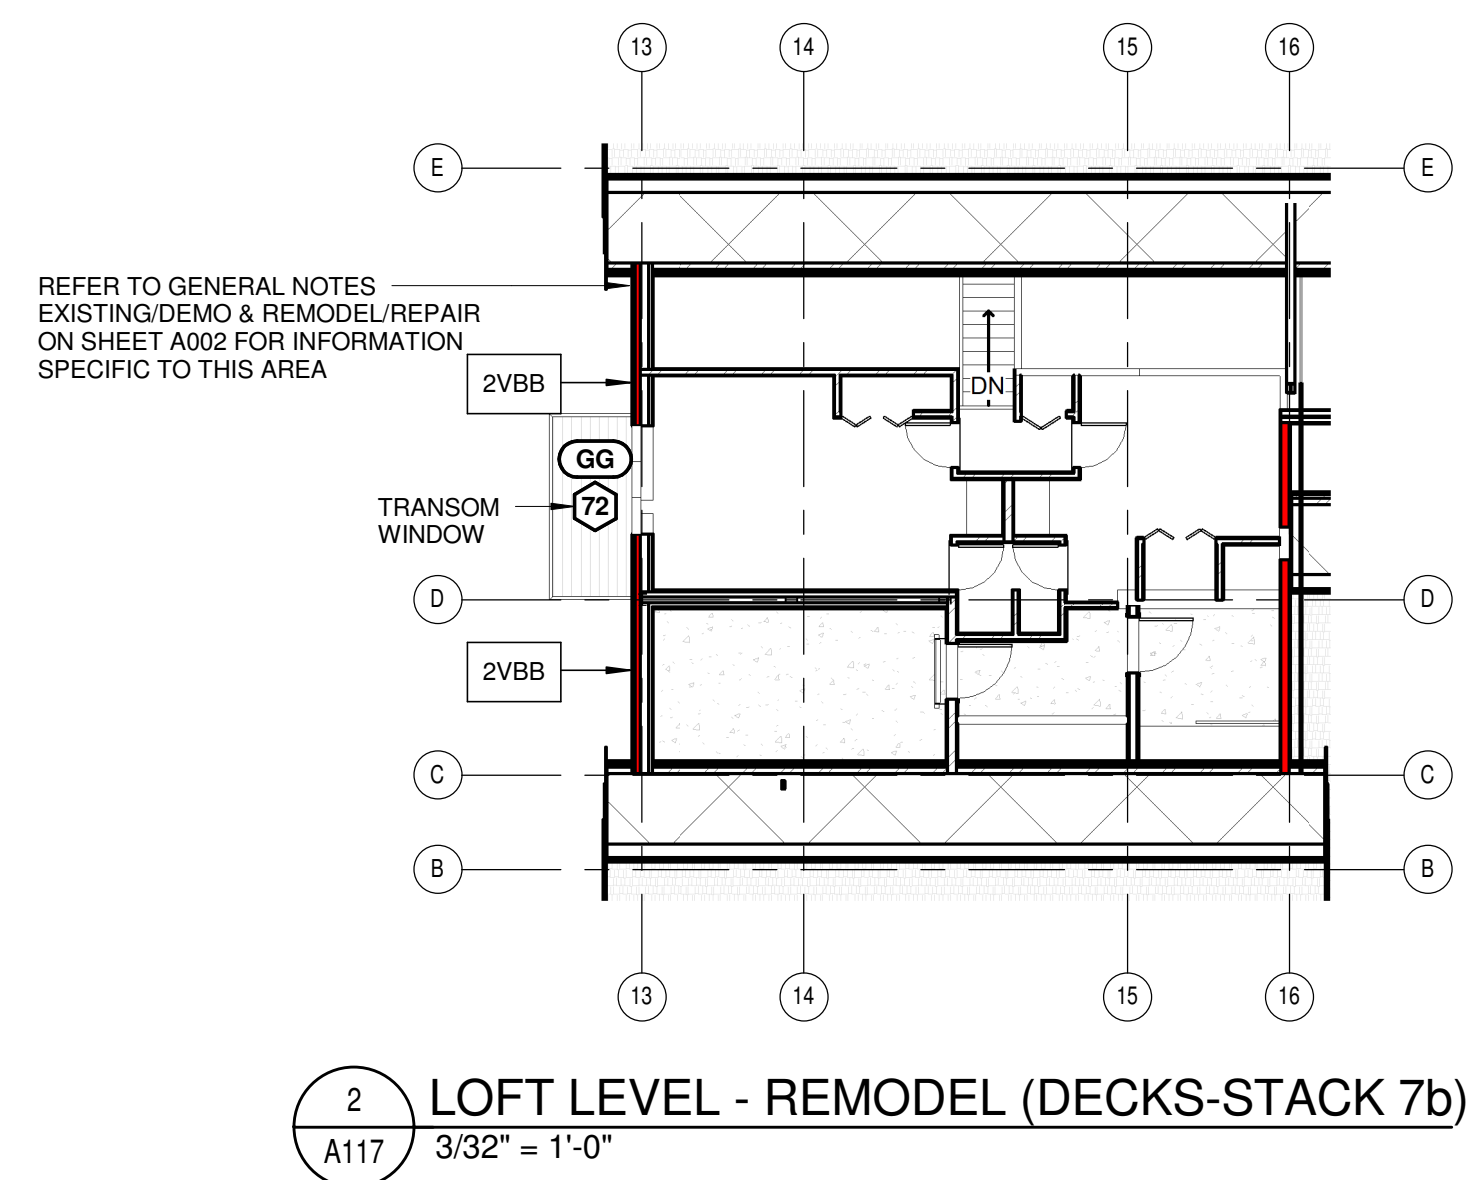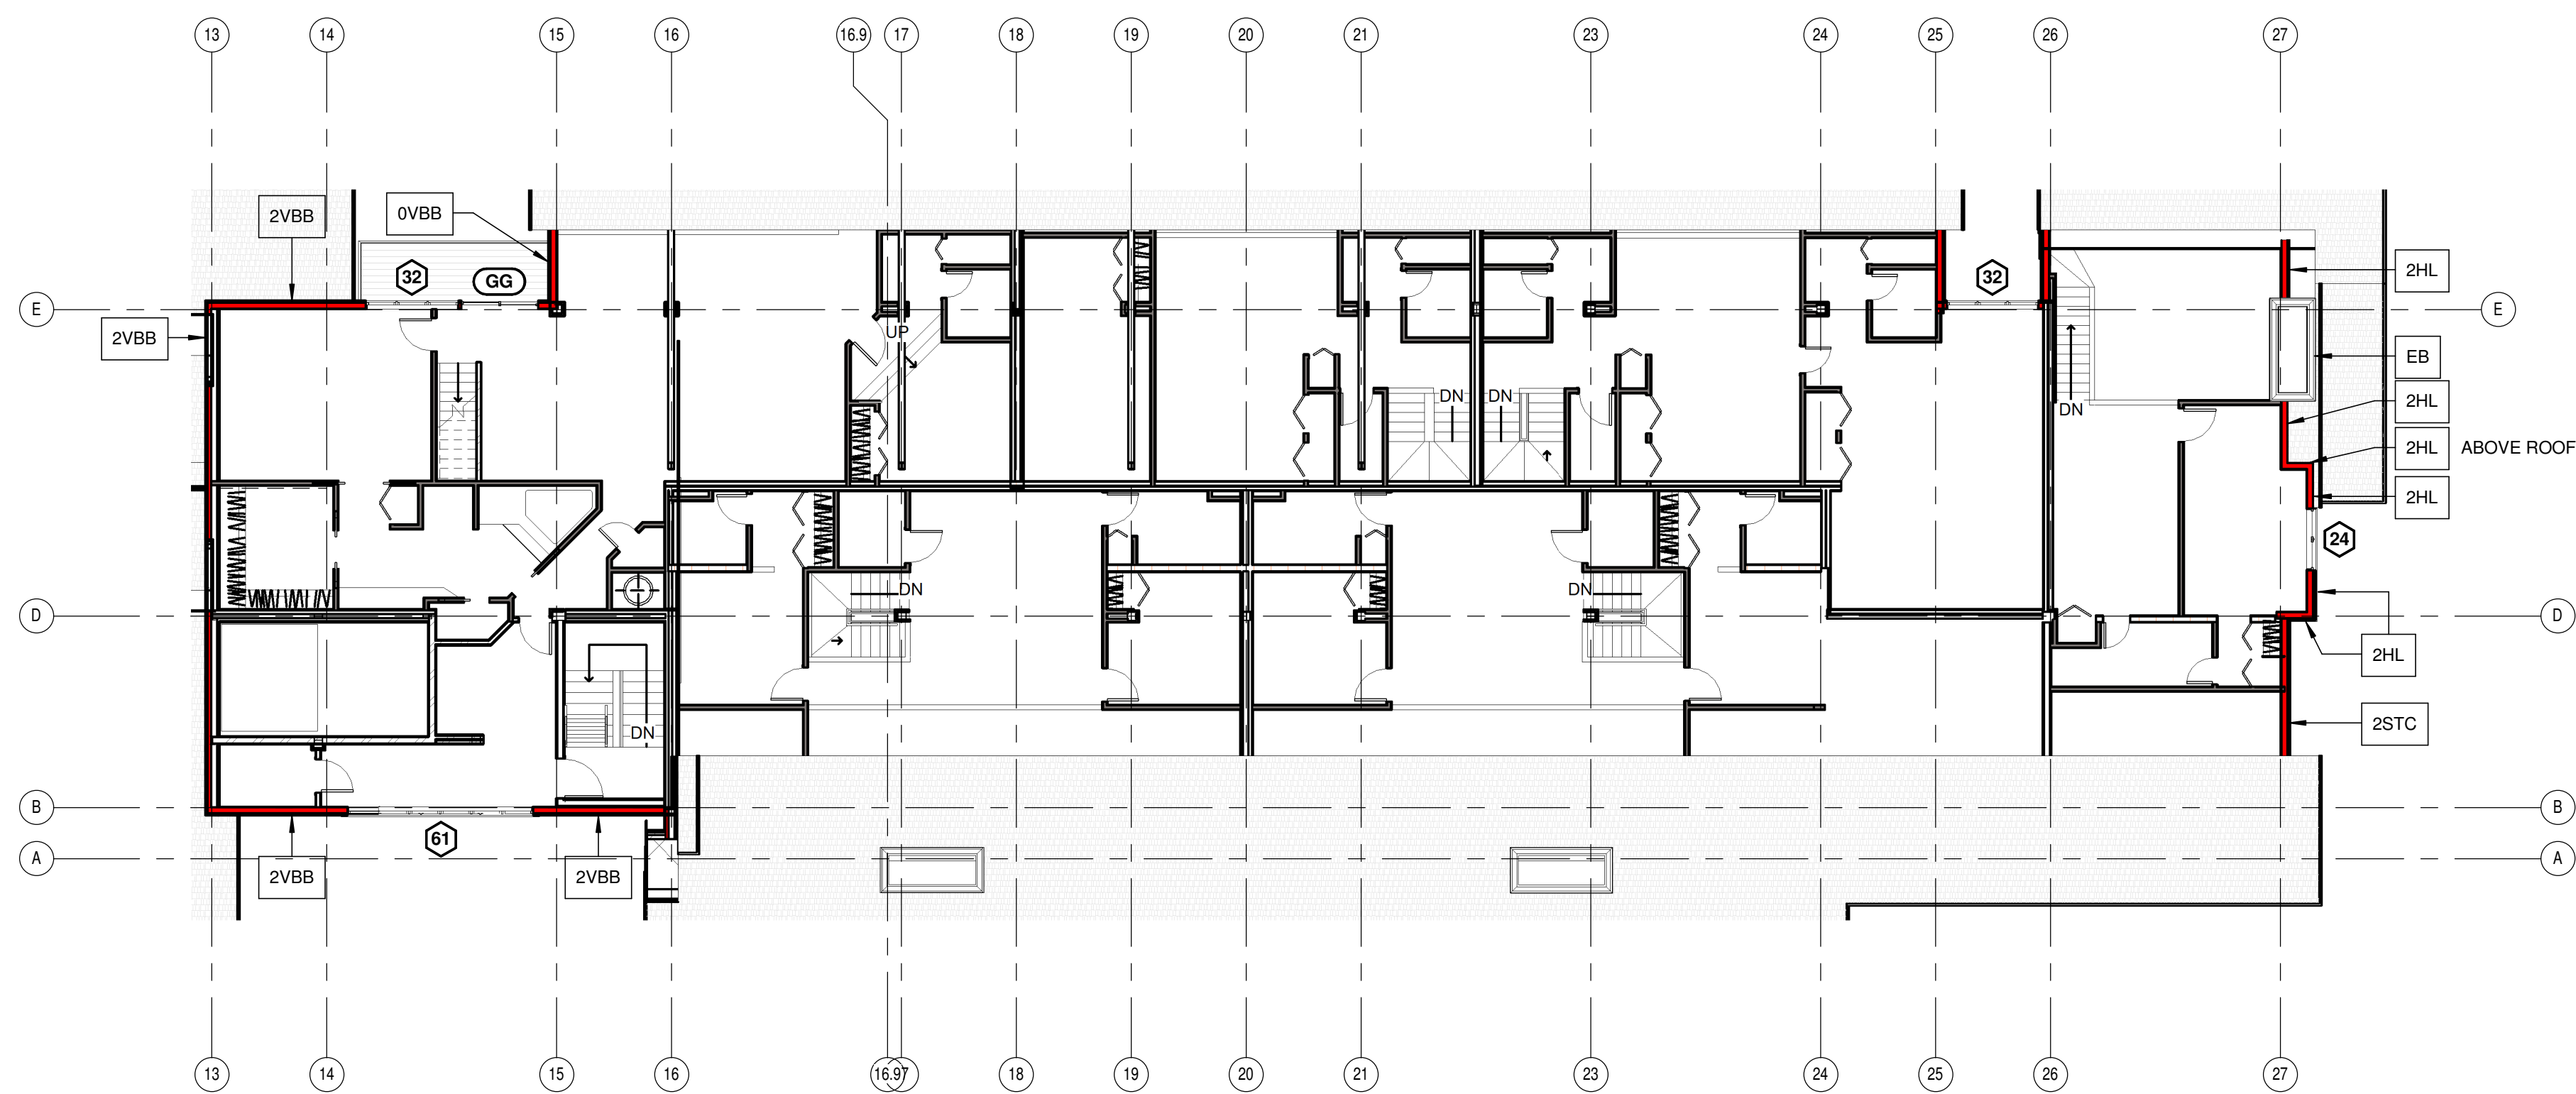

INSULATED SHEATHING LEGEND (BUILDING LAYOUTS):

25TN = 2* INSULATED SHEATHING WITH STONE
15TN = 1* INSULATED SHEATHING WITH STONE
05TN = 0* NOT INSULATED SHEATHING UNDER STONE
25TC = 2* INSULATED SHEATHING WITH STUCCO
15TC = 1* INSULATED SHEATHING WITH STUCCO
05TC = 0* NOT INSULATED SHEATHING UNDER STUCCO
2HL = 2* INSULATED SHEATHING WITH HORIZ. LAP
1HL = 1* INSULATED SHEATHING WITH HORIZ. LAP
0HL = 0* NOT INSULATED SHEATHING UNDER HORIZ. LAP
2VB = 2* INSULATED SHEATHING WITH VERT. B&B
1VB = 1* INSULATED SHEATHING WITH VERT. B&B
0VB = 0* NOT INSULATED SHEATHING UNDER VERT. B&B
EB = EXISTING BRICK TO REMAIN
ESTN = EXISTING STONE

GENERAL NOTE:

- a. 2" INSULATION REFERS TO R-12.6 INSULATED SHEATHING
- b. 1" INSULATION REFERS TO R-6.6 INSULATED SHEATHING
- c. SEE BUILDING ASSEMBLY NOTES (SHEET A501) FOR ADDITIONAL INFORMATION RELATED TO THE INSULATED SHEATHING

NOTICE: DUTY OF COOPERATION


Release of these plans contemplates further cooperation among the owner, his contractor and the architect. Design and construction are a team effort. Although the architect and his consultants have performed their services with due care and diligence, they cannot guarantee perfection. Communication is imperfect and every contingency cannot be anticipated. Any ambiguity or discrepancy discovered by the contractor shall be reported immediately to the architect. Failure to notify the architect compounds misunderstanding and increases construction costs. A failure to cooperate by a simple notice to the architect shall relieve the architect from responsibility for any errors or omissions that arise from the plans without consent of the architect are unauthorized and shall relieve the architect of responsibility for all consequences arising out of such changes.

All design, documents and data prepared by Eric Smith Associates, P.C. as instruments of service shall remain property of Eric Smith Associates, P.C. and shall not be copied, changed or disclosed in any form whatsoever without first obtaining the express written consent of Eric Smith Associates, P.C.

Eric Smith Associates, P.C.


[illegible]

BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, COLORADO

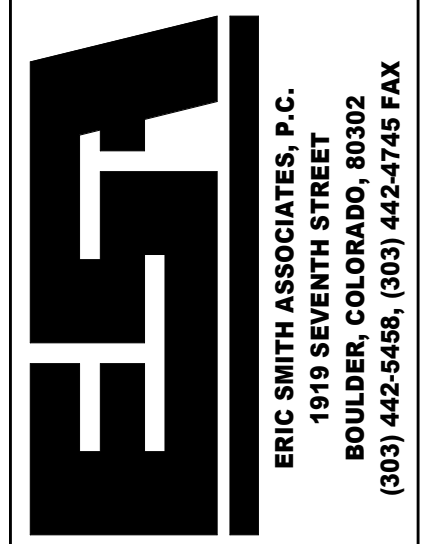


Job Number:	17022
Date:	2018-11-09
Drawn By:	Author
Checked By:	Checker

Project Phase
PERMIT REVIEW
Sheet Title
SEVENTH FLOOR & LOFT BUILDING LAYOUTS
Sheet Number
A117

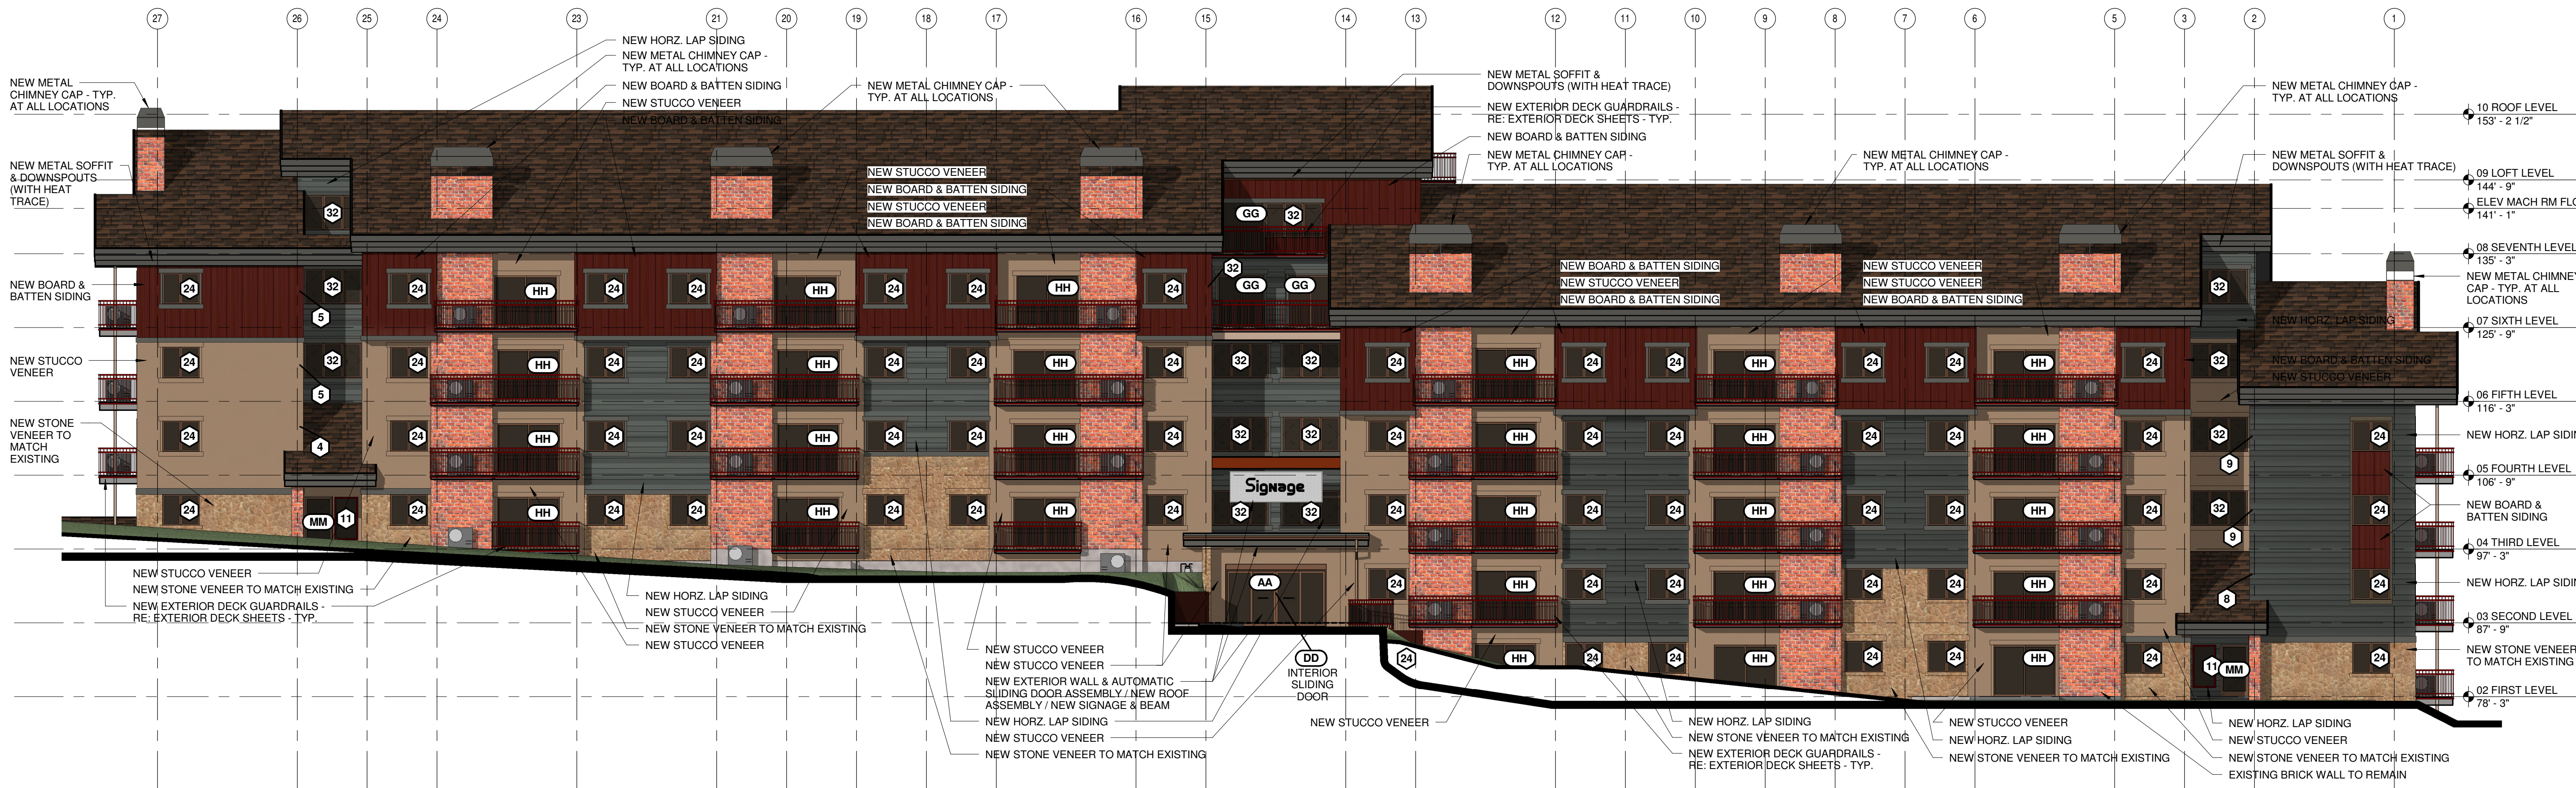


1 NORTH ELEVATION
A201 3/32" = 1'-0"

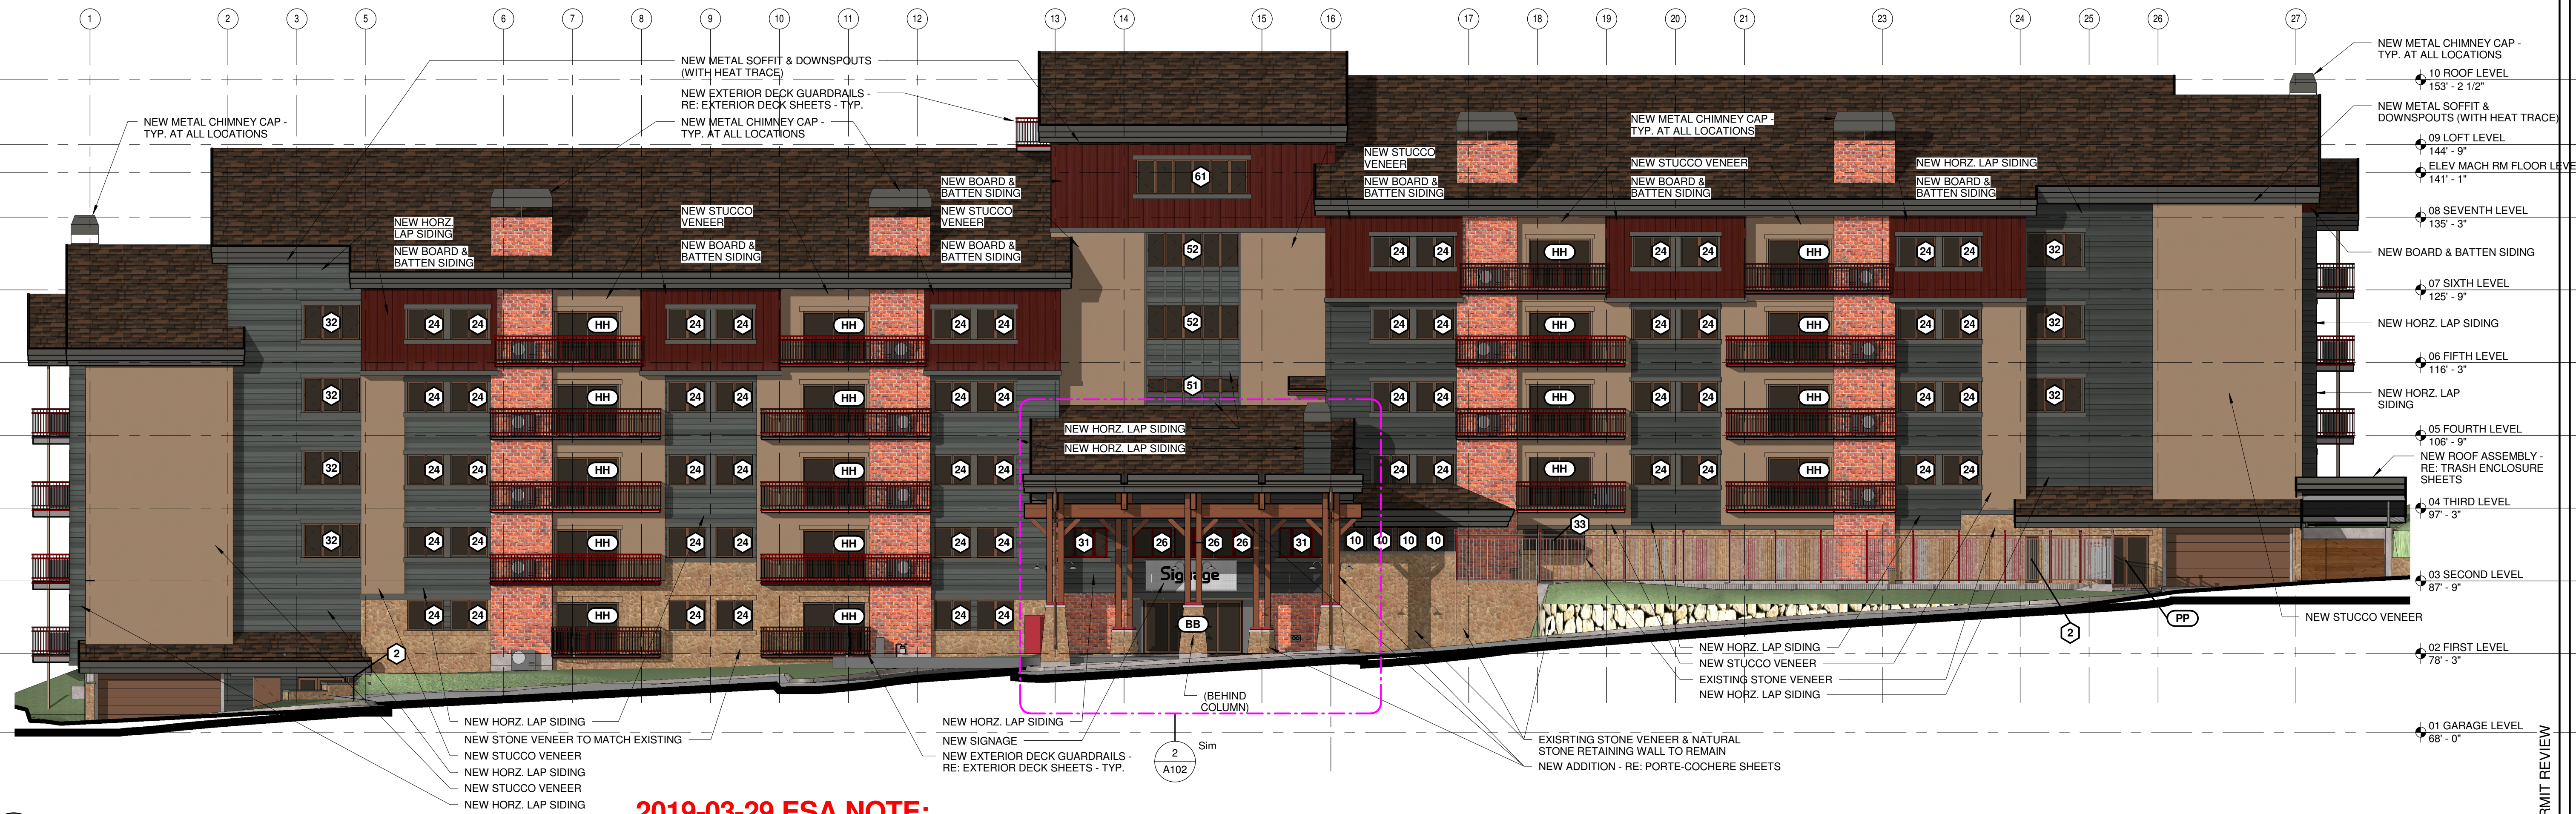

2 SOUTH ELEVATION
A201 3/32" = 1'-0"

2019-03-29 ESA NOTE:
COLORS SHOWN ARE A GENERAL REPRESENTATION ONLY.
ACTUAL COLORS SHALL BE FINALIZED WITH OWNER BASED
ON LARGE FORMAT SAMPLES FOR COMPARISON AND
REVIEW PRIOR TO ORDERING AND INSTALLATION.


1 DOOR & WINDOW TRIM HAVE BEEN
UPDATED PER DETAILS ON SHEET A512

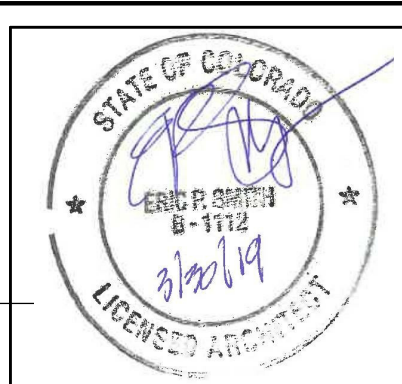

NOTICE: DUTY OF COOPERATION
Release of these plans contemplates further cooperation among the owner, its consultant and the architect. Design and construction are complex. Although the architect and its consultants have performed their services with due care and diligence, they cannot guarantee perfection. Communication is imperative and every contingency cannot be anticipated. Any ambiguity or discrepancy discovered by the use of these plans shall be reported immediately to the architect. Failure to notify the architect compounds misunderstanding and increases construction costs. A failure to cooperate by a single entity to the architect shall release the architect from responsibility for the consequences. Changes made from the plans without consent of the architect are unauthorized and shall release the architect of responsibility for all consequences arising out of such changes.
All design, documents and data prepared by Eric Smith Associates, P.C. as instruments of service shall remain the property of Eric Smith Associates, P.C. and shall not be copied, changed or disclosed in any form whatsoever without first obtaining the express written consent of Eric Smith Associates, P.C.
Eric Smith Associates, P.C.



No.	Description	Date
1	ADDENDUM 01	2018-11-30

BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, COLORADO

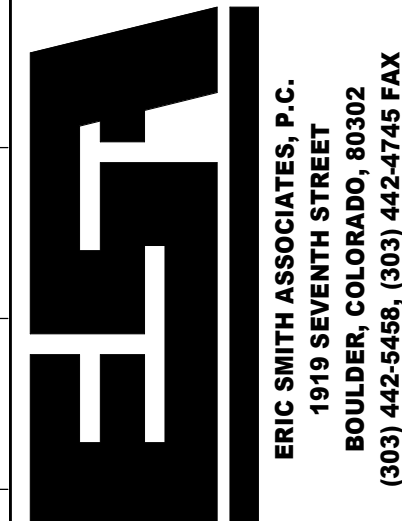


Job Number: 17022
Date: 2018-11-09
Drawn By: Author
Checked By: Checker


Project Phase
PERMIT REVIEW
Sheet Title
EXTERIOR ELEVATIONS
Sheet Number
A201



2019-03-29 ESA NOTE:
COLORS SHOWN ARE A GENERAL REPRESENTATION ONLY.
ACTUAL COLORS SHALL BE FINALIZED WITH OWNER BASED
ON LARGE FORMAT SAMPLES FOR COMPARISON AND
REVIEW PRIOR TO ORDERING AND INSTALLATION.

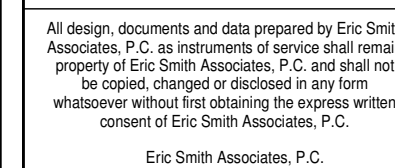[illegible]

BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, COLORADO

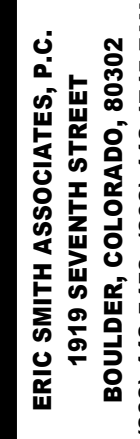

Job Number:	17022
Date:	2018-11-09
Drawn By:	Author
Checked By:	Checker





Project Phase
PERMIT REVIEW
Sheet Title
EXTERIOR ELEVATIONS

Sheet Number
A202

DATE: 2019-03-29 PERMIT REVIEW

JOB CODE & REVIT FILE: 17022 - Bear Claw II CD Set R16.rvt

3/29/2019 2:09:59 PM 17022 BEAR CLAW II SET_R16

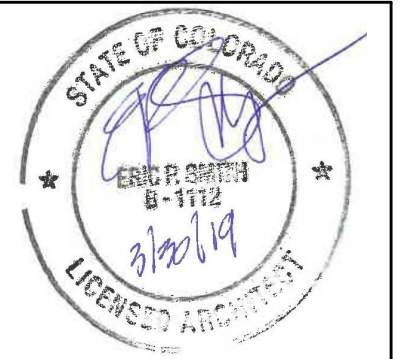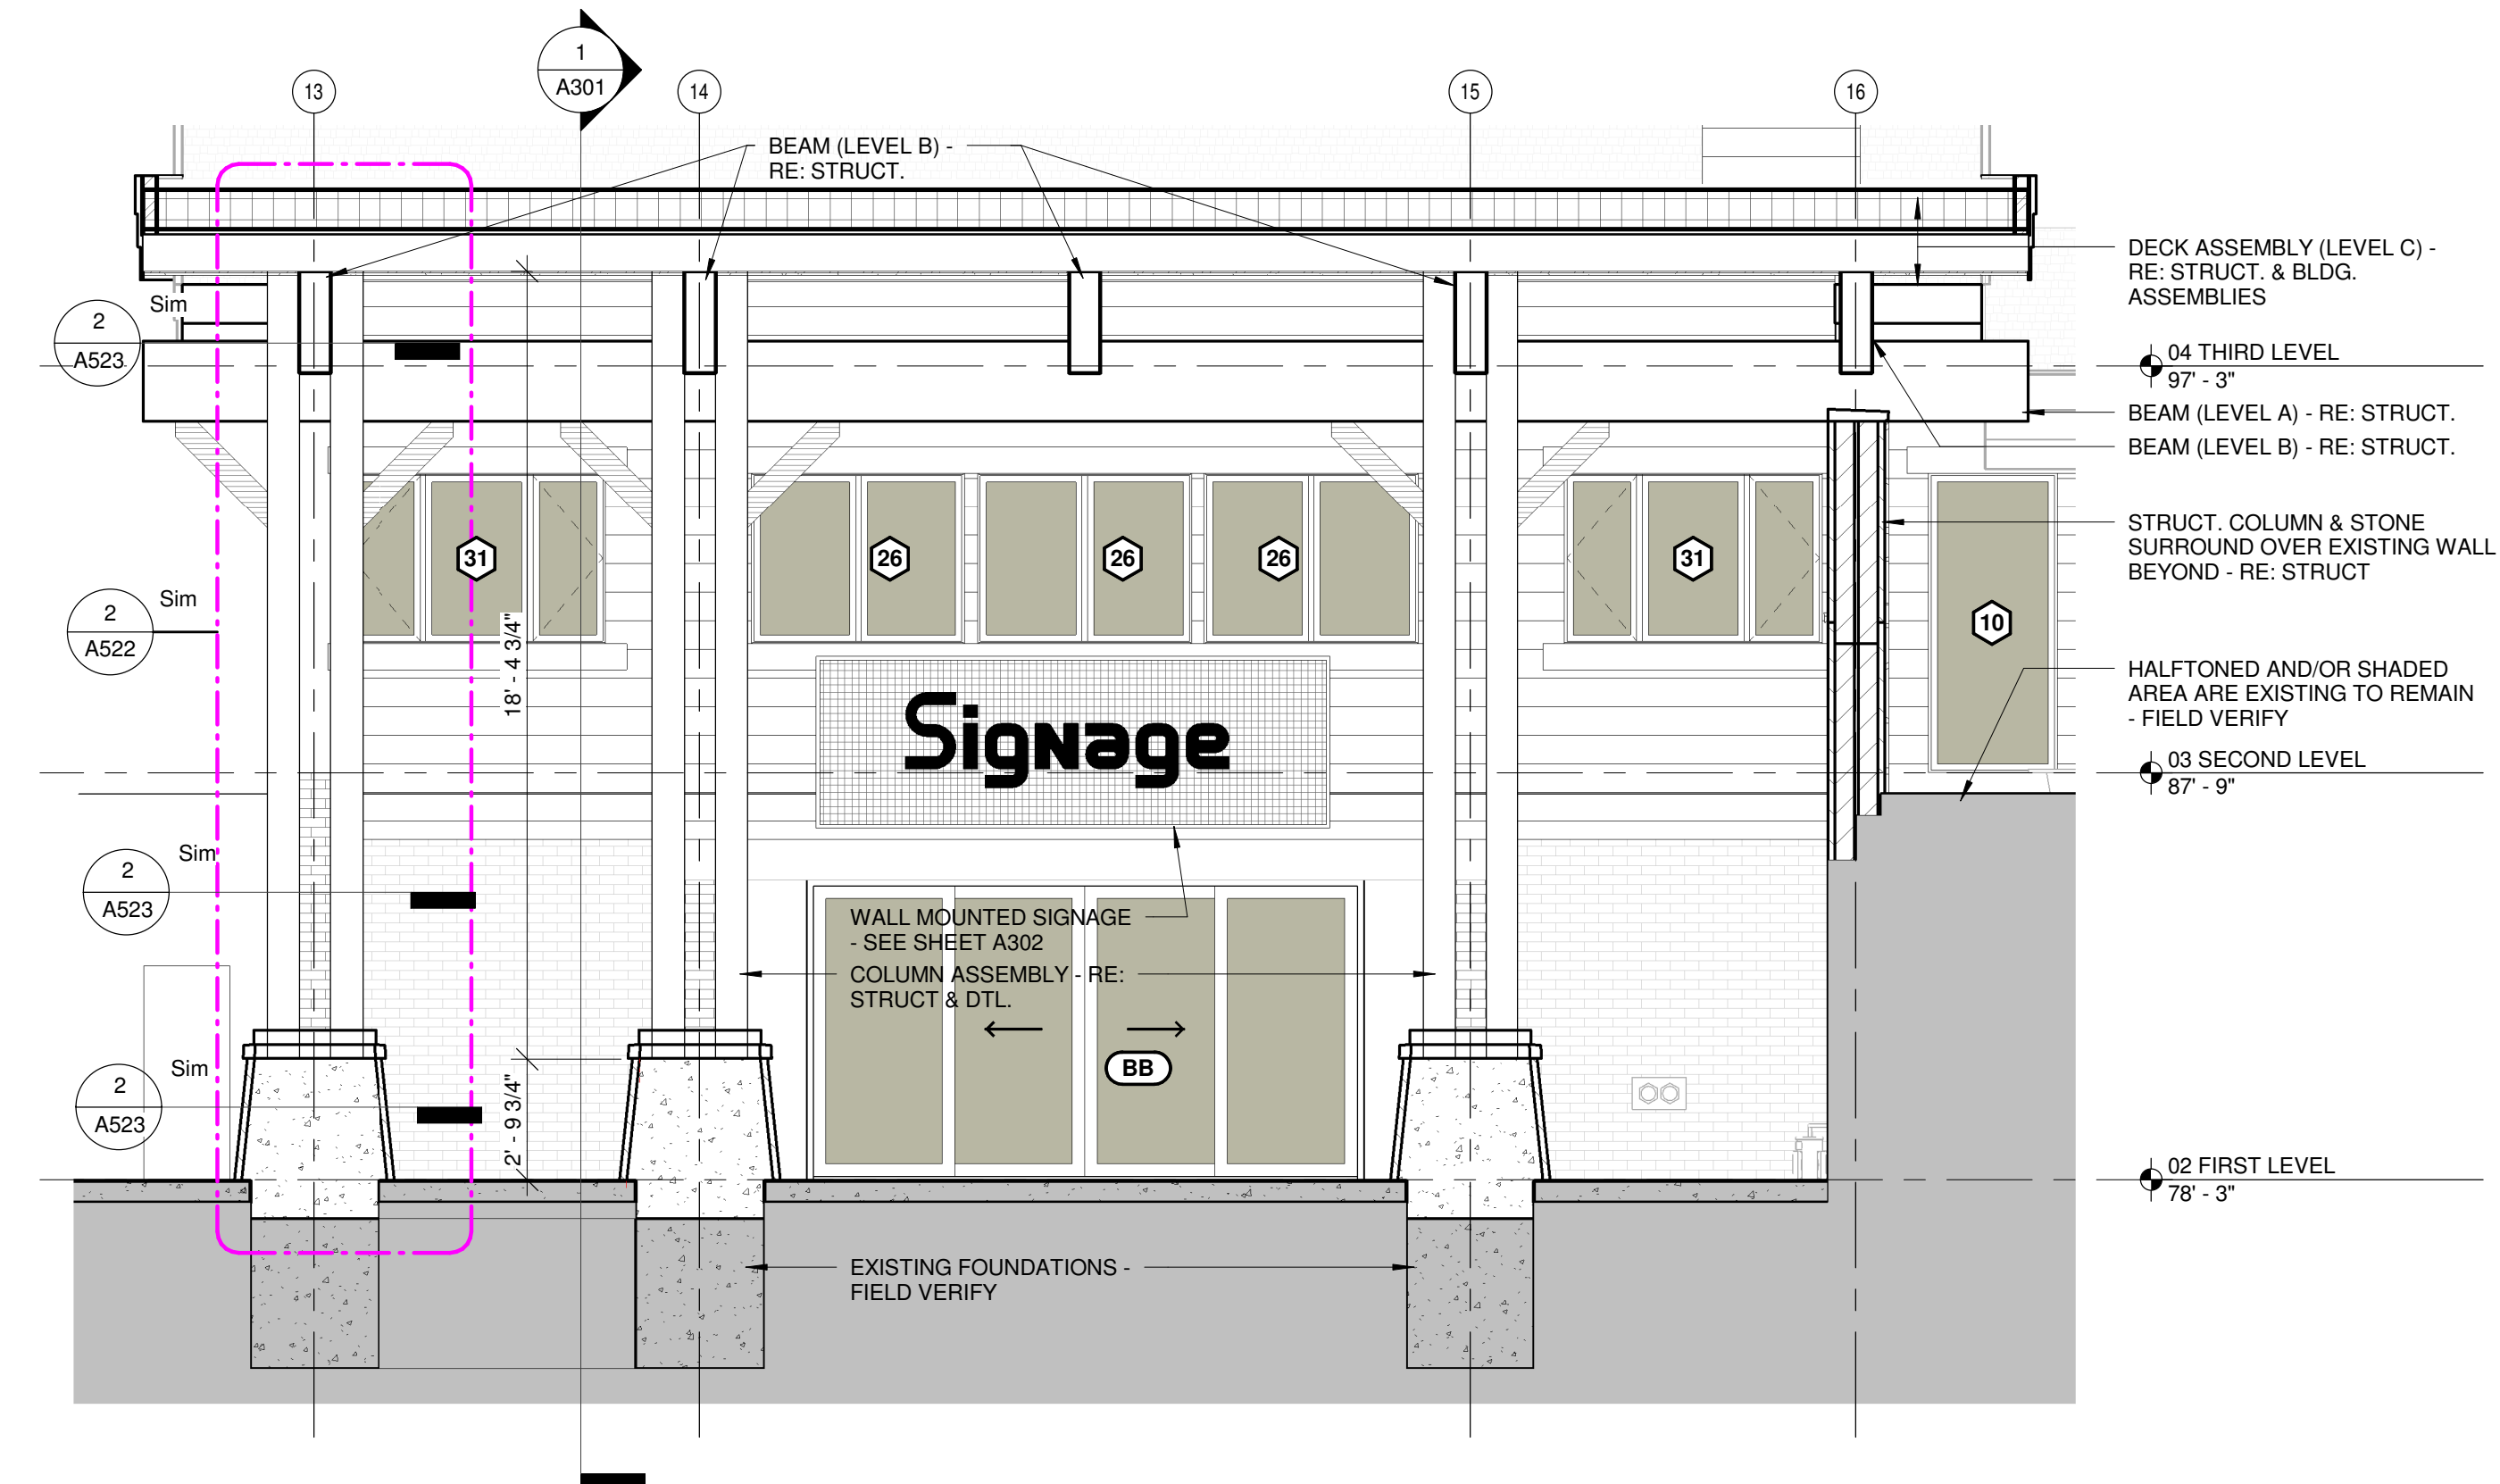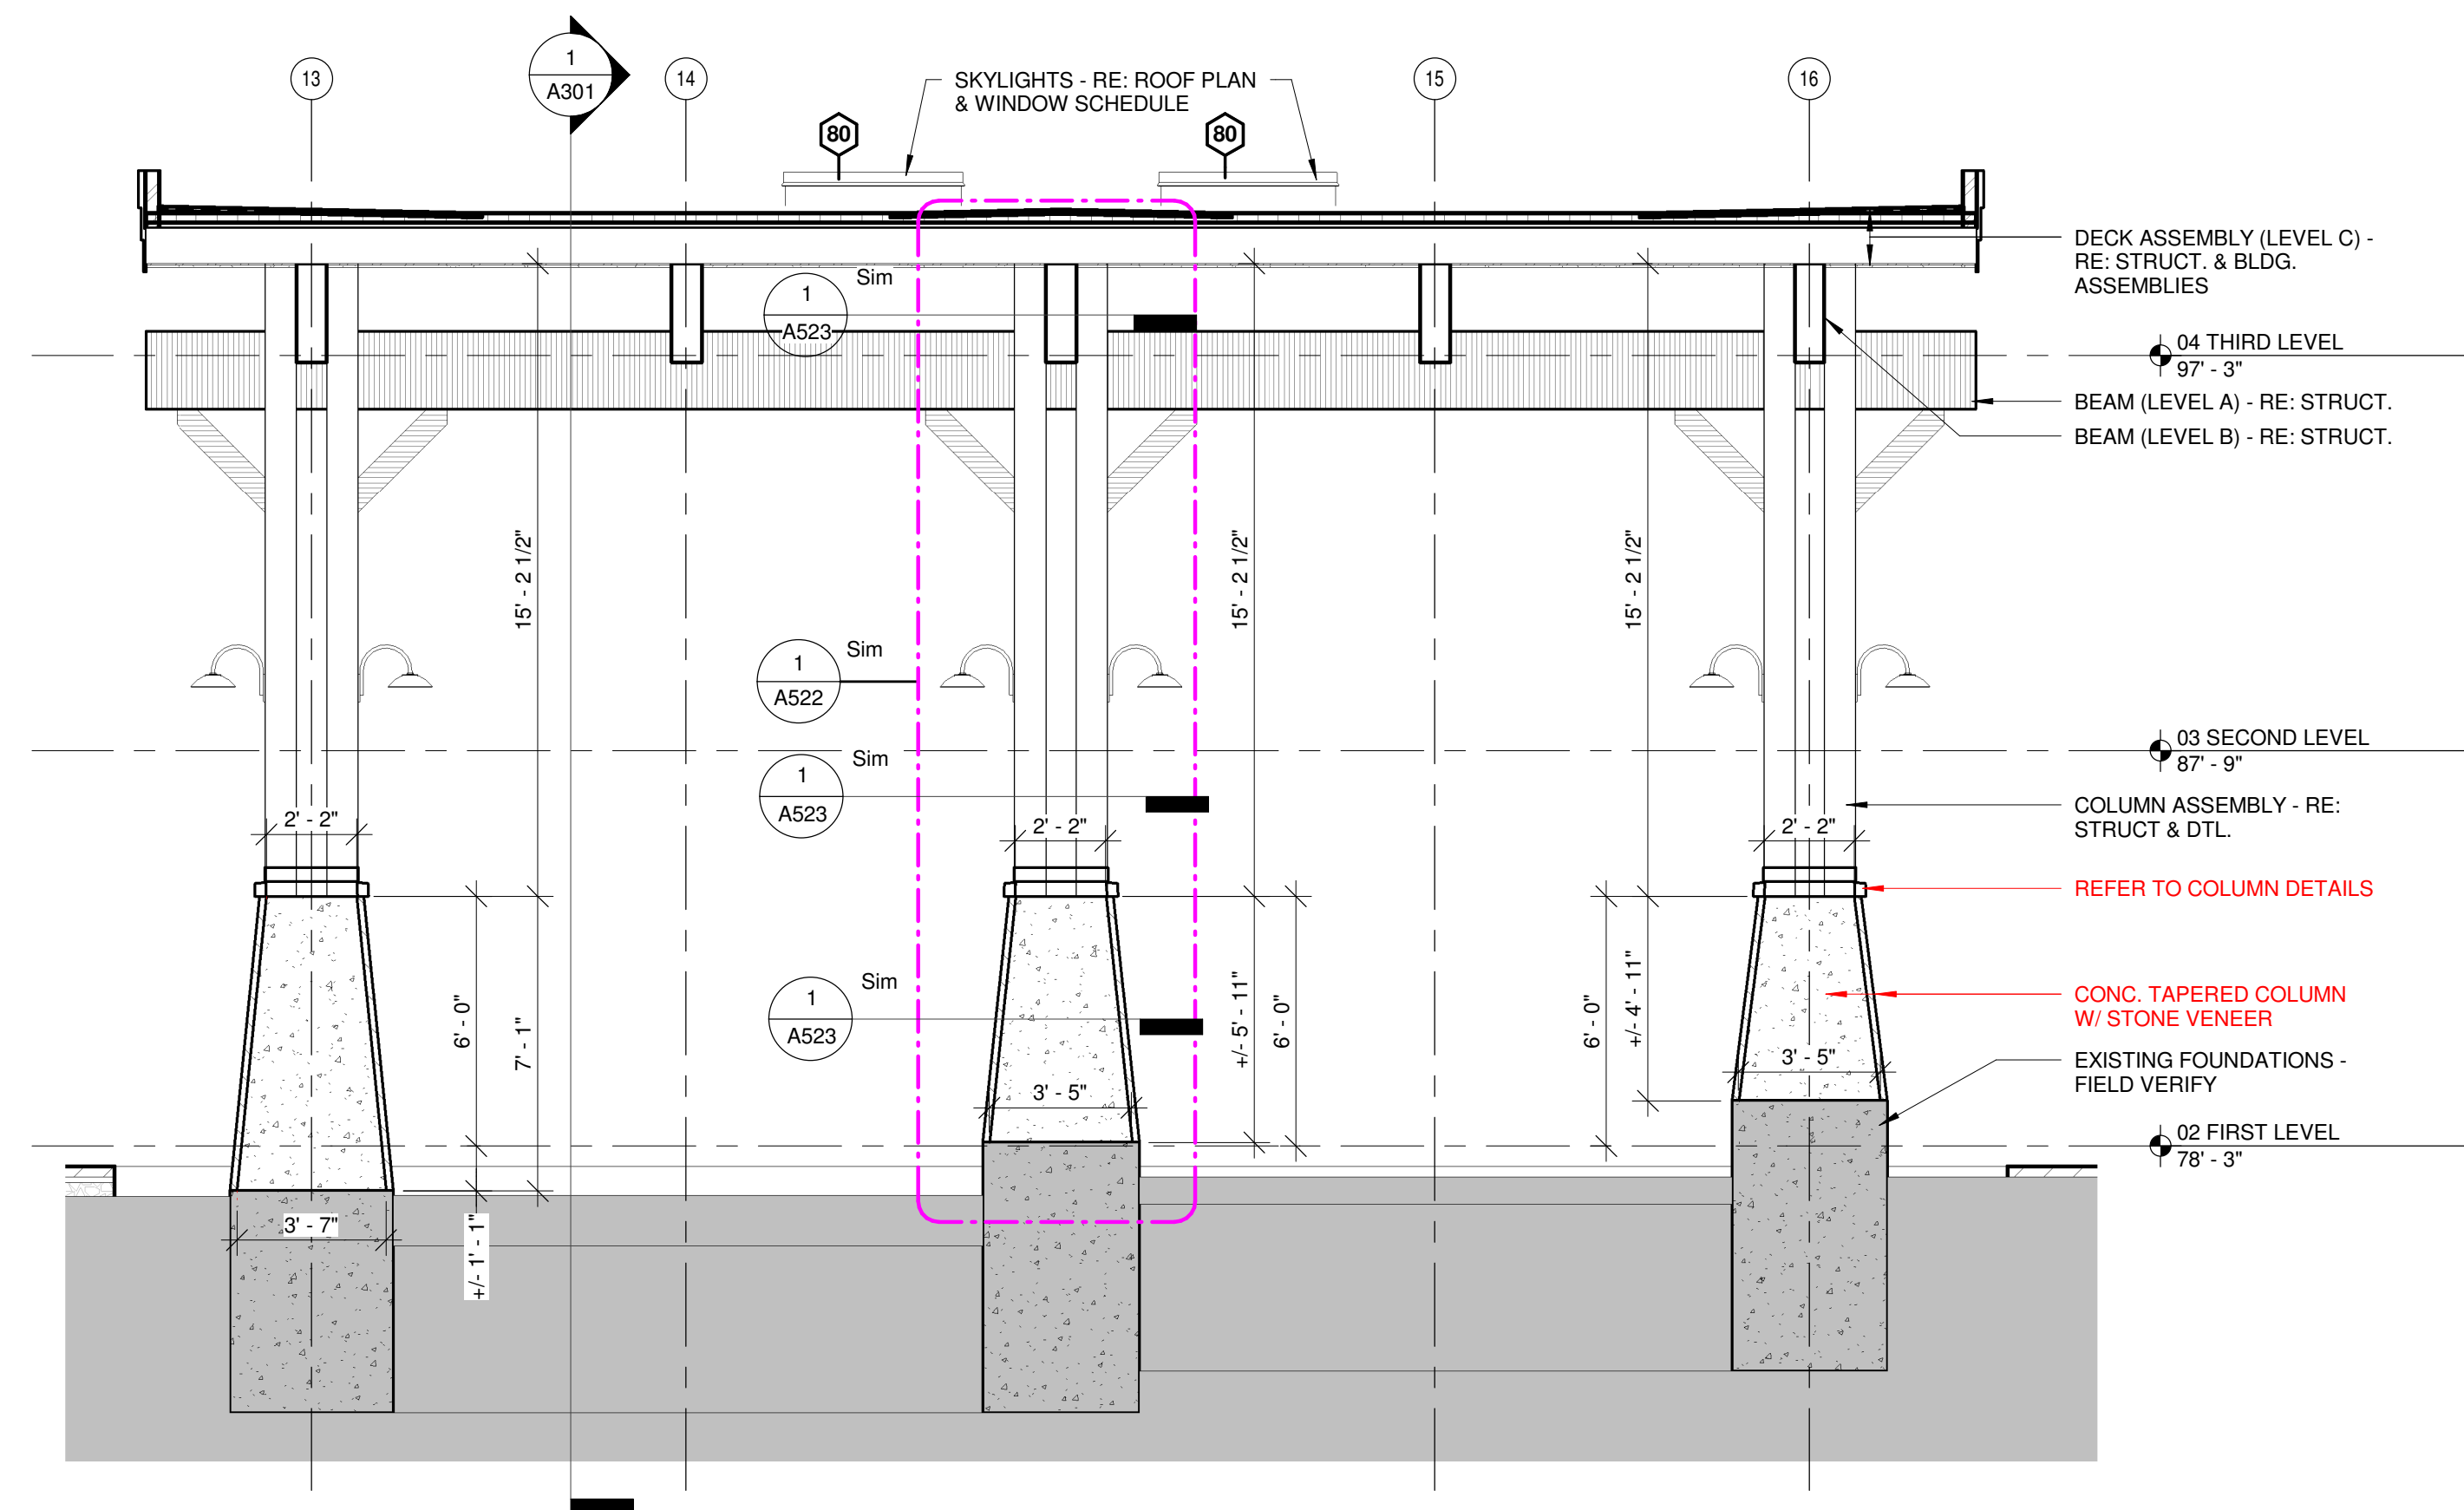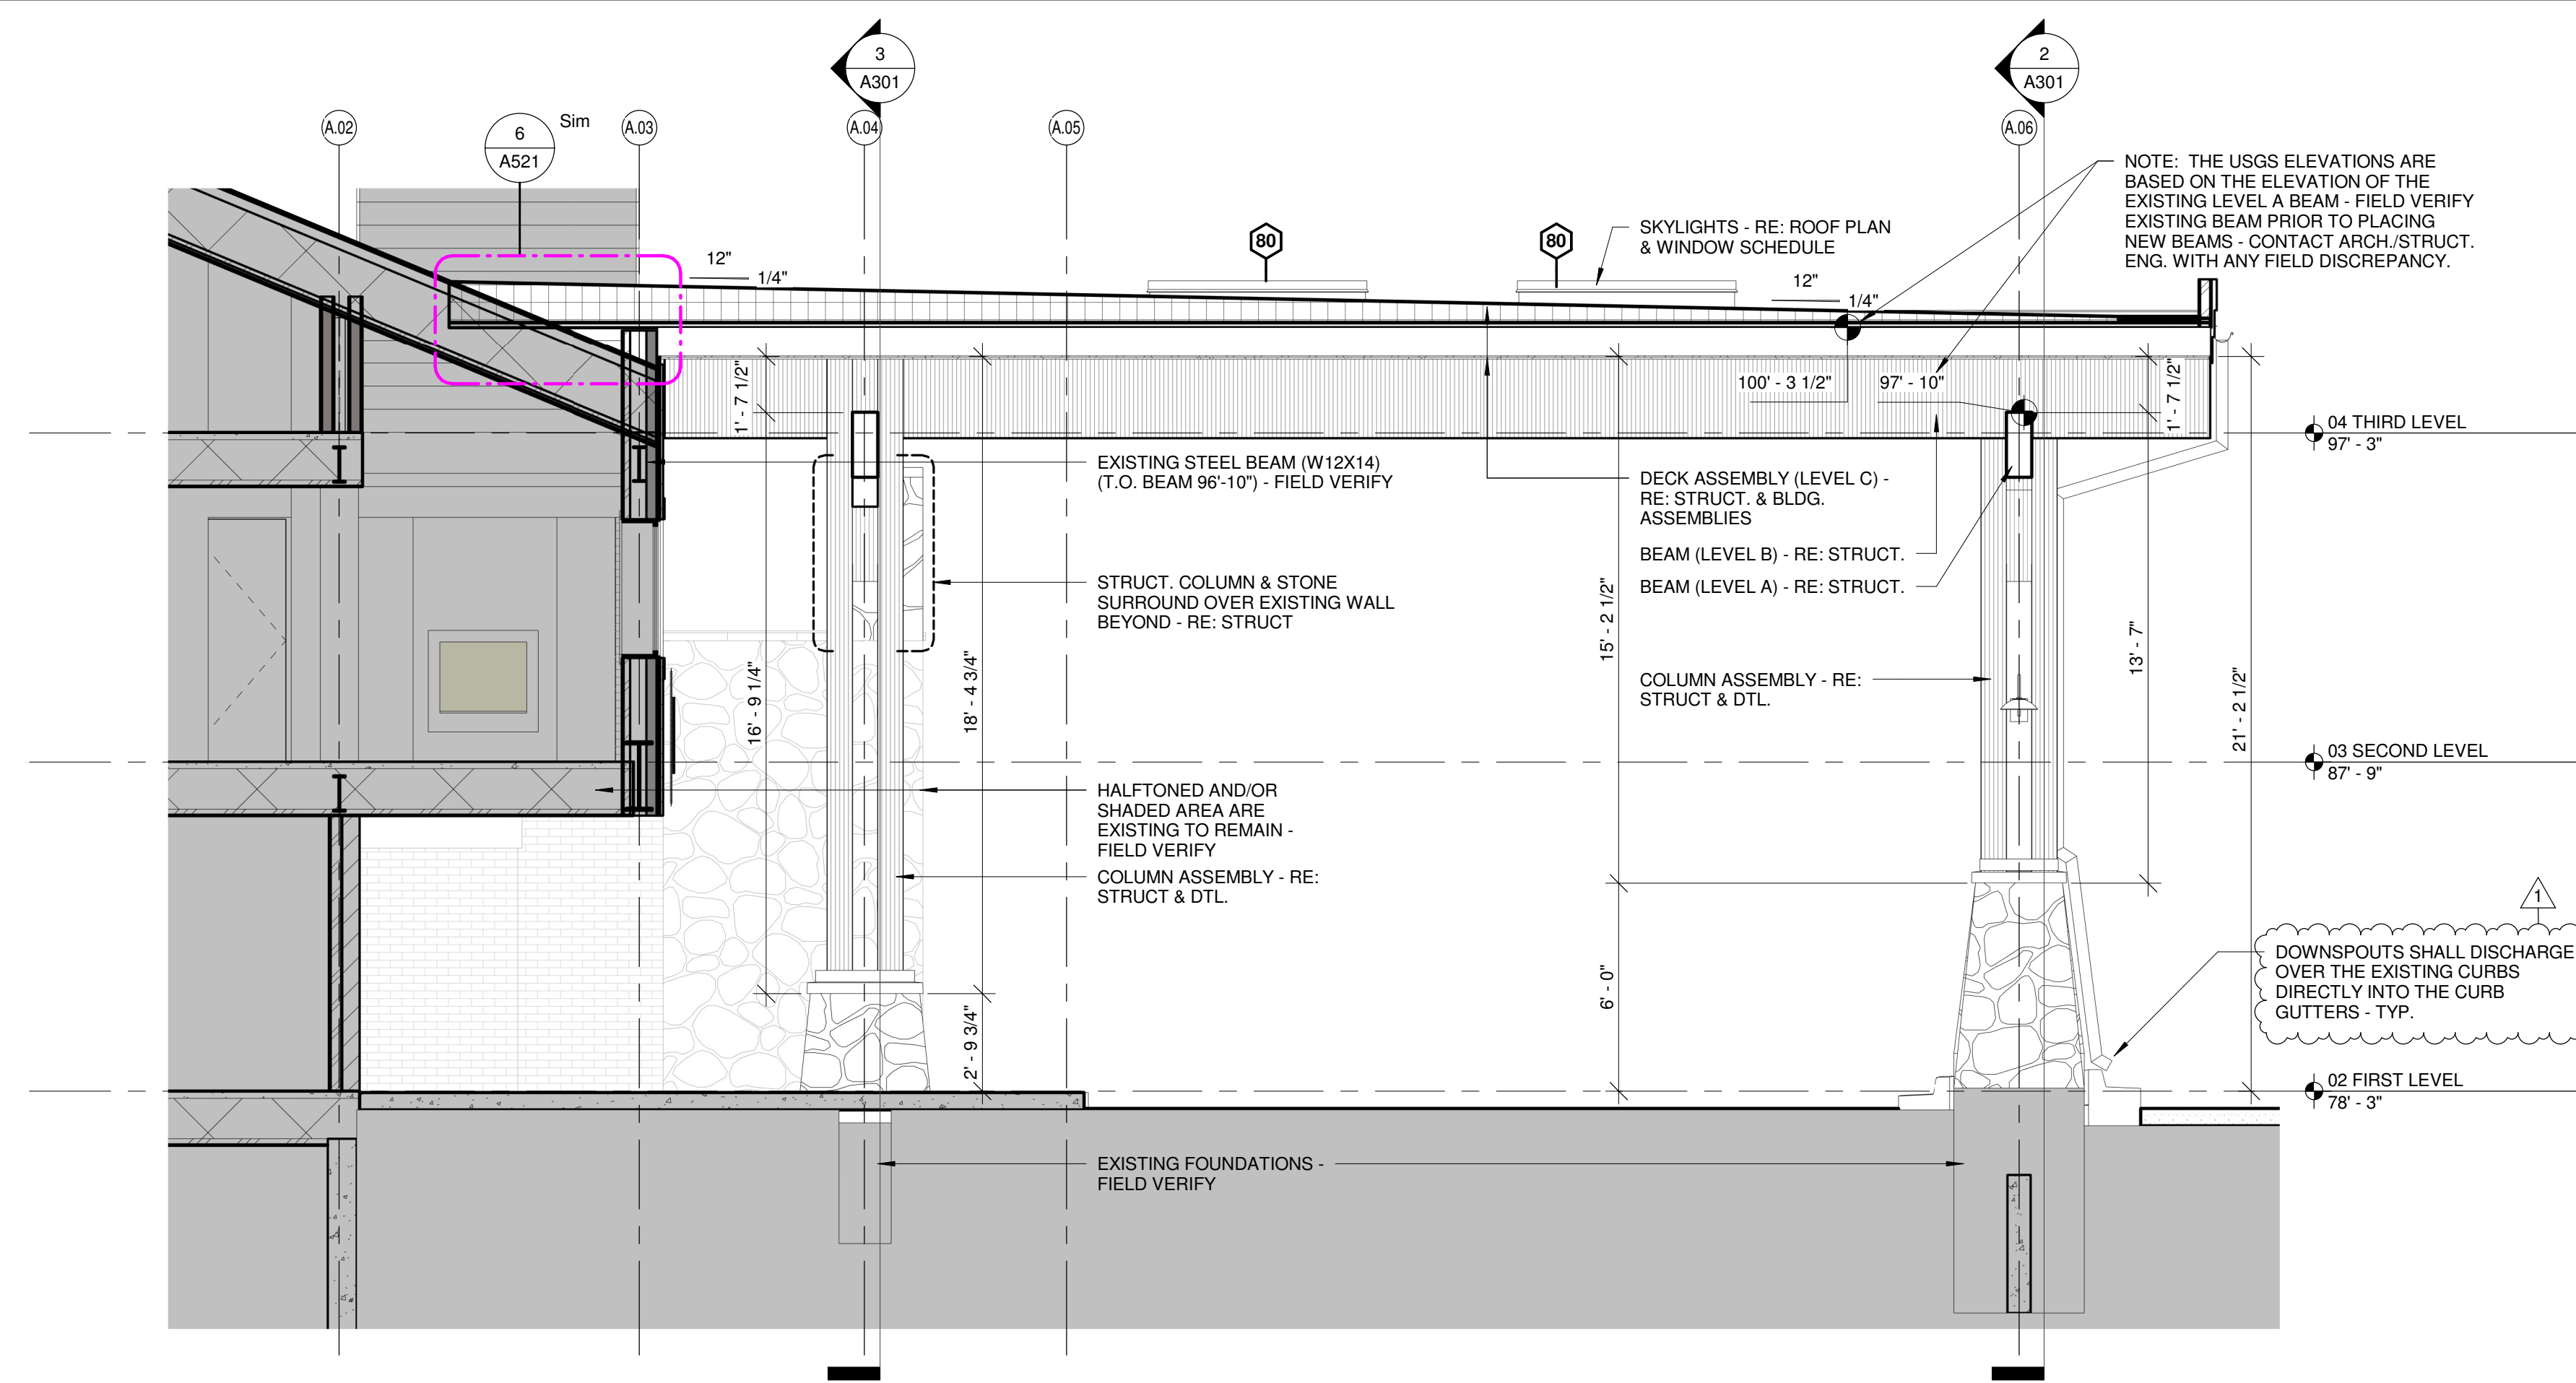

NOTICE: DUTY OF COOPERATION


Release of the plans constitutes further cooperation among the owner, his contractor and the architect. Design and construction are complex. Although the architect and his consultants have performed their services with due care and diligence, they cannot guarantee perfection. Communication is imperfect and every contractor carries some responsibility. Any argument or discrepancy discovered by the use of these plans shall be reported immediately to the architect. Failure to notify the architect compounds misunderstanding and increases construction costs. A failure to cooperate by a simple notice to the architect shall relieve the architect of responsibility for the consequences. Changes made from the plans without consent of the architect are unauthorized and shall relieve the architect of responsibility for all consequences arising out of such changes.

All design, documents and data prepared by Eric Smith Associates, P.C. as instruments of service shall remain property of Eric Smith Associates, P.C. and shall not be copied, changed or disclosed in any form whatsoever without first obtaining the express written consent of Eric Smith Associates, P.C.

Eric Smith Associates, P.C.

[illegible]

BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, COLORADO

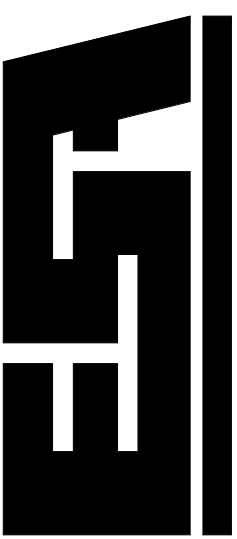

Job Number:	17022
Date:	2018-11-09
Drawn By:	Author
Checked By:	Checker






Project Phase
PERMIT REVIEW

Sheet Title
BUILDING SECTIONS -
PORTE-COCHERE

Sheet Number
A301

DATE: 2019-03-29 PERMIT REVIEW

JOB CODE & REVIT FILE: 17022 - Bear Claw II CD Set_R16.rvt

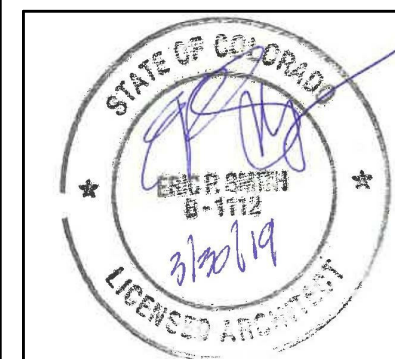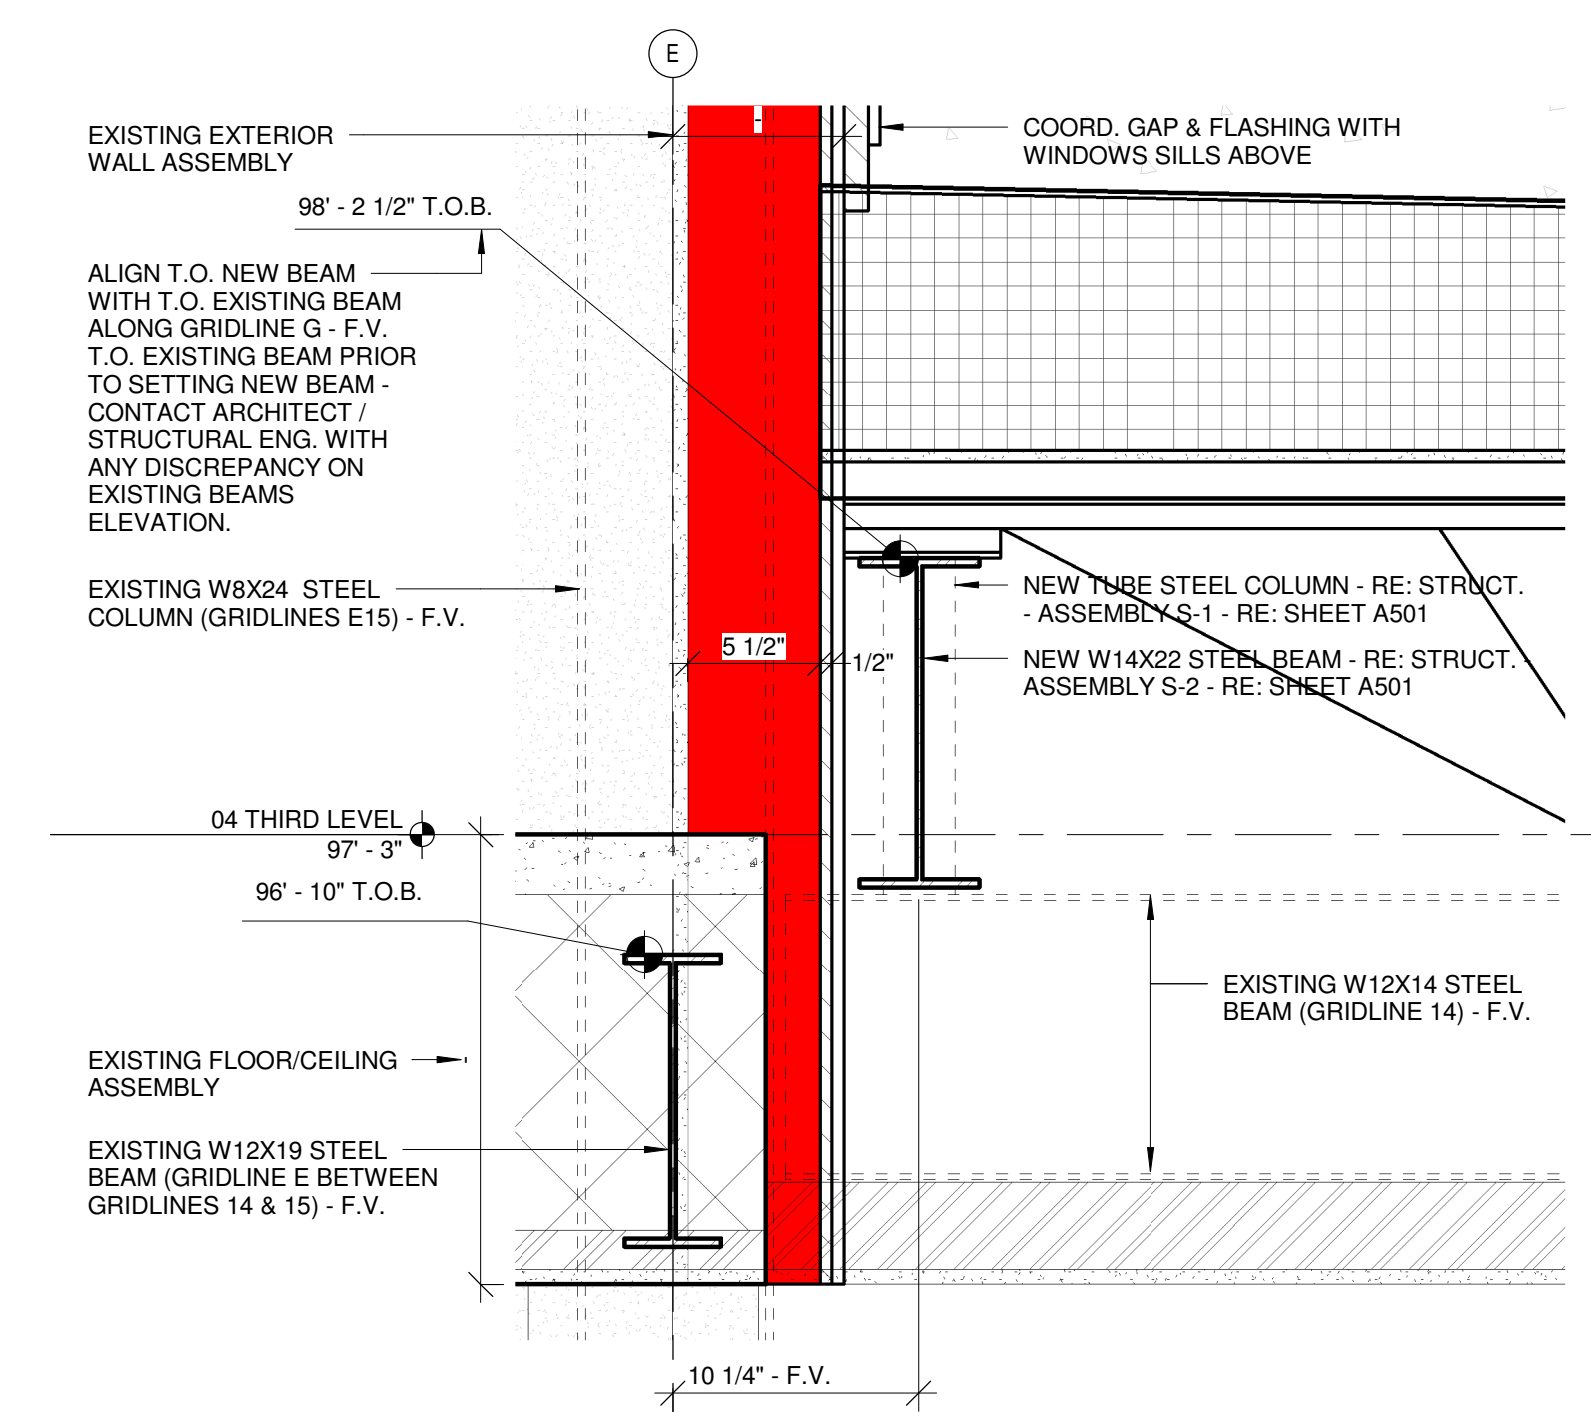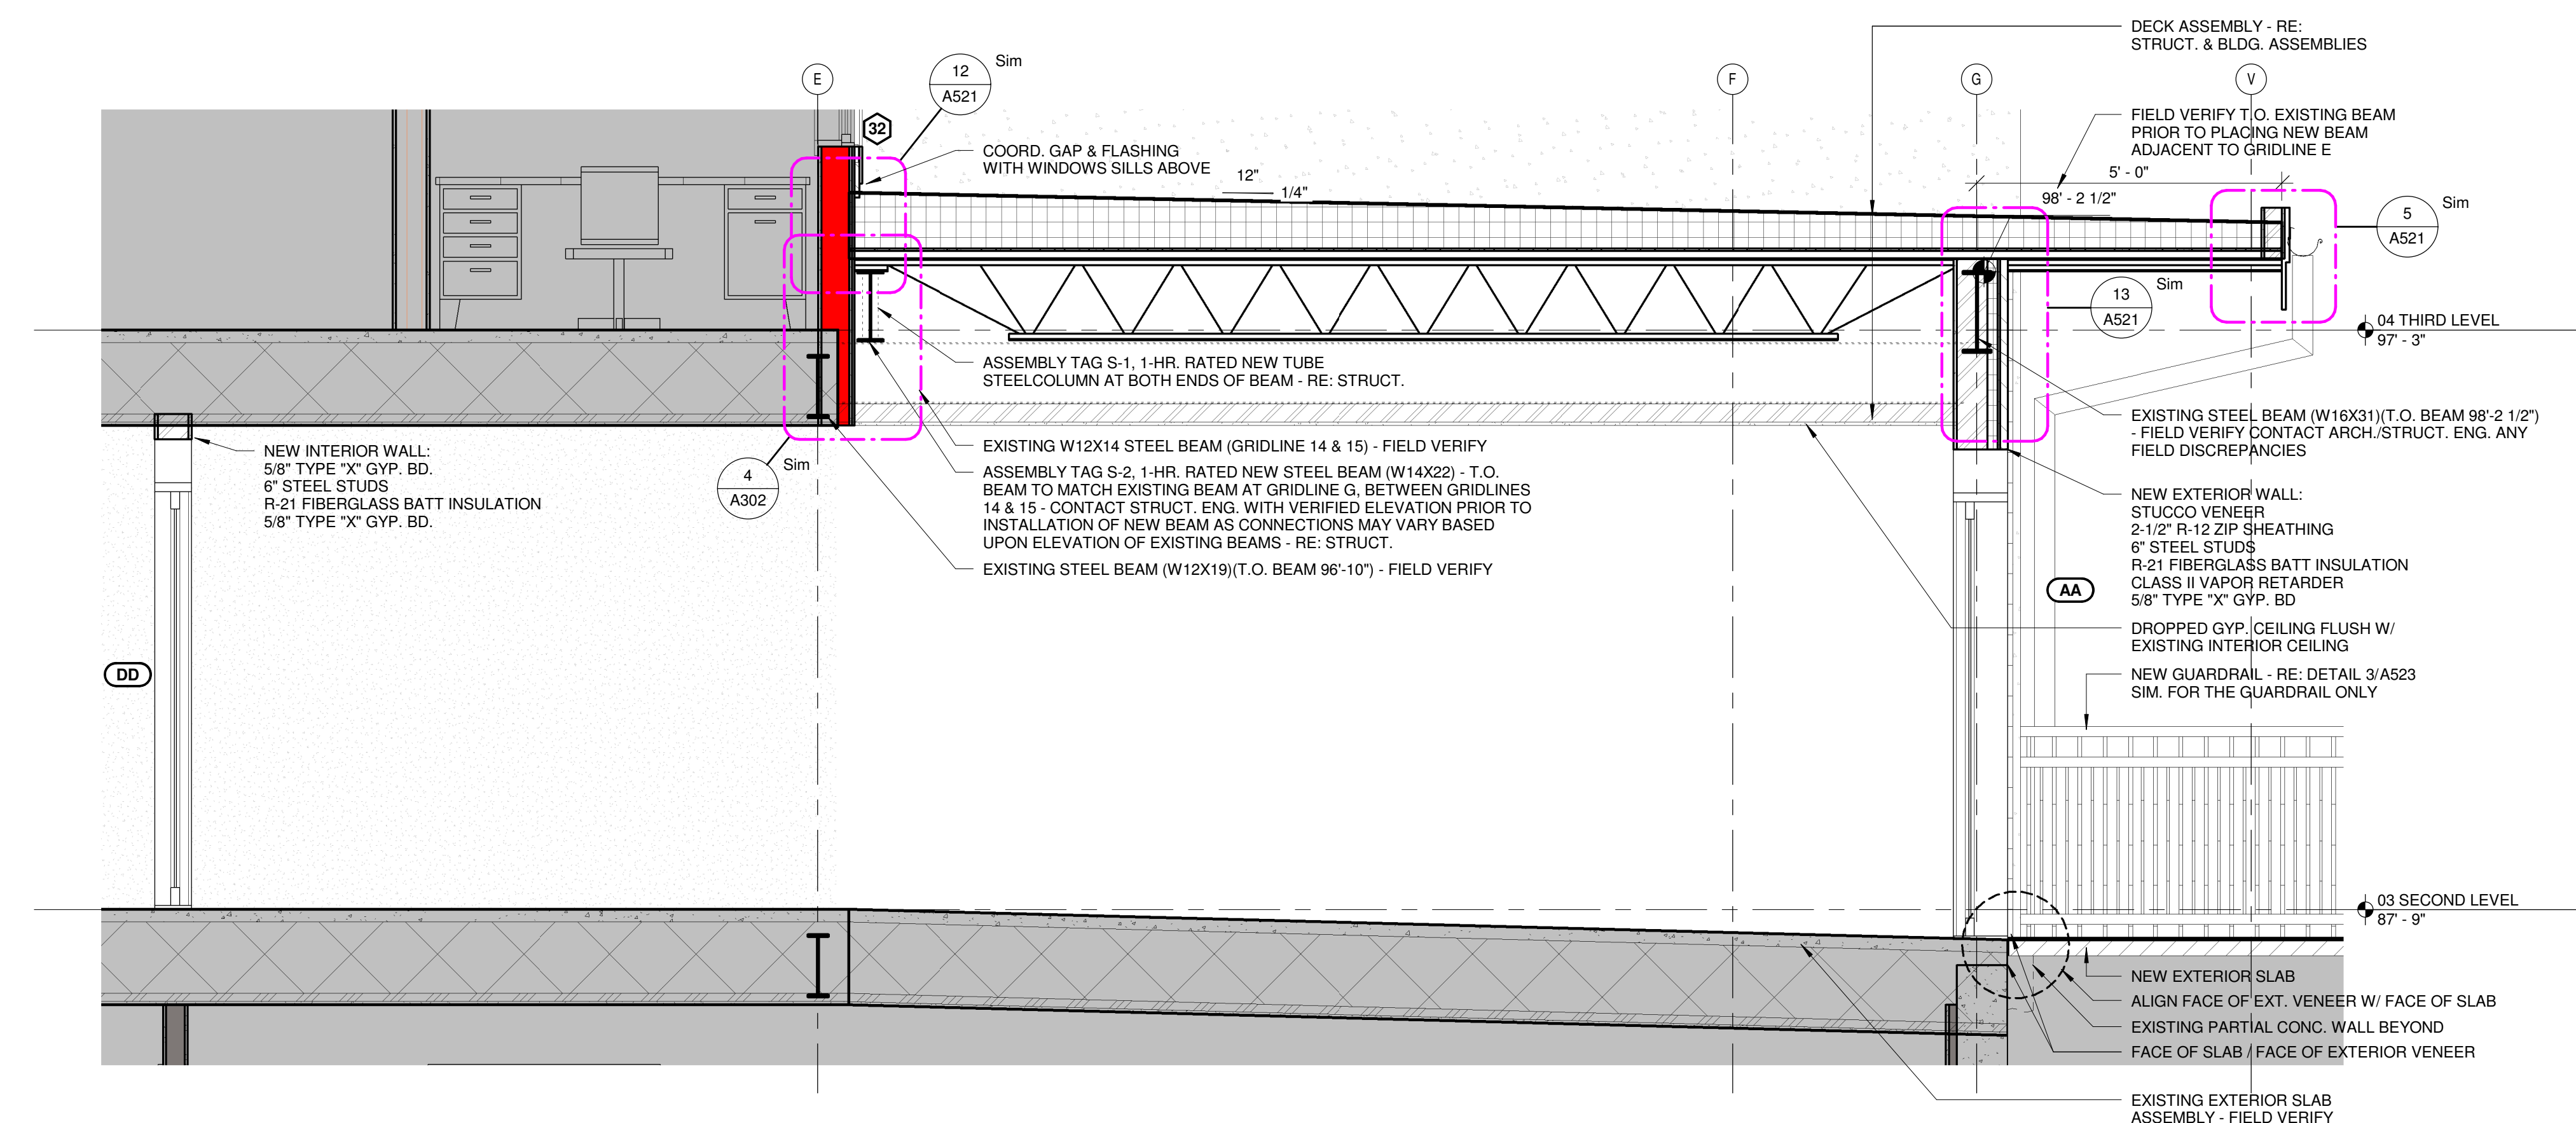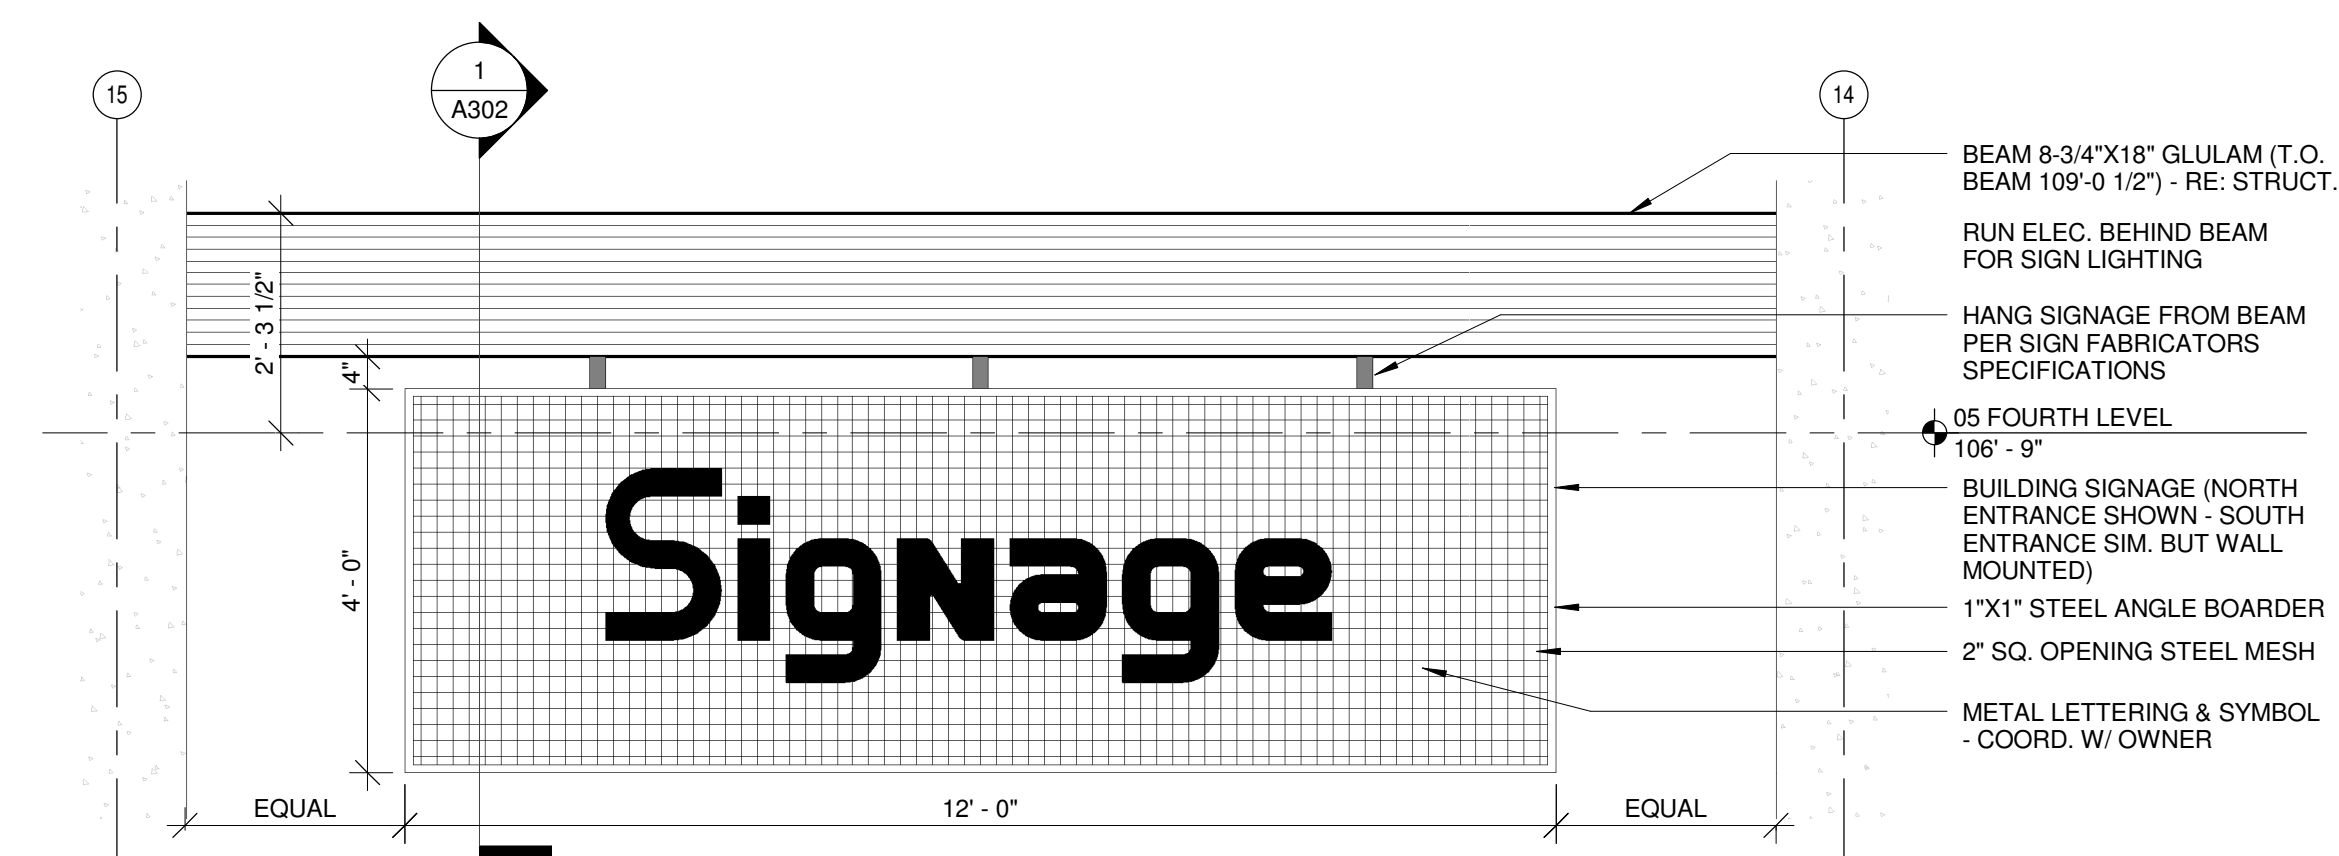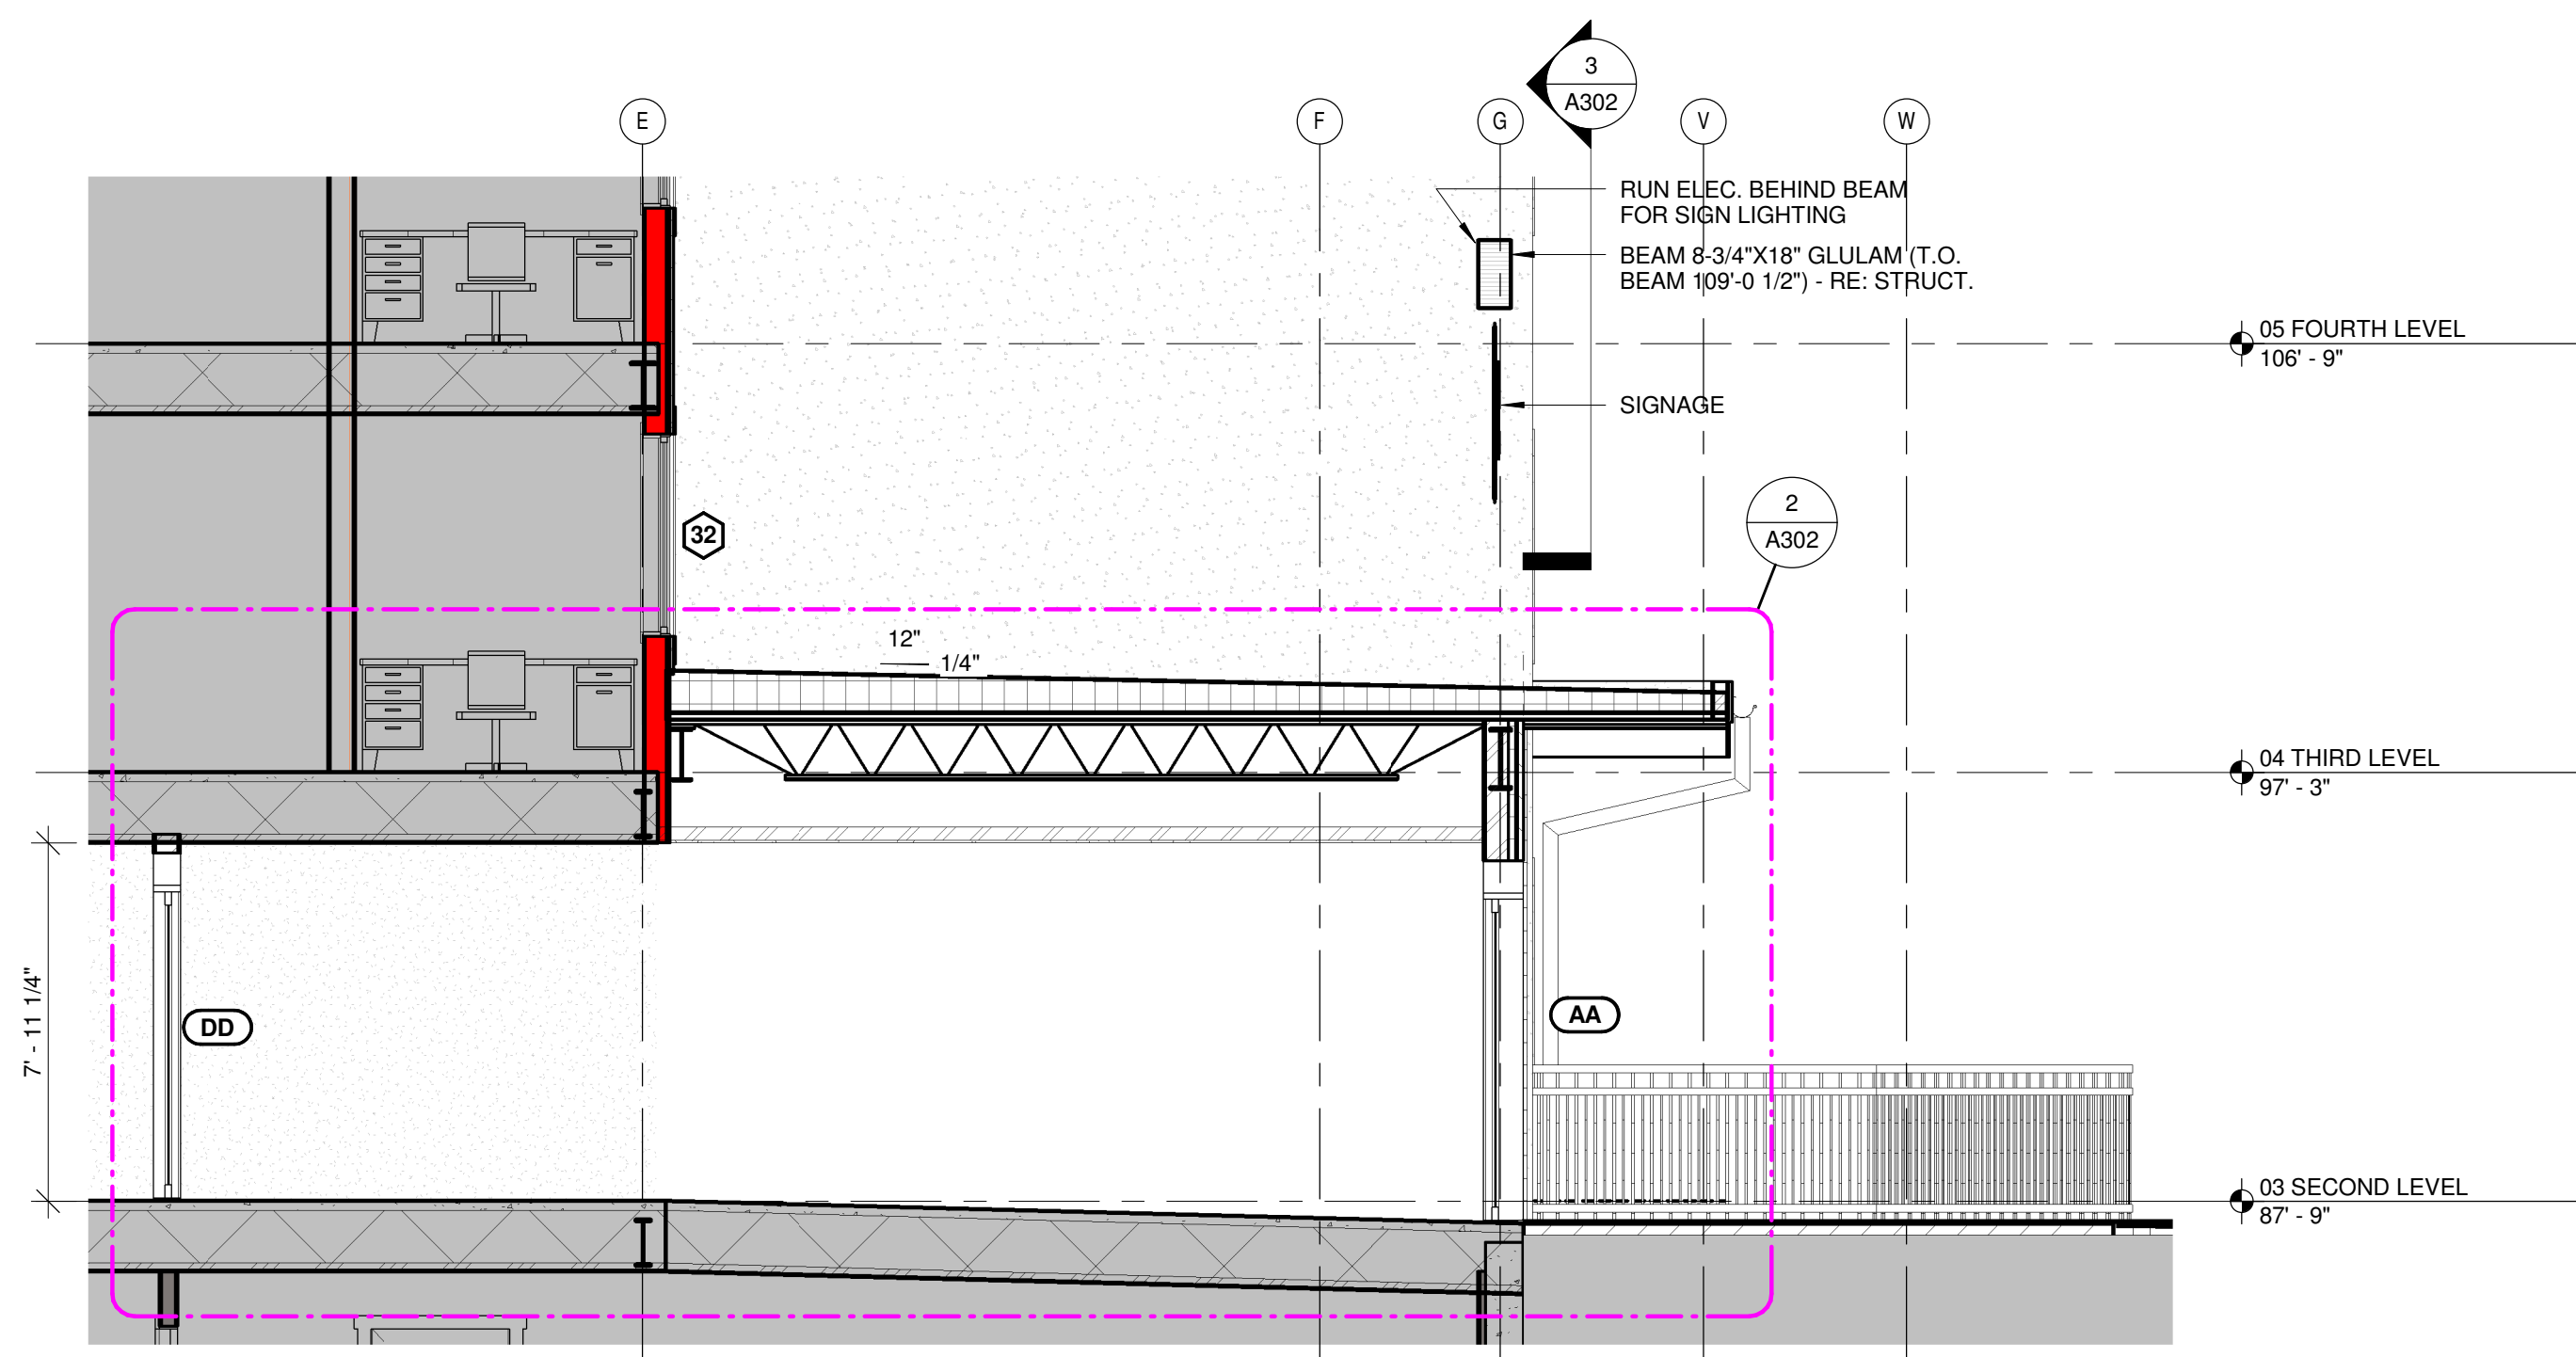

NOTICE: DUTY OF COOPERATION


NOTICE OF COOPERATION

Release of these plans contemplates further cooperation among the owner, his contractor and the architect. Design and construction are complex. Although the architect and his contractor have performed their services with due care and diligence, they cannot guarantee perfection. Communication is imperfect and every contingency cannot be anticipated. Any ambiguity or discrepancy discovered by the use of these plans shall be reported immediately to the architect. Failure to notify the architect compounds misunderstanding and increases construction costs. A failure to cooperate by simply using the plans without consulting the architect for responsibility for the consequences. Changes made from the plans without consent of the architect are unauthorized and shall relieve the architect of responsibility for all consequences arising out of such changes.

All design, documents and data prepared by Eric Smith Associates, P.C. as instruments of service shall remain the property of Eric Smith Associates, P.C. and shall not be copied, changed or disclosed in any form whatsoever without first obtaining the express written consent of Eric Smith Associates, P.C.

[illegible]

BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, COLORADO

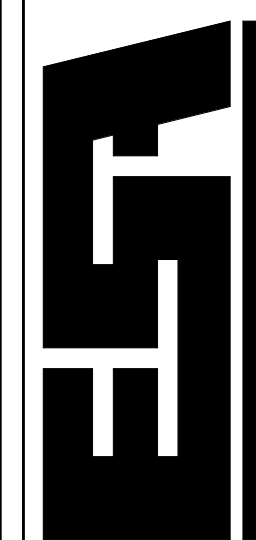




Job Number:	17022
Date:	2018-11-09
Drawn By:	Author
Checked By:	Checker

Project Phase
PERMIT REVIEW
Sheet Title
BUILDING SECTIONS - SKY ENTRY
Sheet Number
A302

DATE: 2019-03-29 PERMIT REVIEW

JOB CODE & REVIT FILE: 17022 - Bear Claw II CD Set R16.mt





3/29/2019 2:10:23 PM 17022 BEAR CLAW II SET_R16

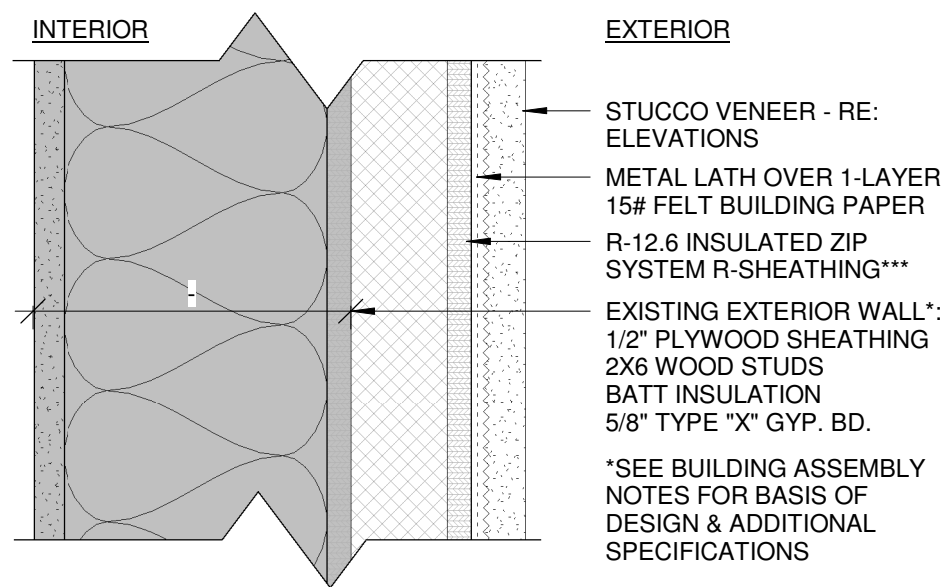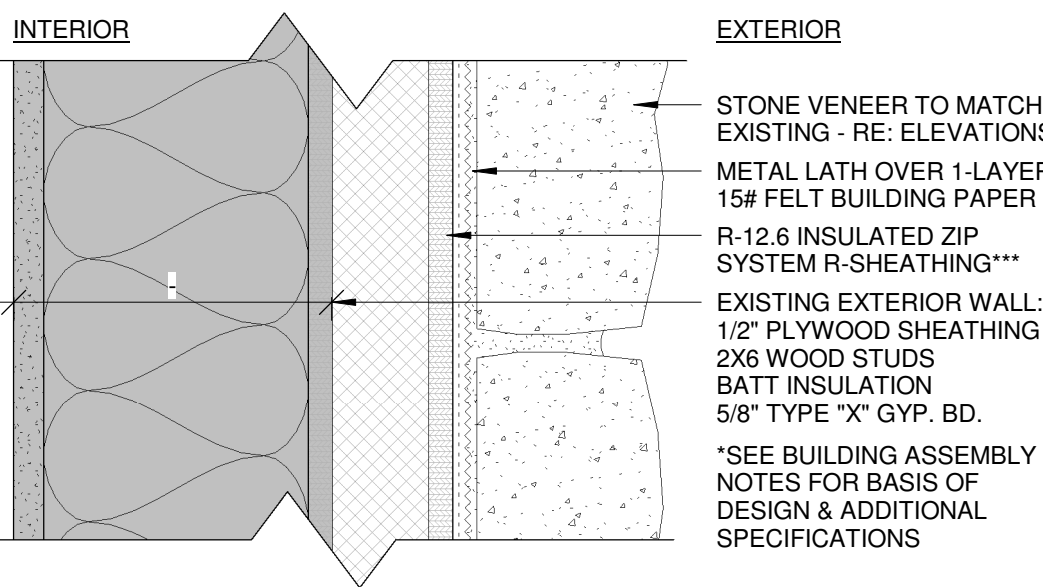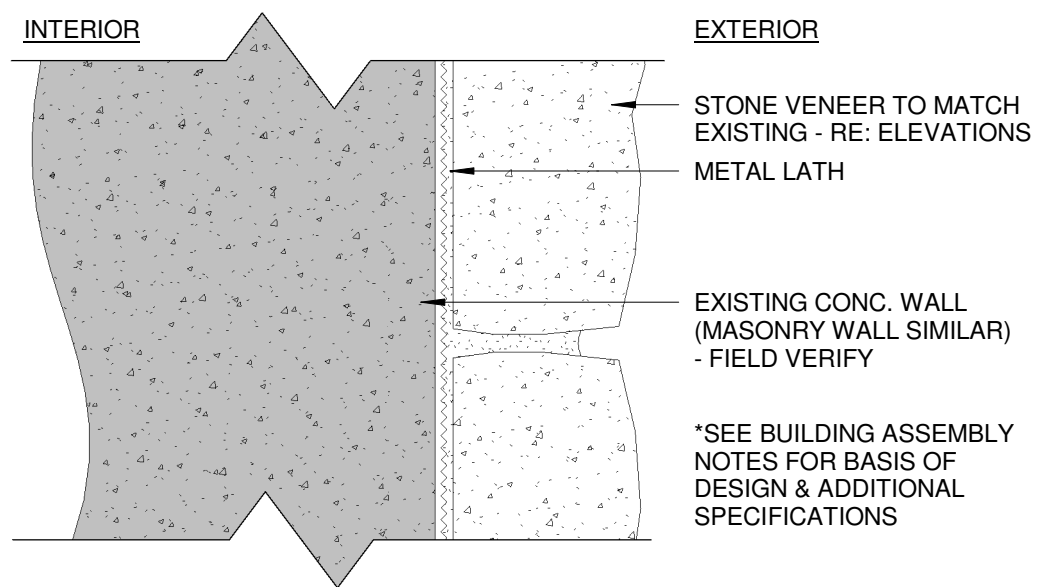

1 EXT. WALL (CONC) W/ STONE VENEER
A501 3" = 1'-0"



2 EXT. WALL W/ STONE VENEER
A501 3" = 1'-0"

3 EXT. WALL W/ STUCCO VENEER
A501 3" = 1'-0"

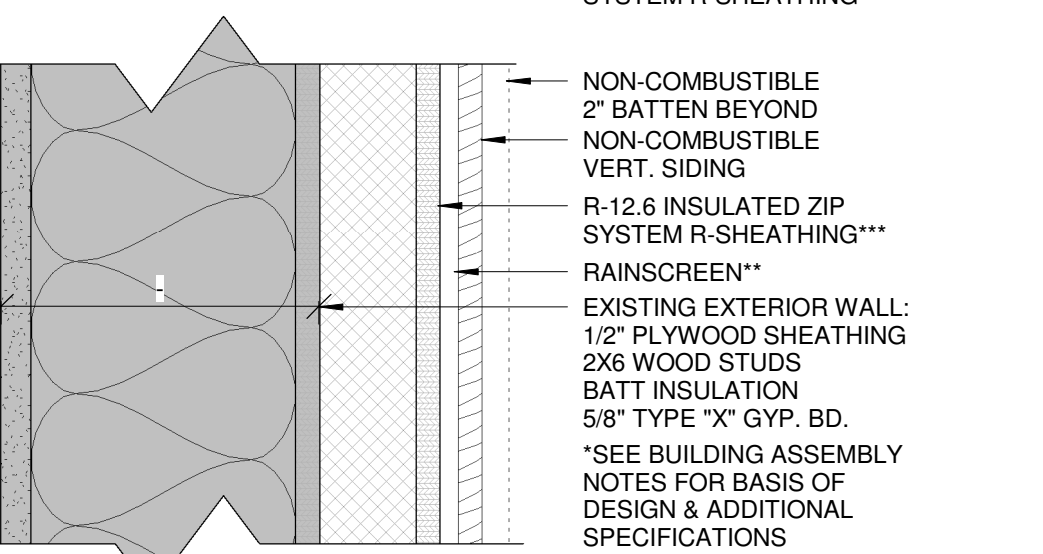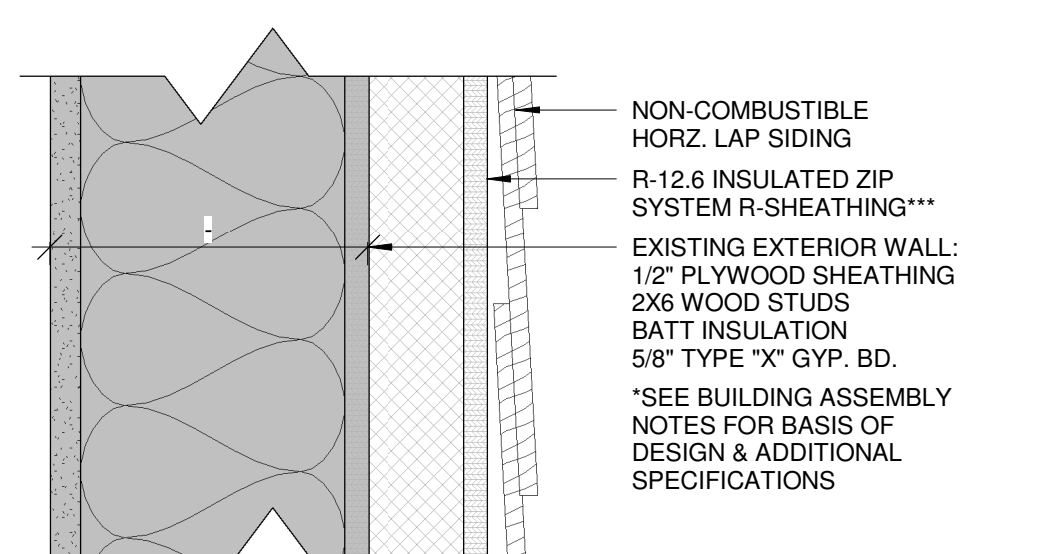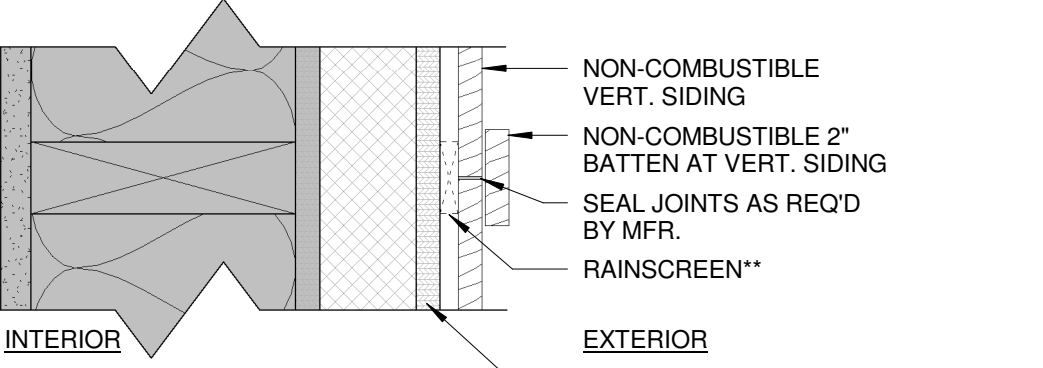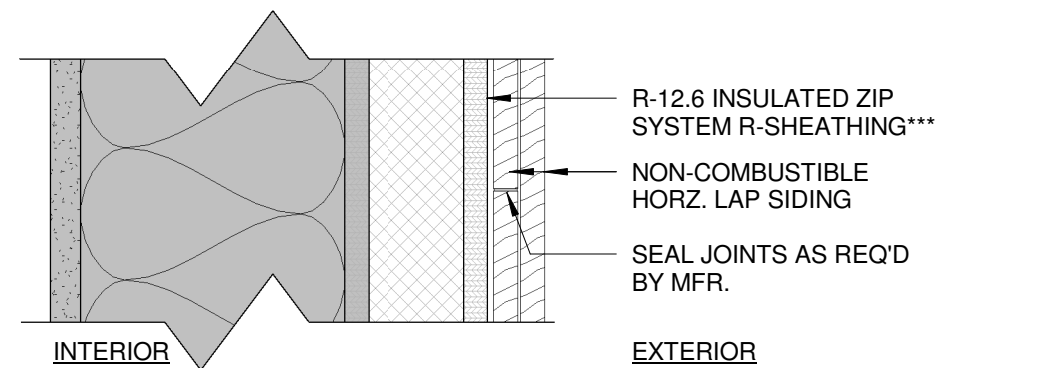



4 EXT. WALL W/ SIDING (HORZ LAP)
A501 3" = 1'-0"

5 EXT. WALL W/ SIDING (VERT B&B)
A501 3" = 1'-0"

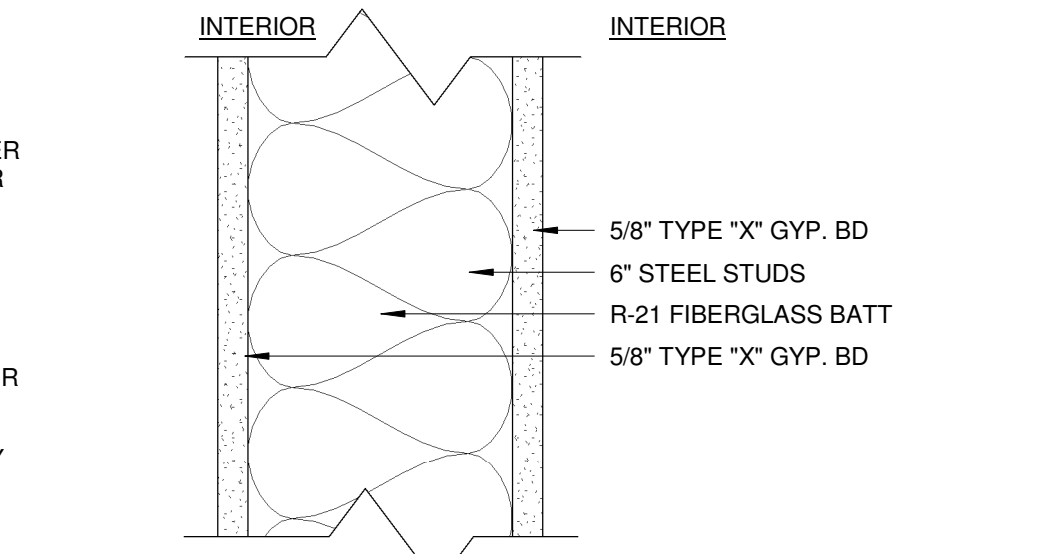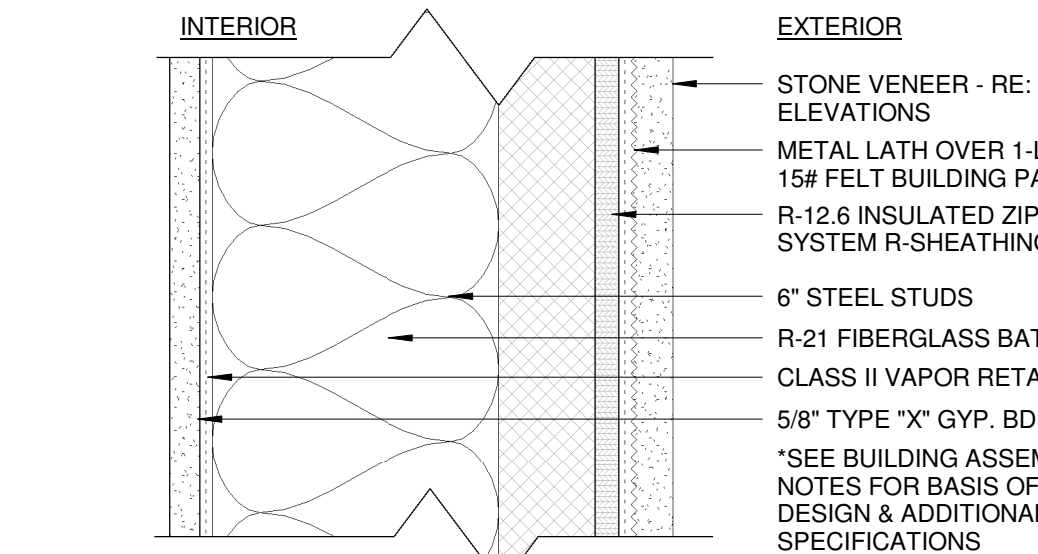

6 EXT. WALL (MTL. STUD) W/ STUCCO VENEER
A501 3" = 1'-0"

7 INT. WALL (6\"/>

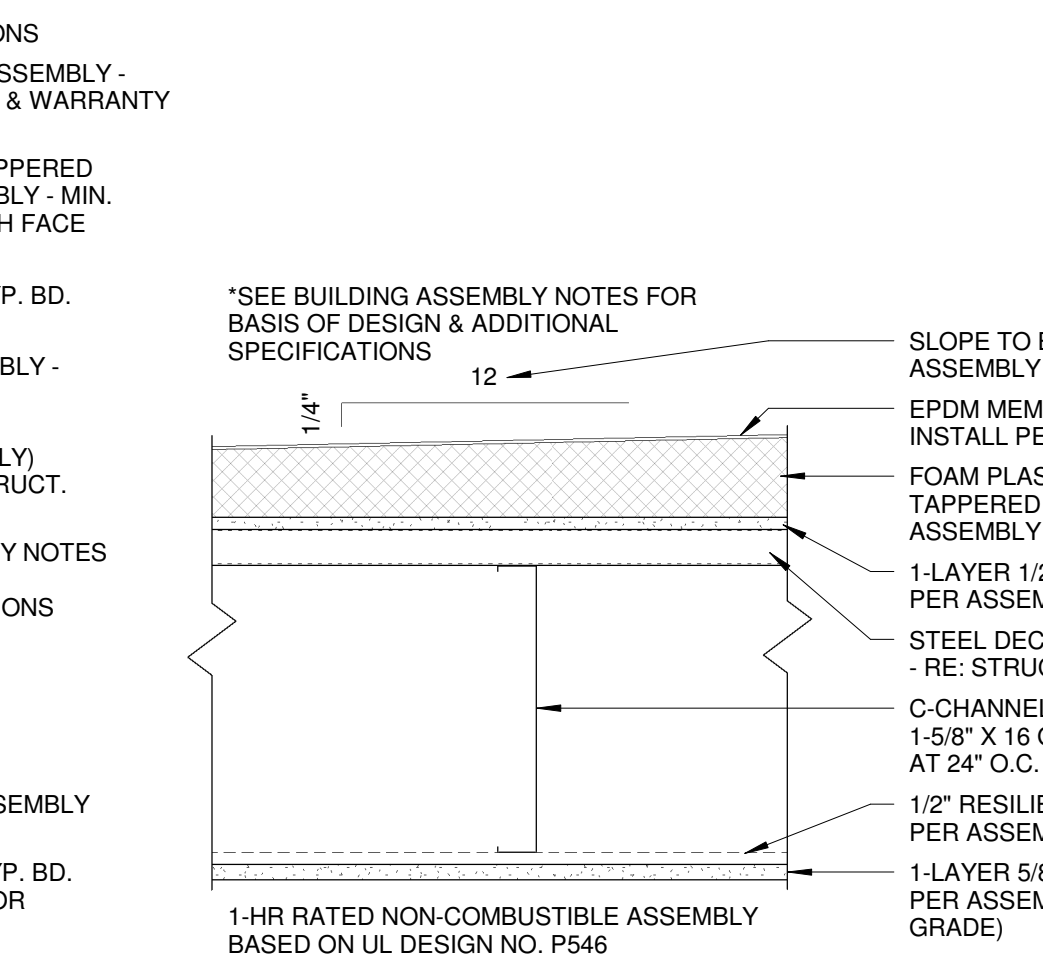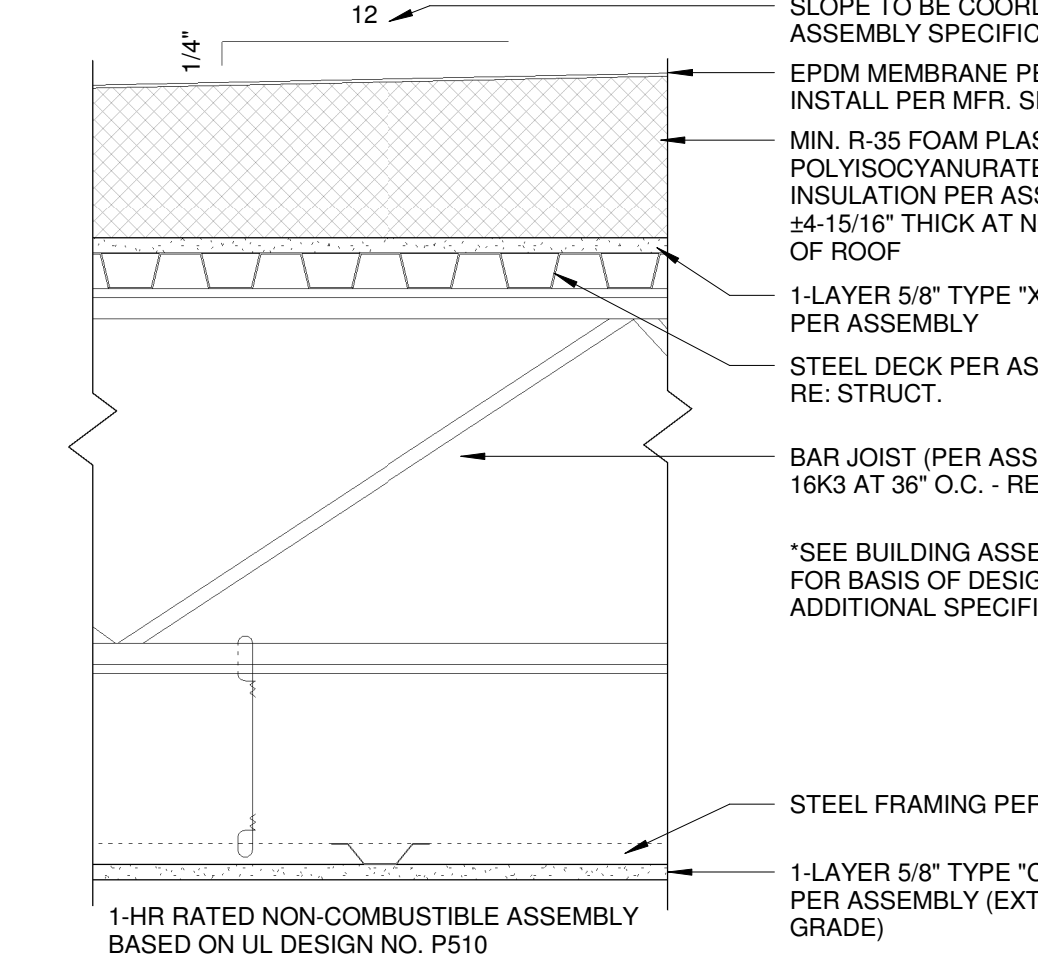


8 ROOF ASSEMBLY - SKI ENTRY
A501 1 1/2\"/>

9 ROOF ASSEMBLY - PORTE-COCHERE
A501 1 1/2\"/>

INSULATED SHEATHING LEGEND (BUILDING LAYOUTS):

2STN	= 2\"/>
1STN	= 1\"/>
0STN	= NO INSULATED SHEATHING UNDER STONE
2STC	= 2\"/>
1STC	= 1\"/>
0STC	= NO INSULATED SHEATHING UNDER STUCCO
2HL	= 2\"/>
1HL	= 1\"/>
0HL	= NO INSULATED SHEATHING UNDER HORZ. LAP
2VBB	= 2\"/>
1VBB	= 1\"/>
0VBB	= NO INSULATED SHEATHING UNDER VERT. B&B
EB	= EXISTING BRICK TO REMAIN
ESTN	= EXISTING STONE

GENERAL NOTE:
a. 2\"/>

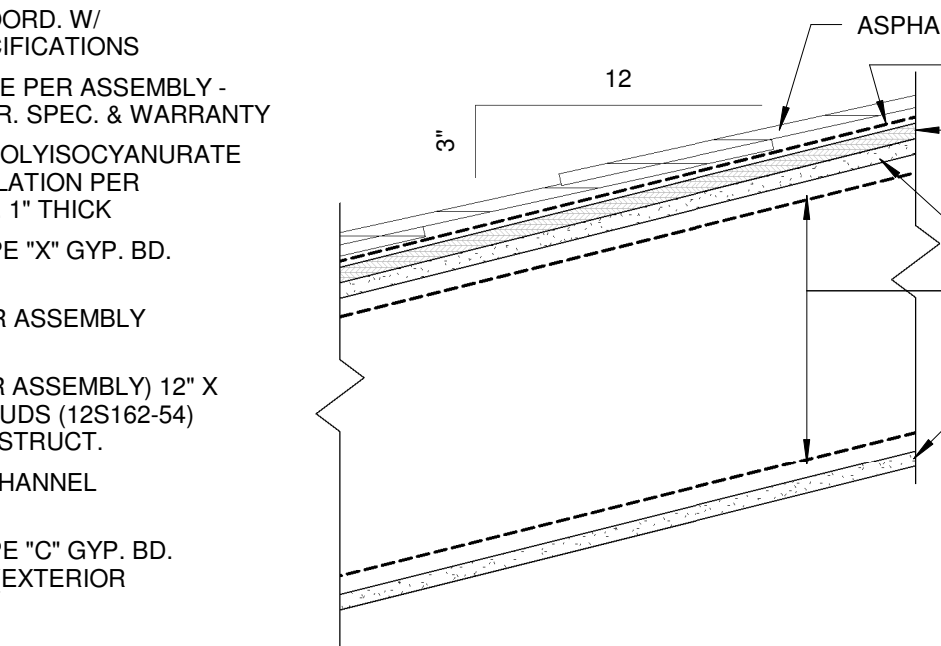

10 ROOF ASSEMBLY - TRASH ENCLOSURE
A501 1 1/2\"/>

UL Design No. X827 (1-Hr Rated): **STRUCTURAL ASSEMBLY TAG: S-1**

1. Steel Pipe or Tube Column — Steel circular pipe (SP) with diameter (ID) ranging from a minimum of 3 in. to a maximum of 32 in. with a minimum wall thickness of 3/16 in.

Steel square or rectangular tube (ST) with outside wall dimensions ranging from minimum 3 in. to a maximum of 36 in. and a minimum wall thickness of 3/16 in.

2. Spray-Applied Fire-Resistive Materials — Applied by spraying with water to the final thicknesses shown below. Crest areas shall be filled with Spray-Applied Fire Resistive Materials above the beam. Beam surfaces must be clean and free of dirt, loose scale and oil. Min average density of 13 pcf with min. ind density of 11 pcf for Types II, or D-C/F. Min avg and min ind densities of 22 and 19 pcf, respectively, for Type HP. For method of density determination, refer to Design Information Section.

The min thickness of Spray-Applied Fire Resistive Material required for various fire resistance ratings of contour sprayed steel pipes or tubes are shown in the tables below.

Min Column Size	A/P	1 HR	1-1/2 HR	2 HR	3 HR	4 HR
ST 3x3x0.188	0.18	1	1-3/4	2-9/16	—	—
ST 4x4x0.188	0.18	15/16	1-9/16	2-3/16	3-1/2	4-13/16
ST 4x4x0.25	0.24	3/4	1-5/16	1-15/16	3	4-13/16
ST 4x4x0.375	0.34	9/16	13/16	1-1/4	2-3/16	3
ST 4x4x0.5	0.44	7/16	3/4	1-11/16	1-11/16	2-5/16
SP 3x0.188	0.18	1	3-3/4	2-9/16	—	—
SP 4x0.237	0.22	13/16	1-7/16	2-1/16	3-3/8	4-13/16

ISOLATEK INTERNATIONAL — Type HP, D-C/F or II. Investigated for exterior use. Type EBS or Type X adhesive/sealer optional.

As an alternate to the above tables, the required thickness of Spray-Applied Fire Resistive Materials to be applied to all surfaces of the steel pipes or tubes for all rating periods may be determined from the following equation:

The thickness of sprayed for ratings of 1, 1-1/2, 2, 3, and 4 h of a steel pipe or tube may be determined by the equation:

$$h = \frac{R - 0.38}{3.58 (A/P)}$$

Where: R = the hourly rating (hrs).
h = the thickness of protection material, min 0.35 - max 3.50 in.
A = the cross sectional area (sq in.)
P = the heated perimeter (in.)

The A/P ratio of a circular pipe is determined by:

$$A/P = \frac{1(d - t)}{d}$$

Where: d = the outer diameter of the pipe (in.)
t = the wall thickness of the pipe (in.)

The A/P ratio of a rectangular tube is determined by:

$$A/P = \frac{t(a + b - 2t)}{a + b}$$

Where: a = the outer width of the tube (in.)
b = the outer length of the tube (in.)
t = the wall thickness of the tube (in.)

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

ESA Note:

- The system above is taken from the Underwriters Laboratories, Inc. (UL) Ultimate Fire Resistance Design Wizard (<http://database.ul.com/cgi-bin/ulwebb/LISEXT/1FRAME/FireResistance/Wizard.html>). See the UL Design Wizard or published directory for the complete assembly (which is not shown in it's entirety above) and the design information section ANSI/UL 263 (BXUV).
- Spray-Applied Fire-Resistive Materials basis of design: CAFCO Blaze Shield System by Isolatak International. The contractor proposes and proceeds with an alternative product, they shall provide all related documentation including but not limited to an approved fire rated assembly, product specifications, letter from manufacturer indicating the use of their product(s) in all conditions utilized within this project.
- See also Isolatak International for additional information and specifications (i.e. material thickness for beam sizes not listed within assembly) not specified above or within the UL Design in it's entirety.
- Letter from Isolatak International allowing the above reference UL Design column assembly in a horizontal configuration to be provided upon request.

UL Design No. X829 (1-Hr Rated): **STRUCTURAL ASSEMBLY TAG: S-2**

1. Steel Pipe or Tube Column — Steel circular pipe (SP) with diameter (ID) ranging from a minimum of 3 in. to a maximum of 32 in. with a minimum wall thickness of 3/16 in.

Steel square or rectangular tube (ST) with outside wall dimensions ranging from minimum 3 in. to a maximum of 36 in. and a minimum wall thickness of 3/16 in.

2. Spray-Applied Fire-Resistive Materials — Applied by spraying with water to the final thicknesses shown below. Crest areas shall be filled with Spray-Applied Fire Resistive Materials above the beam. Beam surfaces must be clean and free of dirt, loose scale and oil. Min average density of 13 pcf with min. ind density of 11 pcf for Types II, or D-C/F. Min avg and min ind densities of 22 and 19 pcf, respectively, for Type HP. For method of density determination, refer to Design Information Section.

The min thickness of Spray-Applied Fire Resistive Material required for various fire resistance ratings of contour sprayed steel pipes or tubes are shown in the tables below.

Min Column Size	A/P	1 HR	1-1/2 HR	2 HR	3 HR	4 HR
ST 3x3x0.188	0.18	1	1-3/4	2-9/16	—	—
ST 4x4x0.188	0.18	15/16	1-9/16	2-3/16	3-1/2	4-13/16
ST 4x4x0.25	0.24	3/4	1-5/16	1-15/16	3	4-13/16
ST 4x4x0.375	0.34	9/16	13/16	1-1/4	2-3/16	3
ST 4x4x0.5	0.44	7/16	3/4	1-11/16	1-11/16	2-5/16
SP 3x0.188	0.18	1	3-3/4	2-9/16	—	—
SP 4x0.237	0.22	13/16	1-7/16	2-1/16	3-3/8	4-13/16

ISOLATEK INTERNATIONAL — Type HP, D-C/F or II. Investigated for exterior use. Type EBS or Type X adhesive/sealer optional.

As an alternate to the above tables, the required thickness of Spray-Applied Fire Resistive Materials to be applied to all surfaces of the steel pipes or tubes for all rating periods may be determined from the following equation:

The thickness of sprayed for ratings of 1, 1-1/2, 2, 3, and 4 h of a steel pipe or tube may be determined by the equation:

$$h = \frac{R - 0.38}{3.58 (A/P)}$$

Where: R = the hourly rating (hrs).
h = the thickness of protection material, min 0.35 - max 3.50 in.
A = the cross sectional area (sq in.)
P = the heated perimeter (in.)

The A/P ratio of a circular pipe is determined by:

$$A/P = \frac{1(d - t)}{d}$$

Where: d = the outer diameter of the pipe (in.)
t = the wall thickness of the pipe (in.)

The A/P ratio of a rectangular tube is determined by:

$$A/P = \frac{t(a + b - 2t)}{a + b}$$

Where: a = the outer width of the tube (in.)
b = the outer length of the tube (in.)
t = the wall thickness of the tube (in.)

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

ESA Note:

- The system above is taken from the Underwriters Laboratories, Inc. (UL) Ultimate Fire Resistance Design Wizard (<http://database.ul.com/cgi-bin/ulwebb/LISEXT/1FRAME/FireResistance/Wizard.html>). See the UL Design Wizard or published directory for the complete assembly (which is not shown in it's entirety above) and the design information section ANSI/UL 263 (BXUV).
- Spray-Applied Fire-Resistive Materials basis of design: CAFCO Blaze Shield System by Isolatak International. The contractor proposes and proceeds with an alternative product, they shall provide all related documentation including but not limited to an approved fire rated assembly, product specifications, letter from manufacturer indicating the use of their product(s) in all conditions utilized within this project.
- See also Isolatak International for additional information and specifications (i.e. material thickness for beam sizes not listed within assembly) not specified above or within the UL Design in it's entirety.
- Letter from Isolatak International allowing the above reference UL Design column assembly in a horizontal configuration to be provided upon request.

ISOLATEK INTERNATIONAL — Type HP, D-C/F or II. Investigated for exterior use. Type EBS or Type X adhesive/sealer optional.

As an alternate to the equations, the minimum thickness of protection Material required for various fire resistance ratings of contour or box sprayed columns may be determined from the table below:

Min Column Size	W/D	1 HR	1-1/2 HR	2 HR	3 HR	4 HR
W8X10	0.33	1-1/4	1-13/16	2-5/16	3-9/16	—
W6X16	0.57	11/16	1-1/8	1-9/16	2-7/16	3-1/4
W8X28	0.68	11/16	1-1/8	1-7/16	1-7/8	2-5/16
W10X49	0.83	11/16	1	1-1/4	1-11/16	2-1/8
W12X106	1.46	7/16	3/4	1	1-7/16	1-15/16
W14X233	2.52	5/16	1/2	1/2	15/16	1-5/16
W14X730	6.68	3/8	3/8	3/8	3/8	9/16

* A 1/2 Hour Rating may be obtained on a minimum W6x16 column with a minimum 3/8 in. of material.

The thicknesses of protection material contained in the table below are applicable when the protection of the contour sprayed column's flange tips are reduced to one-half.

Min Column Size	W/D	1 HR	1-1/2 HR	2 HR	3 HR	4 HR
W8X10	0.33	1-3/8	2	2-5/8	—	—
W6X16	0.57	13/16	1-5/16	1-3/4	2-3/4	3-11/16
W8X28	0.68	13/16	1-5/16	1-11/16	2-9/16	3-7/16
W10X49	0.83	13/16	1-1/8	1-7/16	1-15/16	2-7/16
W12X106	1.46	1/2	13/16	1-1/8	1-5/8	2-3/16
W14X233	2.52	7/16	9/16	9/16	1-1/16	1-1/2
W14X730	6.68	3/8	3/8	3/8	1/2	11/16

ISOLATEK INTERNATIONAL — Type D-C/F, HP or II. Type D-C/F, HP or II investigated for exterior use. Type EBS or Type X adhesive/sealer optional.

2. Metal Lath — (Optional for contour application) — 3.4 lb/sq yd galvanized or painted expanded steel lath. Lath shall be lapped 1 in. and tied together with No. 13 SWG galvanized steel wire spaced vertically 6 in. O.C. or alternately, attached with No. 24 MSG spring clips, 1/2 in. wide, pushed onto column flanges, vertically spaced 6 in. O.C.

3. Steel Column — Min. sizes as shown above in Item 1.

*Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

ESA Note:

- The system above is taken from the Underwriters Laboratories, Inc. (UL) Ultimate Fire Resistance Design Wizard (<http://database.ul.com/cgi-bin/ulwebb/LISEXT/1FRAME/FireResistance/Wizard.html>). See the UL Design Wizard or published directory for the complete assembly (which is not shown in it's entirety above) and the design information section ANSI/UL 263 (BXUV).
- Spray-Applied Fire-Resistive Materials basis of design: CAFCO Blaze Shield System by Isolatak International. The contractor proposes and proceeds with an alternative product, they shall provide all related documentation including but not limited to an approved fire rated assembly, product specifications, letter from manufacturer indicating the use of their product(s) in all conditions utilized within this project.
- See also Isolatak International for additional information and specifications (i.e. material thickness for beam sizes not listed within assembly) not specified above or within the UL Design in it's entirety.
- Letter from Isolatak International allowing the above reference UL Design column assembly in a horizontal configuration to be provided upon request.

BUILDING ASSEMBLY NOTES:

- BASIS OF DESIGN:
1a) INSULATED SHEATHING - HUBER ENGINEERED WOODS ZIP SYSTEM R-SHEATHING WITH ZIP SYSTEM SEAM / FLASHING TAPE AND ZIP SYSTEM FLEXIBLE FLASHING TAPE.
i) 2-1/2" THICK (2" INSULATIONS W/ 1/2" SHEATHING PER MFR. SPEC) = R-12.6.
ii) 1-1/2" THICK (1" INSULATIONS W/ 1/2" SHEATHING PER MFR. SPEC) = R-6.6.
1b) NON-COMBUSTIBLE FIBER CEMENT HORIZONTAL LAP SIDING - JAMES HARDIE.
1c) NON-COMBUSTIBLE FIBER CEMENT VERTICAL BOARD & BATTEN SIDING - JAMES HARDIE.
1d) STONE VENEER - CONTRACTOR TO MATCH EXISTING STONE VENEER.
1e) STUCCO VENEER - STO POWERWALL FAMILY SYSTEM.
1f) ASPHALT SHINGLES - CONTRACTOR TO MATCH EXISTING ASPHALT SHINGLES.
1g) POLYISOCYANURATE FOAMED PLASTIC INSULATION BOARD (UL ASSEMBLY DESIGN NO. P510) IN COMPLIANCE WITH PROPRIETARY LIST INDICATED WITHIN ASSEMBLY (I.E. CARLISLE SYNTAC INCORPORATED - TYPE HP, HP-H, HP-N, HP-W).
1h) POLYISOCYANURATE FOAMED PLASTIC INSULATION BOARD (UL ASSEMBLY DESIGN NO. P546) IN COMPLIANCE WITH THE UL FIRE RESISTANCE DIRECTORY - FOAMED PLASTIC (CCVW).
1i) EPDM MEMBRANE - FULLY ADHERED IN COMPLIANCE WITH THE UL FIRE RESISTANCE DIRECTORY - ROOFING MEMBRANES (CHCI).
1j) SPRAY APPLIED FIRE-RESISTIVE MATERIAL (SPRM) - ISOLATEK INTERNATIONAL CAFCO BLAZE-SHIELD II OR HP.
1k) WATER-RESISTIVE BARRIER - DUPONT TYVEK COMMERCIALWRAP WITH DUPONT TYVEK TAPE AND/OR DUPONT FLASHING TAPE PER MANUFACTURER'S SPECIFICATIONS AND WARRANTY.
2) INSULATED SHEATHING (1a):
2a) SHEATHING SHALL BE INSTALLED PER MANUFACTURER'S SPECIFICATIONS & WARRANTY. CONNECTION TO SIMILAR AND/OR ADJACENT MATERIALS SHALL BE COORDINATED IN THE FIELD WITH THAT MANUFACTURER'S SPECIFICATIONS & WARRANTY INCLUDING BUT NOT LIMITED TO SEALED SEAMS BETWEEN TWO OR MORE PANELS, WINDOW & OPENING FLASHING, THRU PENETRATIONS, ETC..
2b) R-12.6 INSULATED SHEATHING IS INDICATED WITHIN THE BUILDING ASSEMBLY DETAILS; HOWEVER, R-6.6 OR NO INSULATED SHEATHING SHALL BE SUBSTITUTED IN ITS PLACE BASED ON EXISTING CONDITIONS. REFER TO BUILDING LAYOUT SHEETS FOR VENEER FINISH TYPES AND INSULATED SHEATHING THICKNESS & APPLICABLE DETAILS IF A SUBSTITUTION IS USED.
2c) WATER-RESISTIVE BARRIER (TYVEK COMMERCIALWRAP)(1k) SHALL BE INSTALLED OVER THE EXISTING WOOD SHEATHING IN PLACE OF ZIP R-SHEATHING (1a) WHERE "NO INSULATED SHEATHING UNDER..." (SEE INSULATED SHEATHING LEGEND) IS INDICATED / SPECIFIED. THE WATER-RESISTIVE BARRIER SHALL BE INSTALLED IN STRICT CONFORMANCE WITH THE MANUFACTURER'S SPECIFICATIONS & WARRANTY. THE CONTRACTOR SHALL COORDINATE THE OVERLAPPING AND INSTALLATION OF BOTH THE WATER-RESISTIVE BARRIER AND THE ZIP R-SHEATHING SYSTEM PER THEIR RESPECTIVE MANUFACTURERS SPECIFICATIONS WHEN THEY ARE ADJACENT TO ONE ANOTHER.
3) ALL EXTERIOR VENEER MATERIALS TO BE INSTALLED IN STRICT CONFORMANCE WITH THEIR RESPECTIVE MANUFACTURER'S SPECIFICATIONS & WARRANTY.
4) FIELD VERIFY EXISTING WALL. EXISTING EXTERIOR VENEER & MATERIALS TO BE REMOVED DOWN TO PLYWOOD SHEATHING.
5) 1-HR FIRE RATED TUBE STEEL COLUMN ASSEMBLY BASED ON UL DESIGN NO. X827.
6) 1-HR FIRE RATED "W" BEAM ASSEMBLY BASED ON UL DESIGN NO. X829.
7) SFRM THICKNESS BASED ON ISOLATEK INTERNATIONAL'S TECHNICAL SPECIFICATIONS BASED ON THE SIZE AND CONFIGURATION OF THE COLUMN/BEAMS. CONTRACTOR SHALL PROVIDE ALL THE APPLICABLE INFORMATION INCLUDING, BUT NOT LIMITED TO FIRE RATED TESTED ASSEMBLIES, REQUIRED MATERIAL THICKNESS & APPLICABLE DETAILS IF A SUBSTITUTION IS USED.
8) IF A BUILDING ASSEMBLY REFERENCES A SPECIFIC FIRE RATED TESTED ASSEMBLY, THE CONTRACTOR SHALL BUILD THAT SPECIFIC ASSEMBLY BASED ON THE REQUIREMENTS SPECIFIED WITHIN THE REFERENCED ASSEMBLY (I.E. PROPRIETARY MATERIALS, SIZES, SPACING, ETC...). CONTACT THE ARCHITECT AND STRUCTURAL ENGINEER IF THERE IS A CONFLICT BETWEEN THE CONSTRUCTION SET AND THE REFERENCED FIRE TESTED ASSEMBLY.

UL Design No. X829 (1-Hr Rated): **STRUCTURAL ASSEMBLY TAG: S-2**

1. Spray-Applied Fire-Resistive Materials — Applied by spraying with water, in one or more untamped coats at the thickness shown in the table below to steel surfaces which are free of dirt, oil or scale. Use of adhesive is optional. Minimum average untamped density is 13 pcf with minimum ind untamped density of 11 pcf for Types II and D-C/F. Min avg and min ind untamped densities of 22 and 19 pcf, respectively, for Type HP. Tamping is optional. For method of density determination refer to Design Information Section.

The thickness of Spray-Applied Fire Resistive Materials (Item 1) required for rating periods of 1 h, 1-1/2 h, 2 h, 3 h, 4 h of contour sprayed columns may be determined by the equation:

$$h = \frac{R}{1.01 (W/D)} + 0.66$$

Where: h=Protection material thickness in the range 0.375-3.75 in.
R=Fire resistance rating in hours (1-4 h).
D=Heated perimeter of steel column in inches.
W=Weight of steel column in lbs per foot.
W/D=0.55 to 7.0

The thickness of Spray-Applied Fire Resistive Materials in the range of 0.375-3.75 in. required for rating periods of 1 h, 1-1/2 h, 2 h, 3 h, 4 h of contour sprayed columns with W/D=0.30-0.55 may be determined by the equation:

$$h = \frac{R}{0.95 (W/D)} + 0.45$$

As an alternative to the equations, the minimum thickness of protection Material required for various fire resistance ratings of contour or box sprayed columns may be determined from the table below:

Min Column Size	W/D	1 HR	1-1/2 HR	2 HR	3 HR	4 HR
W8X10	0.33	1-1/4	1-13/16	2-5/16	3-9/16	—
W6X16	0.57	11/16	1-1/8	1-9/16	2-7/16	3-1/4
W8X28	0.68	11/16	1-1/8	1-7/16	1-7/8	2-5/16
W10X49	0.83	11/16	1	1-1/4	1-11/16	2-1/8
W12X106	1.46	7/16	3/4	1	1-7/16	1-15/16
W14X233	2.52	5/16	1/2	1/2	15/16	1-5/16
W14X730	6.68	3/8	3/8	3/8	3/8	9/16

* A 1/2 Hour Rating may be obtained on a minimum W6x16 column with a minimum 3/8 in. of material.

The thicknesses of protection material contained in the table below are applicable when the protection of the contour sprayed column's flange tips are reduced to one-half.

Min Column Size	W/D	1 HR	1-1/2 HR	2 HR	3 HR	4 HR
W8X10	0.33	1-3/8	2	2-5/8	—	—
W6X16	0.57	13/16	1-5/16	1-3/4	2-3/4	3-11/16
W8X28	0.68	13/16	1-5/16	1-11/16	2-9/16	3-7/16
W10X49	0.83	13/16	1-1/8	1-7/16	1-15/16	2-7/16
W12X106	1.46	1/2	13/16	1-1/8	1-5/8	2-3/16
W14X233	2.52	7/16	9/16	9/16	1-1/16	1-1/2
W14X730	6.68	3/8	3/8	3/8	1/2	11/16

ISOLATEK INTERNATIONAL — Type D-C/F, HP or II. Type D-C/F, HP or II investigated for exterior use. Type EBS or Type X adhesive/sealer optional.

2. Metal Lath — (Optional for contour application) — 3.4 lb/sq yd galvanized or painted expanded steel lath. Lath shall be lapped 1 in. and tied together with No. 13 SWG galvanized steel wire spaced vertically 6 in. O.C. or alternately, attached with No. 24 MSG spring clips, 1/2 in. wide, pushed onto column flanges, vertically spaced 6 in. O.C.

3. Steel Column — Min. sizes as shown above in Item 1.

*Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

ESA Note:

- The system above is taken from the Underwriters Laboratories, Inc. (UL) Ultimate Fire Resistance Design Wizard (<http://database.ul.com/cgi-bin/ulwebb/LISEXT/1FRAME/FireResistance/Wizard.html>). See the UL Design Wizard or published directory for the complete assembly (which is not shown in it's entirety above) and the design information section ANSI/UL 263 (BXUV).
- Spray-Applied Fire-Resistive Materials basis of design: CAFCO Blaze Shield System by Isolatak International. The contractor proposes and proceeds with an alternative product, they shall provide all related documentation including but not limited to an approved fire rated assembly, product specifications, letter from manufacturer indicating the use of their product(s) in all conditions utilized within this project.
- See also Isolatak International for additional information and specifications (i.e. material thickness for beam sizes not listed within assembly) not specified above or within the UL Design in it's entirety.
- Letter from Isolatak International allowing the above reference UL Design column assembly in a horizontal configuration to be provided upon request.

UL Design No. X829 (1-Hr Rated): **STRUCTURAL ASSEMBLY TAG: S-2**

1. Spray-Applied Fire-Resistive Materials — Applied by spraying with water, in one or more untamped coats at the thickness shown in the table below to steel surfaces which are free of dirt, oil or scale. Use of adhesive is optional. Minimum average untamped density is 13 pcf with minimum ind untamped density of 11 pcf for Types II and D-C/F. Min avg and min ind untamped densities of 22 and 19 pcf, respectively, for Type HP. Tamping is optional. For method of density determination refer to Design Information Section.

The thickness of Spray-Applied Fire Resistive Materials (Item 1) required for rating periods of 1 h, 1-1/2 h, 2 h, 3 h, 4 h of contour sprayed columns may be determined by the equation:

$$h = \frac{R}{1.01 (W/D)} + 0.66$$

Where: h=Protection material thickness in the range 0.375-3.75 in.
R=Fire resistance rating in hours (1-4 h).
D=Heated perimeter of steel column in inches.
W=Weight of steel column in lbs per foot.
W/D=0.55 to 7.0

The thickness of Spray-Applied Fire Resistive Materials in the range of 0.375-3.75 in. required for rating periods of 1 h, 1-1/2 h, 2 h, 3 h, 4 h of contour sprayed columns with W/D=0.30-0.55 may be determined by the equation:

$$h = \frac{$$

1 HEAD/JAMB/SILL DTL. - 01
A512 3" = 1'-0"

2 HEAD/JAMB/SILL DTL. - 02
A512 3" = 1'-0"

3 HEAD/JAMB/SILL DTL. - 03
A512 3" = 1'-0"


4 HEAD/JAMB/SILL DTL. - 04
A512 3" = 1'-0"

- DETAIL NOTES:
1. NEW STUCCO VENEER WALL SHOWN IN DETAIL FOR REFERENCE ONLY. WALL TYPE VARIES BASED ON LOCATION OF PROPOSED AUTOMATIC SLIDING DOOR ASSEMBLY - RE: BLDG. LAYOUTS.
 2. ALIGNMENT OF AUTOMATIC SLIDING DOOR ASSEMBLY WITHIN WALL TO BE COORDINATED IN THE FIELD BASED ON TYPE OF WALL ASSEMBLY IS TO BE INSTALLED WITHIN.
 3. FULL BREAKOUT ASSEMBLY SHOWN, FIXED SIDELITE ASSEMBLY SIMILAR.

5 HEAD/JAMB/SILL DTL. - 05
A512 3" = 1'-0"

6 WINDOW & DOOR EXTERIOR TRIM DTL.
A512 $1\frac{1}{2}" = 1'-0"$

HEAD/JAMB/SILL DETAILS SHOWN ARE FOR GENERAL REPRESENTATION ONLY. INSTALLATION OF DOOR & WINDOW ASSEMBLIES AND RELATED ADJACENT MATERIALS INCLUDING BUT NOT LIMITED TO INSULATED SHEATHING, FLASHING, EXTERIOR FINISHES, ETC., SHALL COMPLY WITH ALL MFR. SPECIFICATIONS & WARRANTY AND ANY AND ALL APPLICABLE CODES THAT HAVE JURISDICTION OVER THIS PROJECT, WHICHEVER IS MORE STRINGENT.

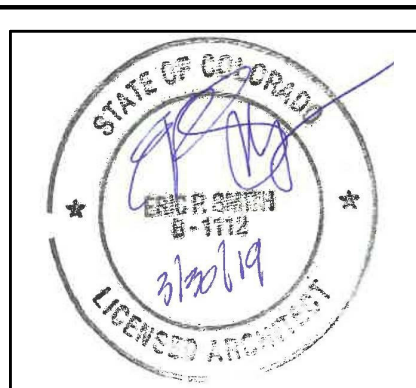

NOTICE: DUTY OF COOPERATION


Release of these plans contemplates further cooperation among the owner, his contractor and the architect. Design and construction are complex. Although the Architect and his consultants have performed their services with due care and diligence, they cannot guarantee perfection. Communication is imperfect and every contingency cannot be anticipated. Any ambiguity or discrepancy discovered by the use of these plans shall be reported immediately to the architect. Failure to notify the architect compounds misunderstanding and increases construction costs. A failure to cooperate by a simple notice to the architect shall relieve the architect from liability for the consequences arising out of the plans without consent of the architect are unauthorized and shall relieve the architect of responsibility for all consequences arising out of such changes.

All design, documents and data prepared by Eric Smith Associates, P.C. as instruments of service shall remain property of Eric Smith Associates, P.C. and shall not be copied, changed or disclosed in any form whatsoever without first obtaining the express written consent of Eric Smith Associates, P.C.

Eric Smith Associates, P.C.


[illegible]

BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, COLORADO

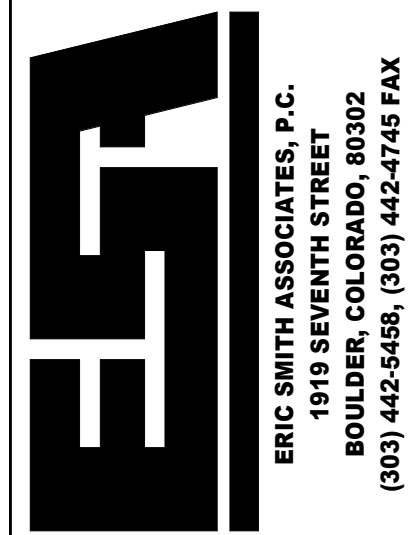


Job Number:	17022
Date:	2018-11-09
Drawn By:	Author
Checked By:	Checker


Project Phase
PERMIT REVIEW
Sheet Title
DOOR & WINDOW DETAILS
Sheet Number
A512

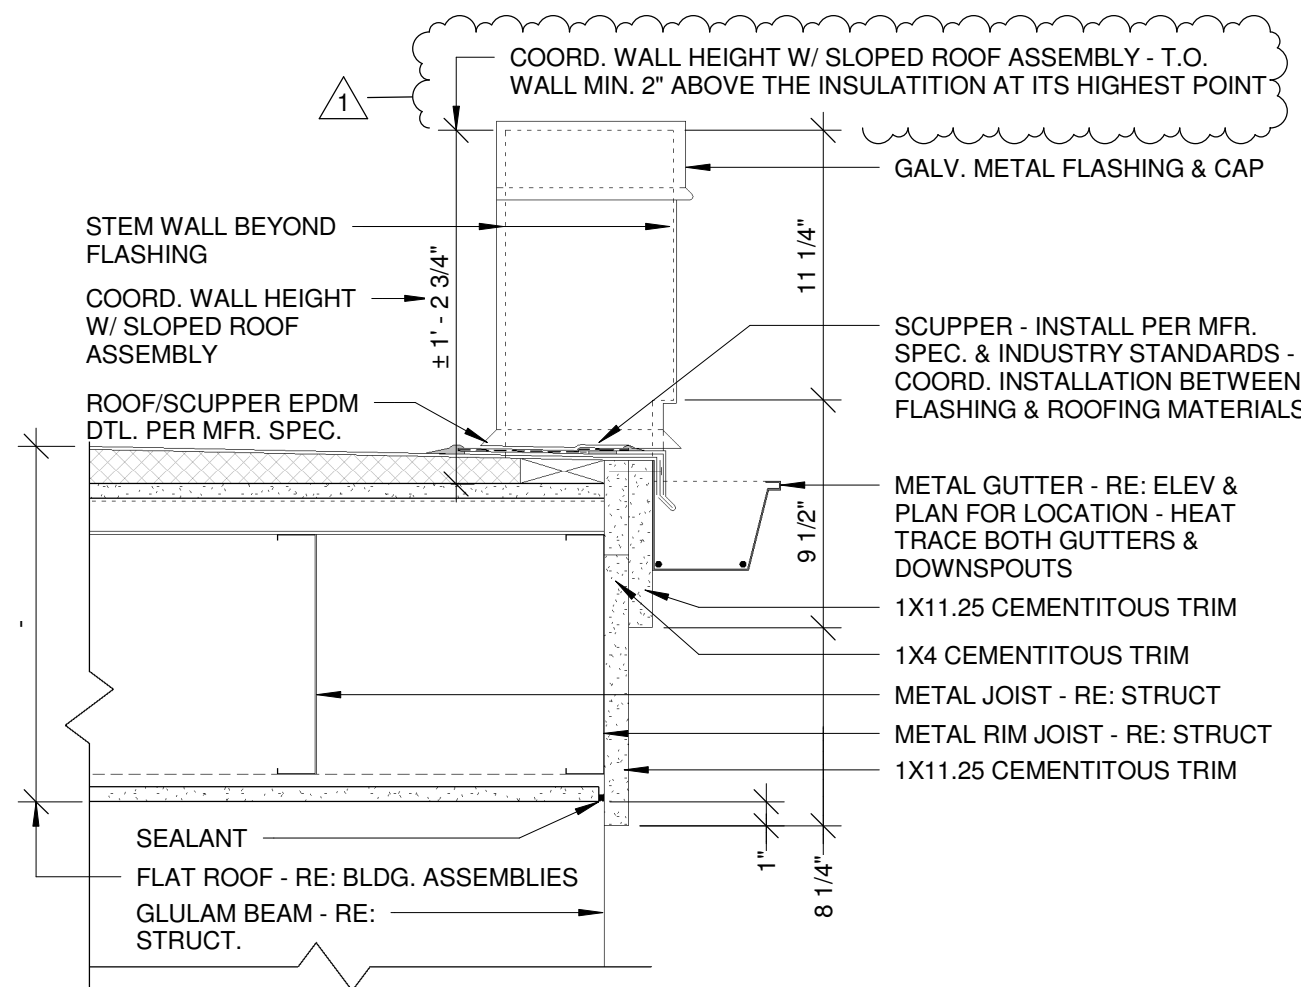


1 PORTE-COCHERE SCUPPER DETAIL-01
1 1/2" = 1'-0"

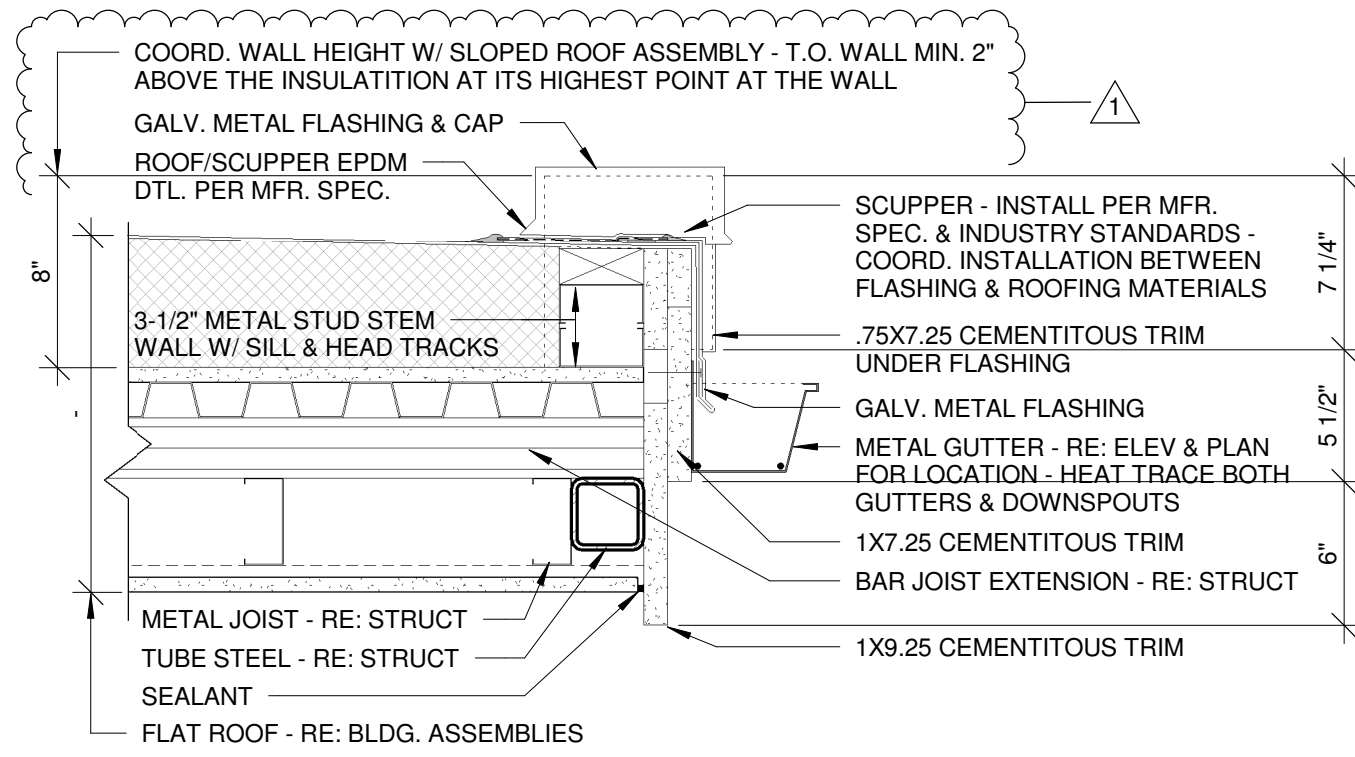


2 SKI ENTRY SCUPPER DETAIL-01
1 1/2" = 1'-0"

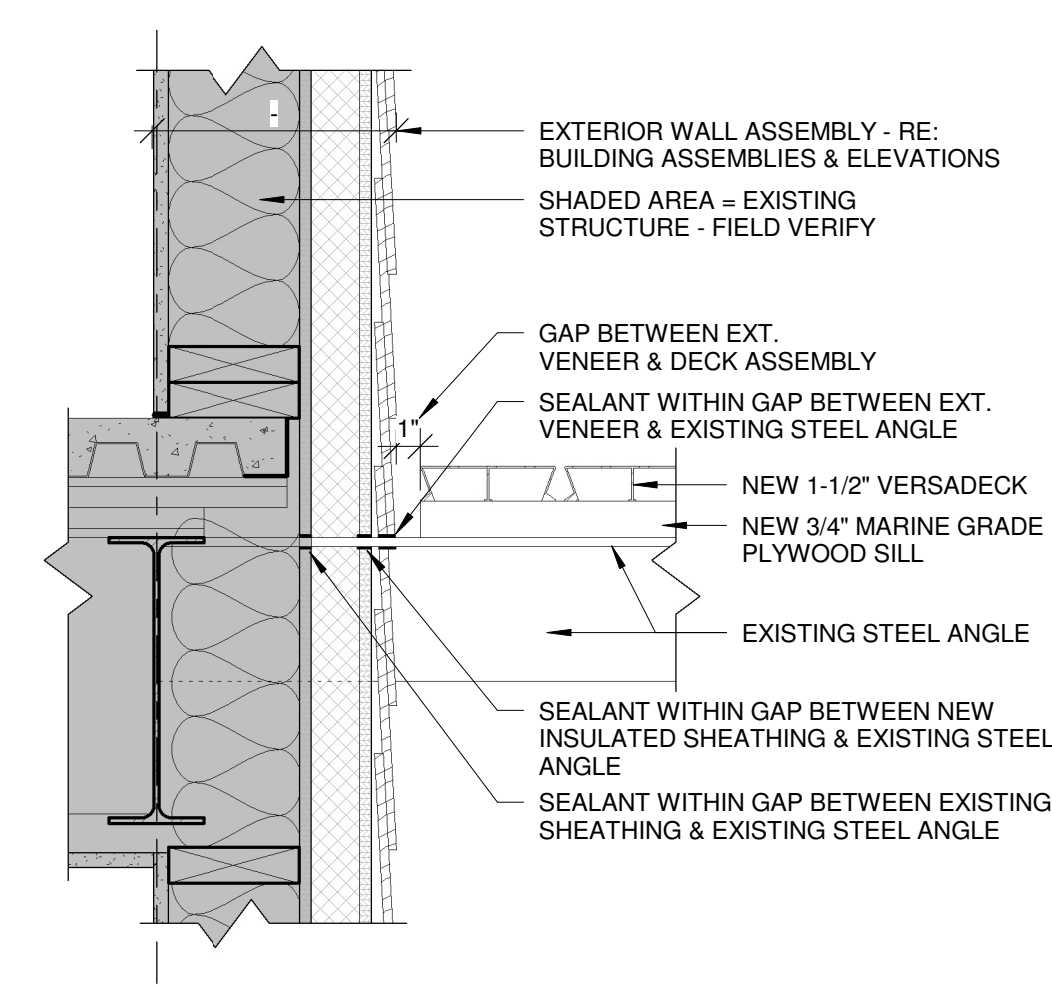


7 WALL/DECK DETAIL-01
1 1/2" = 1'-0"

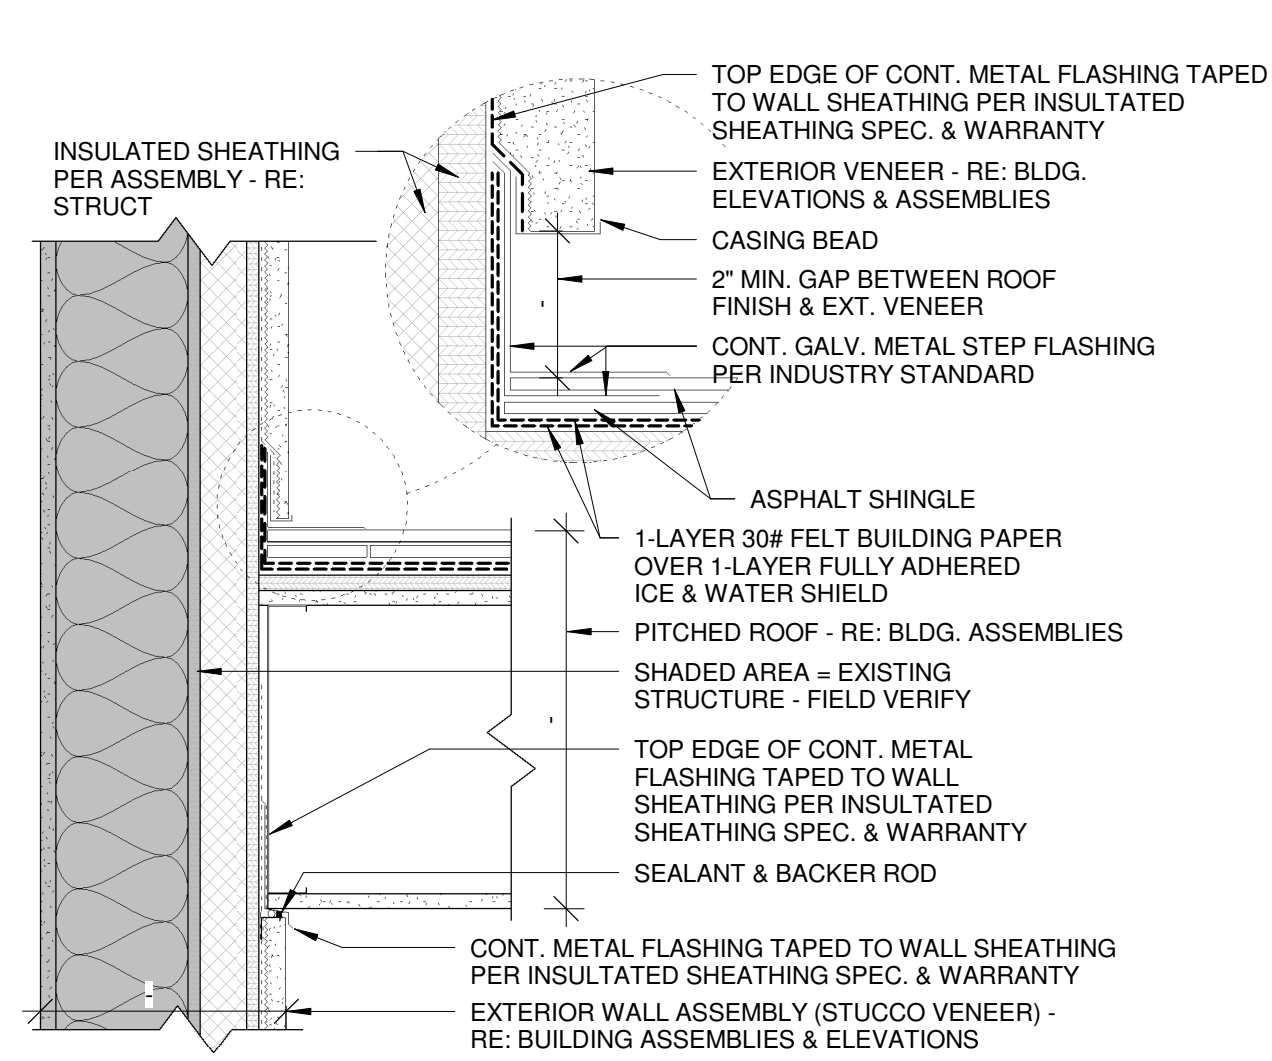


11 WALL/ROOF DETAIL-01
1 1/2" = 1'-0"

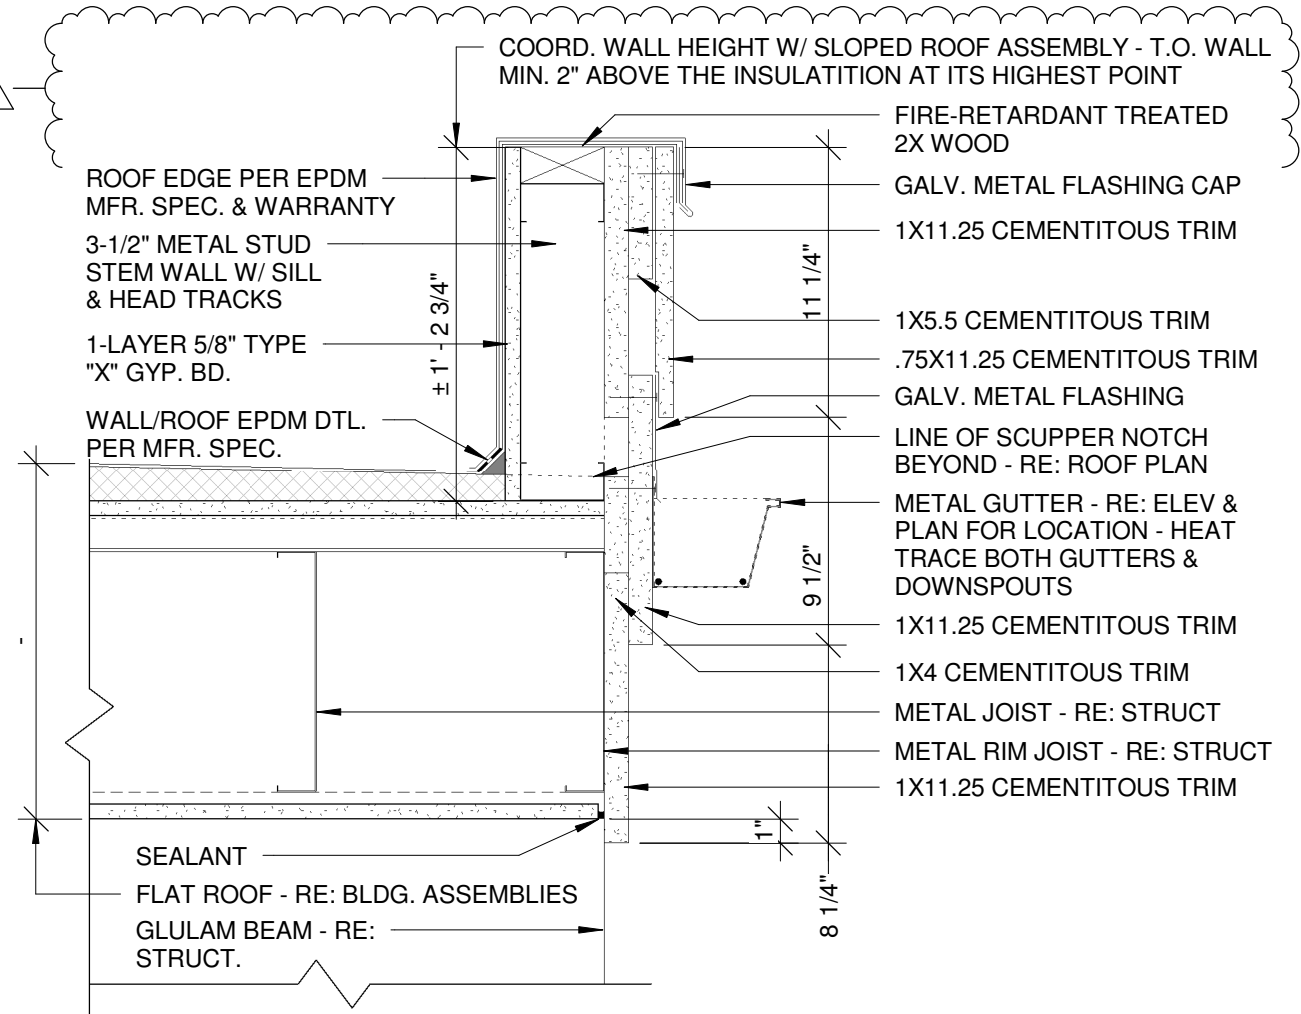


3 PORTE-COCHERE EAVE DETAIL-01
1 1/2" = 1'-0"

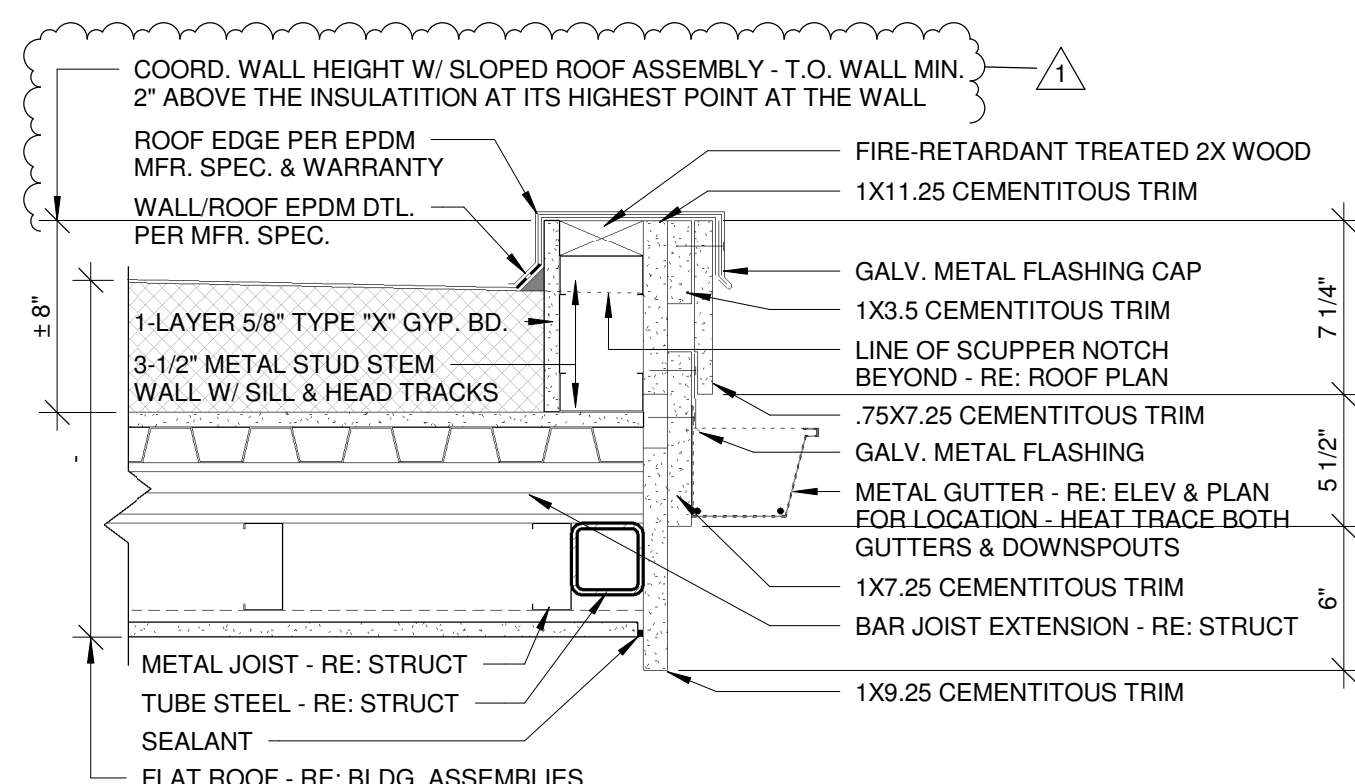


5 SKI ENTRY EAVE DETAIL-01
1 1/2" = 1'-0"

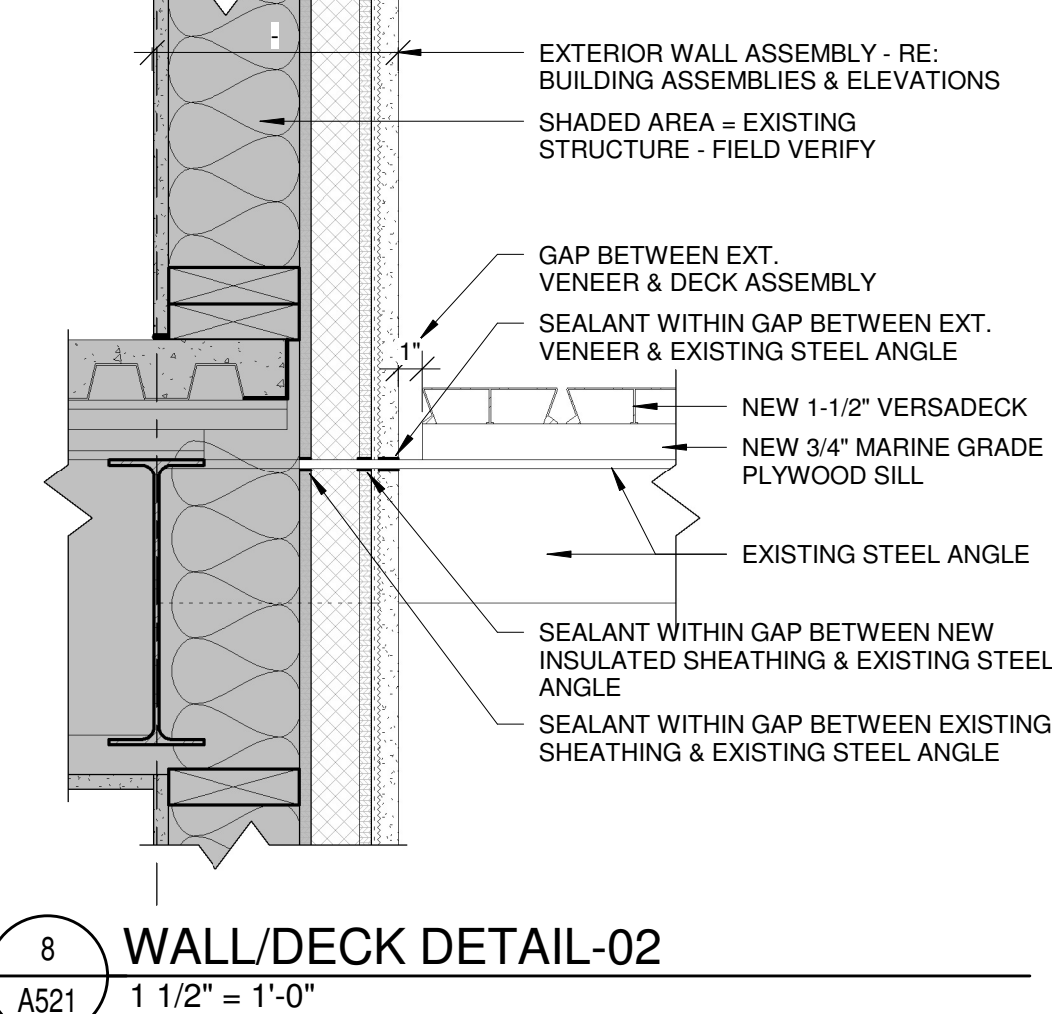


8 WALL/DECK DETAIL-02
1 1/2" = 1'-0"

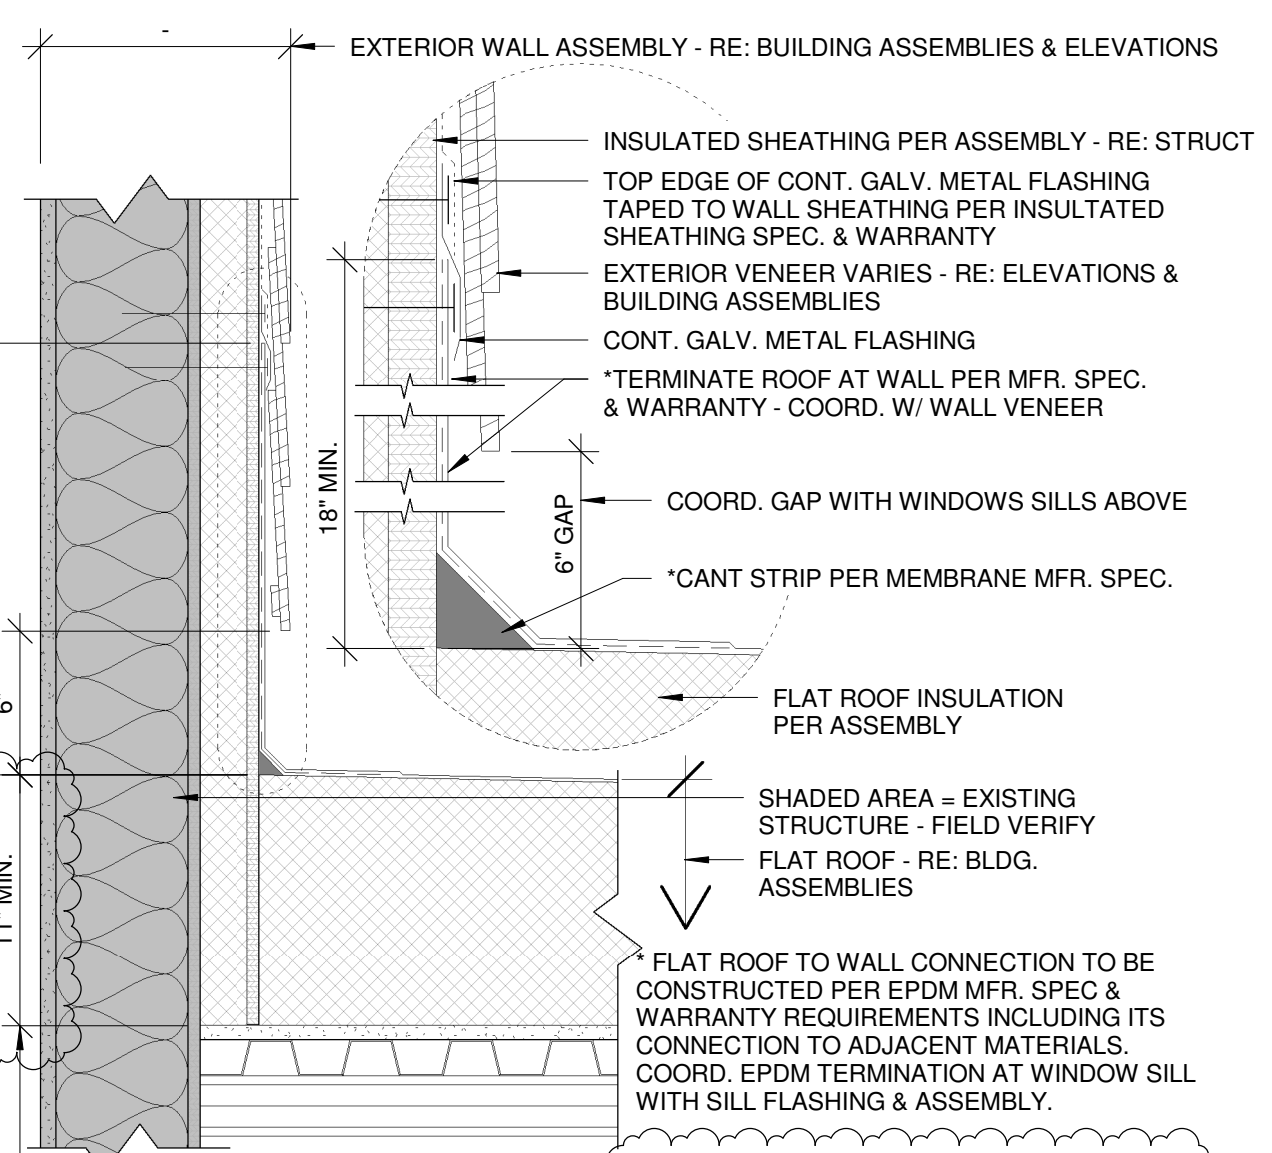


12 WALL/ROOF DETAIL-02
1 1/2" = 1'-0"

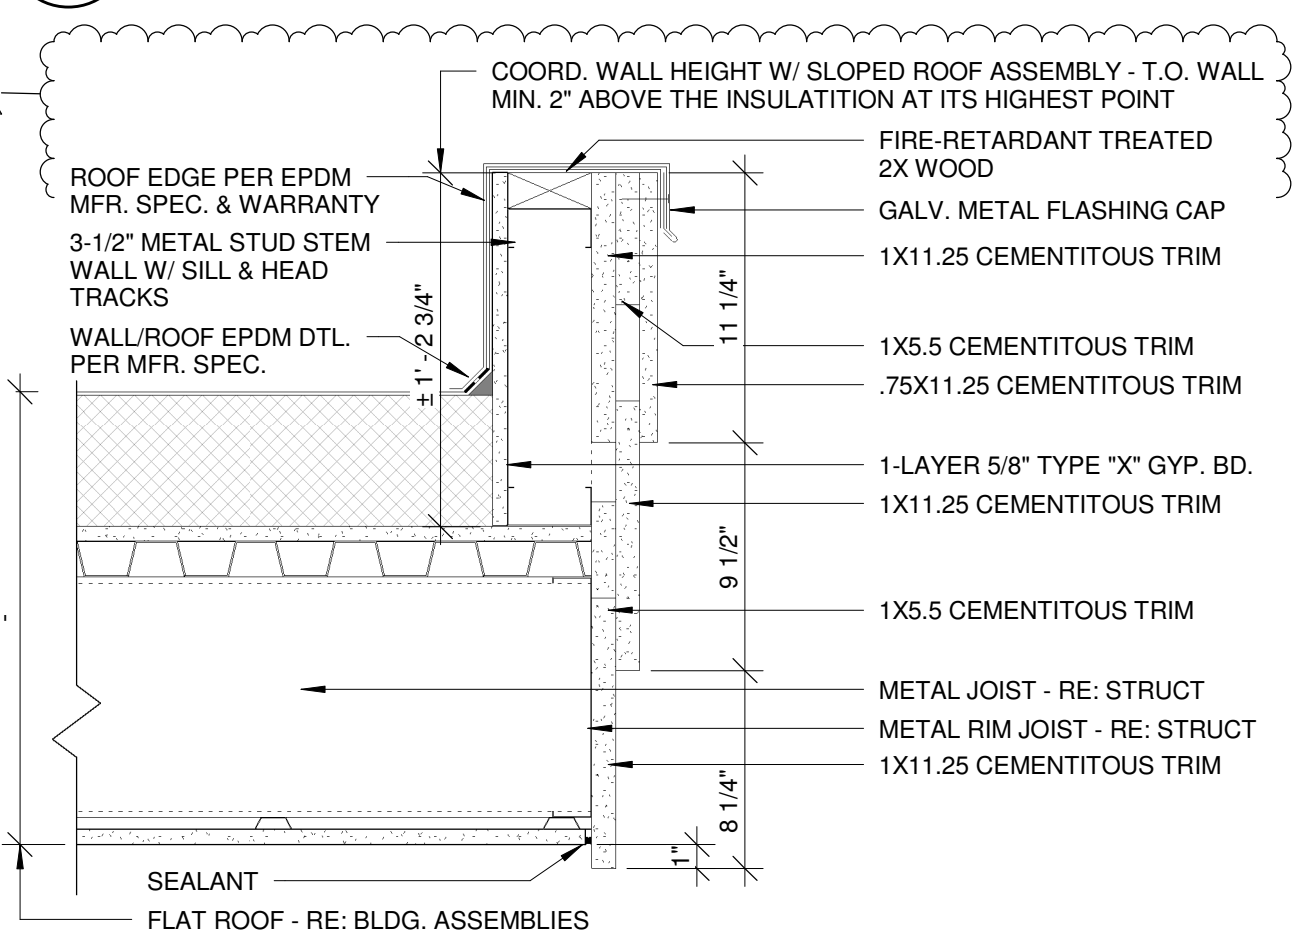


4 PORTE-COCHERE EAVE DETAIL-02
1 1/2" = 1'-0"

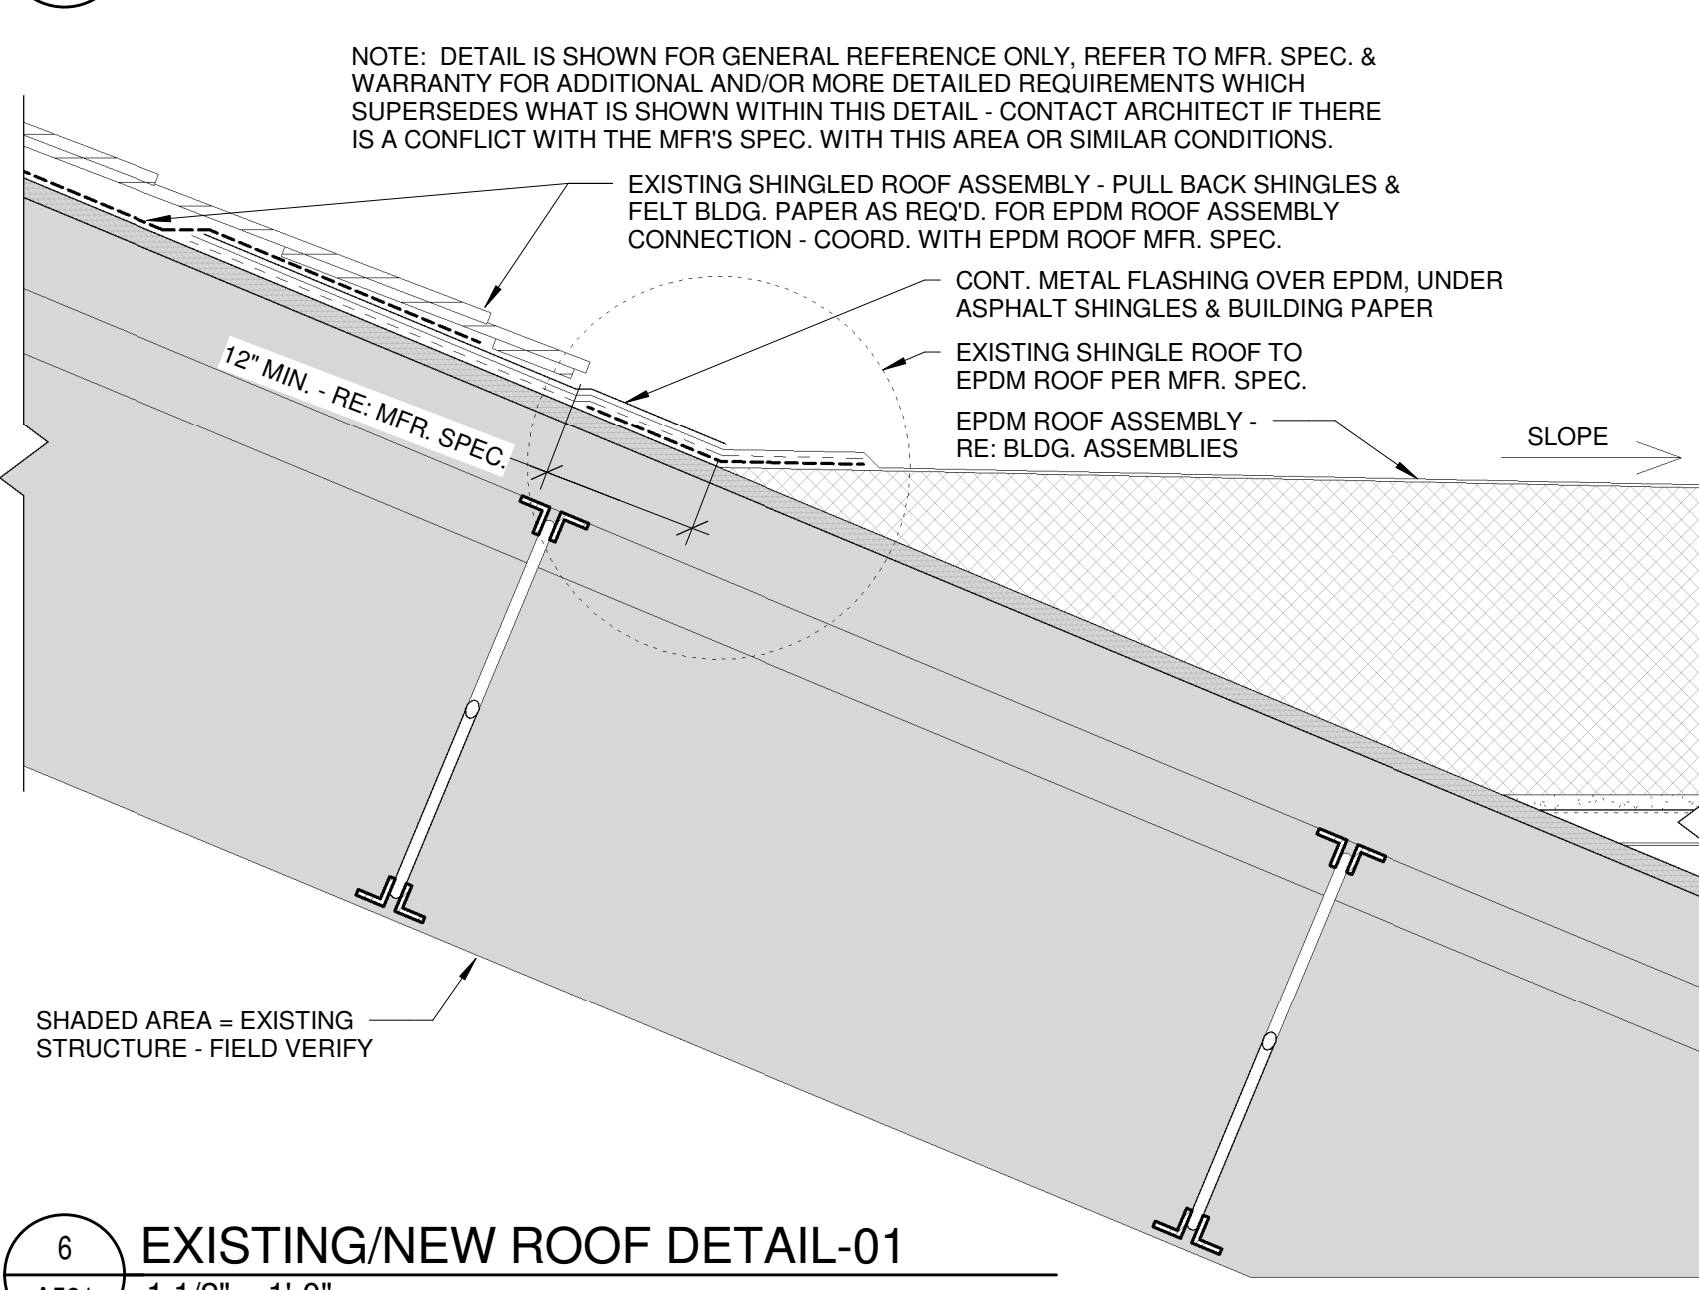


6 EXISTING/NEW ROOF DETAIL-01
1 1/2" = 1'-0"

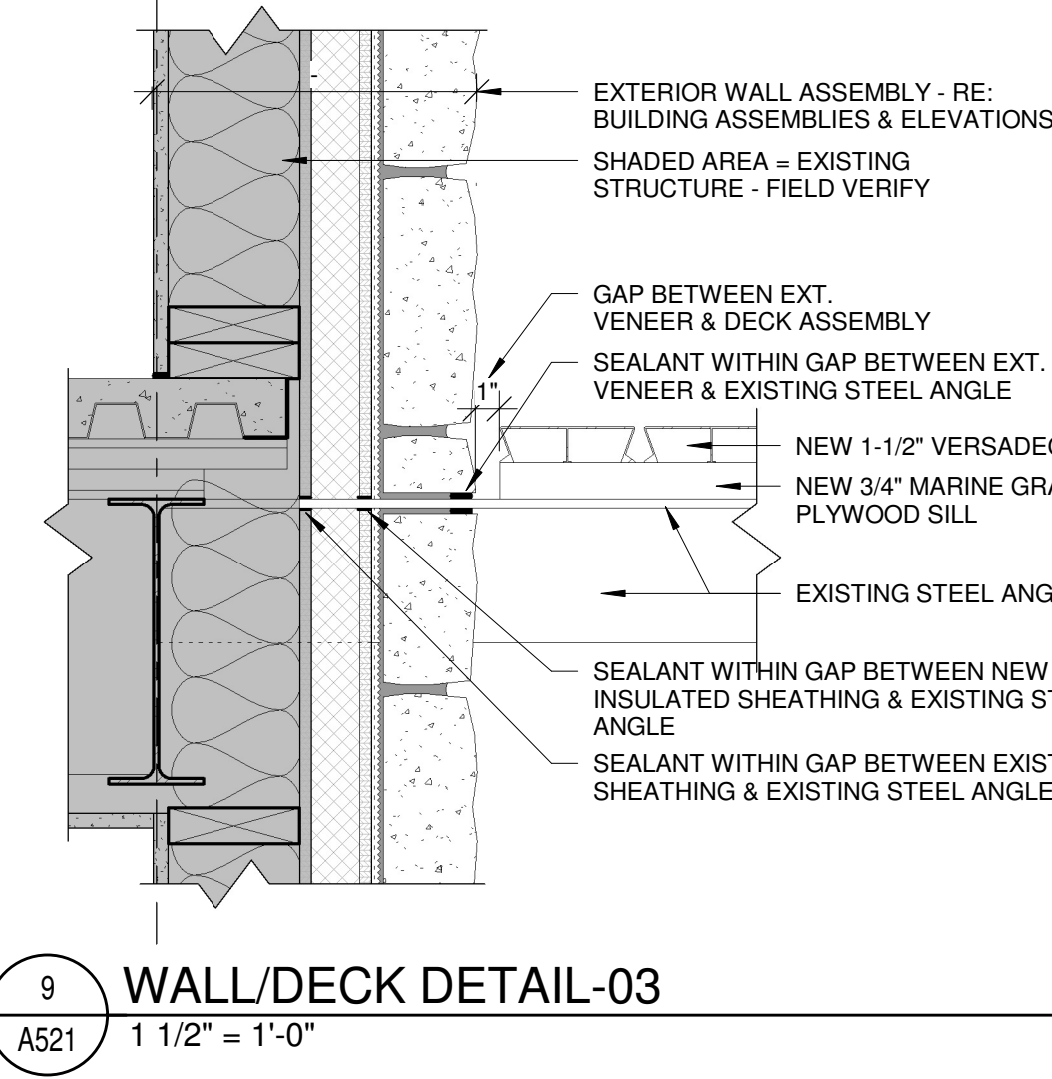


9 WALL/DECK DETAIL-03
1 1/2" = 1'-0"

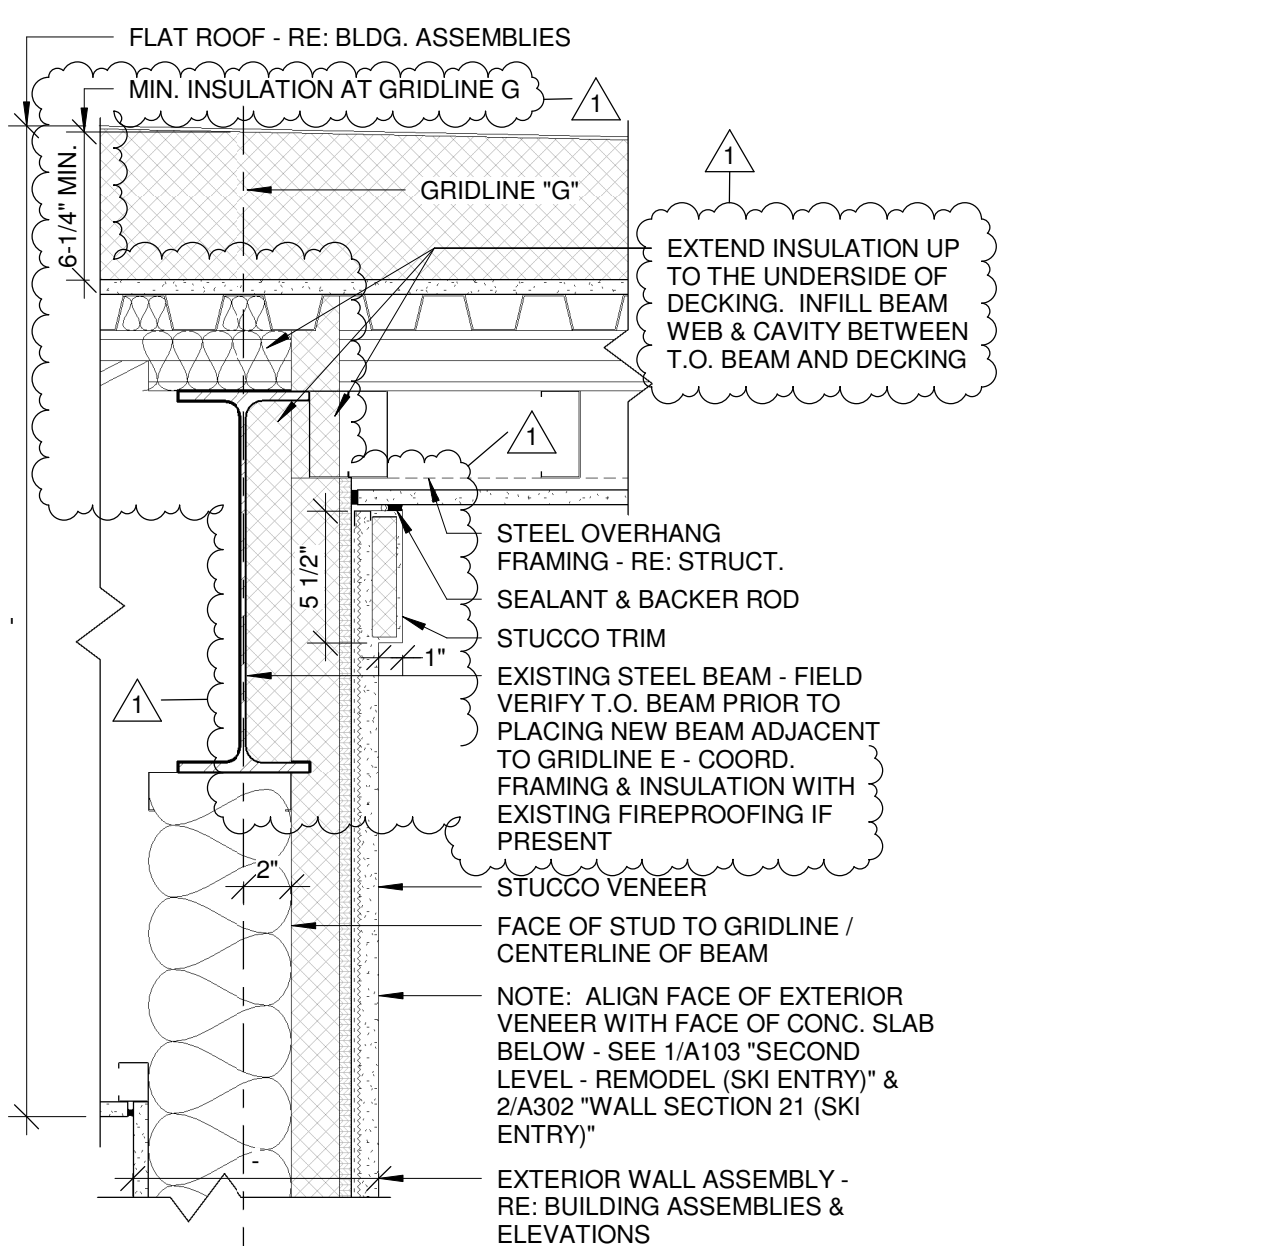

13 WALL/EAVE DETAIL
1 1/2" = 1'-0"

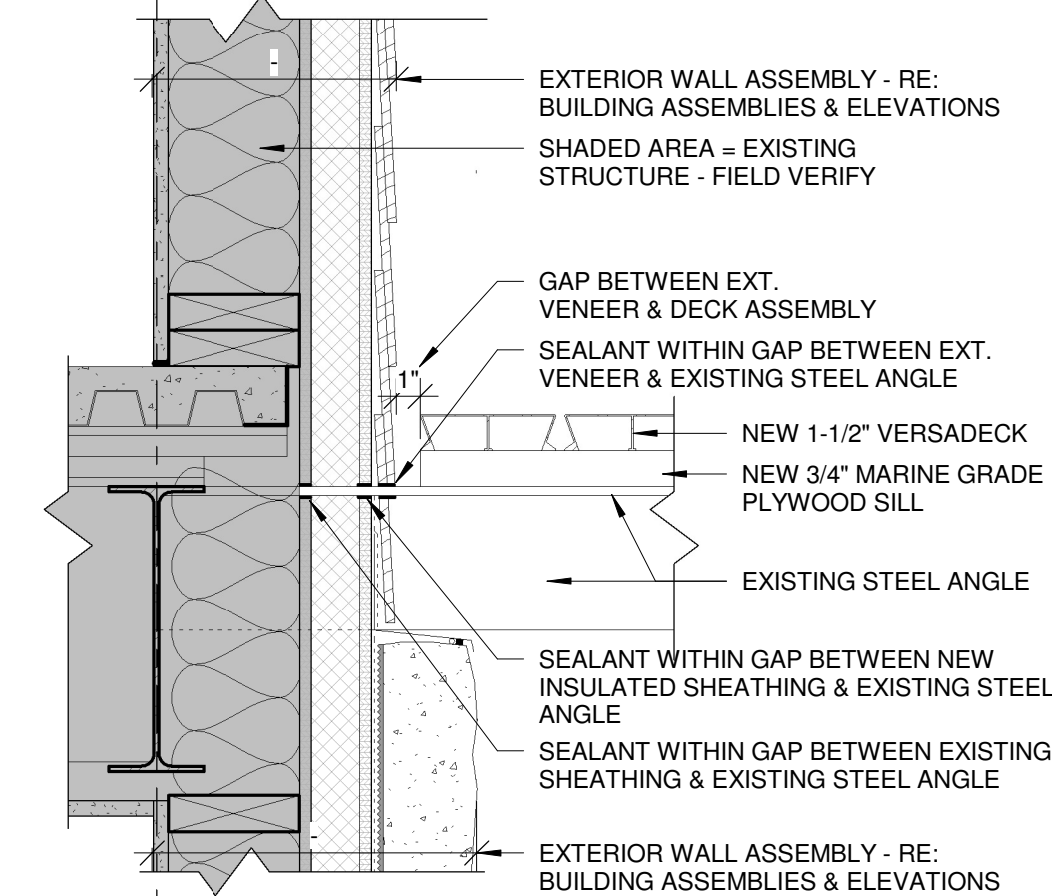

10 WALL/DECK DETAIL-04
1 1/2" = 1'-0"

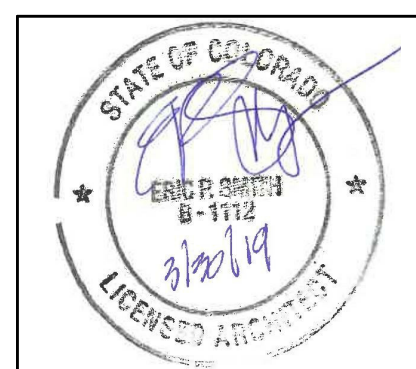

NOTICE: DUTY OF COOPERATION
Release of these plans contemplates further cooperation among the owner, its consultant and the architect. Design and construction are complex. Although the architect and his consultants have performed their services with due care and diligence, they cannot guarantee perfection. Communication is imperative and every contingency cannot be anticipated. Any ambiguity or discrepancy discovered by the use of these plans shall be reported immediately to the architect. Failure to notify the architect constitutes misrepresentation and increases construction costs. A failure to cooperate by a single entity to the architect shall release the architect from responsibility for the consequences. Changes made from the plans without consent of the architect are unauthorized and shall release the architect of responsibility for all consequences arising out of such changes.
All design, documents and data prepared by Eric Smith Associates, P.C., as instruments of service shall remain the property of Eric Smith Associates, P.C., and shall not be copied, changed or disclosed in any form whatsoever without first obtaining the express written consent of Eric Smith Associates, P.C.
Eric Smith Associates, P.C.

No.	Description	Date
1	ADDENDUM 01	2018-11-30

BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, COLORADO





Eric Smith Associates, P.C.
1919 SEVENTH STREET
BOULDER, COLORADO, 80302
(303) 442-5468, (303) 442-7446 FAX

Job Number:	17022
Date:	2018-11-09
Drawn By:	Author
Checked By:	Checker
Project Phase	PERMIT REVIEW
Sheet Title	EXTERIOR DETAILS
Sheet Number	A521



DATE: 2019-03-29 PERMIT REVIEW

JOB CODE & REVIT FILE: 17022 - Bear Claw II CD Set_R16.rvt


3/29/2019 2:11:34 PM 17022 BEAR CLAW II SET_R16

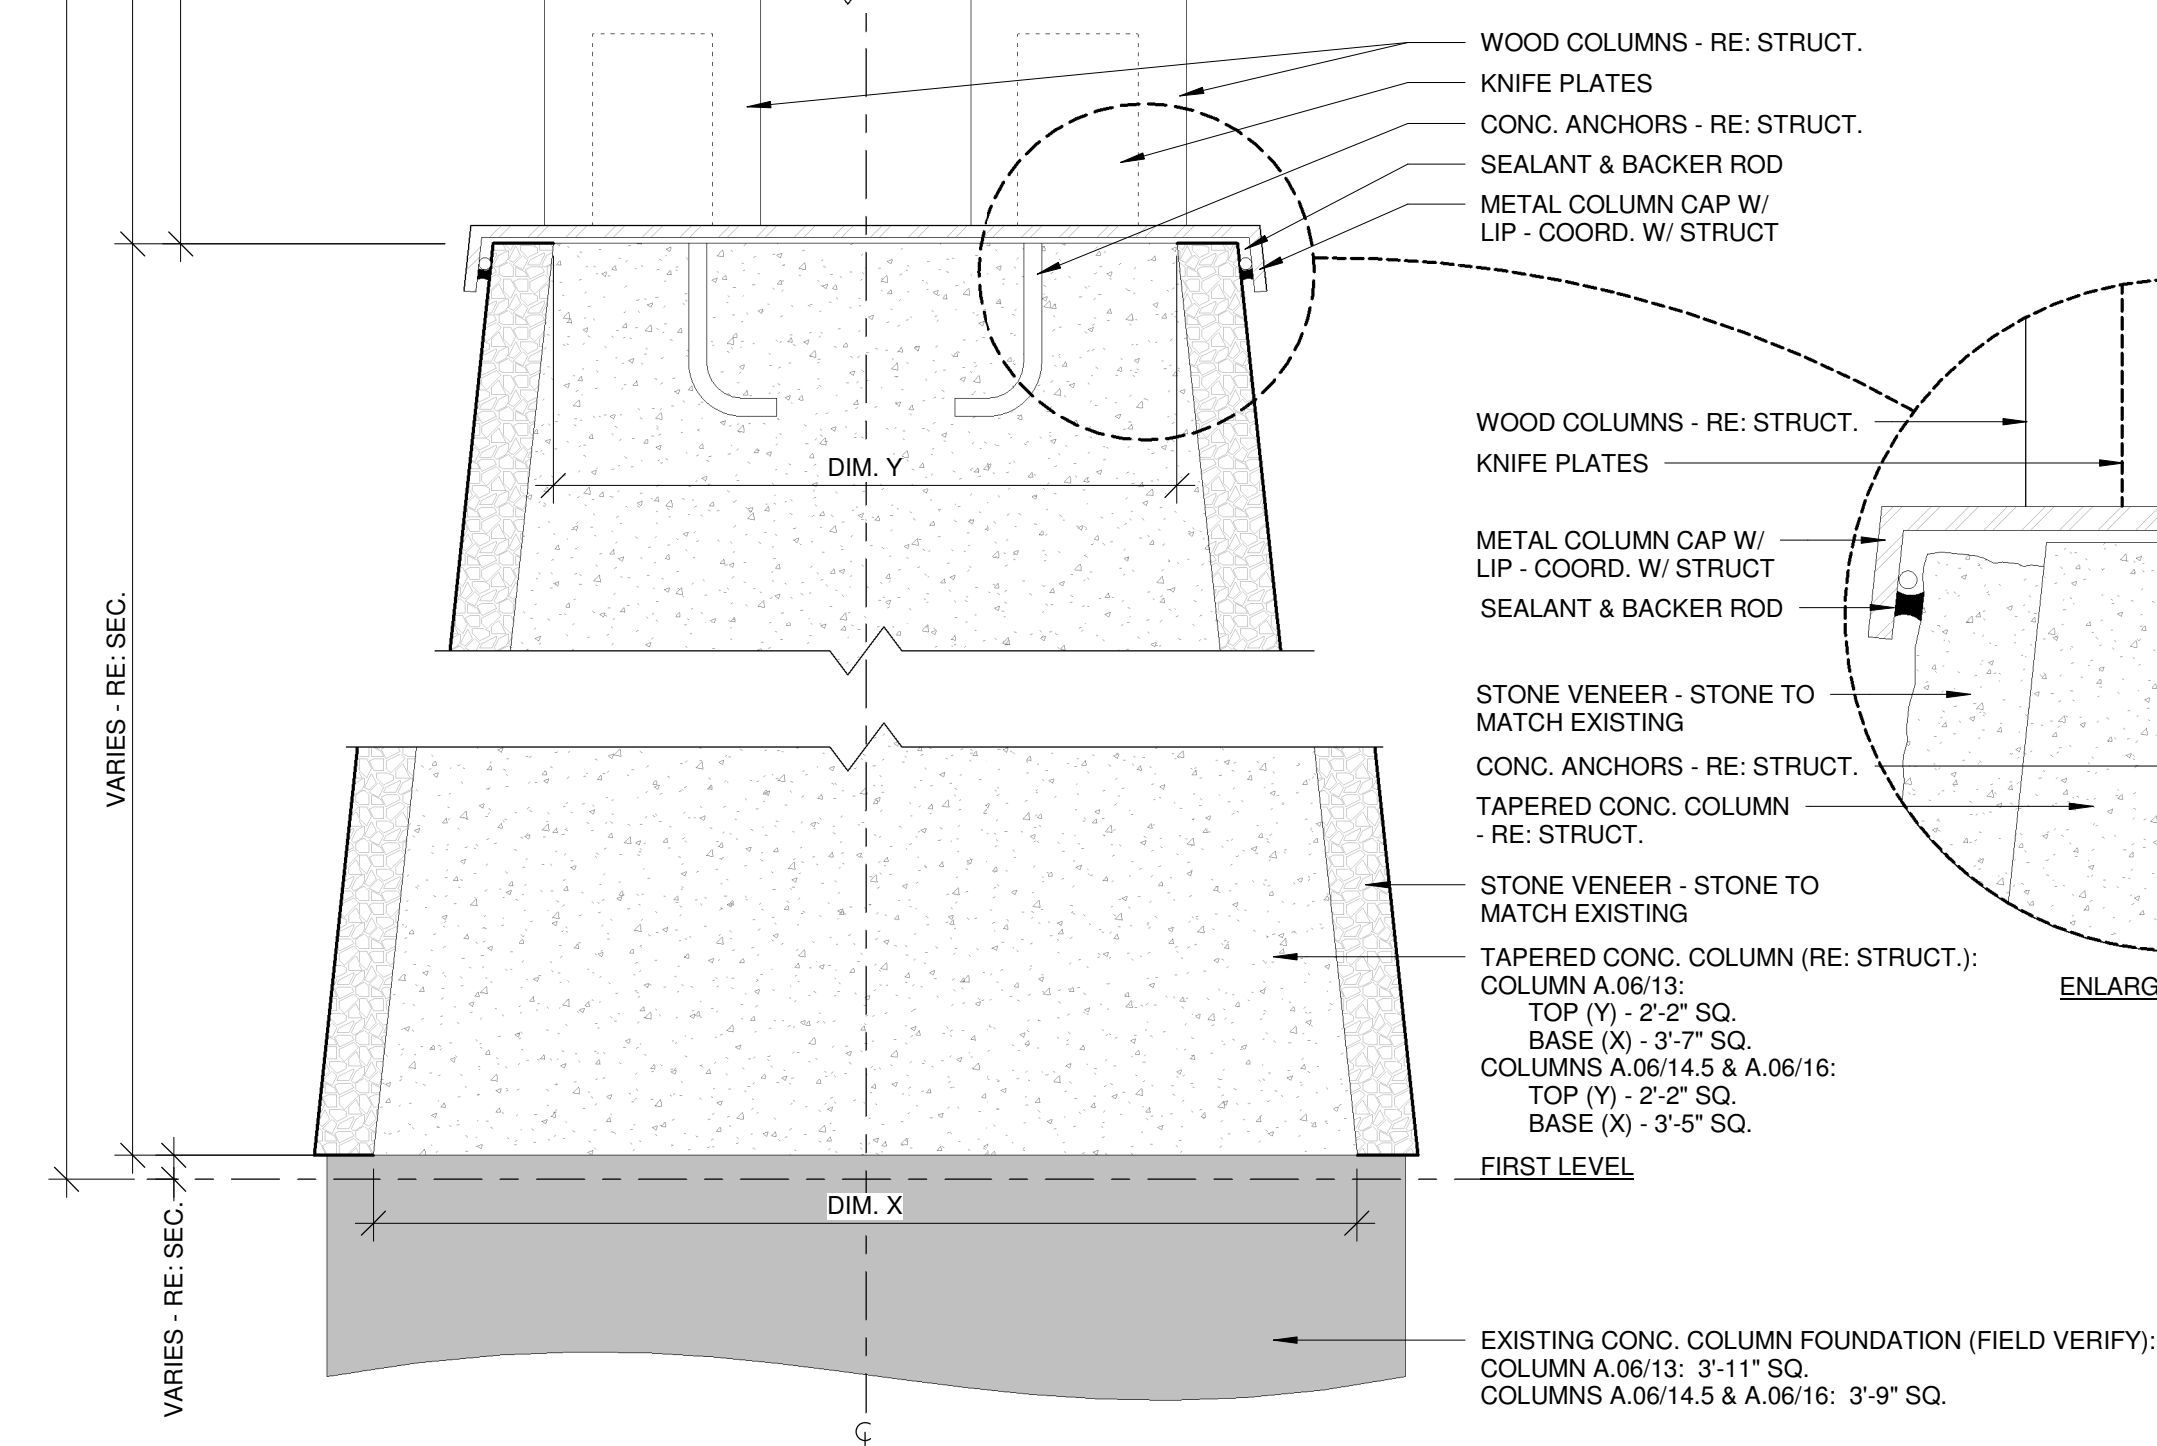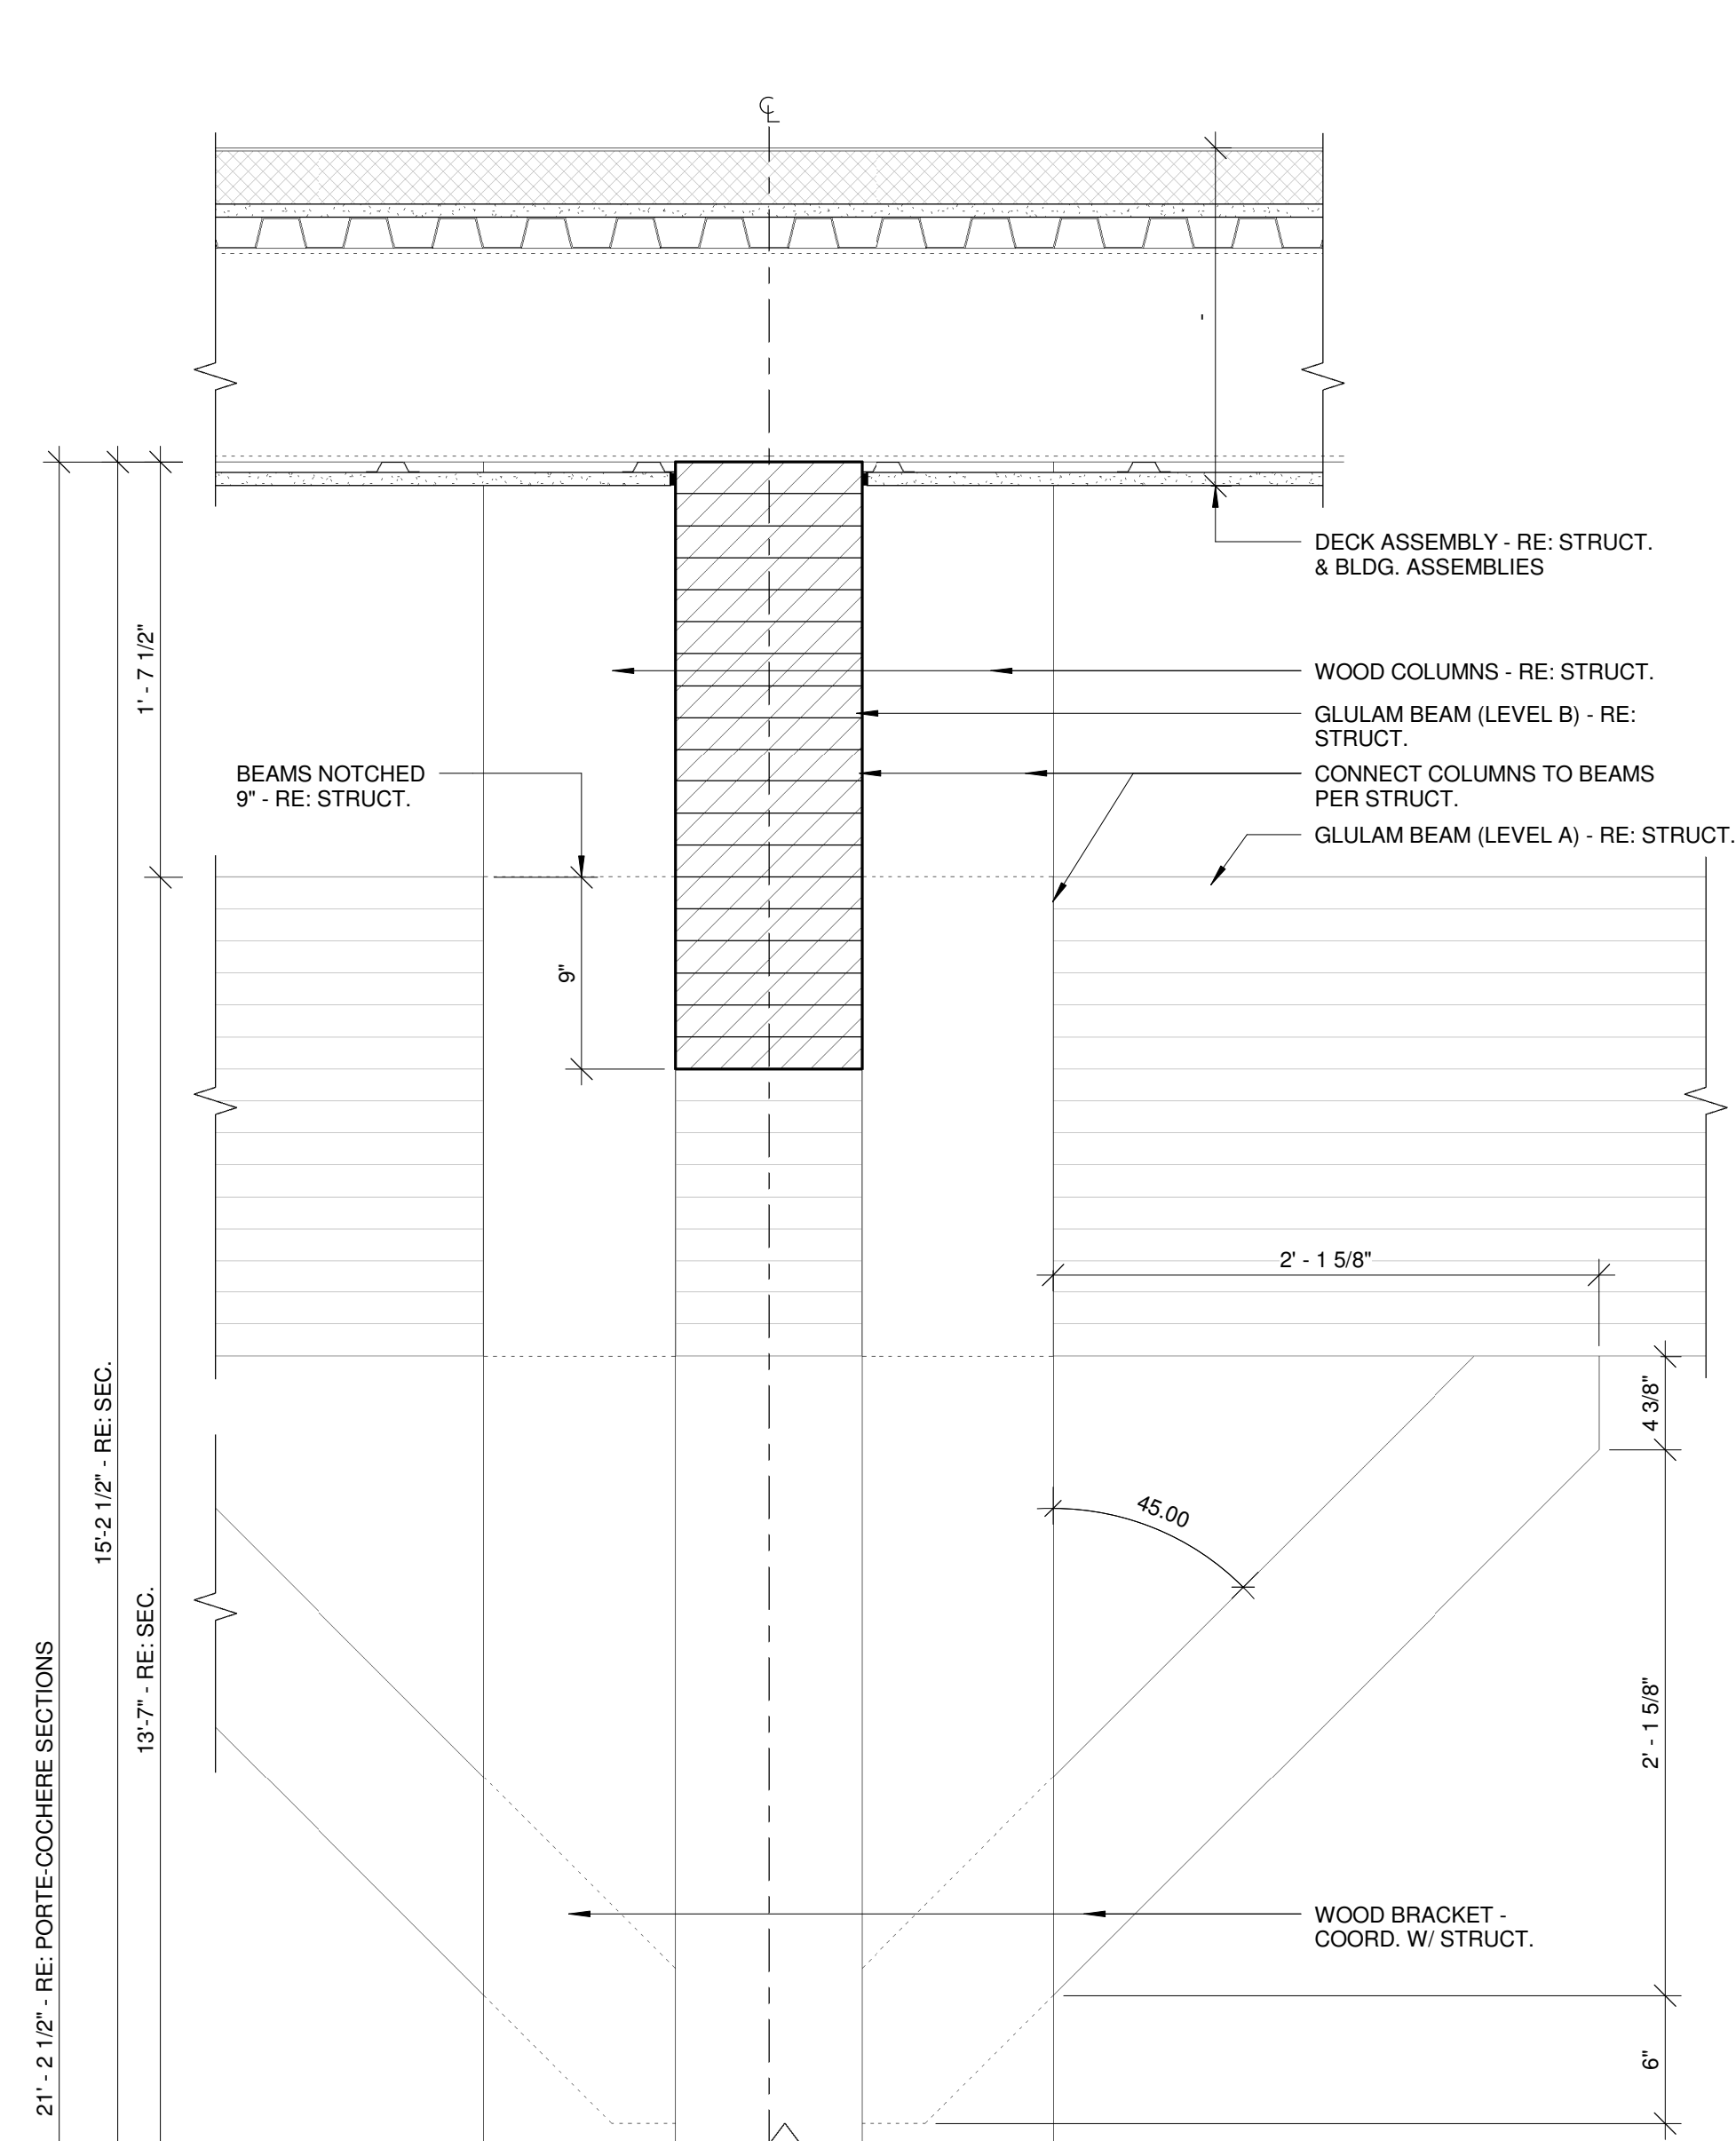

1 COLUMN SECTION DTL. - 01
A522 1 1/2" = 1'-0"

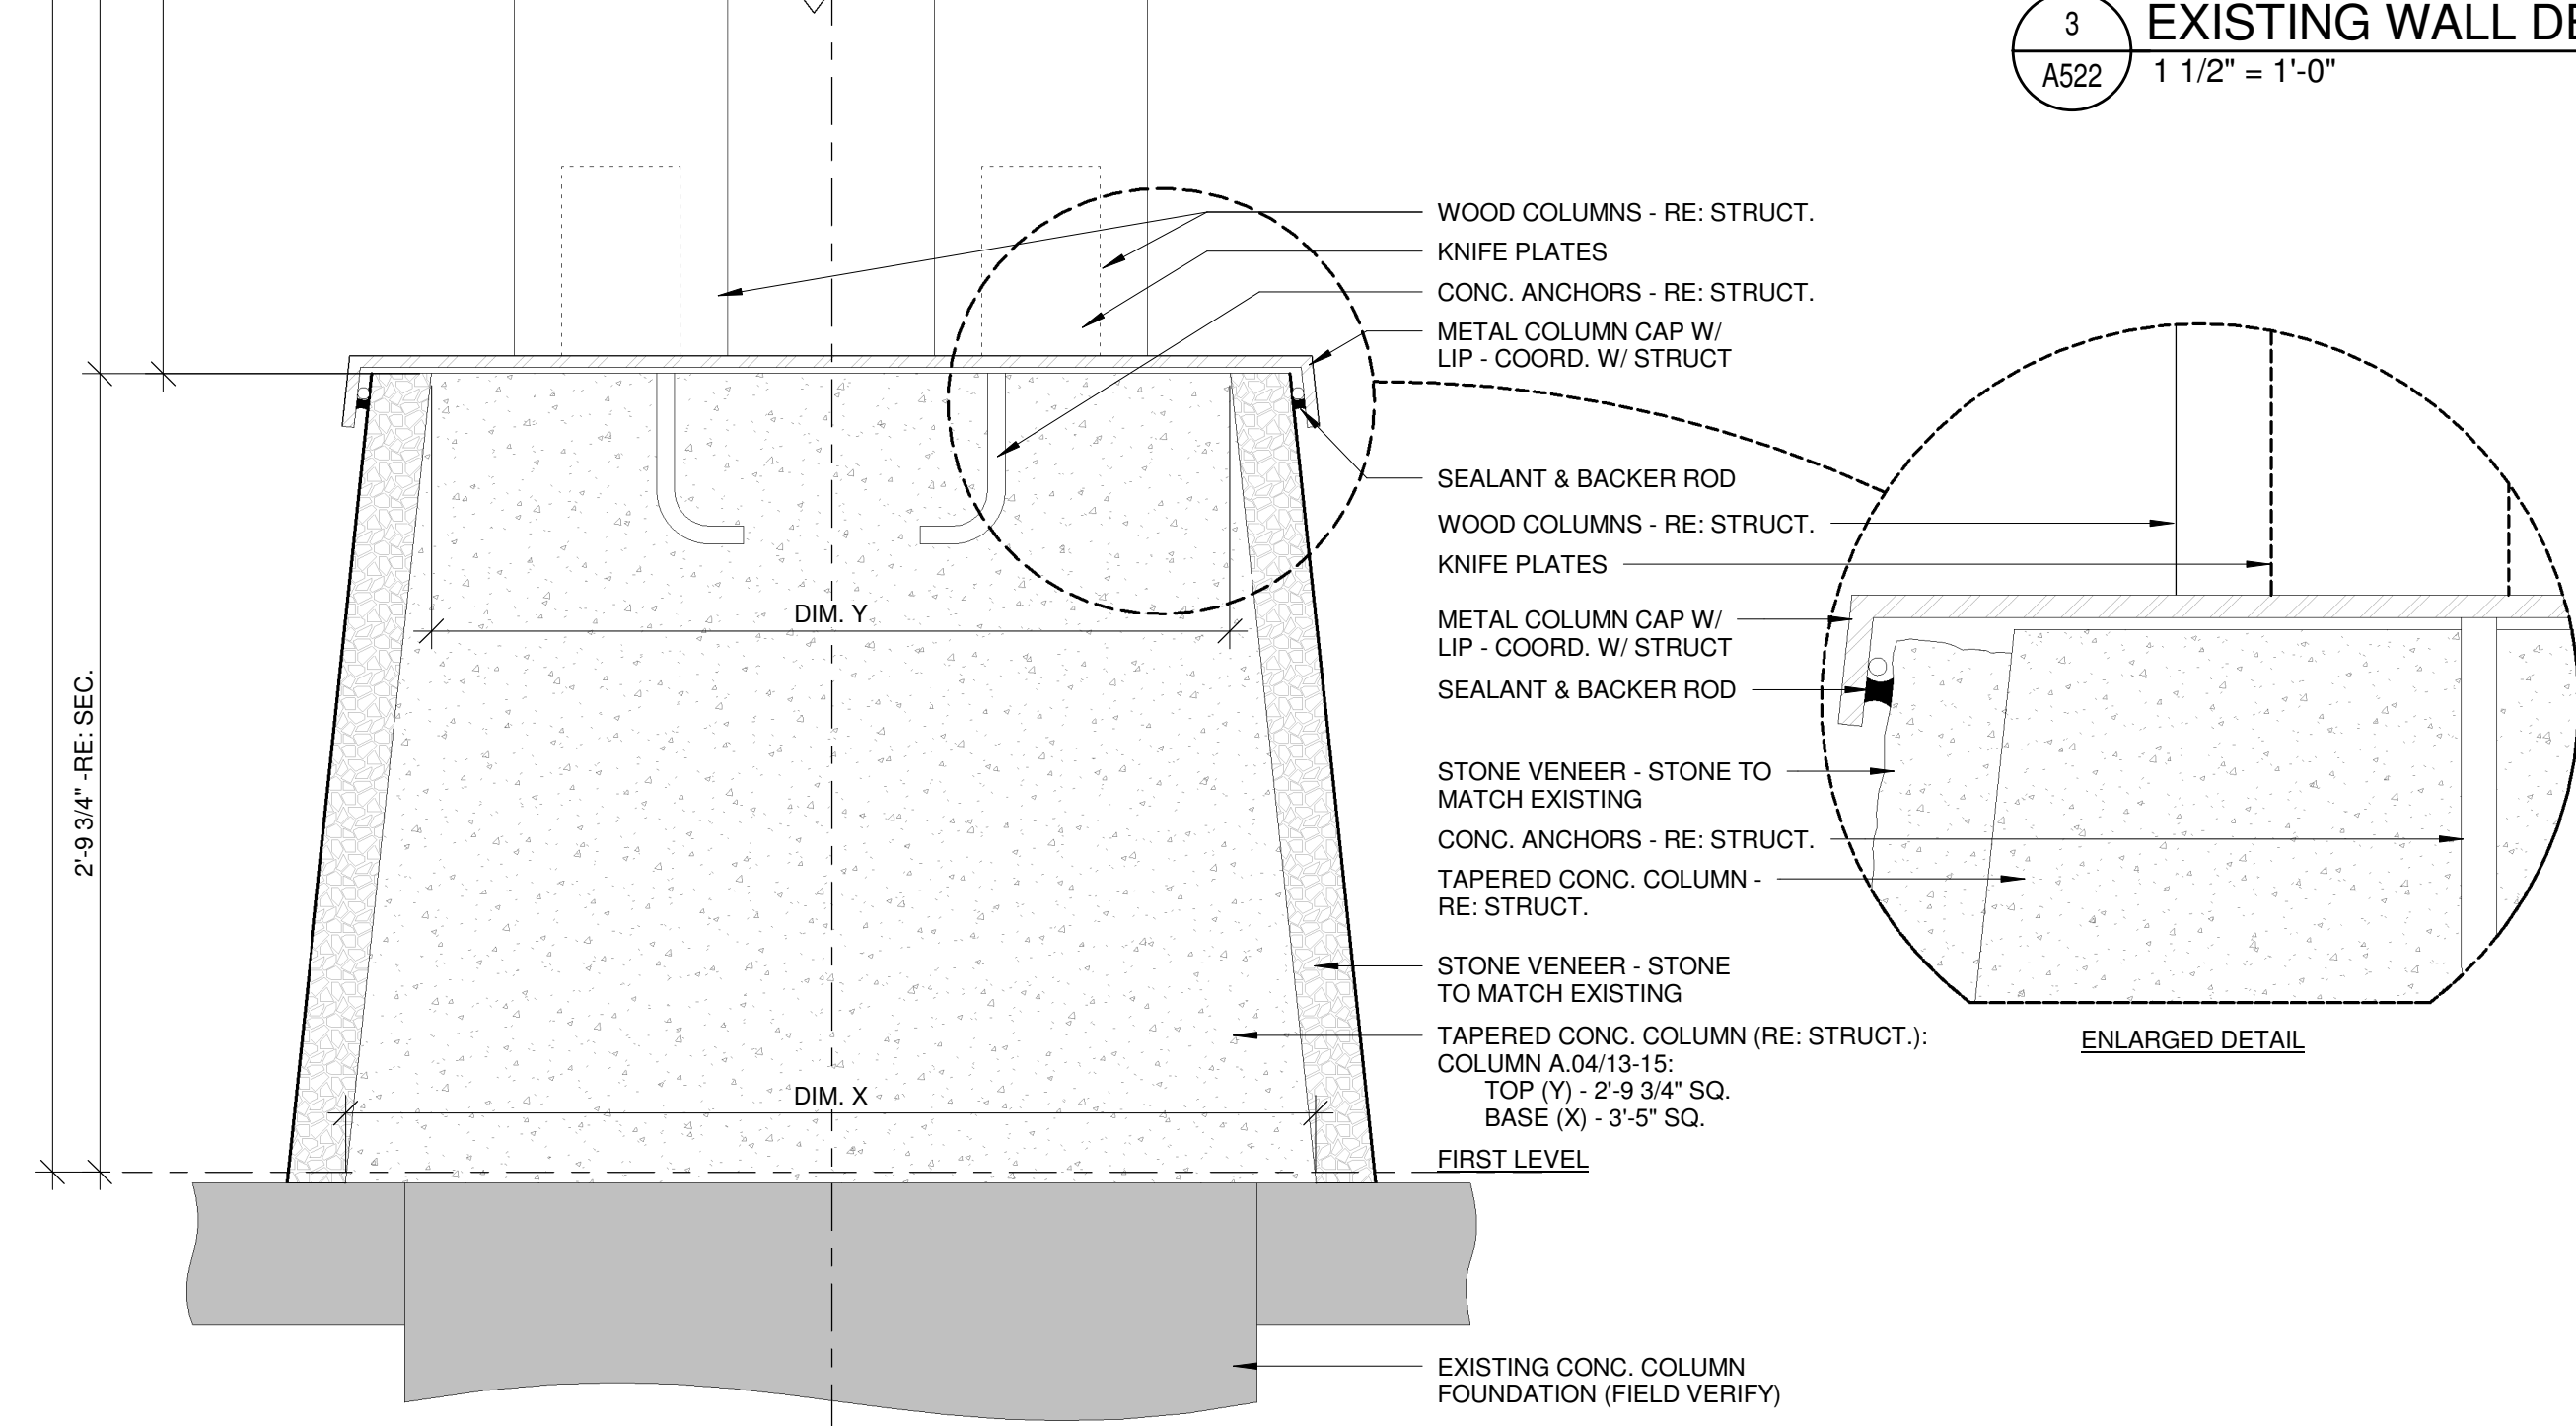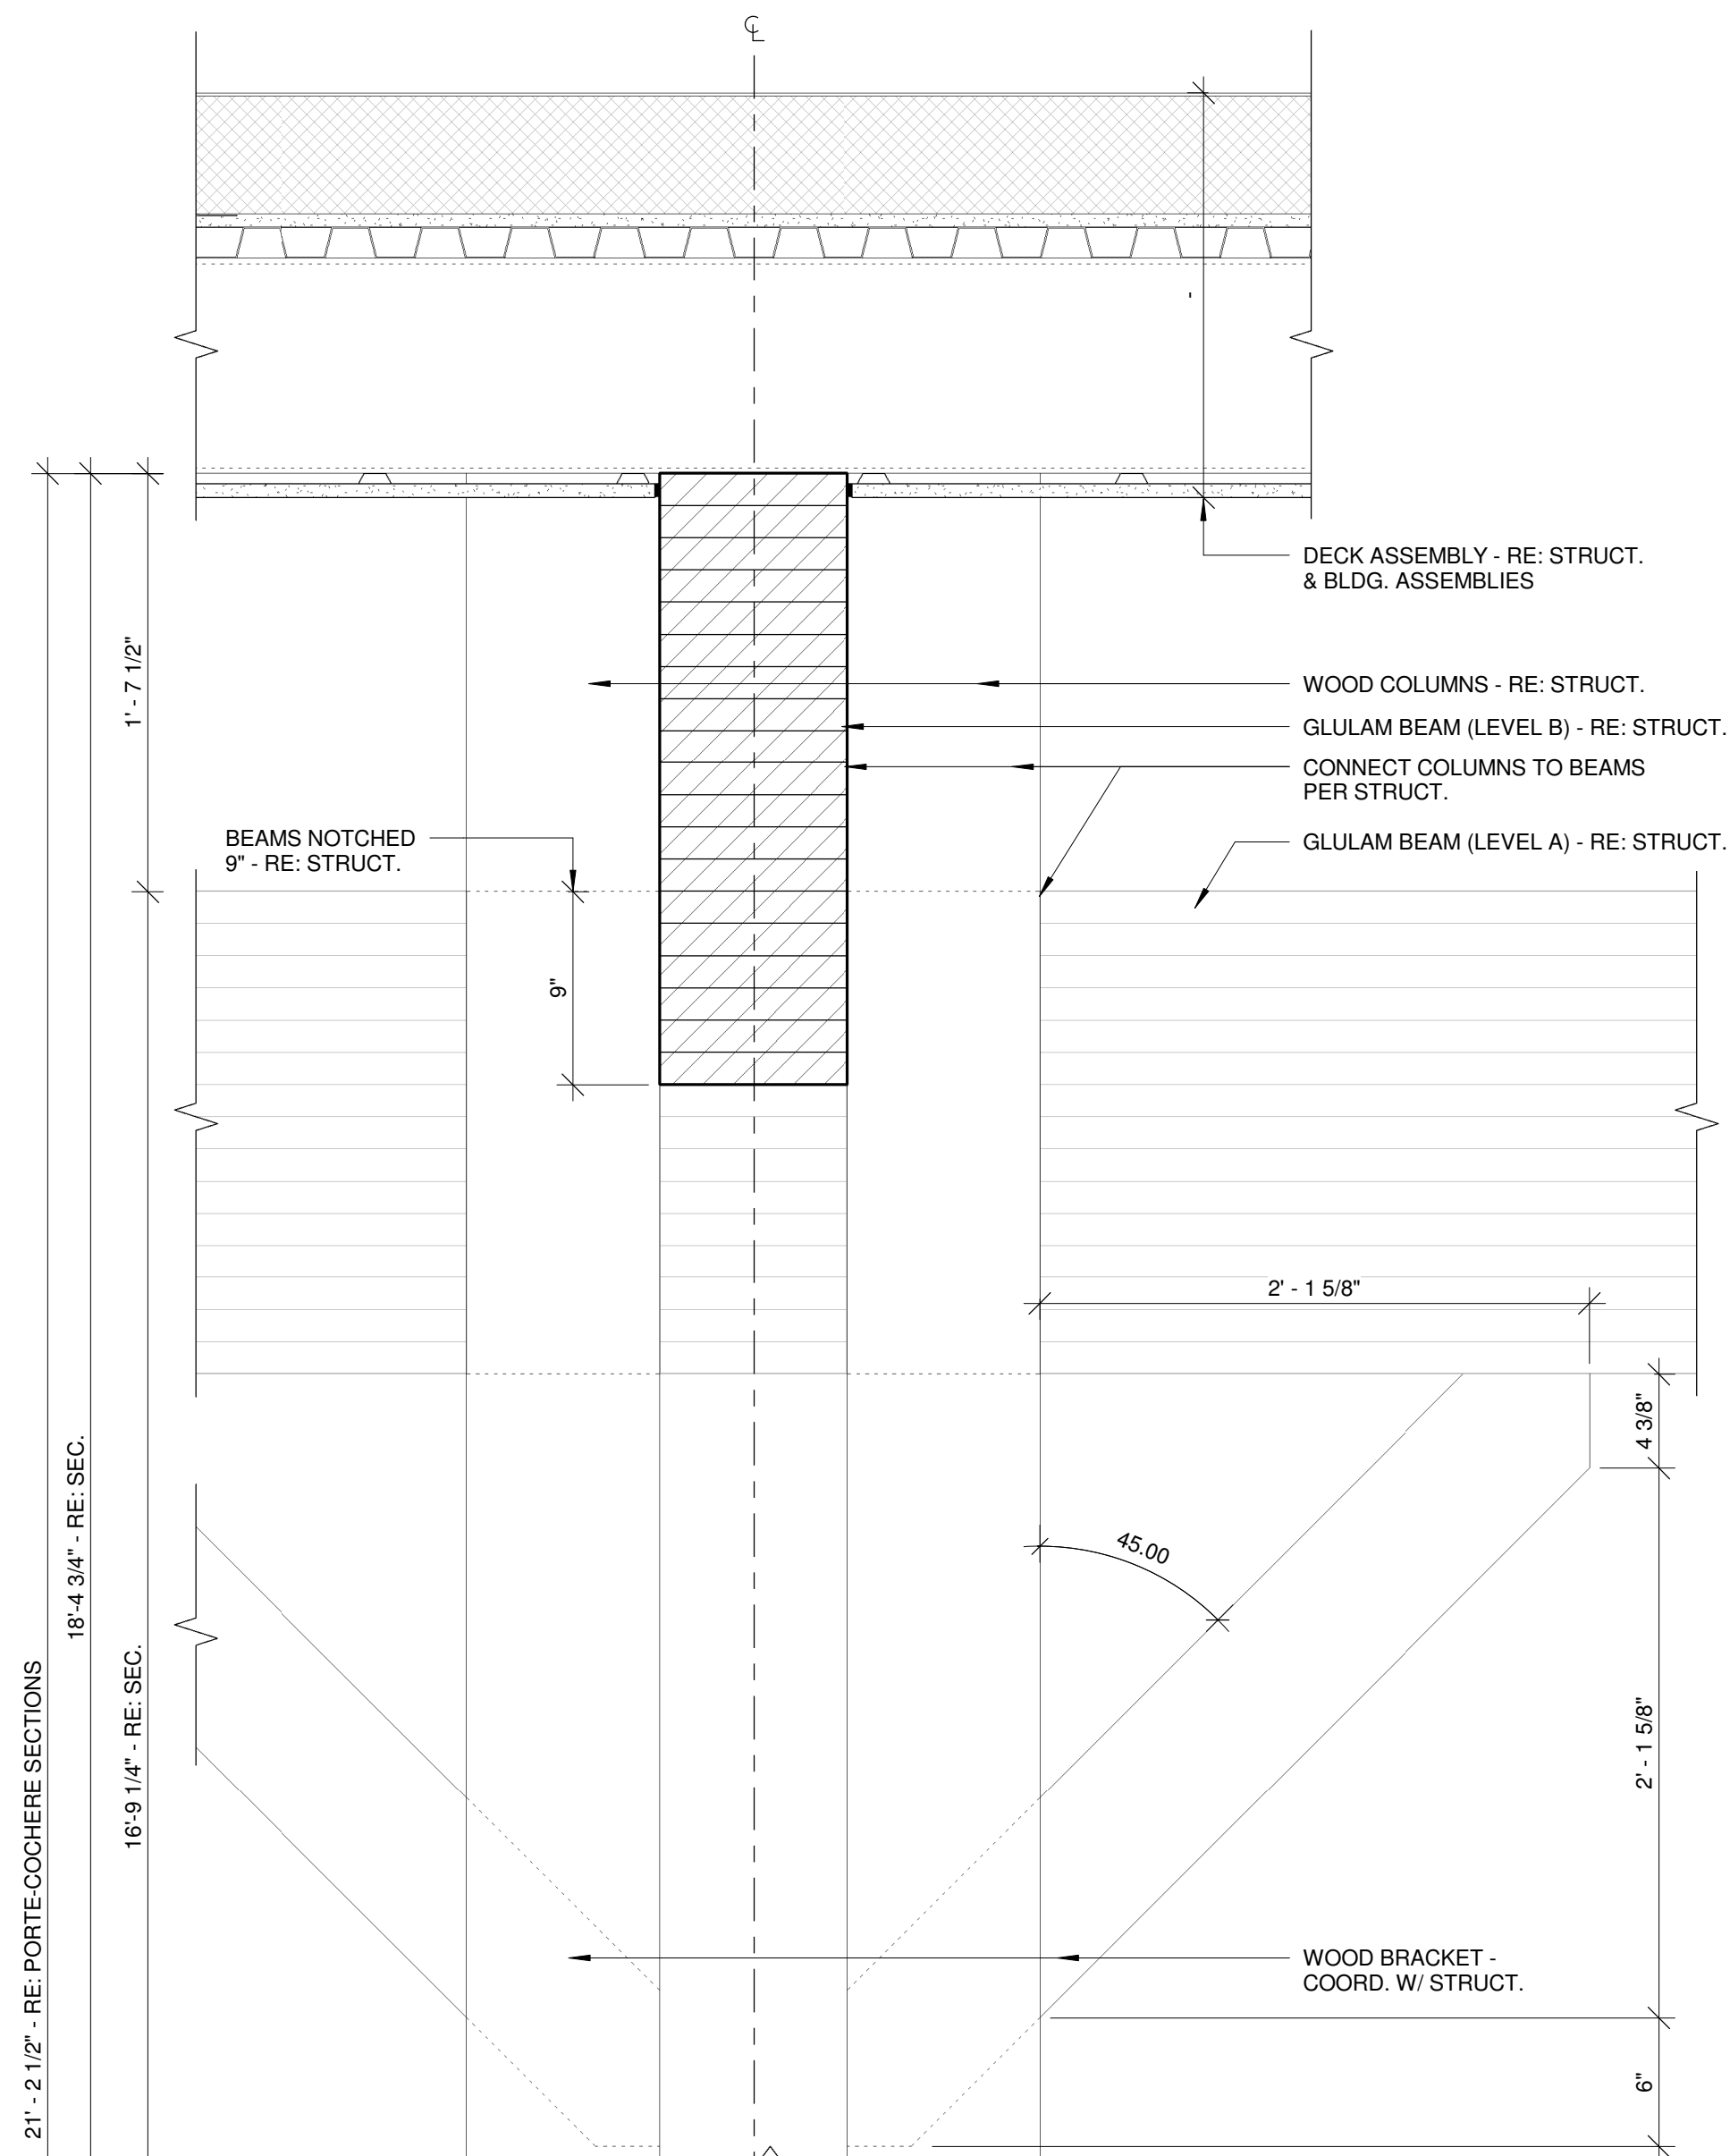

2 COLUMN SECTION DTL. - 02
A522 1 1/2" = 1'-0"

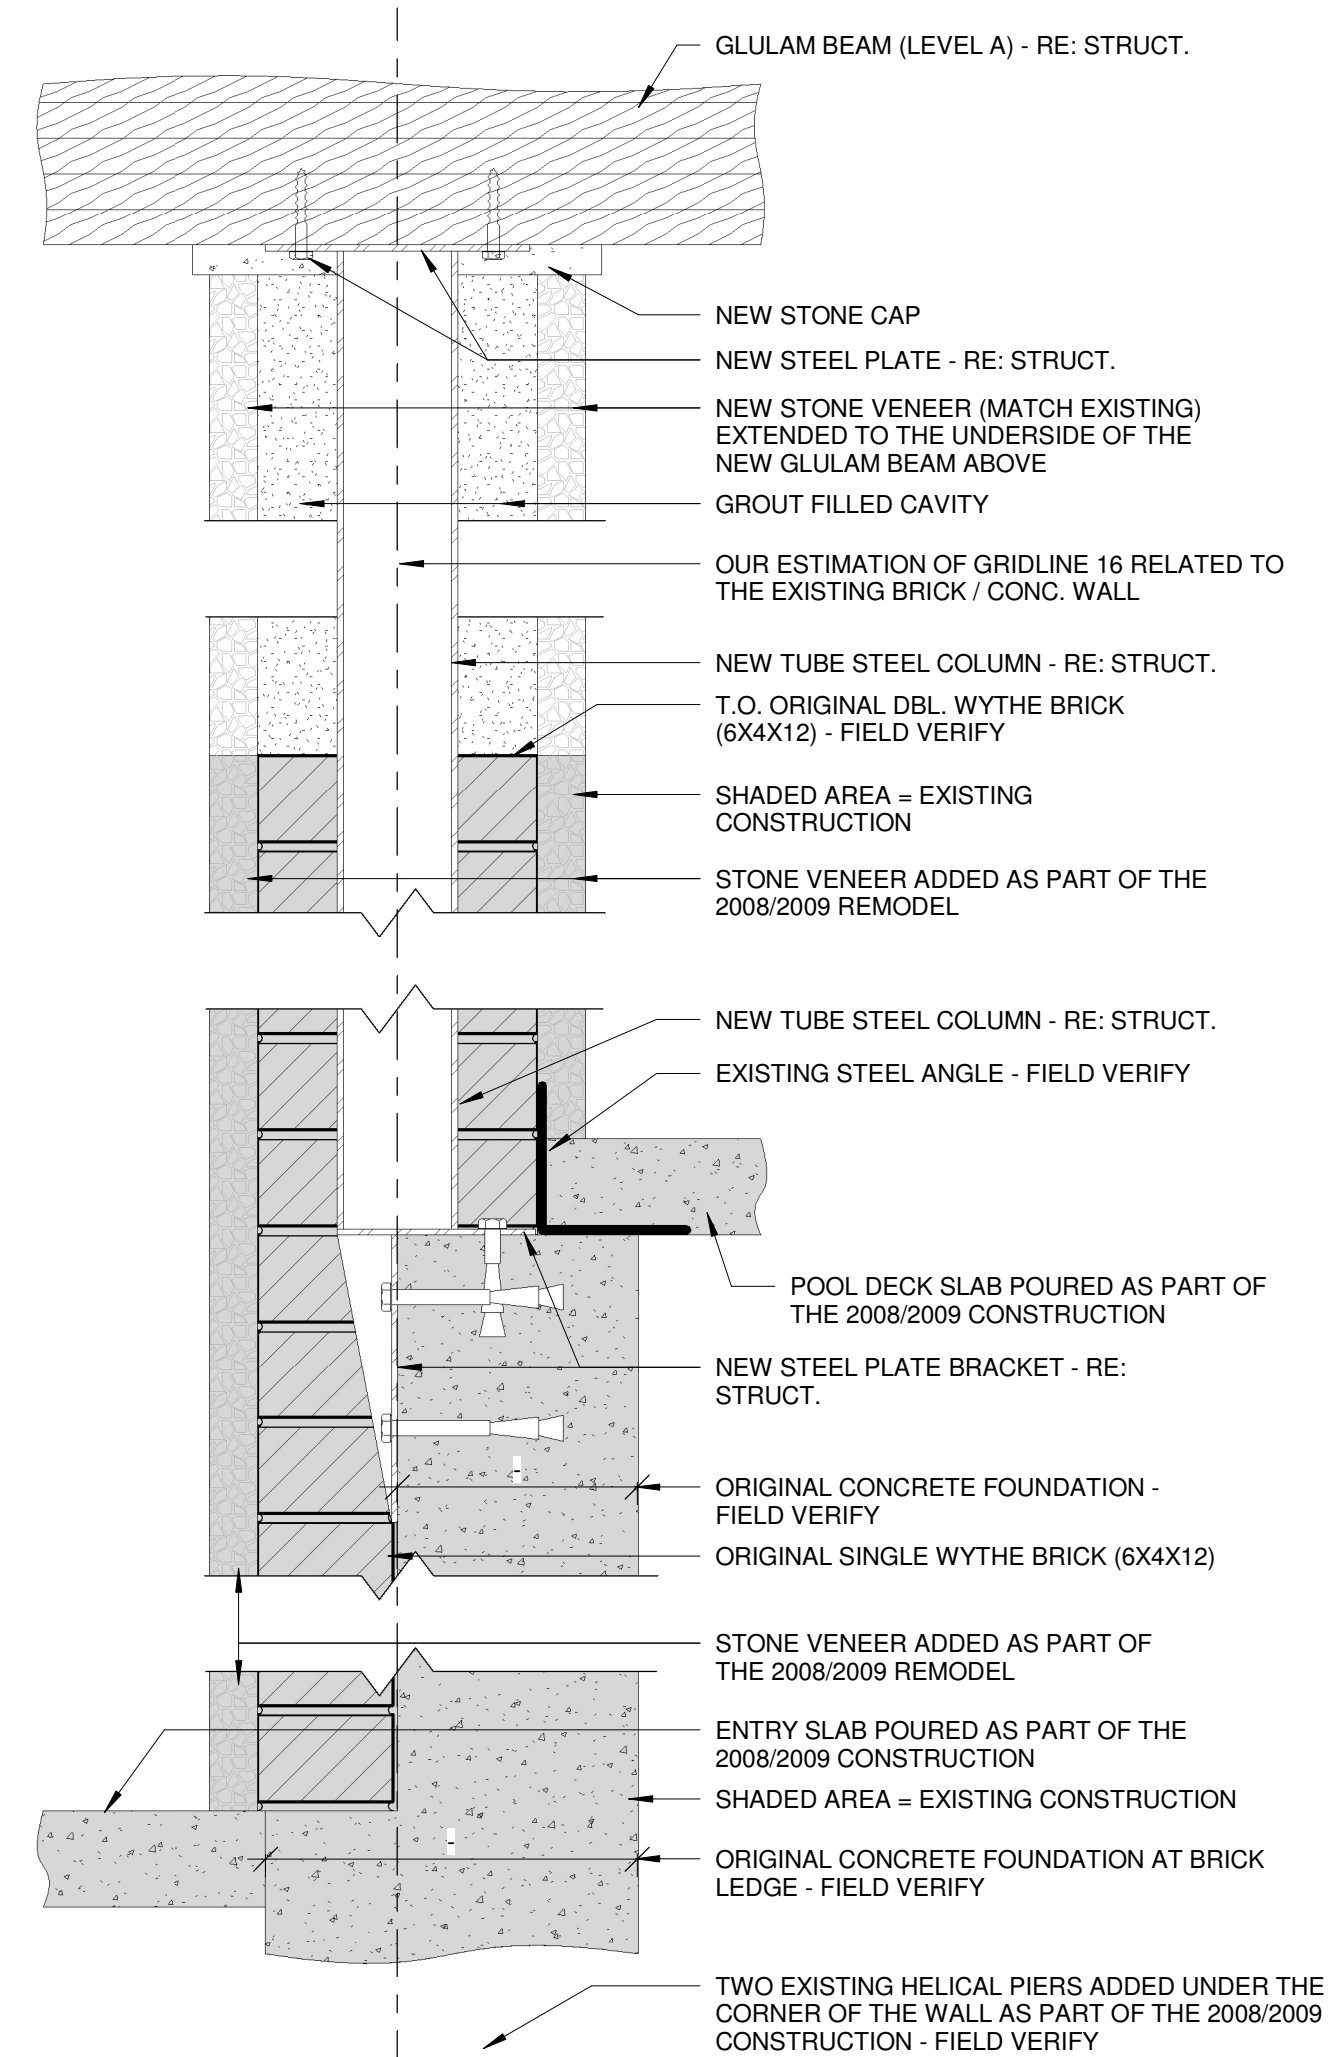


NOTE: DURING THE COURSE OF DEMOLITION OF THIS AREA (GRIDLINE A/04/16 - SHEET AD101), THE CONTRACTOR SHALL HAVE THE STRUCTURAL ENGINEER (AND POSSIBLY THE ARCHITECT) ON SITE TO REVIEW THE EXISTING CONDITIONS TO EITHER VERIFY THE CURRENT COLUMN SUPPORT DESIGN AND/OR MODIFY THE DESIGN AS REQUIRED DUE TO THE EXISTING CONDITIONS. THE CONTRACTOR SHALL NOT PROCEED WITH THE COLUMN SUPPORT DESIGN INDICATED WITHIN THIS DETAIL (3/A522) OR WITHIN THE STRUCTURAL ENGINEERS CD SET WITHOUT PRIOR APPROVAL FROM THE ARCHITECT & STRUCTURAL ENGINEER.

3
A522

EXISTING WALL DETAIL - TEMP

1 1/2" = 1'-0"

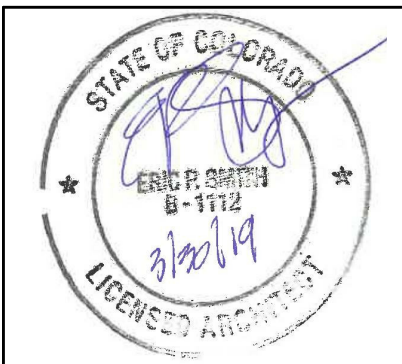

NOTICE: DUTY OF COOPERATION

Release of these plans constitutes further cooperation among the owner, his contractor and the architect. Design and construction are interrelated. Although the architect and his consultants have performed their services with due care and diligence, they cannot guarantee perfect communication. Communication is imperfect and every contingency cannot be anticipated. Any ambiguity or discrepancy observed by the contractor or others shall be reported immediately to the architect. Failure to notify the architect compounds misunderstanding and increases construction costs. A failure to cooperate by a simple notice to the architect shall relieve the architect from any further responsibility for the errors or omissions made from the plans without consent of the architect are unauthorized and shall relieve the architect of responsibility for all consequences arising out of such changes.

All design, documents and data prepared by Eric Smith Associates, P.C. as instruments of service shall remain property of Eric Smith Associates, P.C. and shall not be copied, changed or disclosed in any form whatsoever without first obtaining the express written consent of Eric Smith Associates, P.C.

Eric Smith Associates, P.C.



[illegible]

BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, COLORADO



Job Number:	17022
Date:	2018-11-09
Drawn By:	Author
Checked By:	Checker

Project Phase	PERMIT REVIEW
Sheet Title	EXTERIOR DETAILS
Sheet Number	A522

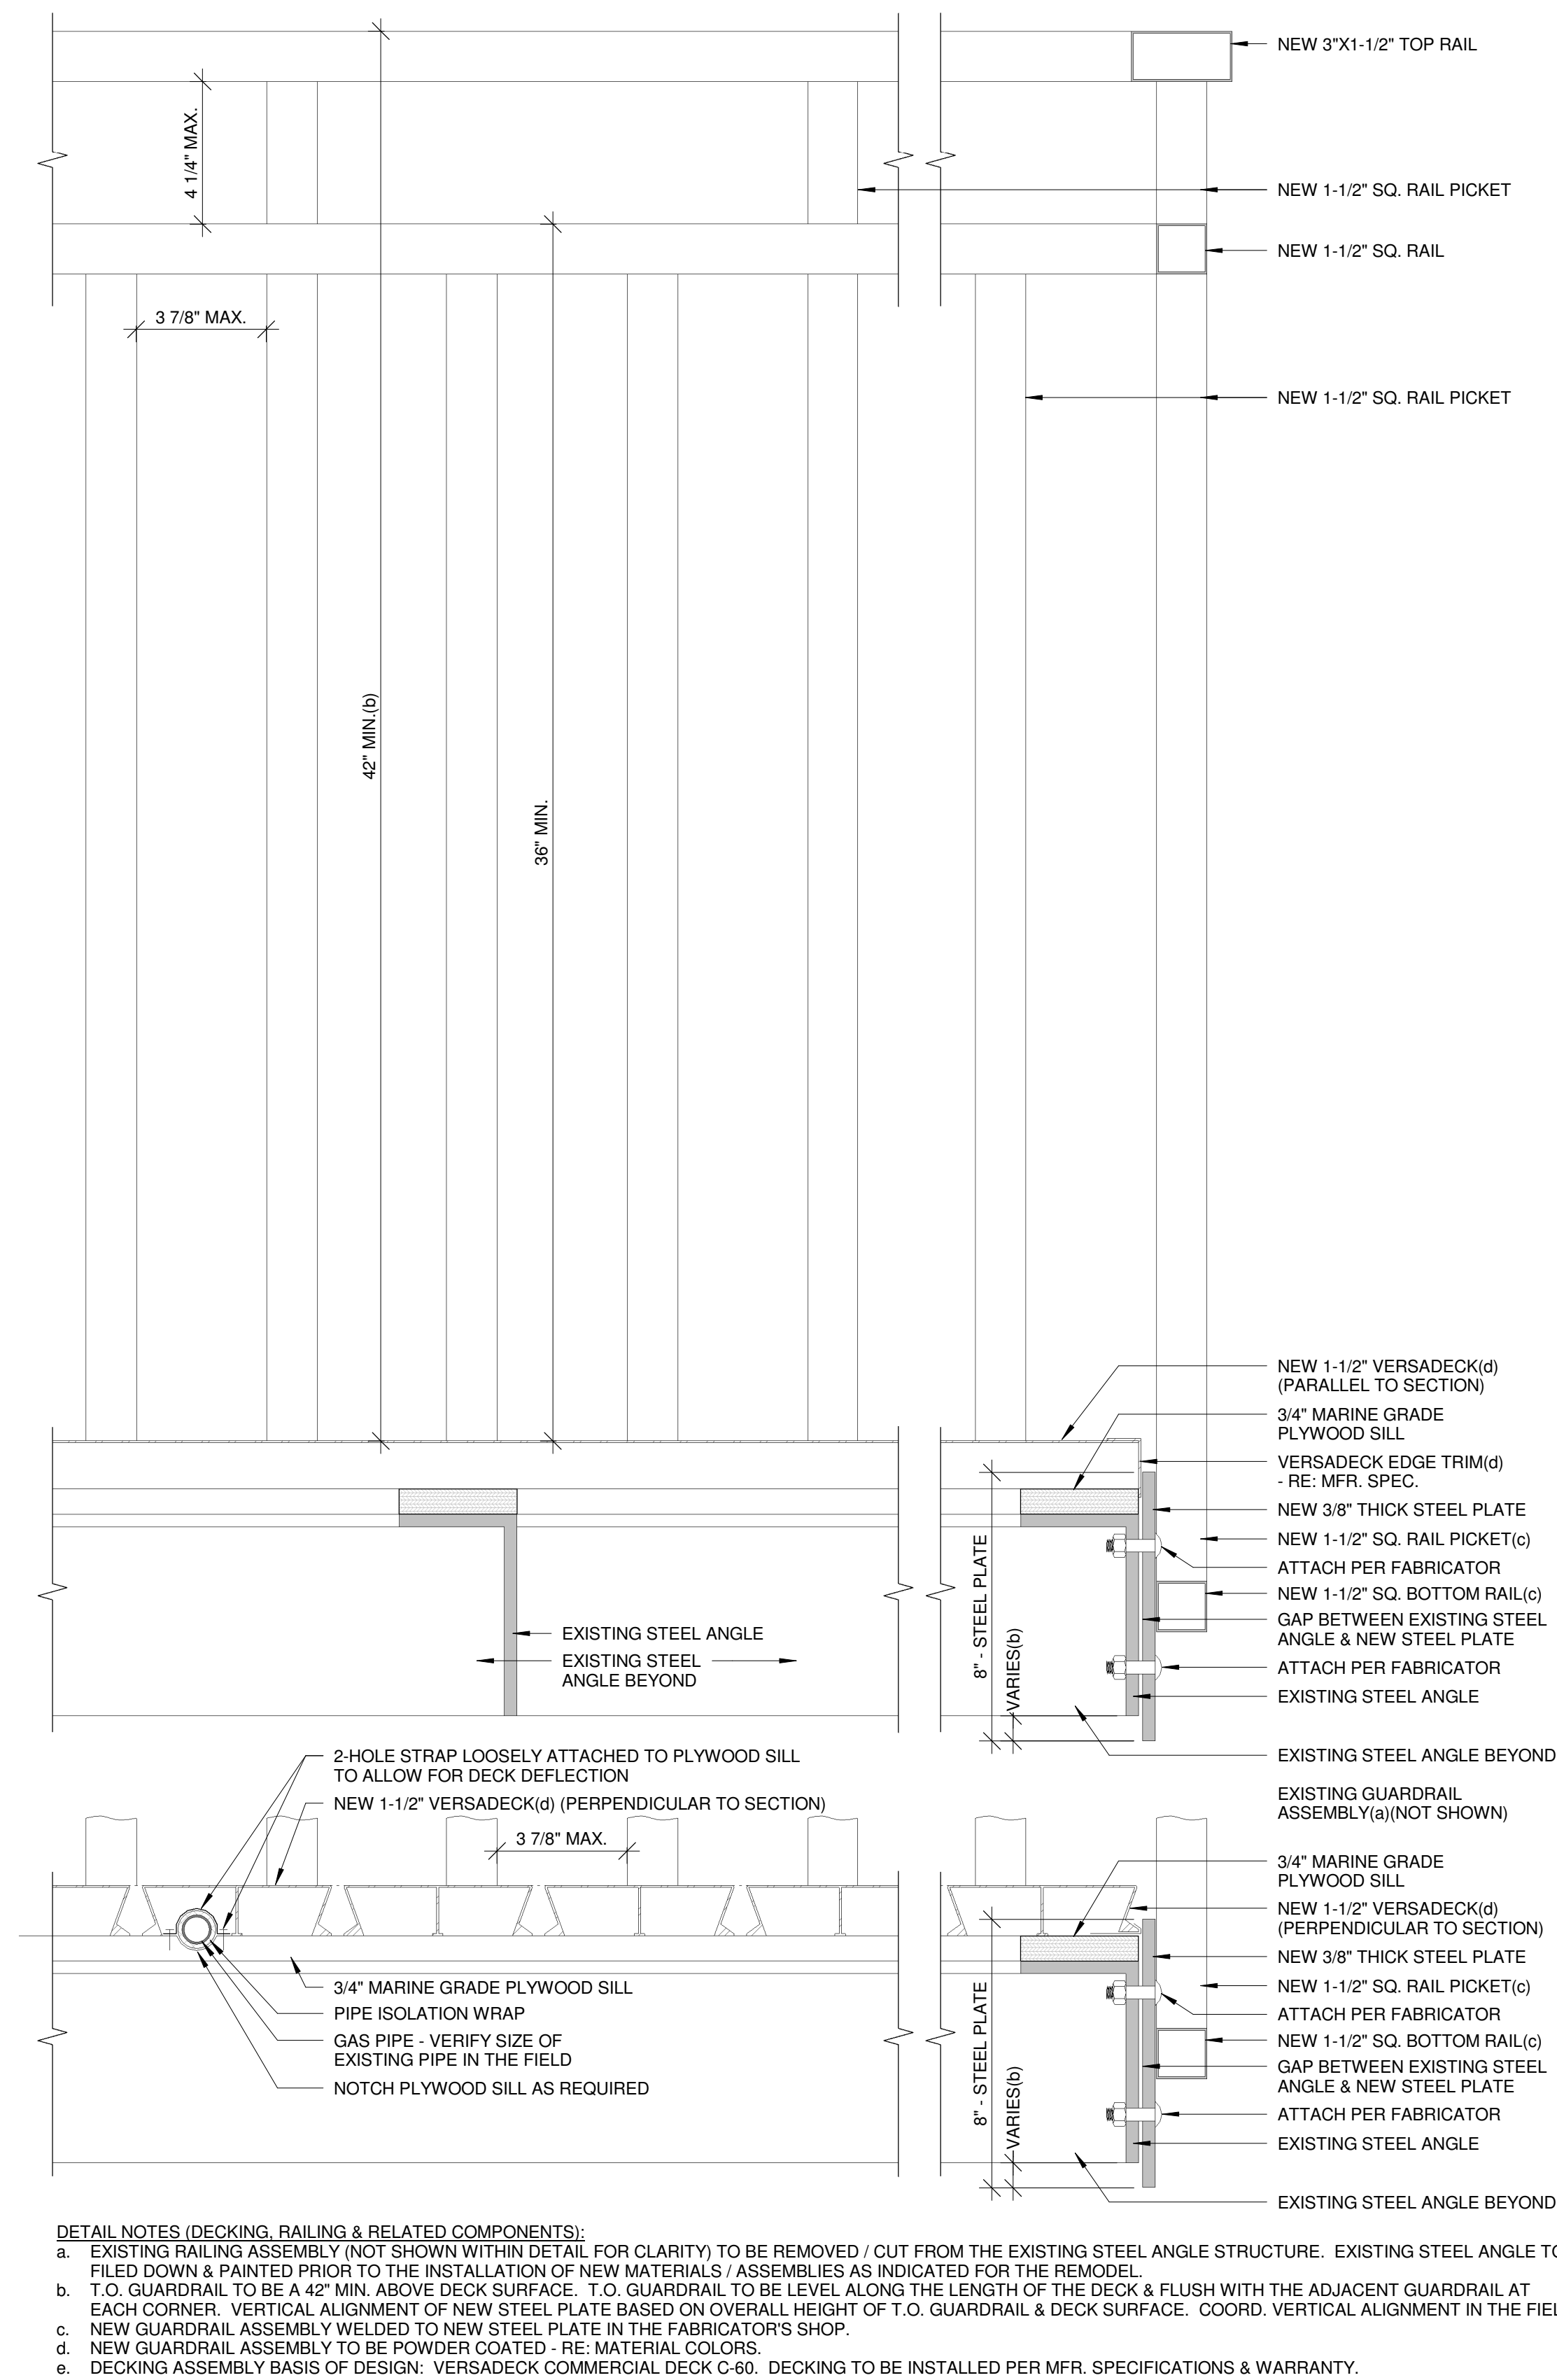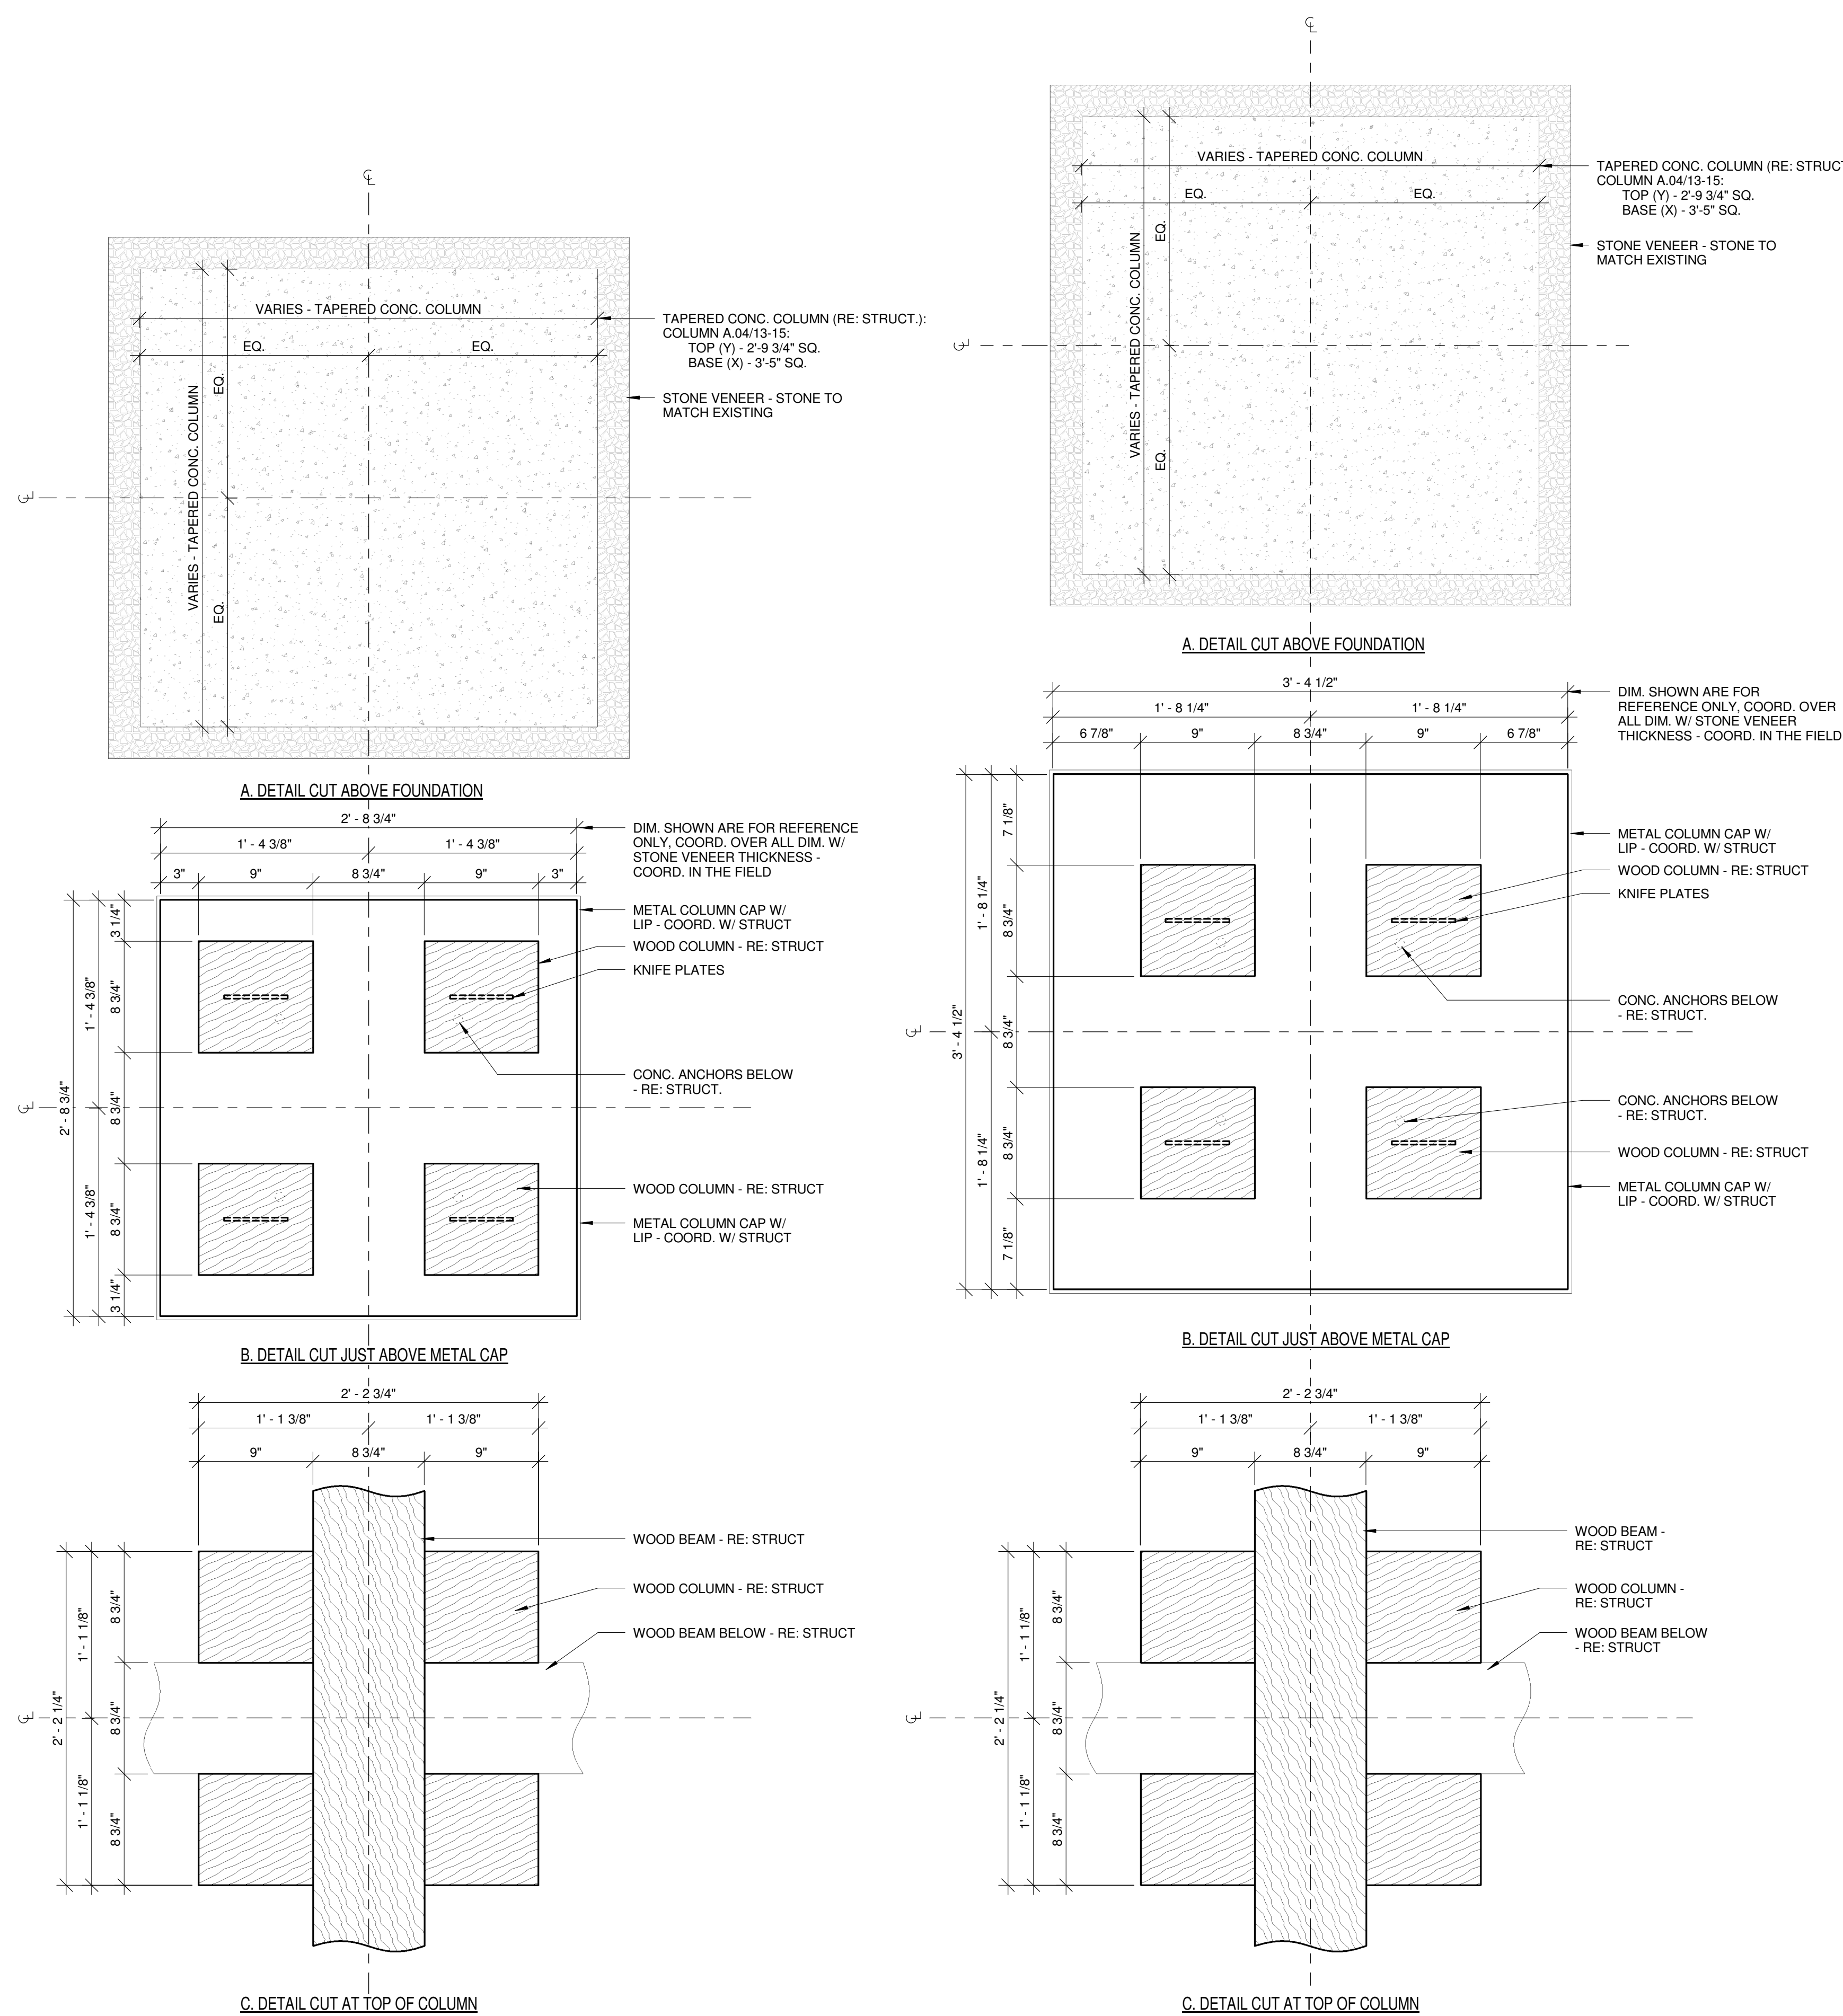

- DETAIL NOTES (DECKING, RAILING & RELATED COMPONENTS):
- EXISTING RAILING ASSEMBLY (NOT SHOWN WITHIN DETAIL FOR CLARITY) TO BE REMOVED / CUT FROM THE EXISTING STEEL ANGLE STRUCTURE. EXISTING STEEL ANGLE TO BE FLOU DOWN & PAINTED PRIOR TO THE INSTALLATION OF NEW MATERIALS / ASSEMBLIES AS INDICATED FOR THE REMODEL.
 - T.O. GUARDRAIL TO BE A 42" MIN. ABOVE DECK SURFACE. T.O. GUARDRAIL TO BE LEVEL ALONG THE LENGTH OF THE DECK & FLUSH WITH THE ADJACENT GUARDRAIL AT EACH CORNER. VERTICAL ALIGNMENT OF NEW STEEL PLATE BASED ON OVERALL HEIGHT OF T.O. GUARDRAIL & DECK SURFACE. COORD. VERTICAL ALIGNMENT IN THE FIELD.
 - NEW GUARDRAIL ASSEMBLY WELDED TO NEW STEEL PLATE IN THE FABRICATOR'S SHOP.
 - NEW GUARDRAIL ASSEMBLY TO BE POWDER COATED - RE: MATERIAL COLORS.
 - DECKING ASSEMBLY BASIS OF DESIGN: VERSADECK COMMERCIAL DECK C-60. DECKING TO BE INSTALLED PER MFR. SPECIFICATIONS & WARRANTY.

- DETAIL NOTES (GAS LINES & RELATED COMPONENTS):**
1. REVIEW BOTH THE EXISTING / DEMO & REMODEL & REPAIR GENERAL NOTES ON SHEET A002 FOR ADDITIONAL ITEMS NOT SPECIFICALLY MENTIONED HEREIN.
 2. INSTALLATION AND ROUTING OF THE GAS LINE SHALL BE COORDINATED WITH THE DECK ASSEMBLY. CONTRACTOR SHALL CONTACT THE ARCHITECT WITH ANY KNOWN DISCREPANCIES PRIOR TO THE REINSTALLATION OF THE GAS LINES & ASSEMBLY.
 3. GAS LINES SHALL BE LOOSELY ATTACHED TO THE ALUMINUM DECKING WITH PIPE INSULATION OR ANOTHER CODE APPROVED ISOLATION MATERIAL.
 4. GAS LINES SHALL BE LOOSELY ATTACHED TO THE PLYWOOD SILL TO ALLOW FOR DEFLECTION IN THE DECK ASSEMBLY WITHOUT COMPROMISING THE GAS LINE CONNECTIONS.



NOTICE: DUTY OF COOPERATION

Release of these plans comprises full cooperation among the owner, his contractor and the architect. Design and construction are complex. Although the architect and his consultants have performed their services with due care and diligence, they cannot guarantee perfection. Communication is imperfect and every communication is subject to misinterpretation, ambiguity or discrepancy discovered by the use of these plans shall be reported immediately to the architect. Failure to notify the architect compounds misunderstanding and increases construction costs. A failure to cooperate by a simple notice to the architect shall relieve the architect from liability for any errors or omissions that may arise from the plans without consent of the architect are unauthorized and shall relieve the architect of responsibility for all consequences arising out of such changes.

All design, documents and data prepared by Eric Smith Associates, P.C. as instruments of service shall remain property of Eric Smith Associates, P.C. and shall not be copied, changed or disclosed in any form whatsoever without first obtaining the express written consent of Eric Smith Associates, P.C.

Eric Smith Associates, P.C.



[illegible]



BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, COLORADO




Job Number:	17022
Date:	2018-11-09
Drawn By:	Author
Checked By:	Checker




Project Phase
PERMIT REVIEW
Sheet Title
EXTERIOR DETAILS
Sheet Number
A523

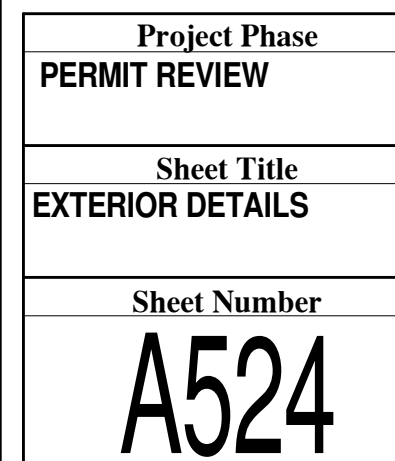

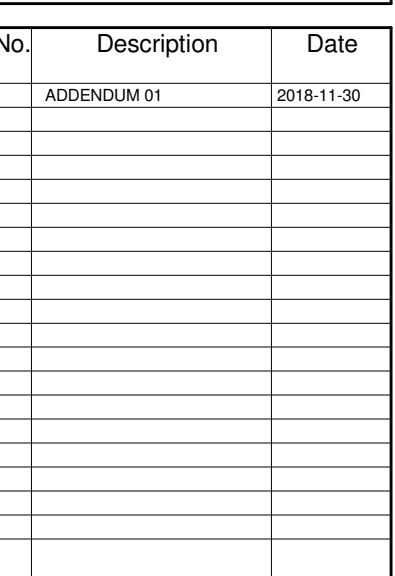

BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, COLORADO

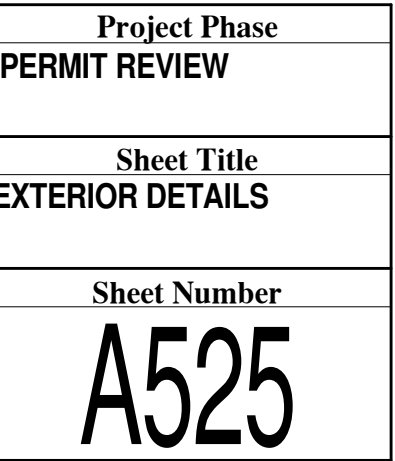

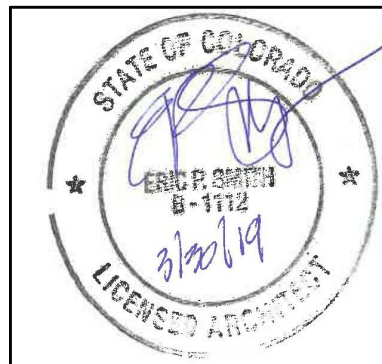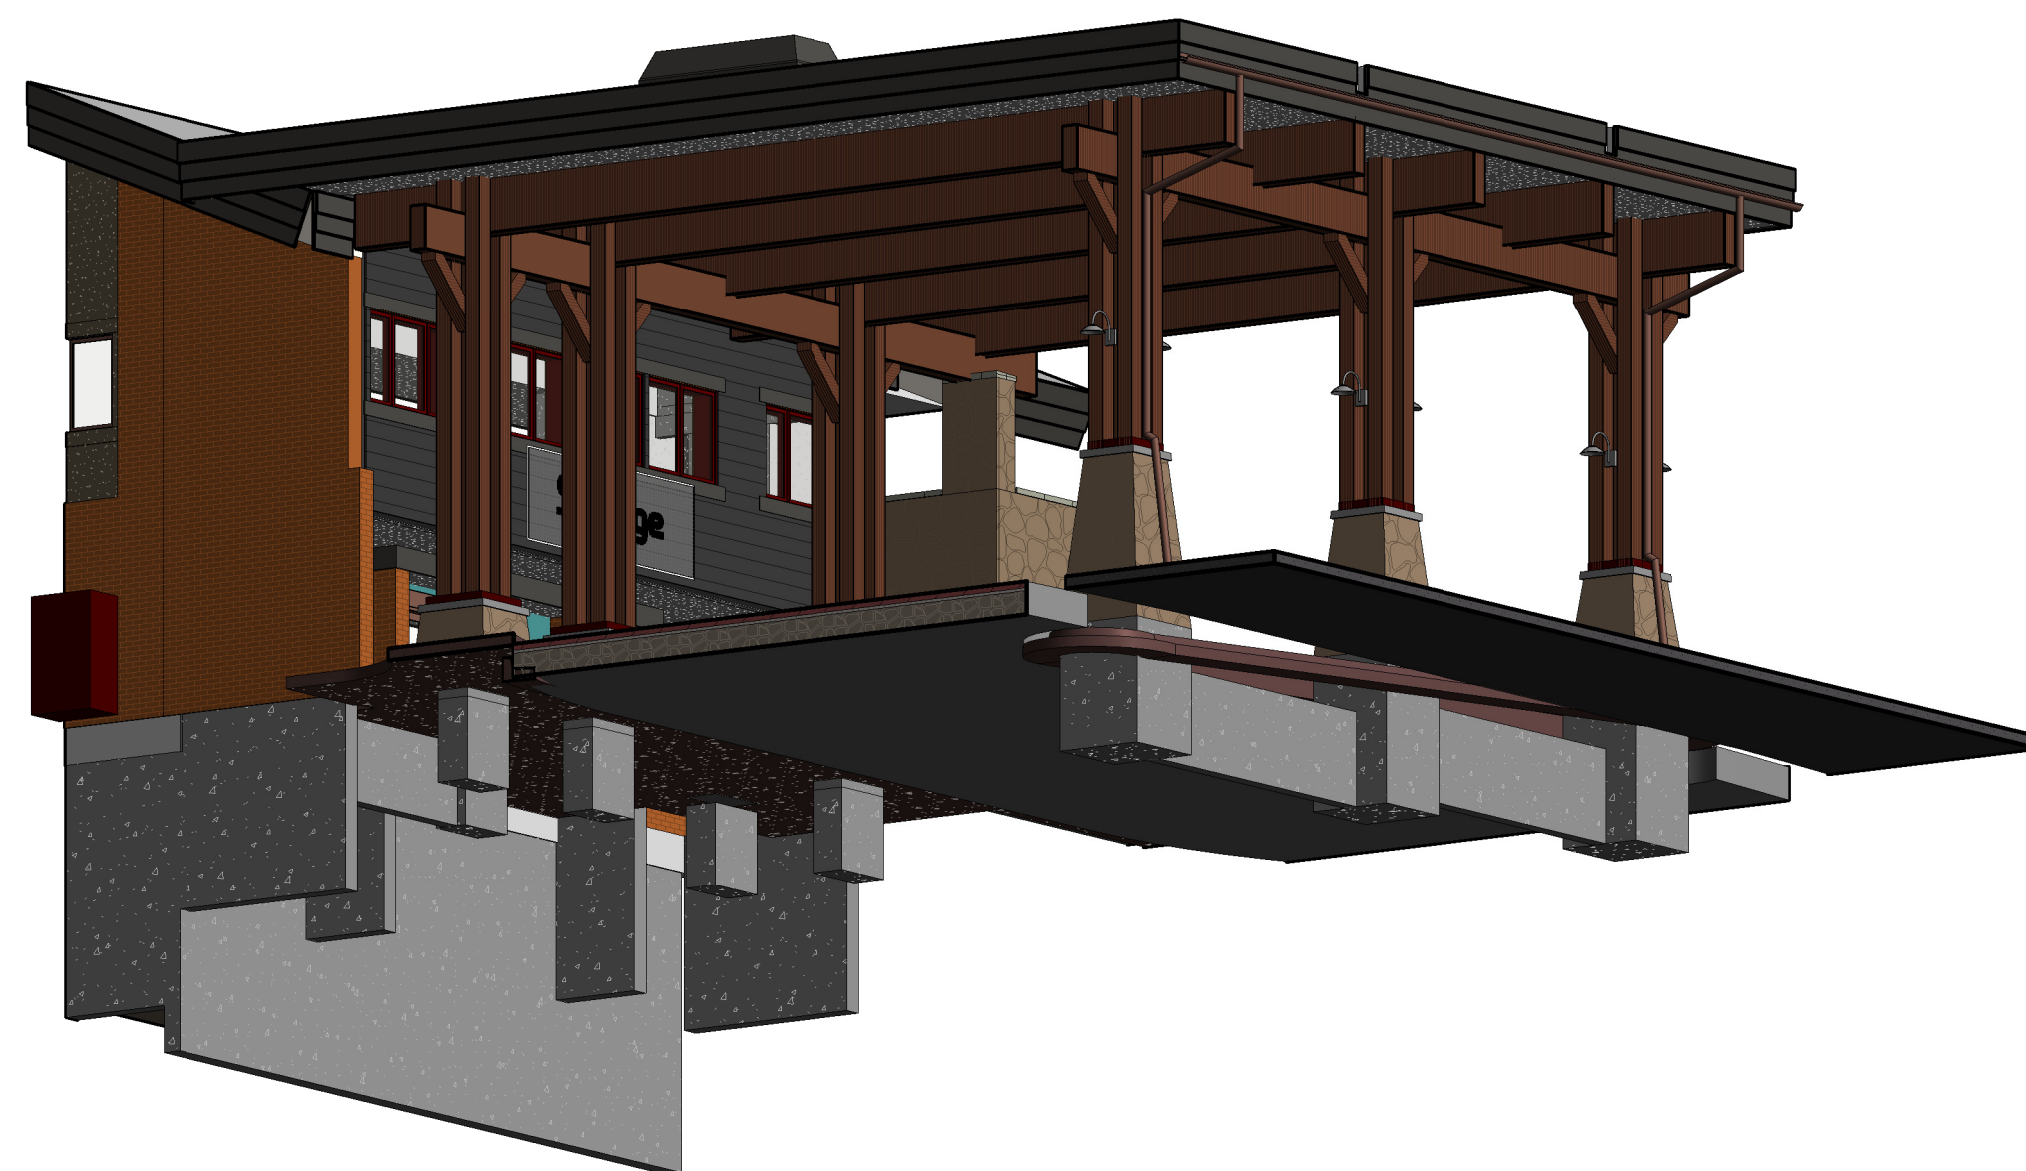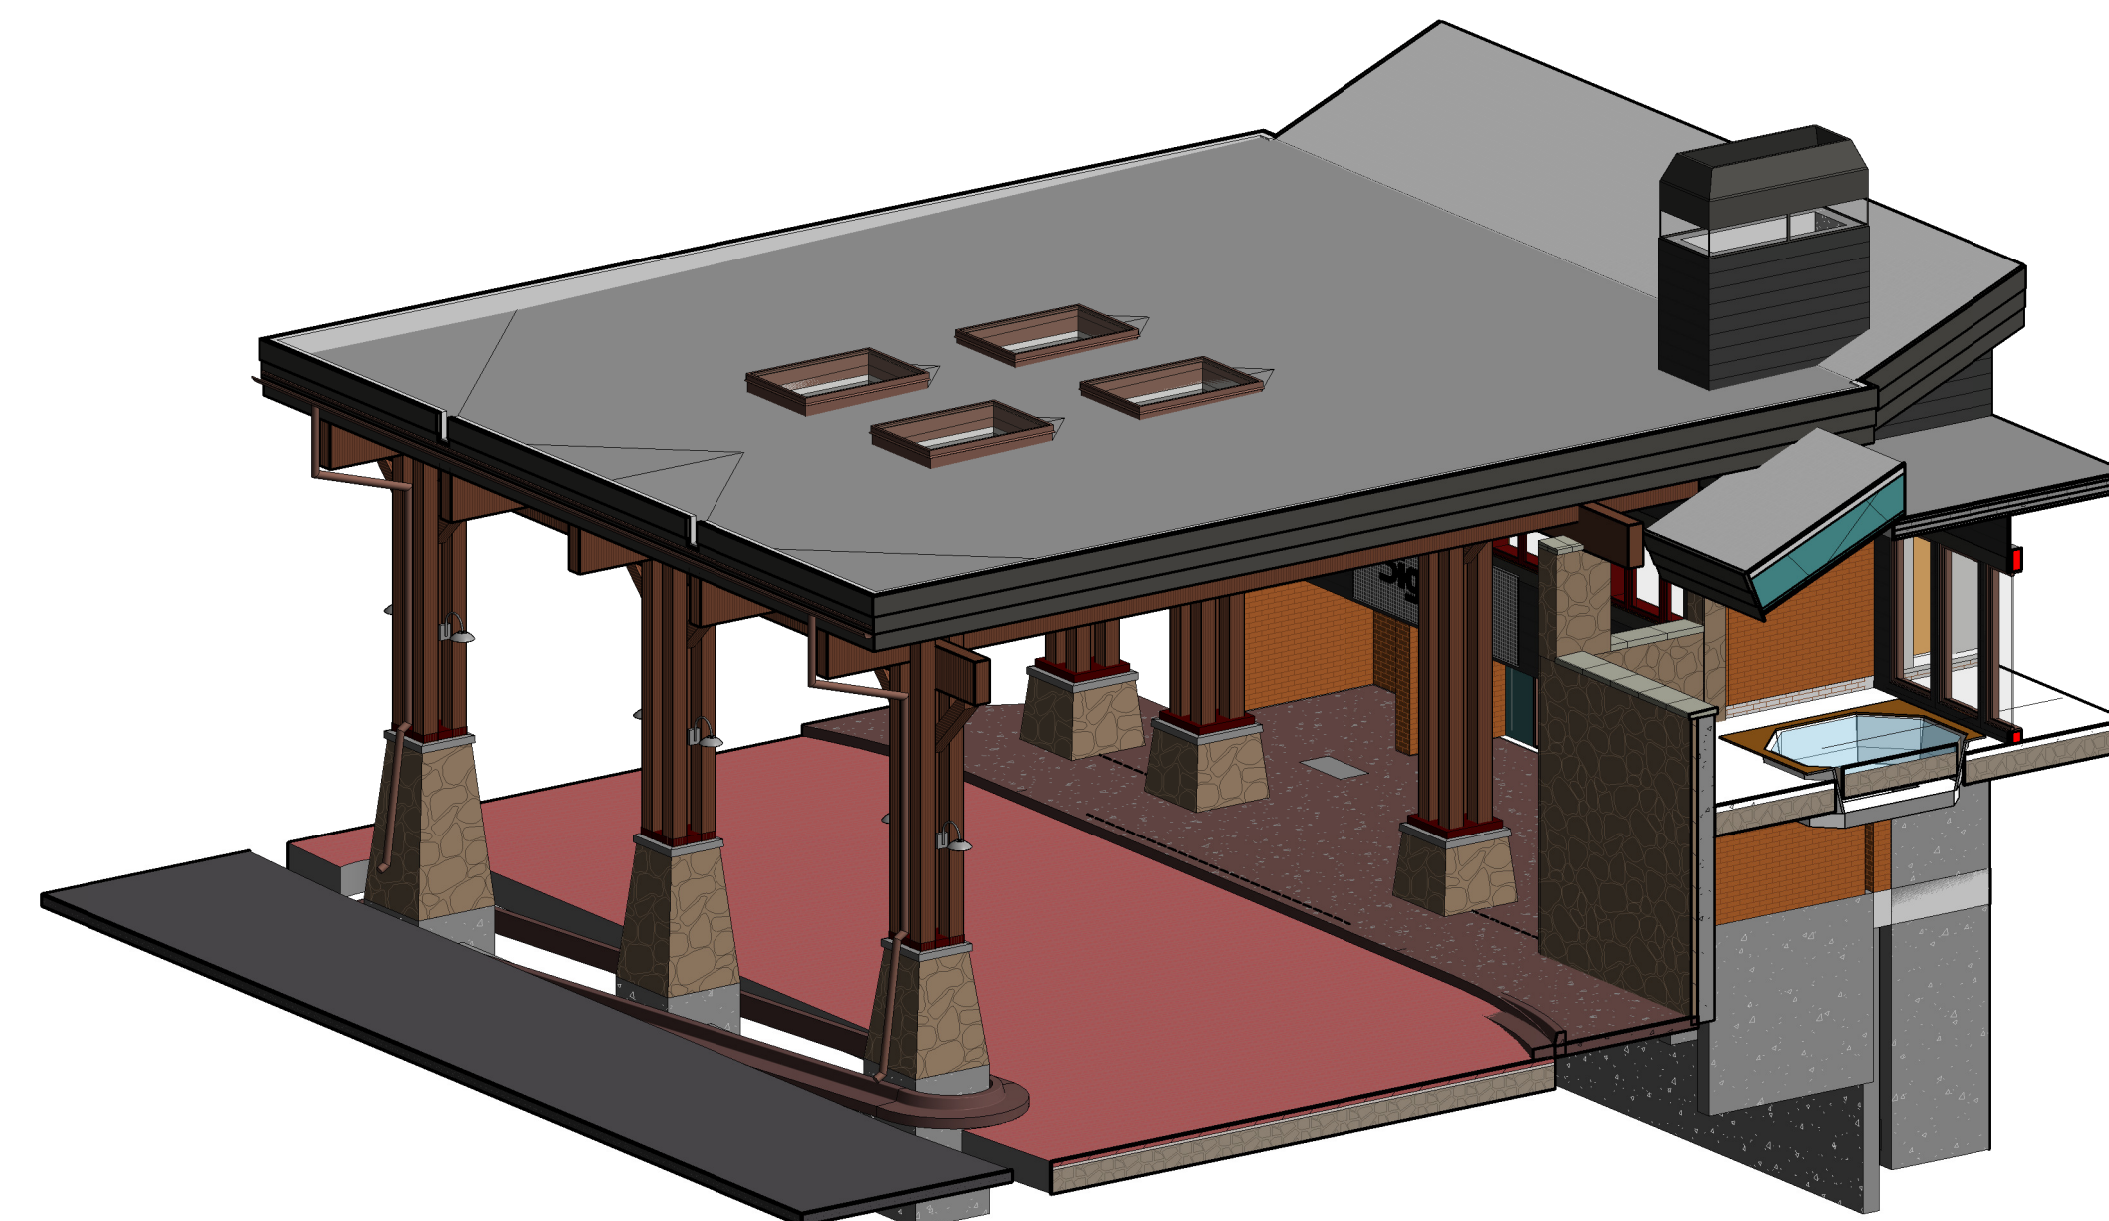

NOTICE: DUTY OF COOPERATION


Release of these plans contemplates further cooperation among the owner, his contractor and the architect. Design and construction are complex. Although the architect and his contractor are to be held responsible for services with due care and diligence, they cannot guarantee perfection. Communication is imperative and every contingency cannot be anticipated. Any ambiguity or discrepancy discovered by the use of these plans shall be reported immediately to the architect. Failure to do so the architect compounds misunderstanding and increases construction costs. A failure to comply by simple notice to the architect shall relieve the architect from responsibility for the consequences. Changes made from the plans without consent of the architect are unauthorized and shall relieve the architect of responsibility for all consequences arising out of such changes.

All design, documents and data prepared by Eric Smith Associates, P.C. as instruments of service shall remain the property of Eric Smith Associates, P.C. and shall not be copied, changed or disclosed in any form whatsoever without first obtaining the express written consent of Eric Smith Associates, P.C.

Eric Smith Associates, P.C.

[illegible]

BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, COLORADO

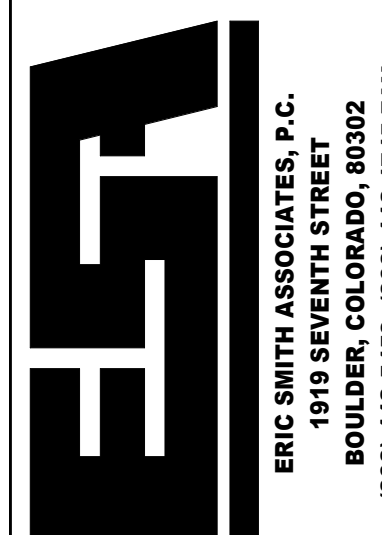

Job Number:	17022
Date:	2018-11-09
Drawn By:	Author
Checked By:	Checker

Project Phase
PERMIT REVIEW

	Sheet Title
--	--------------------

3D VIEWS -
PORTE-COCHERE / SKI
ENTRY

Sheet Number
A901

DATE: 2019-03-29 PERMIT REVIEW

JOB CODE & REVIT FILE: 17022 - Bear Claw II CD Set R16.mt

3/29/2019 2:12:39 PM 17022 BEARCLAW II SET_R16

																		EXISTING		
MOUNTING SURFACE				PANEL L2E										10,000 A.I.C. SYM						
208/120		VOLTS		3 PHASE		4 WIRE		MAIN MLO						BUS 400 A						
VOLT AMPS				DESCRIPTION										VOLT AMPS						
O A	O B	O C	DESCRIPTION										O A	O B	O C					
1200			Heat	2	20	1	A	2	20	3			Washing Machine	1200						
	1200		-	-	-	3	B	4	-	-	-	-	-	1200						
		1360	Garage Ref & Rec	2	1	20	5	C	6	-	-	-	-							
			Dryer	3	20	7	A	8	30	3			Washing Machine	2200		1200				
1200			-	-	-	9	B	10	-	-	-	-	-	2200						
		1200	-	-	-	11	C	12	-	-	-	-	-			2200				
1200			Dryer	3	20	13	A	14	20	2			Laundry Heat	1200						
	1200		-	-	-	15	B	16	-	-	-	-	-	1200						
		1200	-	-	-	17	C	18	20	2			Shop Heat			1200				
			220V Recept		2	20	19	A	20	-	-	-	-	1200						
	1200		-	-	-	21	B	22	20	2			Office Heat	1200						
		1000	Lounge		1	20	23	C	24	-	-	-	-			1200				
1080			Recept	6	1	20	25	A	26	200	3		(N)Panel L2E(2)	21764						
		1080	Recept	6	1	20	27	B	28	-	-	-	-			18250				
			Lighting	1	20	29	C	30	-	-	-	-	-			17580				
1000			Lighting	1	20	31	A	32	20	1			Heat Tape	1200						
	2200		AC		2	30	33	B	34	20	1	6	Recepts		1080					
		2200	-	-	-	35	C	36	20	2			Baseboard Heat			1200				
			Spare	1	20	37	A	38	-	-	-	-	-	1200						
	1200		Welder	1	20	39	B	40	20	1	6		Recepts		1080					
		1080	Recept	6	1	20	41	C	42	20	1		Pool Cover			1200				
6880 9280 9040 VALINE														29964	26210	25780				
OA = 36844														OB = 35490						
														OC = 34820						
CONTINUOUS LOADS														NON-CONTINUOUS LOADS						
UP TO 10 kVA 6840 xl.00= 6840																				
3250 xl.25= 4063 RECEPTACLES														OTHER 97064 xl.00 97064						
REMAINDER														xl.50=						
TOTAL DESIGN kVA= 108														TOTAL DESIGN AMPS= 300						

(1) Provide new breaker as shown.


MOUNTING SURFACE										PANEL L2E(2)										10,000		A.I.C. SYM																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																	
208/120			VOLTS		3 PHASE		4 WIRE		MAIN				MLO				BUS 200 A																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																						
VOLT AMPS			DESCRIPTION						R E C E		L E G		B O K I		C R		C I		B O K I		R E C E		L E G		B O K I		C R		C I		DESCRIPTION		VOLT AMPS																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																						
O A		O B		O C																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																		</	

(1) Existing load re-located to new panel.


PANEL L2D																		10,000			A.I.C. SYM																				
MOUNTING SURFACE			208/120			VOLTS			3			PHASE			4			WIRE			MAIN			MLO			BUS			400 A											
VOLT AMPS			DESCRIPTION												VOLT AMPS			DESCRIPTION																							
00A	00B	00C													00A	00B	00C																								
1000			Controller												1	20	1	A	2	40	2	Zone 8 #4																			
	3800		Zone 7												2	40	3	B	4	-	-	-																			
		3800	-												-	-	5	C	6	50	2	Zone 8 #5																			
3800			Zone 8 #1												2	40	7	A	8	-	-	-																			
		3800	-												-	-	9	B	10	40	2	Zone 9																			
		3800	Zone 8 #2												2	40	11	C	12	-	-	-																			
3800			-												-	-	13	A	14	40	2	(N) Zone 10																			
		3800	Zone 8 #3												2	40	15	B	16	-	-	-																			
		3800	-												-	-	17	C	18	-	-	-																			
			Space														19	A	20		Space																				
			Space														21	B	22		Space																				
			Space														23	C	24		Space																				
			Space														25	A	26		Space																				
			Space														27	B	28		Space																				
			Space														29	C	30		Space																				
8600			11400			11400			VALUE												11800			11100			8300														
0 A=			20400			0 B=												22500			0 C=												19700								
CONTINUOUS LOADS																		NON-CONTINUOUS LOADS																							
x1.25=						UP TO 10 kVA						x1.00=						OTHER						62600						x1.00						62600					
						RECEPTACLES						REMAINDER						x0.50=																							
TOTAL DESIGN kVA = 63																		TOTAL DESIGN AMPS= 174																							

2420 Ski Trail Lane
Steamboat Springs, CO

600 S. Lincoln Ave. #201
Steamboat Springs, CO 80487

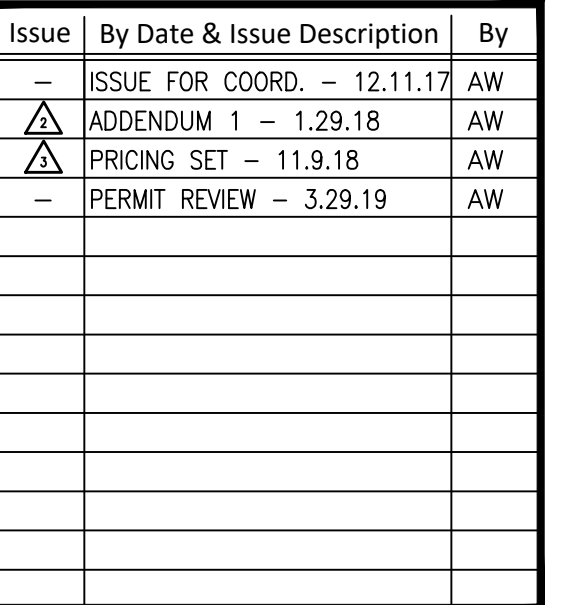

Scale:	1/4"=1'-0"
24x36	
Description: ELECTRICAL PLAN	
Project Name: BEAR CLAW II	
Project Number: 201783	
Sheet No.	
E101	

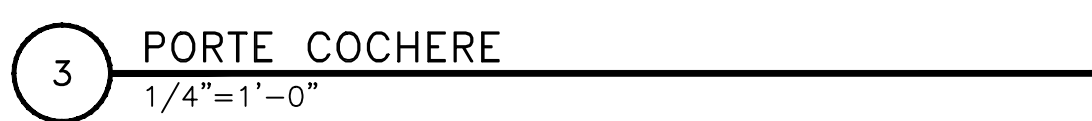

1. ALL POWER EQUIPMENT SHOWN IS NEW UNLESS OTHERWISE NOTED.
2. PROVIDE TYPEWRITTEN DIRECTORIES REFLECTING ALL NEW WORK PERFORMED IN THIS PROJECT.
3. ALL WIRE SHALL BE #12 AWG MIN., 90 DEG. "C" IN 1/2" - 2 #12 AWG & #12 GND, UNLESS OTHERWISE NOTED.
4. VERIFY LOCATIONS OF ALL ELECTRICAL EQUIPMENT WITH ARCHITECTURAL DRAWINGS AND CONDITIONS IN THE FIELD.

- 1 REPLACE EXISTING (6) DOWNLIGHT FIXTURES WITH NEW F18 FIXTURE. VERIFY COUNT IN THE FIELD. CIRCUITING AND SWITCHING TO REMAIN.
- 2 REPLACE EXISTING (2) FACADE FIXTURES WITH NEW F4 FIXTURE. CIRCUITING AND SWITCHING TO REMAIN.
- 3 REPLACE EXISTING (3) FACADE FIXTURES WITH NEW F4 FIXTURE. CIRCUITING AND SWITCHING TO REMAIN.
- 4 REPLACE EXISTING (3) DOWNLIGHT FIXTURES WITH NEW F18 FIXTURE. VERIFY COUNT IN THE FIELD. CIRCUITING AND SWITCHING TO REMAIN.
- 5 REPLACE EXISTING (4) FACADE FIXTURES WITH NEW F4 FIXTURE. CIRCUITING AND SWITCHING TO REMAIN.
- 6 REPLACE EXISTING (2) FACADE FIXTURES WITH NEW F3 FIXTURE. CIRCUITING AND SWITCHING TO REMAIN.
- 7 F5 FIXTURE TO REPLACE INDIVIDUAL UNIT FACADE FIXTURES. REPLACE ON ALL 52 UNIT DECKS. VERIFY COUNT IN THE FIELD.
- 8 NEW FIXTURE F2 TO BE CONNECTED TO EXTERIOR CIRCUIT THAT POWERS F1 FIXTURES ON SOUTH SIDE OF BUILDING. PROVIDE NEW SWITCH AS SHOWN.
- 9 CONNECT ALL NEW PORTE COCHERE FIXTURES TO A NEW CIRCUIT FROM A PANEL LOCATED IN THE MAIN ELECTRICAL ROOM JUST OFF THE MAIN ENTRANCE. SWITCHING TO MATCH EXISTING FACADE FIXTURES.
- 10 PROVIDE CONNECTION FOR AUTO DOOR OPENER. VERIFY WITH MANUFACTURER CONNECTION REQUIREMENTS. CONNECT TO TO A NEW CIRCUIT FROM A PANEL LOCATED IN THE MAIN ELECTRICAL ROOM JUST OFF THE MAIN ENTRANCE.
- 11 PROVIDE CONNECTION FOR GAS FIRED SNOWMELT BOILER. VERIFY WITH MANUFACTURER CONNECTION REQUIREMENTS. CONNECT TO TO A NEW CIRCUIT FROM A PANEL LOCATED IN THE MAIN ELECTRICAL ROOM JUST OFF THE MAIN ENTRANCE.
- 12 AS AN ADD/ALTERNATIVE CONTRACTOR TO PRICE NEW SNOWMELT SYSTEM IN NEW CONCRETE PATHWAY. PROVIDE 1/2" - 2#8 AWG & #10 GND TO JUNCTION BOX TO SNOWMELT SYSTEM. PROVIDE CABLE AT 4" ON CENTER. PROVIDE MATCHING CONTROLLER BY ENVIRONMENTAL TECHNOLOGIES IN LOADING DOCK NEXT TO PANEL L2D. FIELD VERIFY AS NEEDED.



BEAR CLAW II

Ext. Remodel


2420 Ski Trail Lane
Steamboat Springs, CO

ESA Architecture
and Planning

600 S. Lincoln Ave. #201
Steamboat Springs, CO 80487




WILDER ENGINEERING LLC
Andrew Wilder PE
1170 Blue Sage Drive
Steamboat Springs, CO 80487
P: 970-819-7848
E: andy@wilder-eng.com

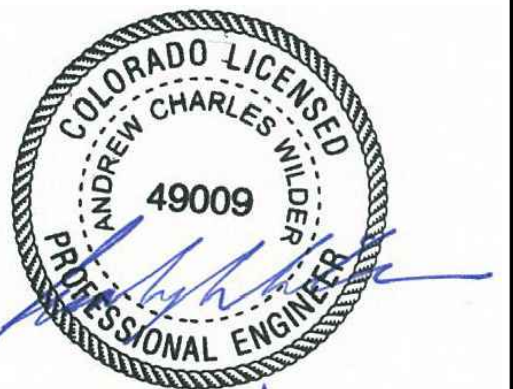

Issue	By	Date & Issue Description	By
-		ISSUE FOR COORD. - 12.11.17	AW
-		ADDENDUM 1 - 1.29.18	AW
△		PRICING SET - 11.9.18	AW
-		PERMIT REVIEW - 3.29.19	AW

Scale:	1/2"=1'-0"
	24x36
Description:	ELECTRICAL PLAN
Project Name:	BEAR CLAW II
Project Number:	201783
Sheet No.	E102

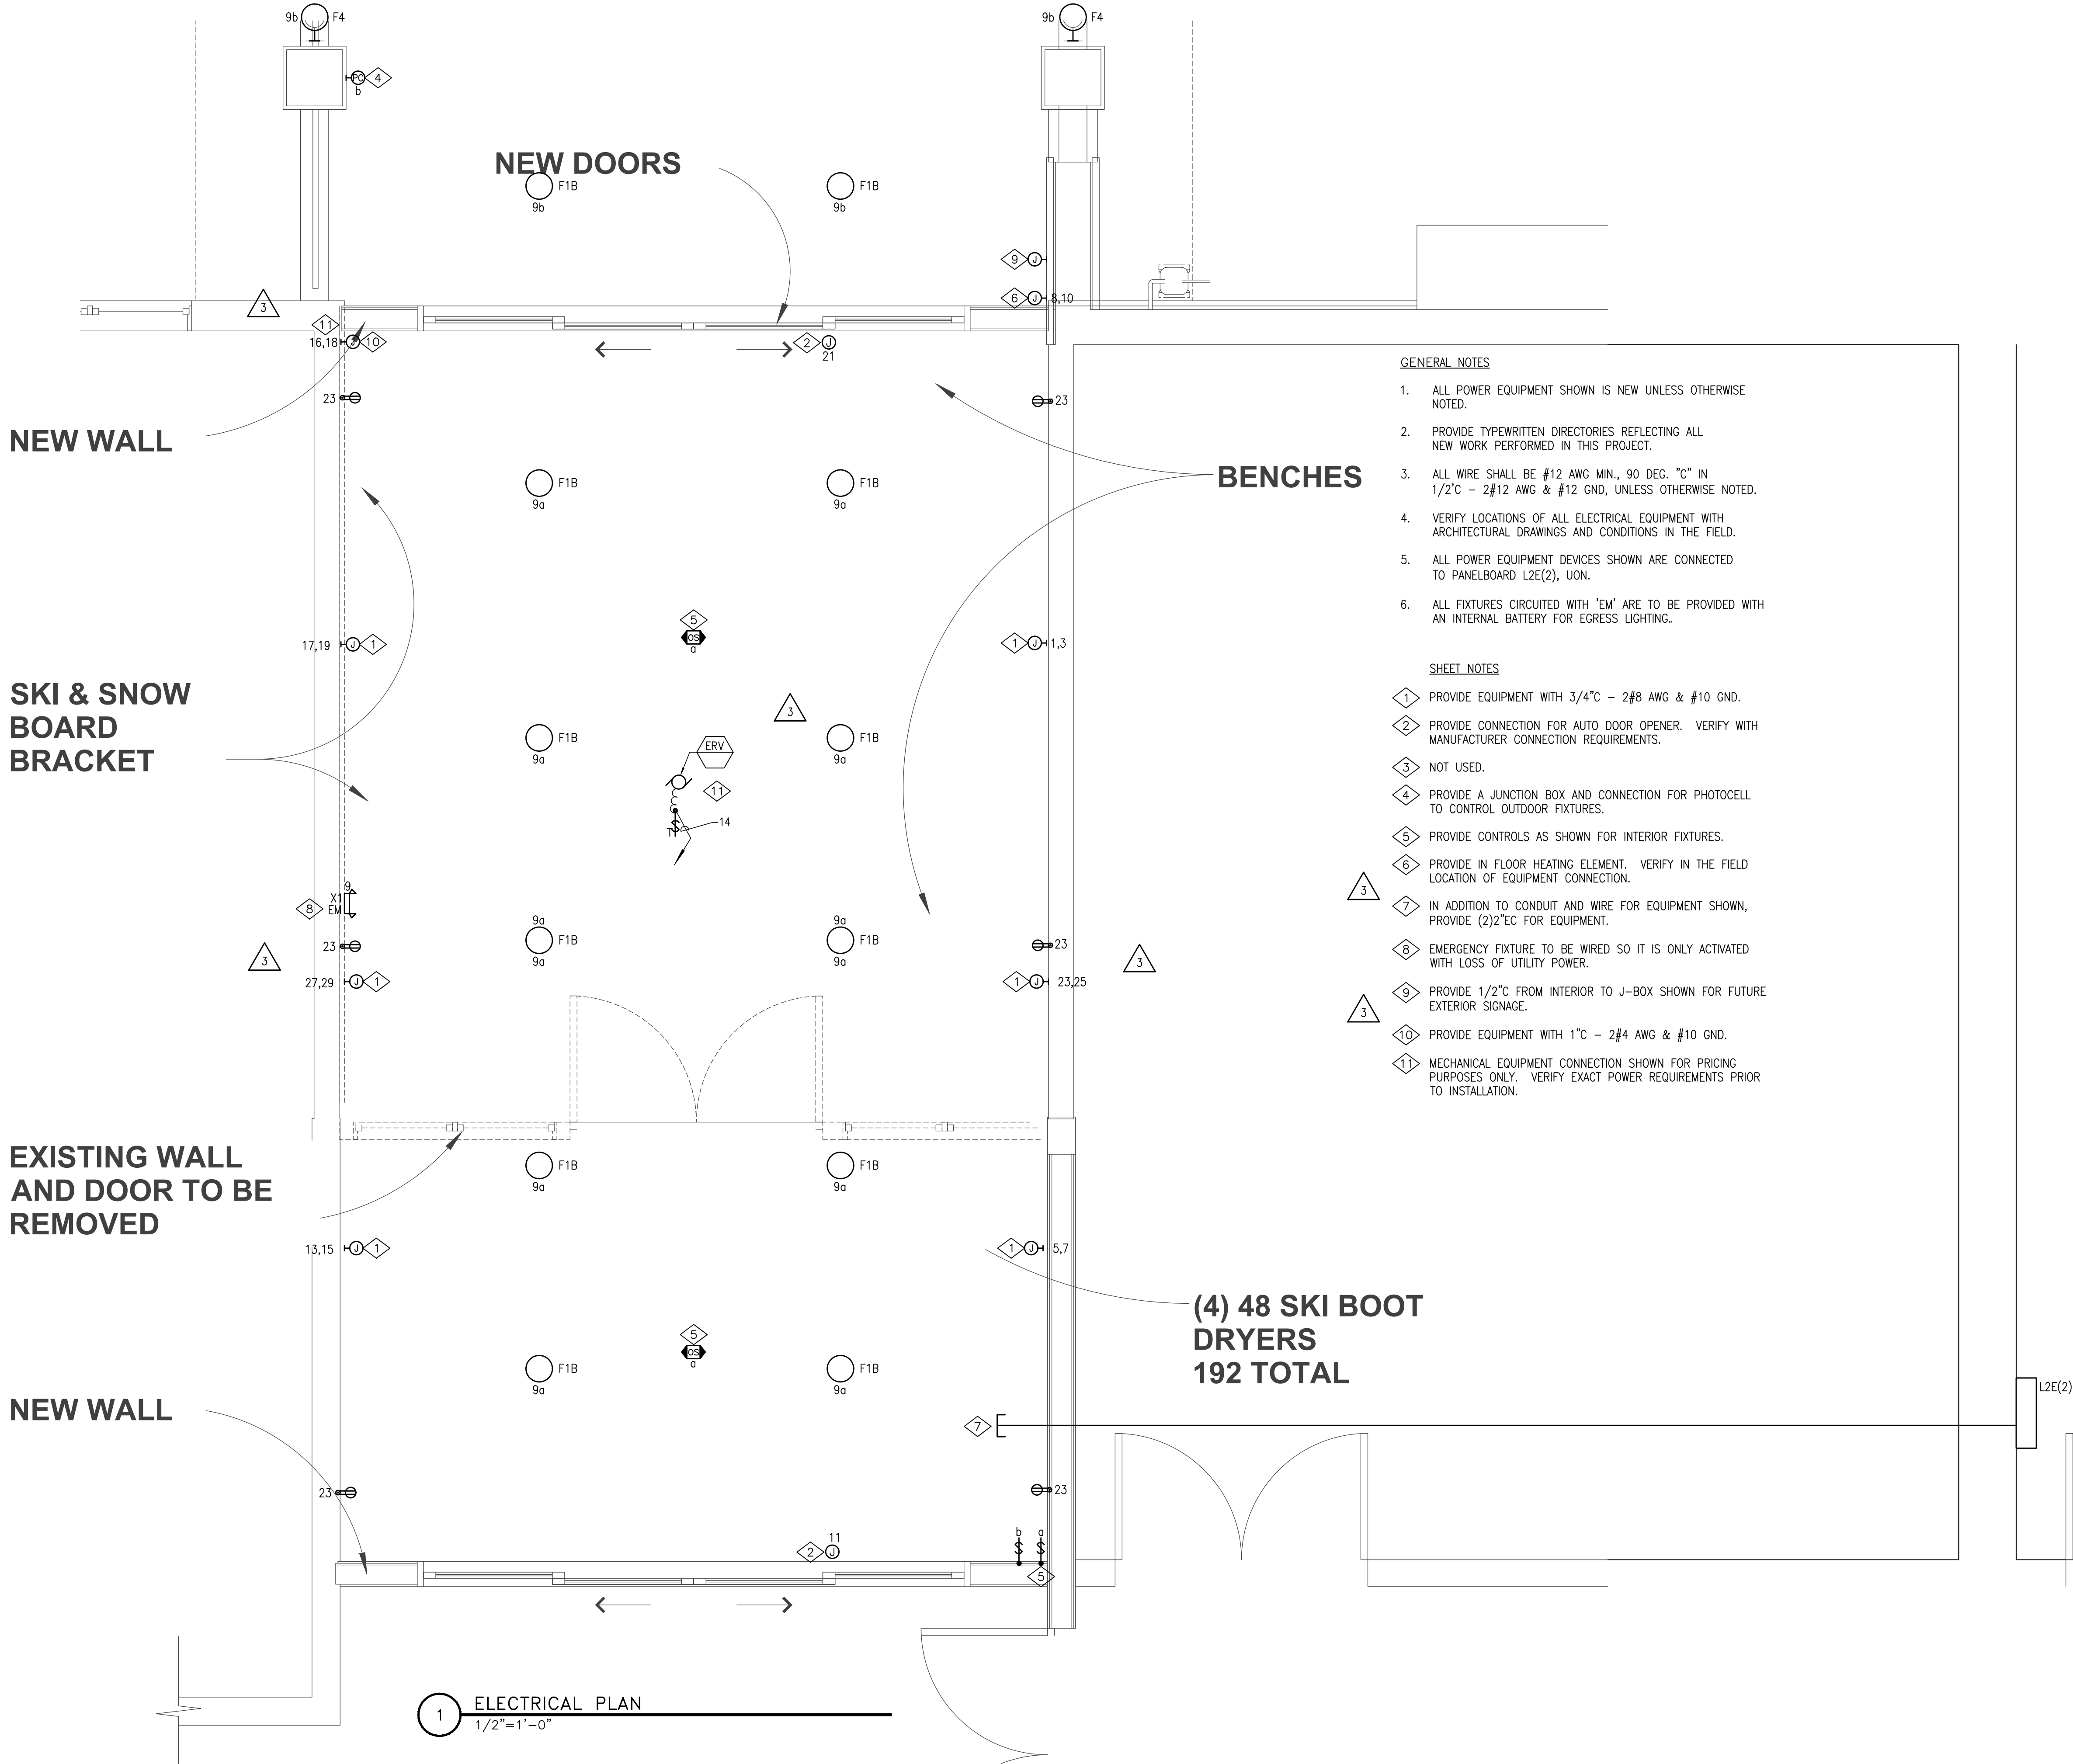

STRUCTURAL GENERAL NOTES

GOVERNING CODE: 2015 INTERNATIONAL BUILDING CODE (IBC) AND ALL LOCAL AMENDMENTS, EXCEPT AS NOTED

DESIGN LOADS:

RISK CATEGORY:	II Standard
ROOF LIVE LOADS:	
Roof Live Load:	20 psf
Flat Roof Snow Load (psf):	125 psf (perscriptive)
Ground Snow Load (psf):	88 psf (for drift calculations)
Snow Exposure Factor (Ce):	1.0
Thermal Factor (Ct):	1.2
FLOOR LIVE LOADS:	
Residential:	40 psf
Corridors & Public Spaces:	100 psf
Corridors Above 1st Floor:	80 psf
Exterior Decks:	Same as occupancy served
Balconies:	100 psf

ROOF AND FLOOR DEAD LOADS:

Roof - Asphalt Shingle:	20 psf
Floor - Carpet or Hardwood:	15 psf
Floor - 3/8" Ceramic Tile:	20 psf
Roof - Porta Cochere:	20 psf
Deck:	15 psf

WIND LOADS (ASCE 7-10):

Basic Wind Speed (3-second gust):	115 mph Ultimate
Building Enclosure Classification:	Enclosed Building, Open Porte Cochere
Internal Pressure Coefficient (GCp):	0.18 Enclosed 0.0 Open
Wind Exposure:	C

COMPONENTS AND CLADDING DESIGN WIND PRESSURES (PSF) (ASCE 7-10):

Wall Zone (<Fig. 6-17> <Fig. 30.4.1-1>):	
5 Within 6'-4" of corners:	+24.1 psf, -32.1 psf
4 Internally:	+24.1 psf, -26.1 psf
Roof Zone (<Fig. 6-17> <Fig. 30.4.1-1>):	
3 Within 6'-4" of corners:	+10.7 psf, -66.4 psf
3 Overhangs within 6'-4" of corners and ridges:	+10.7 psf, -66.4 psf
2 Within 6'-4" of edges and ridges:	+10.7 psf, -44.1 psf
2 Overhangs:	+10.7 psf, -41.9 psf
1 Internally:	+10.7 psf, -26.3 psf

SEISMIC LOADS: Exempt per IBC Section 1613.1, Exception #1

Spectral Response Acceleration Coefficients	
Short Period Ss: 0.269g	Ss: 0.285g
One Second S1: 0.074g	S1: 0.119g
Soils Site Class:	D
Seismic Design Category:	B
Basic Seismic-Force-Resisting System(s):	Timber Frames
Design Base Shear:	9.56 kips
Seismic Response Coefficient(s) (Cs):	0.1912
Response Modification Factor(s) (R):	1.5
Analysis Procedure:	Equivalent Lateral Force Procedure

FOUNDATION DESIGN:

Foundation design is in accordance with recommendations contained in soils investigation Report Number 07-7808 prepared by NorthWest Colorado Consultants, Inc (NWC) dated April 28, 2009.

HELICAL PIERS:

Piers selected by the owner shall be installed by a contractor certified by the manufacturer and shall develop the manufacturer's recommended installation torque to satisfy the load requirements given on the structural drawings. Certification shall include the technical aspects of the particular piers being used and the ascribed installation techniques. Shaft dimension, helix diameter, and helix spacing shall be determined by the pier manufacturer based on the criteria presented in the soils report and the manufacturer's own requirements. Appropriate pier selection shall consider load plus accepted safety factors, soil parameters and the installation torque versus capacity equation as per the manufacturer's recommendations. The helical lead sections and extensions shall be solid steel, rounded corner square shaft configuration, with one or more helical bearing plates welded to the shaft.

The soils engineer shall be present during pier installation to confirm that the proper installation procedures are used and required installation torque is applied to each pier.

All work shall be performed in accordance with all applicable safety codes in effect at the time of installation. All piers must be corrosion protected by galvanization per ASTM B633.

Installation units shall consist of a rotary type torque motor with forward and reverse capabilities. Installation units shall be capable of developing the minimum torque as required and may be either electrically or hydraulically powered.

Installation units shall be capable of positioning the helical pier at the proper installation angle. The appropriate steel underpinning bracket or new construction load transfer device shall be used.

EARTH RETAINING STRUCTURES:

Earth equivalent fluid lateral pressure:

Walls restrained at top (at rest):	45 pc
Cantilevered walls (active):	35 pc
Passive resisting:	250 pc
Coefficient of sliding friction:	0.4

REINFORCED CONCRETE:

Concrete design is based on the American Concrete Institute "Building Code Requirements for Reinforced Concrete" (ACI 318) and shall be constructed in accordance with the "Standard Specifications for Structural Concrete" (ACI 301).

STRUCTURAL CONCRETE SHALL HAVE THE FOLLOWING PROPERTIES (normal weight concrete unless noted otherwise):

Minimum 28 day compressive strength (f'c) as follows:

Cement Type:	III
Maximum Aggregate Size:	3/4"
Footings:	3,000 psi (Max W/C Ratio 0.52); Entrained Air 1.5% (± 1.5%); Slump 5 inches (± 1")
Walls:	4,000 psi (Max W/C Ratio 0.50); Entrained Air 3.0% (± 1.5%); Slump 4 inches (± 1")
Interior Slabs-on-Grade:	3,500 psi (Max W/C Ratio 0.50); Entrained Air 3.0% (± 1.5%); Slump 4 inches (± 1")
Beams, Columns:	4,000 psi (Max W/C Ratio 0.45); Entrained Air 3.0% (± 1.5%); Slump 4 inches (± 1")

Reinforcing steel shall be fabricated and placed in accordance with ACI 315 "Details and Detailing of Concrete Reinforcement."

When cold weather conditions exist, place and cure concrete in accordance with ACI 308.

Welded wire fabric shall conform to ASTM A185.

Deformed reinforcement shall be domestic near billet steel conforming to ASTM A615, Grade 60 including stirrups and ties, except that reinforcing which is required to be welded shall conform to ASTM A706.

Epoxy coated reinforcing bars shall conform to ASTM A775.

Zinc coated (galvanized) reinforcing bars shall conform to ASTM A767.

Unless otherwise noted on the structural drawings, lap bars 50 diameters (50"Bar Diameter minimum).

Reinforcing at all abutting concrete (including footings) shall be continuous through or around all corners and intersections OR use matching corner bars of equal size and spacing to reinforcing in the abutting members.

Install 2-#5 bars (minimum) around all sides of all openings in concrete and extend 2'-0" past edges of openings, unless otherwise noted.

In continuous members, splice top bars at mid-span between supports and splice bottom bars over supports.

Form intermittent shear keys at all construction joints and as shown on the structural drawings.

Unless otherwise noted on the drawings, minimum concrete cover over reinforcing shall be as follows:

Unformed surface cast against and permanently exposed to earth: 3"

Formed surface exposed to earth or weather:

#6 through #18 bars	2"
#5 bar, w/31 or c31 wire, and smaller	1-1/2"

Formed surface not exposed to weather or in contact with ground:

Slabs, walls, piers: #11 bars and smaller	3/4"
---	------

Beams and columns:

Primary reinforcement	1-1/2"
Stirrups, ties, spirals	1-1/2"

Install chairs, bolsters, additional reinforcement, and accessories necessary to support reinforcement at position shown on drawings. Support of reinforcement on wood, brick, or other unacceptable materials shall not be permitted.

Keep reinforcement clean and free of dirt and oil. Oil forms prior to placing reinforcement.

Fiber admixture shall be 100% virgin polypropylene, fibrillated fibers, type 111 4.1.3, performance level one, per ASTM C1116.

Properly place, accurately position and maintain securely in place all embedded items prior to and during concrete placement.

Anchor bolts and rods for beam and column-bearing plates shall be placed with setting templates.

Unless otherwise shown in the architectural drawings, provide 3/4" chamfers at all column, wall, slab or beam edges that are exposed to view in the finished structure.

STRUCTURAL STEEL:

Structural steel shall be detailed, fabricated and erected in accordance with the "Specification for Structural Steel Buildings" (AISC 360) and the "Code of Standard Practice for Steel Buildings and Bridges" (AISC 303) by the American Institute of Steel Construction (AISC).

All structural steel shall conform to the ASTM Standards and grades indicated below, unless noted otherwise on the drawings or details.

Structural steel wide flange beams and WTs:	ASTM A992, 50 ksi yield
Roll-steel floor plates:	ASTM A736, Commercial grade
Other rolled shapes, including plates, channels, and angles:	ASTM A36, 36 ksi yield.
Hollow structural section (HSS) rectangular shapes:	ASTM A500, Grade B, 46 ksi yield
HSS round shapes:	ASTM A500, Grade B, 42 ksi yield
Pipe shapes:	ASTM A53, Grade B, 35 ksi yield.

Adjustable pipe columns:

3" diameter 11 gauge, shall be certified by the manufacturer for a safe load capacity of 13,500 lbs at 7'-6".

3" diameter "Heavy Duty" schedule 40 shall be certified for a safe load capacity of 28,000 lbs at 7'-6".

Unless otherwise noted, framed beam connections shall be bearing-type with 3/4" diameter, snug tight, ASTM A325 bolts, detailed in conformance with the structural drawings and the "Steel Construction Manual" by the AISC, 14th edition. Install bolts in accordance with AISC's "Specification for Structural Joints Using ASTM A325 or A490 bolts."

All beams shall have full depth web stiffeners each side of webs above and below columns (1/4" plate or as noted).

Anchor rods shall conform to ASTM F1554, Grade 55 as noted on the structural drawings with weldability supplement S1.

Headed anchors (HAS) shall conform to ASTM A108 and shall be connected to structural steel with equipment approved by the stud manufacturer according to the stud manufacturer's recommendations.

Welding shall be done by a certified welder in accordance with the AISC documents listed above, the American Welding Society (AWS) D1.1: 2005 Structural Welding Code, and the recommendations for use of E70XX electrodes. Where not specifically noted, minimum weld shall be 3/16" fillet by length of contact edge.

All post-installed anchors shall have current International Code Council Evaluation Service (ICC-ES) reports and shall be installed in accordance with the manufacturer's requirements.

Expansion anchors shall be approved "wedge" type unless specifically noted to be "sleeve" type as noted on the structural drawings. Chemical anchors shall be approved epoxy or similar adhesive type as appropriate for installation in solid and non-solid base materials.

Grout beneath column base and beam bearing plates shall have a minimum 28-day, compressive strength of <7,500><5,000> psi and shall be non-shrink, non-metallic, and tested in accordance with ASTM C1107.

STEEL DECKING:

Steel roof, non-composite floor (or "form"), and composite floor deck shall be manufactured and erected in accordance with the standard deck specifications and the "Manual of Construction with the Steel Deck Institute (SDI).

Roof deck shall be connected to supporting members and interconnected to develop the diaphragm shears and net uplift pressures due to lateral forces as noted on the structural drawings.

Non-composite and composite floor deck shall be connected to supporting members and interconnected as required to satisfy SDI minimum requirements except as noted on the structural drawings.

Welding patterns, screw patterns, and details shall be indicated on the deck supplier's shop drawings.

LIGHT GAUGE STRUCTURAL STEEL FRAMING:

Member forming shall conform to American Iron and Steel Institute (AISI) North American Specification for the Design of Cold-Formed Steel Structural Members (NAS-01), including 2004 supplement.

All structural framing (studs, joists, track, runners, bracing, and bridging) shall be galvanized G-60 sheet steel conforming to ASTM A1003.

Studs, tracks, and joists shall be 33 ksi yield unless noted as 50 ksi for 5/4 mils and heavier.

Subcontractor shall provide bridging and blocking at a maximum of 6 foot spacing or as required for stability and stiffness of the final assembly wherever sheathing does not provide adequate bracing.

Where punctures are within 8" of member ends, install unpunched stiffeners of equal strength and gauge with 4-#10 screws each edge to the stiffened member.

Parallel members in contact shall be connected with #10 screws @ 16" maximum along each contact edge in the field of the member unless noted otherwise on drawings.

The Steel Stud Manufacturers Association (SSMA) product identification codes are used to label members on the drawings: [Member Depth in 1/100 inches][Style][Flange Width in 1/100 inches][Material Thickness in mils] [Yield Strength if >33ksi] ksi]

Style	Section	Material Thickness (mils)	Reference Only Gauge No.
S	Stud or Joist	20	- Structural
T	Track	43	18
U	Channel	54	16
F	Furring Channel	68	14

STRUCTURAL MASONRY:

Design is based on ACI 530/ASCE 5-05/TMS 602-05, "Building Code Requirements for Masonry Structures," <Allowable Stress Design> <Strength Design>.

Masonry work shall conform to ACI 530.1/ASCE 6-05/TMS 602-05 "Specification for Masonry Structures".

Compressive strength of masonry assembly used for design is 2000 psi (f'm = 2000 psi), based on net-bedded area.

Except at masonry lintels using standard lintel units, bond beam units shall be produced from standard vertically voided units with pre-cast

compressive strength of 1,900 psi based on average net area.

Facing brick shall conform to ASTM C216 Grade SW.

Building brick shall conform to ASTM C62 Grade SW.

Hollow brick shall conform to ASTM C662, Grade SW.

Mortar shall be type "S" conforming to ASTM C270. Mortar SHALL NOT be substituted for grout.

Masonry cement shall not be used unless part of a pre-packaged mortar or grout mix approved by the structural engineer.

Provide full shovled mortar in all head and bed joints.

Admixtures shall not be used unless approved by the architect and/or structural engineer.

Grout used in masonry walls and block cells shall be coarse grout, as defined by ASTM C476, with a minimum cube strength = 2,000 psi or 3,000 psi concrete using 3/8" diameter aggregate and placed by vibrating unless an approved self-consolidating mix is used.

"Low-Lift" grouting shall not exceed 5 feet in height unless ACI 530.1 high-lift grouting procedures are reviewed and approved by the architect and structural engineer.

Vertically space continuous horizontal joint reinforcing at 16" maximum in all CMU walls. Joint reinforcing shall be welded type with 9 gage side rods and 9 gage trussed or ladder cross rods. In exterior walls, joint reinforcing shall be stainless steel or hot-dip galvanized. All other joint reinforcing shall be mill galvanized, hot-dip galvanized, or stainless steel. Horizontal joint reinforcing shall be lapped no less than 6" at all splices.

Wire ties for veneer shall be 9 gage diameter for cavity widths 2" or less. Where nominal cavity width exceeds 2 inches, veneer ties shall be 1/4" diameter. Ties shall be spaced a maximum of 16" in each direction.

Reinforcing bars shall be as for reinforced concrete except as noted. Unless otherwise noted on the structural drawings, lap bars 50 diameters (50"Bar Diameter minimum) at splices. Reinforcement shall be secured against displacement prior to grouting by wire bar locators or other suitable devices at intervals not exceeding 200 bar diameters or 10 feet.

Reinforce and fully grout vertical cells at corners, ends of walls, jacks of openings, each side of vertical control joints, and at spacing shown on drawings. Vertical reinforcing bars shall have a minimum clearance of 3/4" from masonry.

Foundation dowels shall match vertical reinforcing, unless otherwise noted on the drawings.

Where noted on the drawings, provide clearance between masonry and structural elements, or wrap steel with polyethylene film.

Locate vertical control joints in all masonry walls as shown on the architectural drawings, structural drawings, or spaced horizontally at 25'-0" maximum spacing where not shown.

Cold weather construction shall conform to guide specifications from the International Masonry Industry All-Weather Council (IMI/ABC), latest version.

STRUCTURAL WOOD & TIMBER:

Design is based on ANSI/APA/ASCE "National Design Specification for Wood Construction with Supplement: Design Values for Wood Construction" and ANSI/APA SDPWS "Special Design Specifications for Wind and Seismic."

2x framing lumber shall be S4S Hem-Fir No. 2 and better unless otherwise noted.

All lumber shall be 19% or less maximum moisture content, unless noted otherwise.

Soft timber beams and posts shall be Kiln Dried Douglas Fir-Larch No. 1.

2x stud bearing walls shall be 2x6 @ 16" (UNO) Hem-Fir Stud grade or better.

2x top and bottom plates shall be Hem-Fir No. 2 or better.

Use of wood bearing walls shown on drawings with laterally unsupported heights in excess of that shown in IBC Table 2308.9.1 have been justified by Anthem's analysis.

Fasteners for use with treated wood shall comply with IBC Section 2304.9.5 - IBC.

Wood in contact with concrete shall be pressure-treated Douglas Fir-Larch or Southern Yellow Pine.

Preservative treated wood shall be treated in accordance with AWPA U1 and AWPA M4.

Conventional light framing shall comply with IBC Sections R602, R602, and R602->IBC Section 2308>.

Minimum nailing shall be provided as specified in <IRC Table R602.3(1) "Fastener Schedule for Structural Members"> <IBC Table 2304.9.1 "Fastening Schedule.">

Metal framing anchors shown or required, shall be Simpson Strong-Tie or equal code approved connectors and installed with the number and type of nails recommended by the manufacturer to develop the maximum rated capacity. Note that heavy-duty hangers and skewed hangers may not be stocked locally and require special order from the factory.

Glue wood nailer plates to steel beams and attach with either 1/2"x0 bolts @ 32" o.c., staggered or 0.145"x0 powder actuated drive pins @ 16" o.c. staggered. Width of nailer plate shall match beam width + 1/8" min (1/4" max) overhang each side.

Lead holes for lag screws shall be 40%-70% of the shank diameter at the threaded section and equal to the shank diameter at the unthreaded section per NDS Section 11.1.3.

Connector bolts and Lag screws shall conform to ANSI/ASME B18.2.1 and ASTM A5E J429 Grade 1.

Nails and Spikes shall conform to ASTM F1667.

Wood Screws shall conform to ANSI/ASME B18.6.1.

WOOD FRAMING NOTES:

Install solid blocking between joists under jamb studs of openings.

Columns must have a continuous load path to foundation.

Unless noted otherwise, install two lengths of solid blocking x joist depth x 12 inches long in floor framing under column loads.

Built-up stud columns shall consist of 2x4, 2x6, or 2x8 studs with number of laminations noted on plan and each lamination shall be nailed together with (2) rows of 12d gum nails (0.131"x0 x 3 1/4") @ 6" full height of column. Do not splice laminations.

All beams and trusses shall be braced against rotation at points of bearing.

Unless noted otherwise, lower chord of gable and trusses shall be anchored to wall plate with framing anchors at 4'-0" spacing and laterally braced to roof framing at 8'-0" spacing.

Provide continuous wall studs each side of openings equal to one-half or greater the number of studs interrupted by opening unless noted otherwise.

All wall studs shall be continuous from floor to floor or from floor to roof.

Provide solid blocking or rim joists at all joist supports and joist ends.

Sole plate at all perimeter walls and at designated shear walls shall be nailed with (4) 0.131"x0x3" nails at 16" minimum.

All roof rafters, joists, trusses, beams shall be anchored to supports with metal framing anchors.

WOOD SHEATHING:

Plywood and Oriented Strand Board (OSB) floor, roof, and wall sheathing shall be APA rated with stamp including APA trademark and panel span rating.

Minimum Wall Sheathing: 7/16" OSB or CDX plywood, APA 24/16, blocked and nailed. Zip or Zip R sheathing is acceptable.

Nail wall sheathing with minimum 8d gum or sinker nail @ 4" at panel edges, and @ 8" at intermediate framing except as noted. **Block and nail ALL edges between studs.** Minimum (3) 8d nails per stud. Nail all plates using panel edge nail spacing indicated.

Sheathe all exterior walls. Sheathe interior walls as shown on the drawings.

Sheathing shall be continuous from bottom plate to top plate. cut in "L" and "T" shapes around openings. Lap sheathing over rim joists a minimum 4" at all floors to be upper and lower stud walls together.

Minimum height of sheathing panels shall be 16" to ensure that plates are tied to studs.

Machine Applied Nailing (i.e. Gun Nailing). The use of machine applied nailing is subject to satisfactory jobsite demonstration and the approval by the project structural engineer. The approval is subject to continued satisfactory performance. If nail heads penetrate the outer ply more than would be normal for a hand hammer or if minimum allowable edge distances are not maintained the performance will be deemed unsatisfactory.

TONGUE AND GROOVE DECKING:

Tongue and groove decking shall be Douglas Fir-Larch and have the following minimum allowable design values:

F_y = 1,750 psi F_x = 165 psi E = 1800 ksi

Tongue and groove decking shall comply with Section 2304.5 of the IBC installed in a <simple span>-two span continuous>-combination simple span two span continuous>-cantilevered pieces intermixed>-controlled random> layout pattern.

PLANT FABRICATED / PRE-ENGINEERED WOOD FRAMING:

I-series roof and floor joists shall be manufactured by Level Trus Joist with structural wood flanges and webs designed for structural capacities and design provisions according to ASTM D 5055. Substitution of equivalent series by other manufacturer is acceptable with engineer approval.

I-series roof and floor joists shall be installed per the manufacturer's recommendations. Do not cut or notch chords in any manner. Holes in webs shall not exceed manufacturer's published limit criteria.

Members noted as LVL (Laminated Veneer Lumber) on plan shall be 1 3/4" wide x depth indicated, plant-fabricated, and have the following minimum allowable design values:

F_y = 2600 psi F_x = 285 psi F_a = 2510 psi F_u = 750 psi E = 2000 ksi

Members noted as PSL (Parallel Strand Lumber) on plan shall be plant-fabricated and have the following minimum allowable design values:

Beams: F_y = 2300 psi F_x = 290 psi F_a = 2900 psi F_u = 750 psi E = 2000 ksi

Columns: F_y = 2400 psi F_x = 190 psi F_a = 2600 psi F_u = 425 psi E = 1800 ksi

Members noted as LSL (Laminated Strand Lumber) on plan shall be plant-fabricated and have the following minimum allowable design values:

≤1 1/2" F_y = 1700 psi F_x = 400 psi F_a = 1400 psi F_u = 680 psi E = 1300 ksi

1 3/4" F_y = 2325 psi F_x = 310 psi F_a = 2325 psi F_u = 800 psi E = 1550 ksi

Bridging and blocking shall be installed according to the fabricator's requirements.

STRUCTURAL GLUED LAMINATED TIMBER:

Materials, manufacture, and quality control shall be in conformance with ANSI/AITC A190.1 "Structural Glued Laminated Timber" and AITC 117 "Standard Specifications for Structural Glued Laminated Timber of Softwood Species, Design and Manufacturing Requirements."

Continuous and cantilevered members shall be Douglas Fir Combination Symbol 24F-V8 DF/DF with no camber.

Columns shall be Combination #2 or better.

All glued laminated timber shall have less than 16% moisture content, unless noted otherwise.

Members shall be "Architectural-Industrial" appearance grade.

Adhesives shall meet the requirements for wet conditions service.

Seal cut edges and ends exposed to weathering.

The fabricator shall furnish all items of condition steel and hardware for joining timber members to each other and to their supports; exclusive of anchorage embedded in masonry, setting plates, and items field-welded to structural steel.

SHOP DRAWINGS:

The structural drawings are copyrighted and shall not be



NOTICE: DUTY OF COOPERATION
Release of these plans contemplates further cooperation among the owner, the contractor and the architect. Design and construction are complex. Although the architect and its consultants have performed their services with due care and diligence, they cannot guarantee perfection. Communication is imperfect and every contingency cannot be anticipated. Any ambiguity or discrepancy discovered by the use of these plans shall be reported immediately to the architect. Failure to notify the architect compounds misunderstanding and increases construction costs. A failure to cooperate by a simple notice to the architect shall relieve the architect from responsibility for the consequences. Changes made from the plans without consent of the architect are unauthorized and shall relieve the architect of responsibility for all consequences arising out of such changes.

All design, documents and data prepared by Eric Smith Associates, P.C. as instruments of service shall remain property of Eric Smith Associates, P.C. and shall not be copied, changed or disclosed in any form whatsoever without first obtaining the express written consent of Eric Smith Associates, P.C.


Eric Smith Associates, P.C.

No. Description Date

ABBREVIATIONS KEY							
AB	Anchor Rod (Bolt)	EJ	Expansion Joint	MEZZ	Mezzanine	SF	Square Feet
ADDL	Additional	EL	Elevation	MFR	Manufacture, -er, -rd	SHT	Sheet
AFF	Above Finished Floor	ENGR	Engineer	MIN	Minimum	SHTG	Sheathing
ALT	Alternative	EQ	Equal	MTL	Metal	SIM	Similar
AMT	Amount	EQUIP	Equipment	NIC	Not In Contact	SLH	Short Leg Horizontal
APPROX	Approximate	EQUIV	Equivalent	N-S	North to South	SLV	Short Leg Vertical
ARCH	Architect, Architectural	ES	Each Side	NTS	Not to Scale	SOG	Slab On Grade
AVG	Average	EST	Estimate	OD	Outside Diameter	SP	Space, -s
BC	Bottom of Concrete	E-W	East to West	OF	Outside Face	SPEC	Specifications
BL	Brick Ledge	EXC	Excavate	OH	Opposite Hand	SQ	Square
BLK	Block	EXP	Expansion	OPNG	Opening	STD	Standard
BLKG	Blocking	EXT	Exterior	OPP	Opposite	STL	Steel
BM	Beam	FDN	Foundation	OSB	Oriented Strand Board	STIFF	Stiffener
BOT	Bottom	FF	Finished Floor	PAF	Powder Actuated Fastener	STRUCT	Structure (Structural)
BRG	Bearing	FIG	Figure	PC	Precast	SY	Square Yard
BW	Bottom of Wall	FL	Flush	PE	Pre-engineered (trusses)	SYM	Symmetrical
CF	Cubic Foot	FLR	Floor	PEN	Penetration	T&B	Top and Bottom
CIP	Cast In Place	FP	Full Penetration	PERP	Perpendicular	T&G	Tongue and Groove
CJ	Construction Joint (Control Joint)	FTG	Footing	PKT	Pocket	TB	Top of Beam
CLG	Ceiling	GA	Gage (Gauge)	PL	Property Line	TC	Top of Concrete
CLR	Clear	GALV	Galvanized	PLF	Pounds per Linear Foot	TJ	Top of Joist
CMU	Concrete Masonry Unit	GC	General Contractor	PSF	Pounds per Square Foot	TL	Total Load, Top of Ledge
COL	Column	GEN	General	PSI	Pounds per Square Inch	TRANS	Transverse
COM	Common	GL	Glue Laminated (Glu-lam)	PSL	Parallel Strand Lumber (generic)	TW	Top of Wall
CONC	Concrete	GR	Grade	PT (1)	Pressure Treated	TYP	Typical
CONN	Connection	GT	Girder Truss	PT (2)	Post Tensioned	ULT	Ultimate
CONT	Continue (Continuous)	GYP BD	Gypsum Board	PV	Photovoltaic	UNO	Unless Noted Otherwise
COORD	Coordinate, Coordination	HAS	Headed Anchor Stud	QTY	Quantity	VERT	Vertical
CS	Countersink	HORIZ	Horizontal	R	Radius	VIF	Verify In Field
CTR	Center	HT	Height or Heavy Timber	RE	Reference (refer to)	WA	Wedge Anchor
CY	Cubic Yard	ID	Inside Diameter	RECT	Rectangle	WP	Work Point
DAB	Deformed Anchor Bar	INT	Interior	REINF	Reinforcement	WT	Weight
DIAG	Diagonal	K	Kip (1,000 lbs)	REQ	Required	WWF	Welded Wire Fabric
DIM	Dimension	LL	Live Load	REQMT	Requirement	XS	Extra Strong
DL	Dead Load	LLH	Long Leg Horizontal	RET	Retaining Wall	XSECT	Cross Section
DN	Down	LLV	Long Leg Vertical	RM	Room	XXS	Double Extra Strong
DP	Drilled Pier	LT	Light	RMO	Rough Masonry Opening		
DWG	Drawing	LVL	Laminated Veneer Lumber (generic)	RO	Rough Opening		
EA	Each	LW	Light Weight	SC	Slip Critical		
ECC	Eccentric	MATL	Material	SCH	Schedule		
E-E	End to End	MAX	Maximum	SDST	Self Drilling Self Tapping		
EF	Each Face	MECH	Mechanical	SECT	Section		

LEGEND			
	*X" King studs, *Y" Trimmer studs, studs to match wall thickness		CMU
	Indicates column continuous through level shown		Concrete
	Indicates column above level shown, see next level framing plan for size; install squash blocking in floor cavity of equal size and equal column size below to foundation - unless noted otherwise		Earth fill
	Indicates column type below level shown		Porous fill (i.e. gravel)
	Indicates dropped header or beam		Interior wood bearing wall
	Beam, Joist, or Truss bears on wall or beam below		Wood shear wall
	Beam, Joist, or Truss connected to support with metal hanger	<E>	Indicates 'existing'
	Beam, Joist, or Truss connected to support with concealed hanger	<N>	Indicates 'new'
	Indicates span direction	<R>	Indicates 'to be removed'
	Indicates step in floor elevation		Indicates location of bend in bent beam
	Indicates top of concrete slab or wood subfloor elevation		Indicates shear wall. See schedule for sheathing type and nailing
	Indicates top of footing or pier elevation		Indicates holdown. See schedule for description
	Indicates minimum pier penetration into bedrock		Indicates rigid frame
	Continuous spread footing. See schedule for size and reinforcing		Fully welded moment connection
	Isolated pad footing. See schedule for size and reinforcing		Indicates braced frame
	Indicates top of concrete elevation		Indicates top of steel beam elevation
	Indicates bottom of concrete elevation		Indicates floor drain
	Indicates step in top of concrete elevation		Indicates shoring
	Indicates step in bottom of concrete elevation		Indicates direction of slope
	Indicates top of concrete ledge elevation		
	Indicates beam pocket in concrete wall (X=width, Y=height, Z=depth in inches) with bottom of pocket elevation		
	Indicates step in top of concrete ledge elevation		

BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, CO

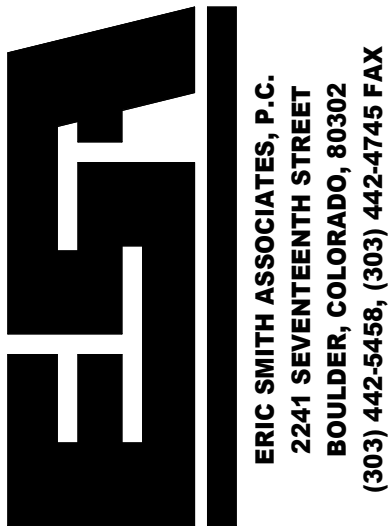

ERIC SMITH ASSOCIATES, P.C.
2241 SEVENTEENTH STREET
BOULDER, COLORADO, 80502
(303) 442-5456, (303) 442-4745 FAX

Job Number:	17022
Date:	03/29/2019
Drawn By:	DRS
Checked By:	EJS

Project Phase
Permit Review Set
Sheet Title
Abbreviations
Sheet Number
S002


NOTICE: DUTY OF COOPERATION

Release of these plans contemplates further cooperation among the owner, his contractor and the architect. Design and construction are complex. Although the architect and his consultants have performed their services with due care and diligence, they cannot guarantee that the design and construction will be free of all errors. It is impractical to anticipate and prevent every contingency cannot be anticipated or prevented or discrepancy discovered by the use of these plans shall be reported immediately to the architect. Failure to notify the architect compounds misunderstanding and increases construction costs. A failure to cooperate by a simple notice to the architect relieves the architect from responsibility for the consequences. Changes made from the plans without consent of the architect are unauthorized and shall relieve the architect of responsibility for all consequences arising out of such changes.

All design, documents and data prepared by Eric Smith Associates, P.C. as instruments of service shall remain property of Eric Smith Associates, P.C. and shall not be copied, changed or disclosed in any form whatsoever without first obtaining the express written consent of Eric Smith Associates, P.C.

No.	Description	Date
-----	-------------	------

BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, CO

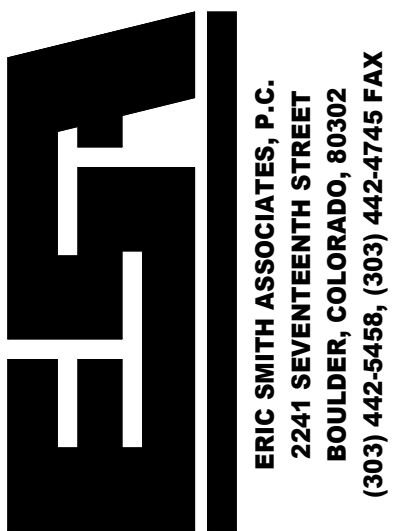

Job Number:	17022
Date:	03/29/2019
Drawn By:	DRS
Checked By:	EJS

Project Phase
Permit Review Set
Sheet Title
Porte Cochere
Sheet Number

S101



TYPICAL ROOF DECK:
1 1/2" DEEP x 20 GAGE WIDE RIB STEEL DECK (VULCRAFT TYPE 1.5B) WITH 5/8" PUDDLE WELDS (36/7) AT INTERMEDIATE SUPPORTS & EDGES AND (2) #10 SDST SCREWS AT SIDELAP CONNECTIONS. STEEL DECK SHALL BE CONTINUOUS OVER TWO OR MORE SUPPORTS. SEE ARCH FOR FIRE RATE ASSEMBLY AND CEILING CONSTRUCTION.



NOTICE: DUTY OF COOPERATION
Release of these plans contemplates further cooperation among the owner, the contractor and the architect. Design and construction are complex. Although the architect and its consultants have performed their services with due care and diligence, they cannot guarantee perfection. Communication is imperfect and every contingency cannot be anticipated. Any ambiguity or discrepancy discovered by the use of these plans shall be reported immediately to the architect. Failure to notify the architect constitutes misunderstanding and increases construction costs. A failure to cooperate by a single notice to the architect shall relieve the architect from responsibility for the consequences. Changes made from the plans without consent of the architect are unauthorized and shall relieve the architect of responsibility for all consequences arising out of such changes.

All design, documents and data prepared by Eric Smith Associates, P.C. as instruments of service shall remain property of Eric Smith Associates, P.C. and shall not be copied, changed or disclosed in any form whatsoever without first obtaining the express written consent of Eric Smith Associates, P.C.


No.	Description	Date
-----	-------------	------

BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, CO


ESA
ERIC SMITH ASSOCIATES, P.C.
2241 SEVENTEENTH STREET
BOULDER, COLORADO, 80502
(303) 442-5486, (303) 442-4745 FAX

Job Number:	17022
Date:	03/29/2019
Drawn By:	DRS
Checked By:	EJS

Project Phase
Permit Review Set
Sheet Title
Ski Entry
Sheet Number
S102

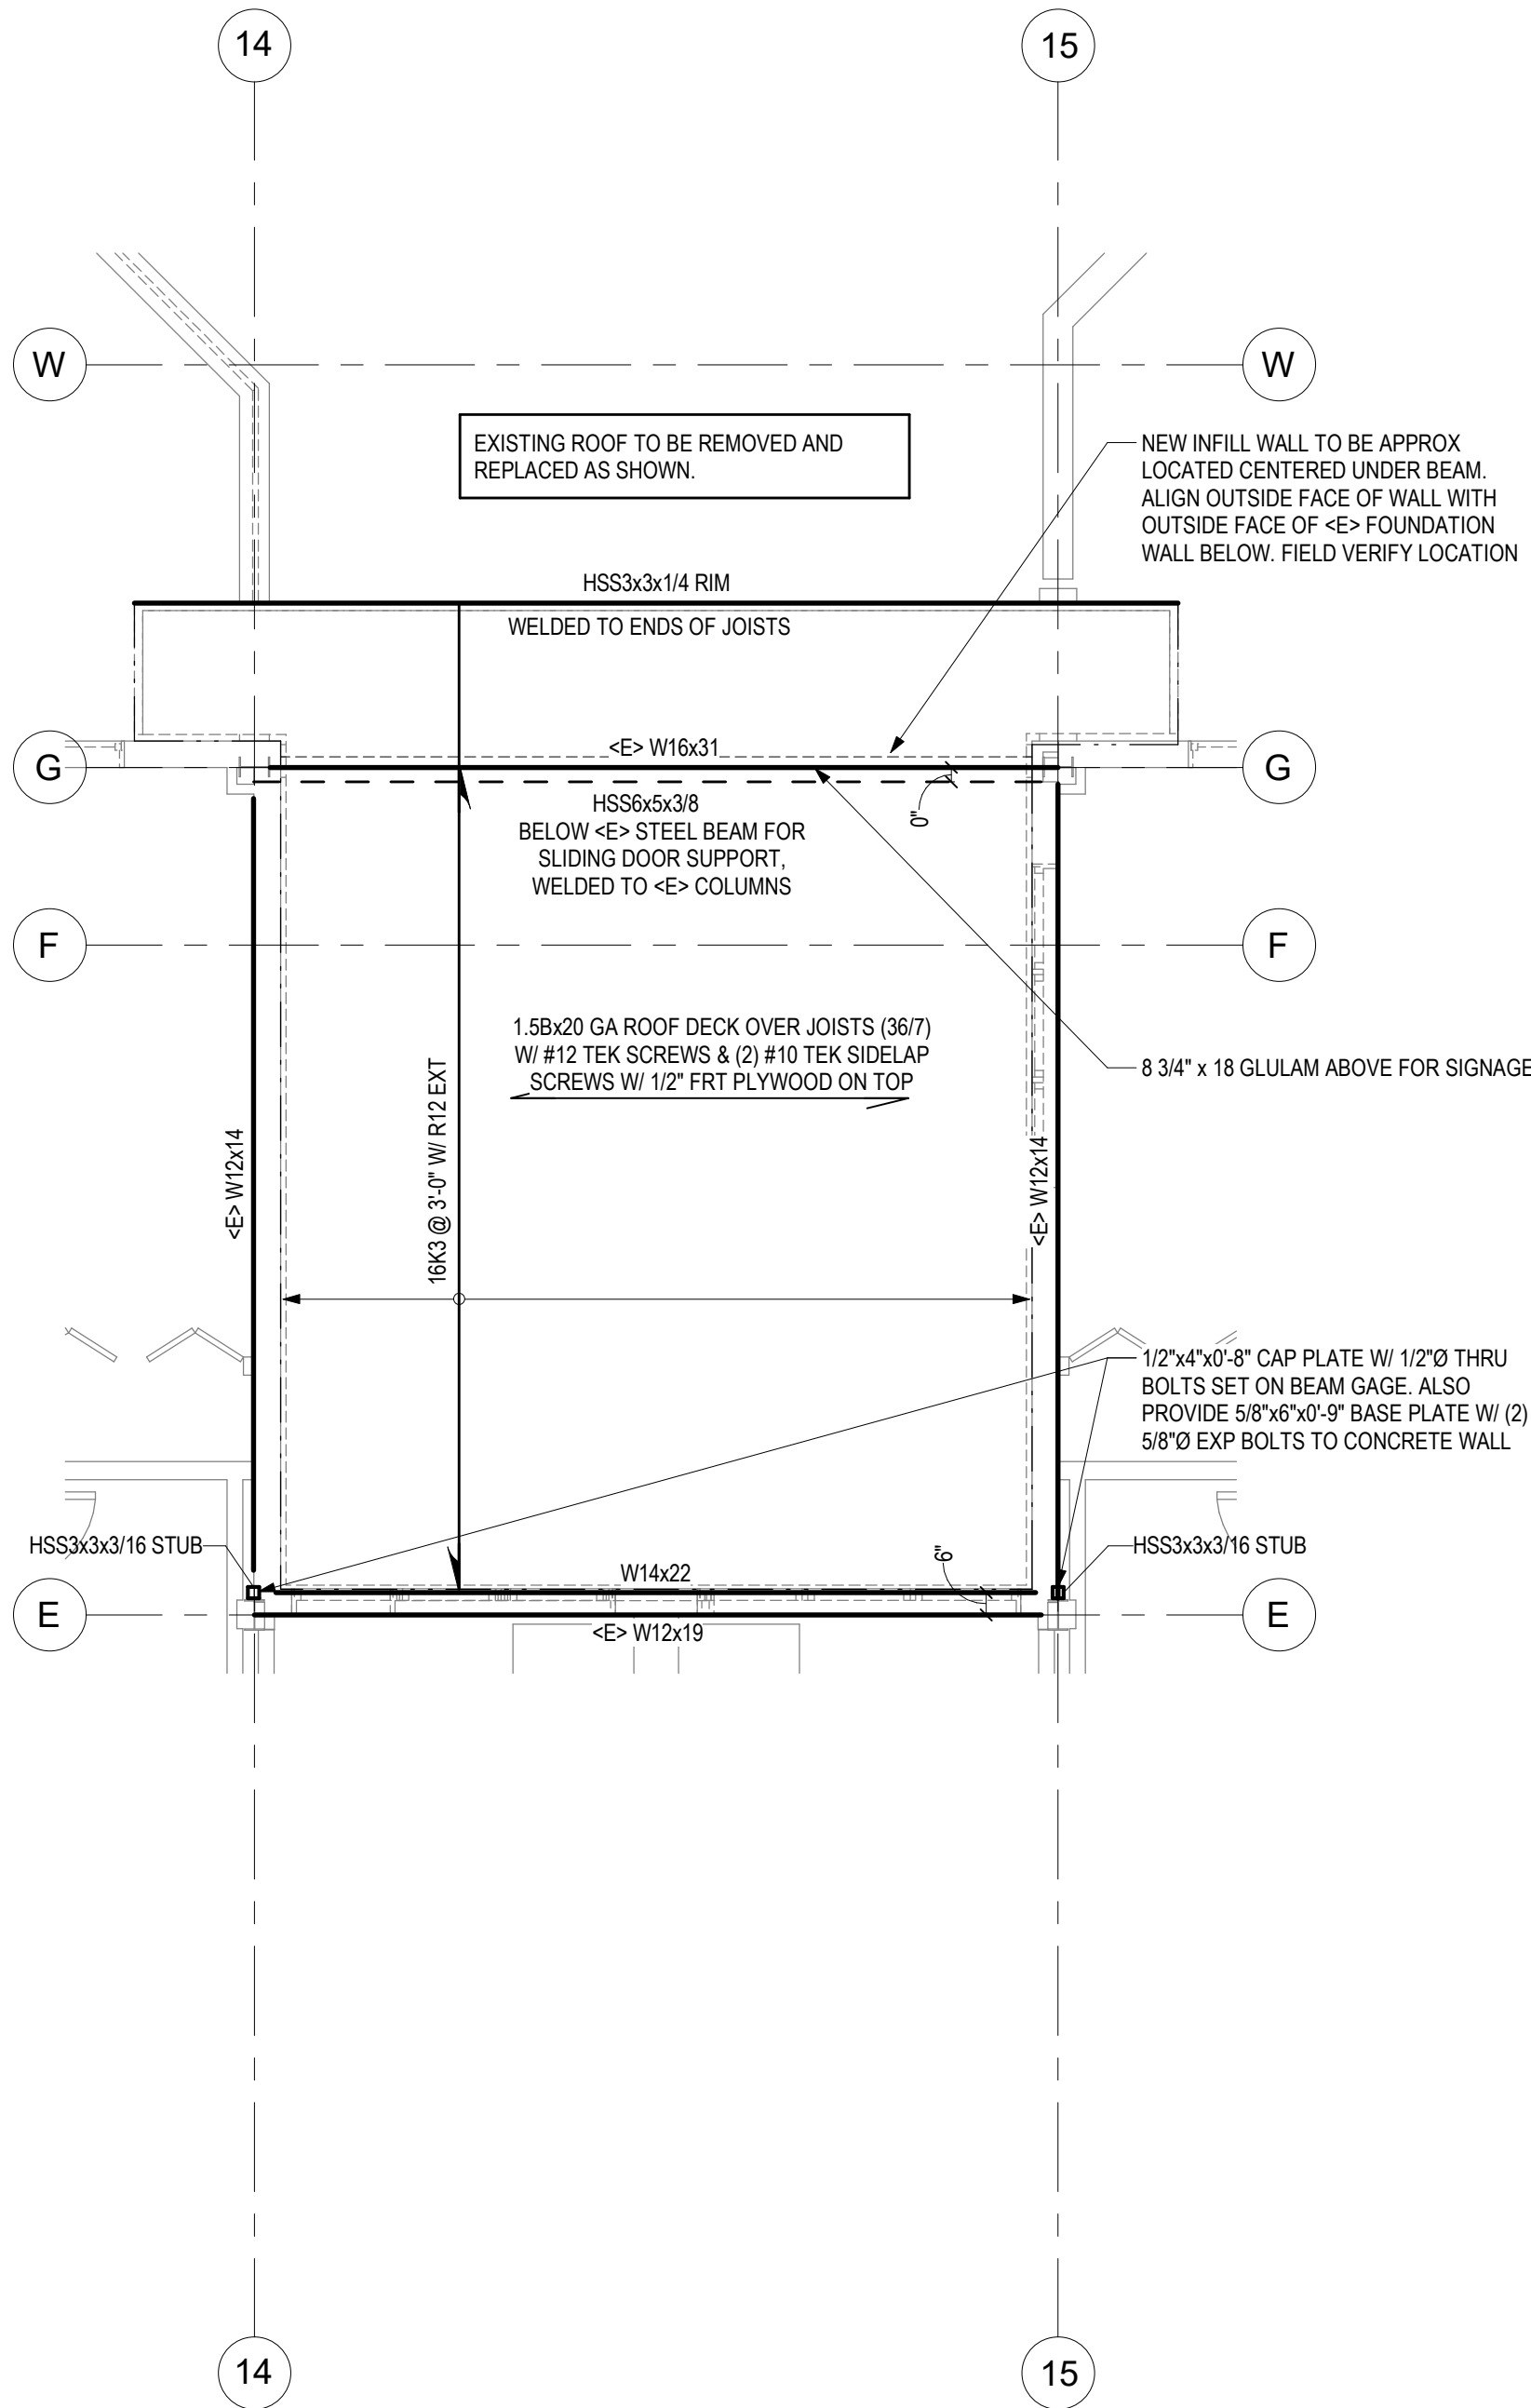

SKI ENTRY ROOF PLAN
1/4" = 1'-0"
PLAN NORTH

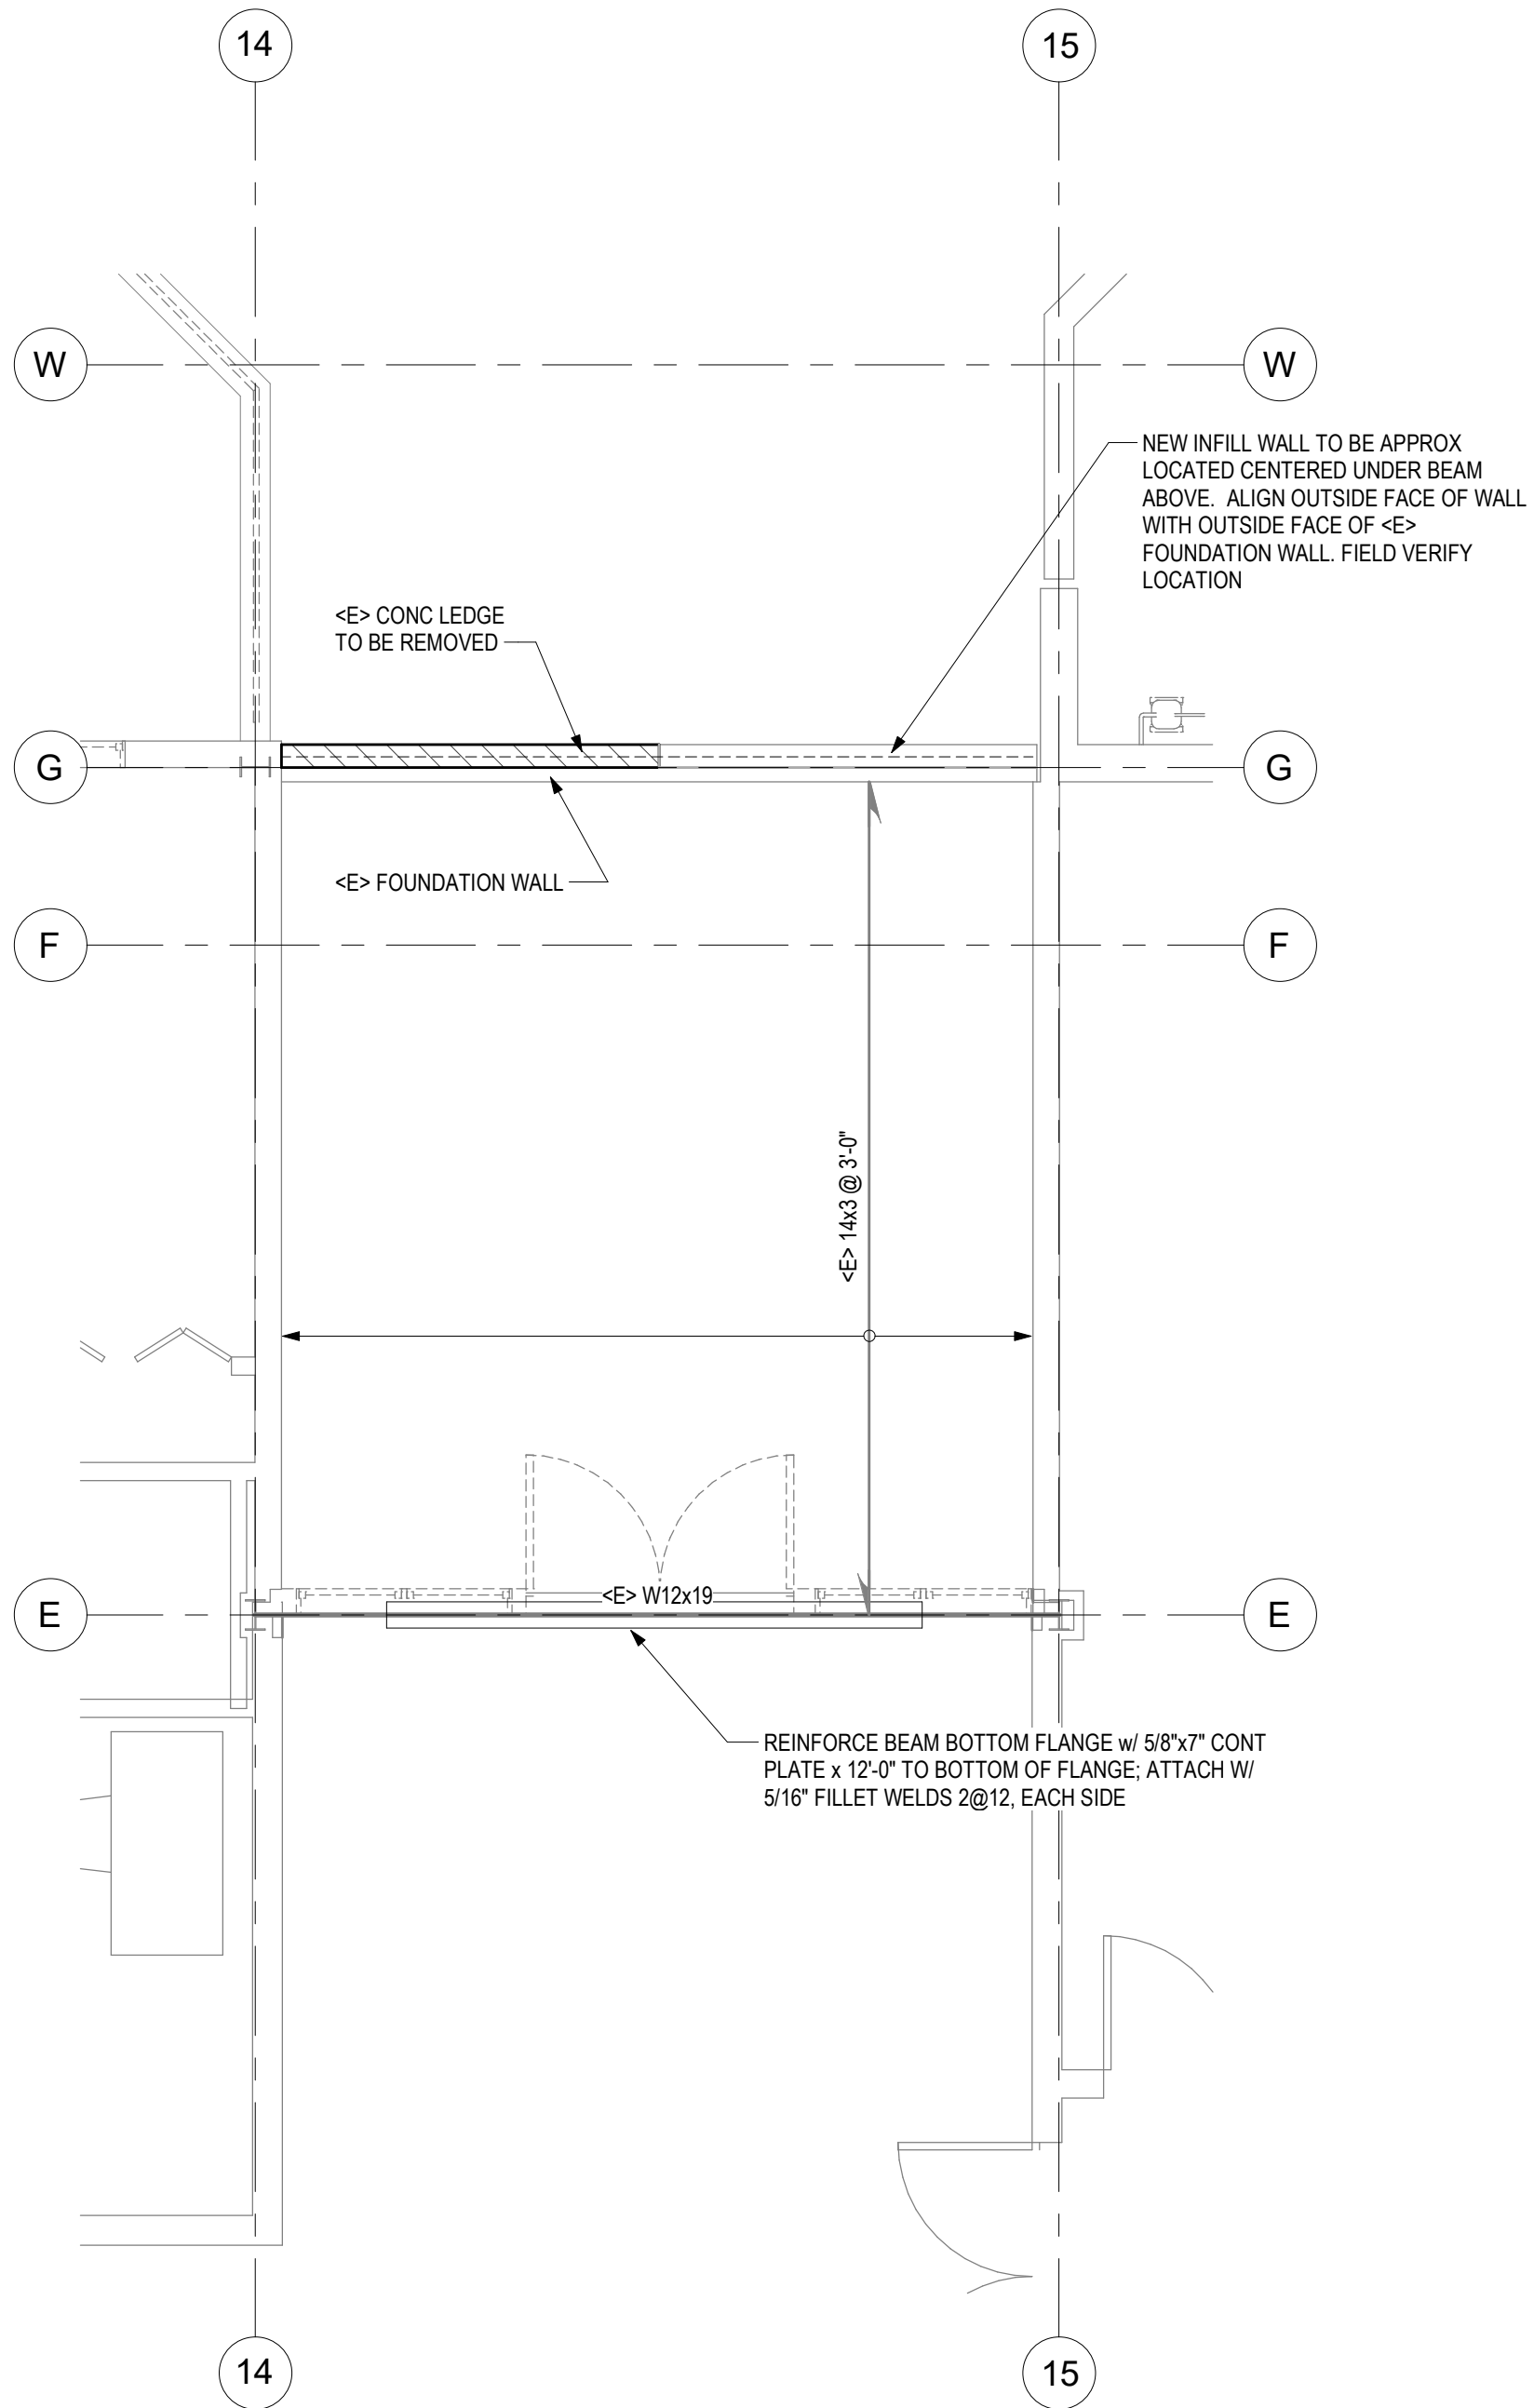

SKI SECOND FLOOR PLAN
1/4" = 1'-0"
PLAN NORTH




NOTICE: DUTY OF COOPERATION
Release of these plans contemplates further cooperation among the owner, its contractor and the architect. Design and construction are complex. Although the architect and its consultants have performed their services with due care and diligence, they cannot guarantee perfection. Communication is imperfect and every contingency cannot be anticipated. Any ambiguity or discrepancy discovered by the use of these plans shall be reported immediately to the architect. Failure to notify the architect compounds misunderstanding and increases construction costs. A failure to cooperate by a single notice to the architect shall relieve the architect from responsibility for the consequences. Changes made from the plans without consent of the architect are unauthorized and shall relieve the architect of responsibility for all consequences arising out of such changes.


All design, documents and data prepared by Eric Smith Associates, P.C. as instruments of service shall remain property of Eric Smith Associates, P.C. and shall not be copied, changed or disclosed in any form whatsoever without first obtaining the express written consent of Eric Smith Associates, P.C.

Eric Smith Associates, P.C.


No.	Description	Date
-----	-------------	------

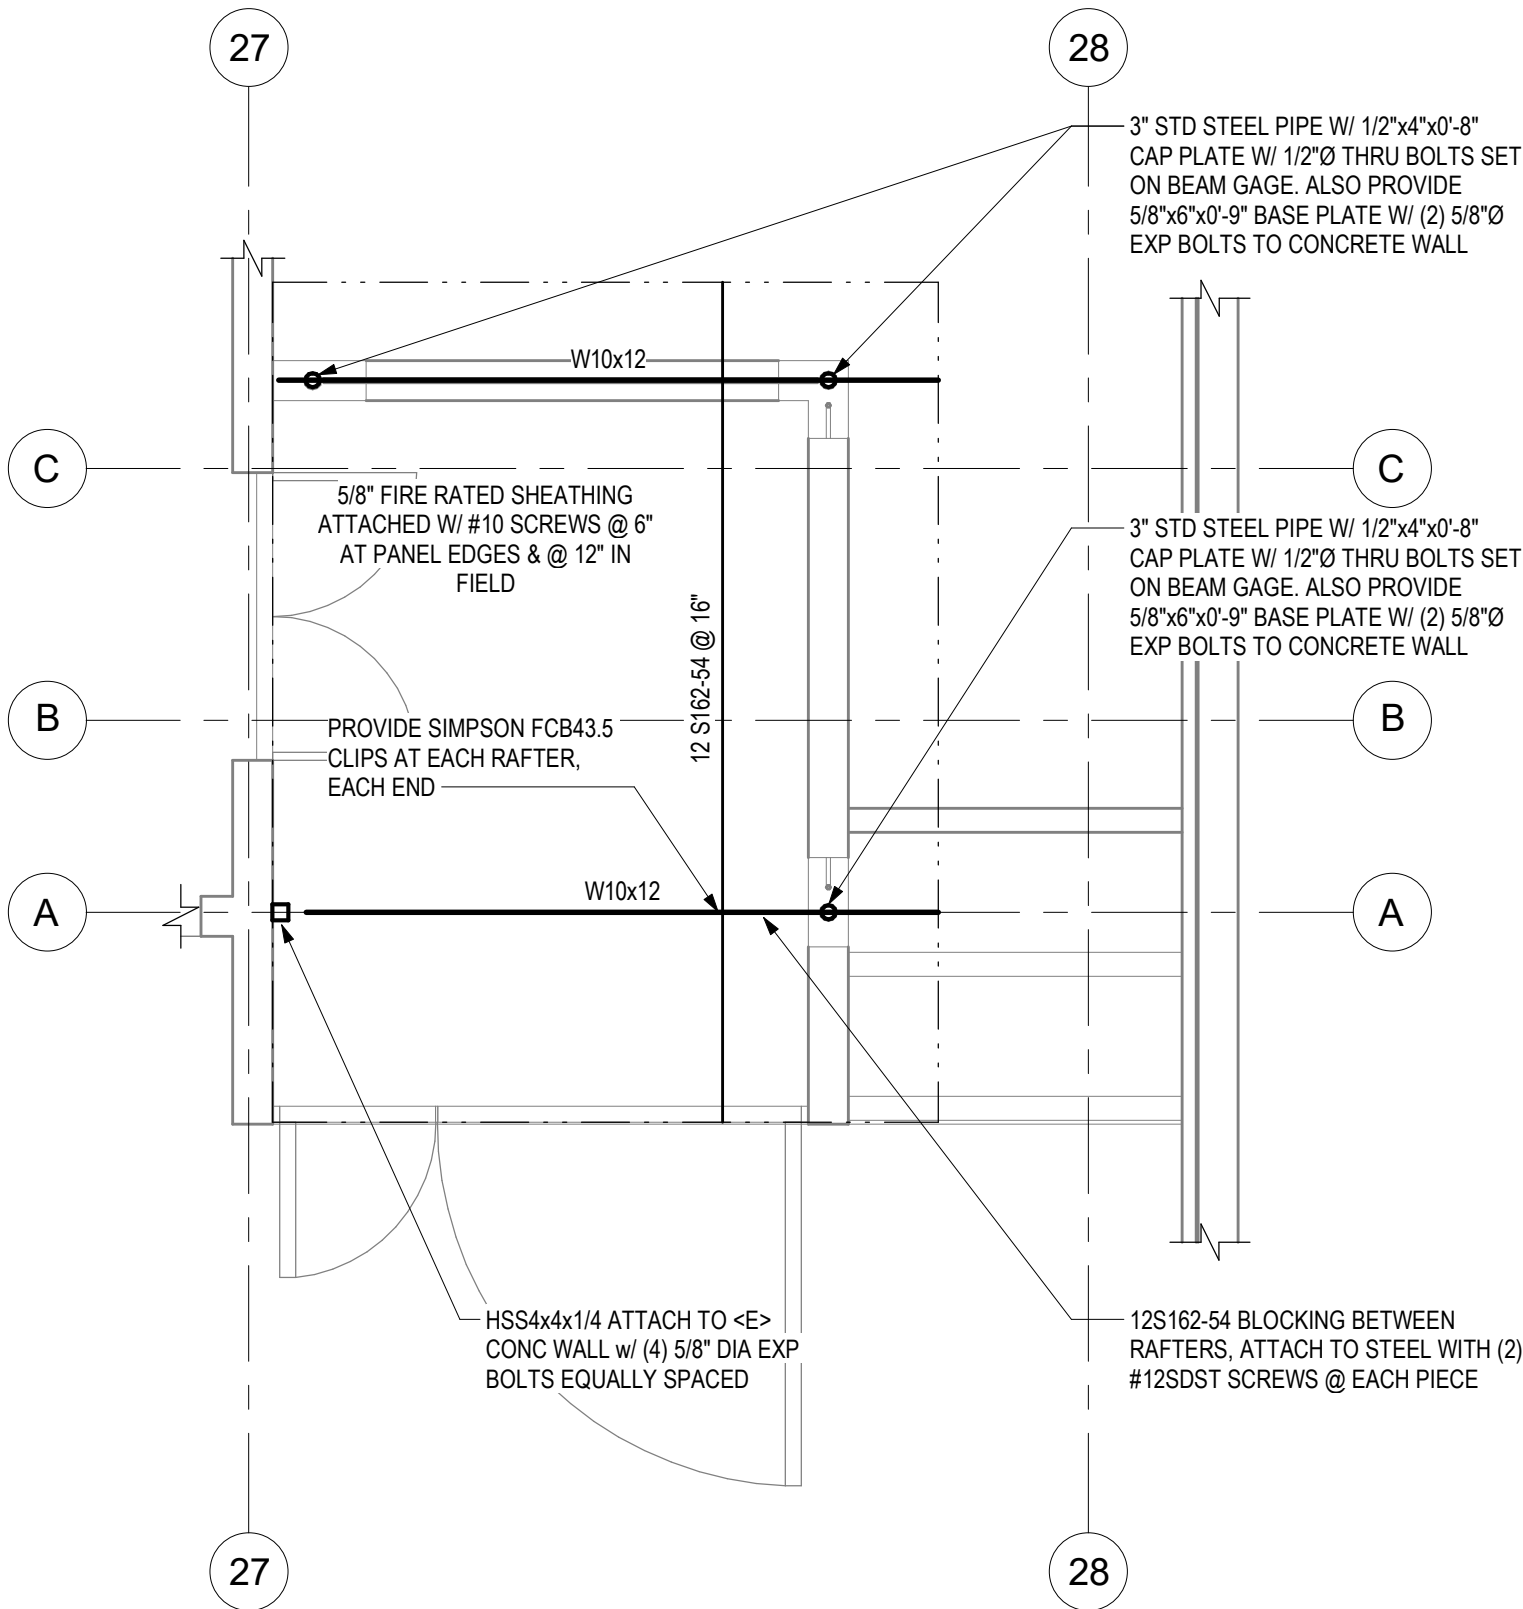

TRASH ENCLOSURE PLAN
1/4" = 1'-0"



BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, CO

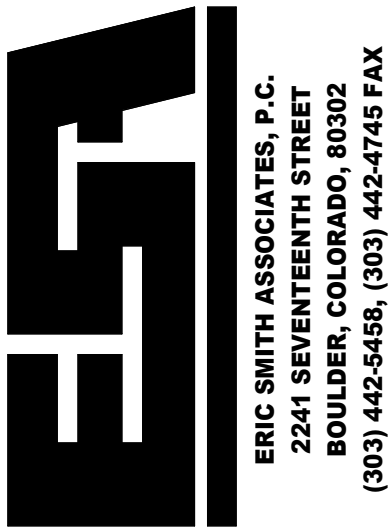

ERIC SMITH ASSOCIATES, P.C.
2241 SEVENTEENTH STREET
BOULDER, COLORADO, 80502
(303) 442-5486, (303) 442-4745 FAX

Job Number:	17022
Date:	03/29/2019
Drawn By:	DRS
Checked By:	EJS


Project Phase
Permit Review Set
Sheet Title
Trash Enclosure
Sheet Number
S103




NOTICE: DUTY OF COOPERATION
Release of these plans contemplates further cooperation among the owner, its contractor and the architect. Design and construction are complex. Although the architect and its consultants have performed their services with due care and diligence, they cannot guarantee perfection. Communication is imperfect and every contingency cannot be anticipated. Any ambiguity or discrepancy discovered by the use of these plans shall be reported immediately to the architect. Failure to notify the architect constitutes misunderstanding and increases construction costs. A failure to cooperate by a single notice to the architect shall relieve the architect from responsibility for the consequences. Changes made from the plans without consent of the architect are unauthorized and shall relieve the architect of responsibility for all consequences arising out of such changes.

All design, documents and data prepared by Eric Smith Associates, P.C. as instruments of service shall remain property of Eric Smith Associates, P.C. and shall not be copied, changed or disclosed in any form whatsoever without first obtaining the express written consent of Eric Smith Associates, P.C.

No.	Description	Date

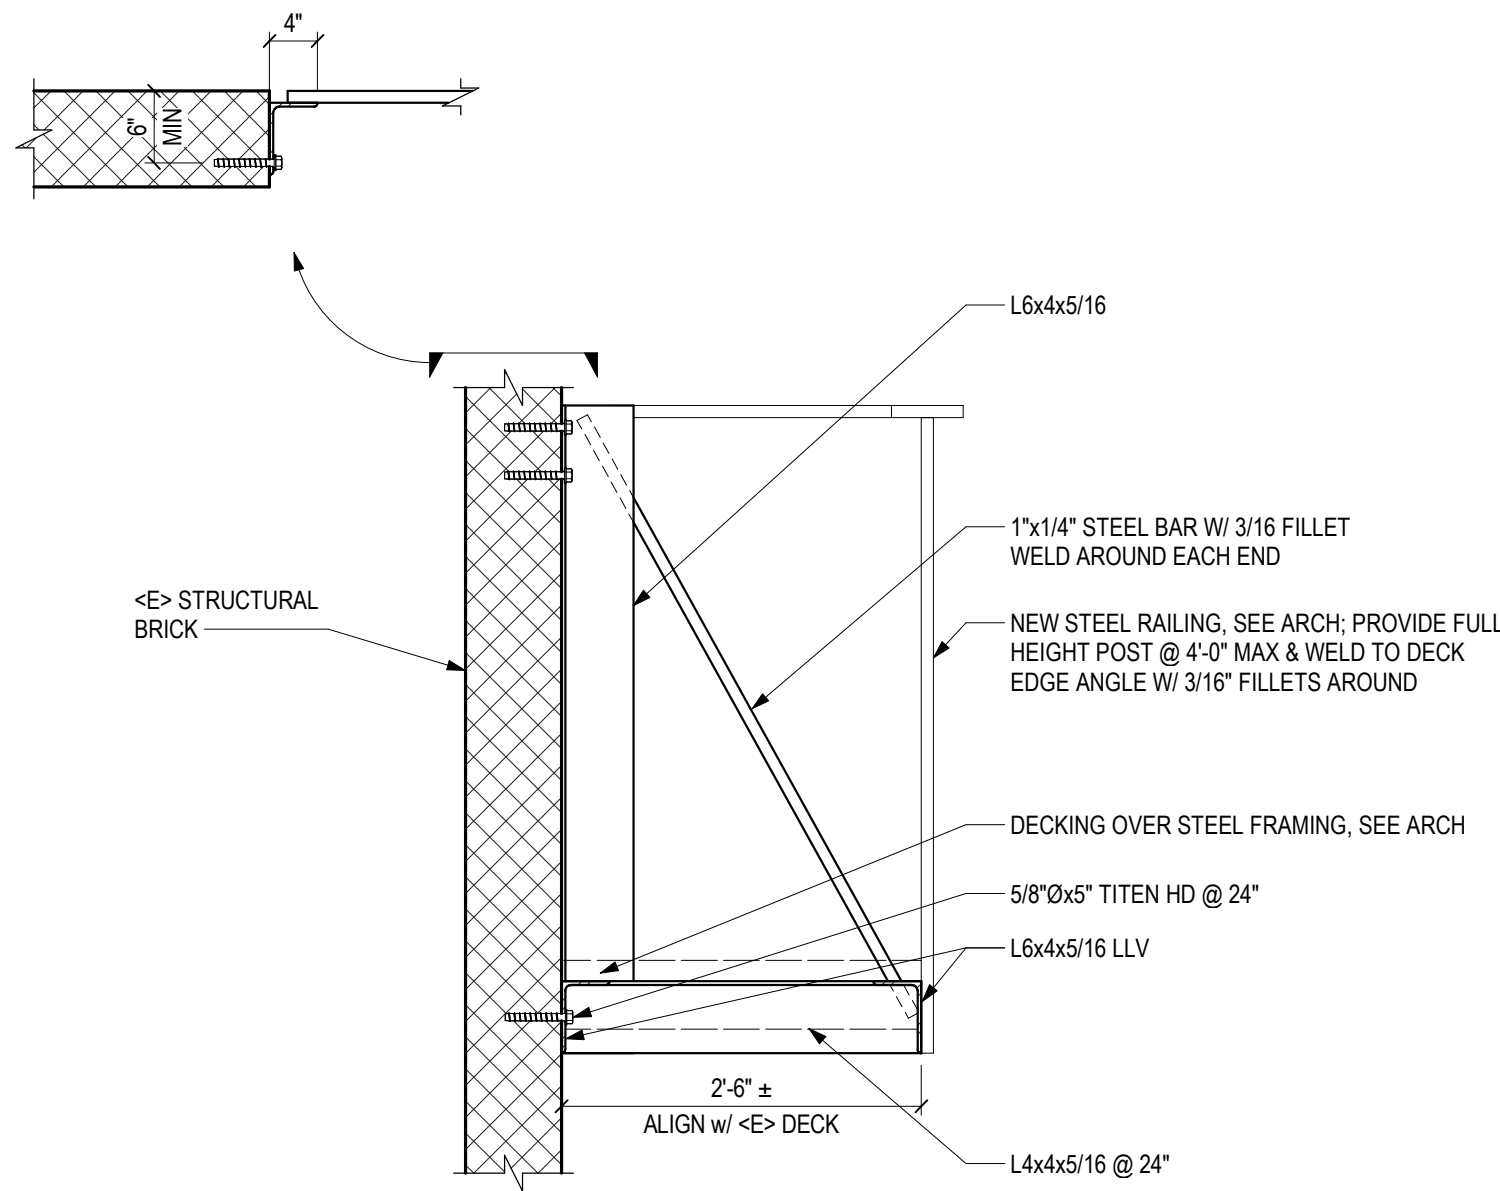

1 DETAIL
3/4" = 1'-0"
0 6" 1' 2' 3'

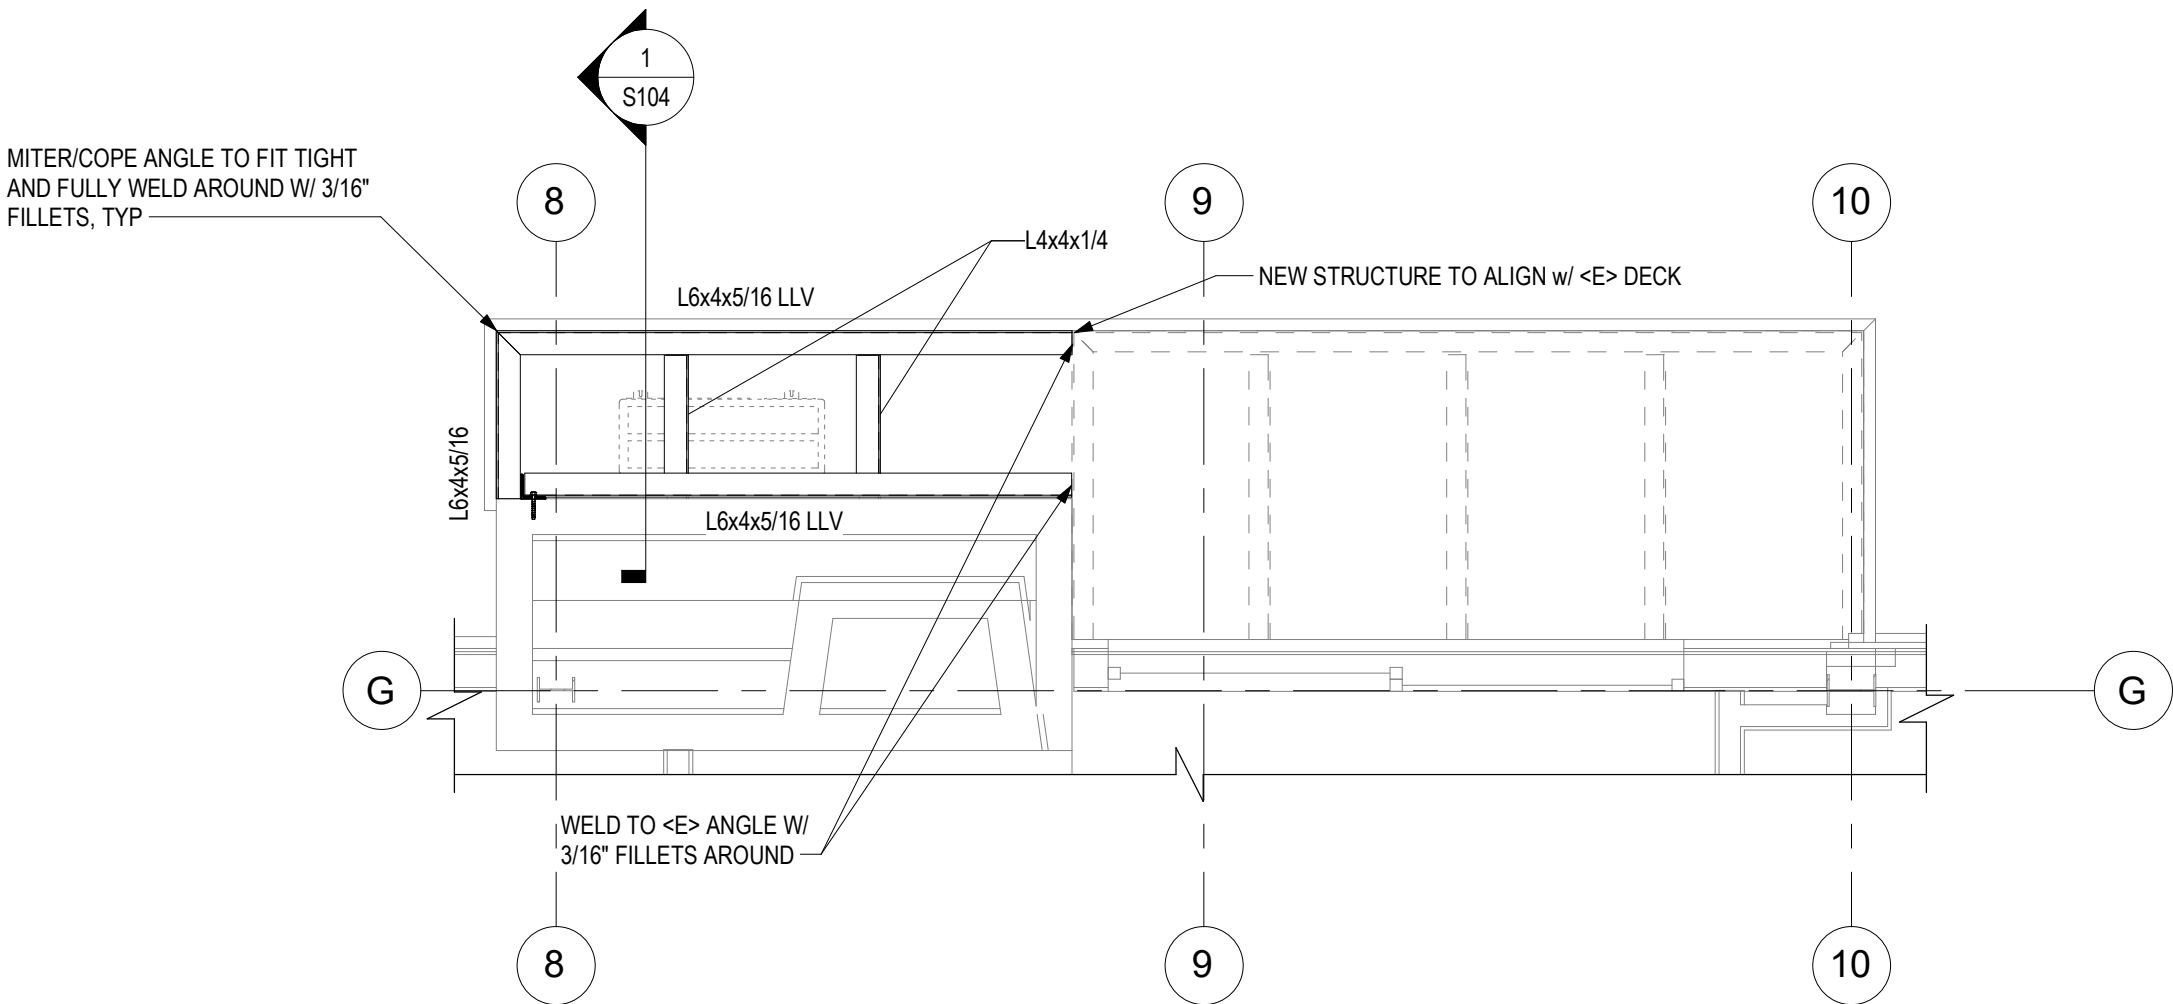

EXTERIOR DECK FRAMING PLAN
3/8" = 1'-0"
PLAN NORTH
0 1' 2' 4' 6'

**BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, CO**



ERIC SMITH ASSOCIATES, P.C.
2241 SEVENTEENTH STREET
BOULDER, COLORADO, 80502
(303) 442-5486, (303) 442-1745 FAX

Job Number:	17022
Date:	03/29/2019
Drawn By:	DRS
Checked By:	EJS






Project Phase
Permit Review Set
Sheet Title
Exterior Decks
Sheet Number
S104



NOTICE: DUTY OF COOPERATION
Release of these plans contemplates further cooperation among the owner, the contractor and the architect. Design and construction are complex. Although the architect and its consultants have performed their services with due care and diligence, they cannot guarantee perfection. Communication is imperfect and every contingency cannot be anticipated. Any ambiguity or discrepancy discovered by the use of these plans shall be reported immediately to the architect. Failure to notify the architect constitutes misunderstanding and increases construction costs. A failure to cooperate by a single notice to the architect shall relieve the architect from responsibility for the consequences. Changes made from the plans without consent of the architect are unauthorized and shall relieve the architect of responsibility for all consequences arising out of such changes.

All design, documents and data prepared by Eric Smith Associates, P.C. as instruments of service shall remain property of Eric Smith Associates, P.C. and shall not be copied, changed or disclosed in any form whatsoever without first obtaining the express written consent of Eric Smith Associates, P.C.
Eric Smith Associates, P.C.

No.	Description	Date
-----	-------------	------

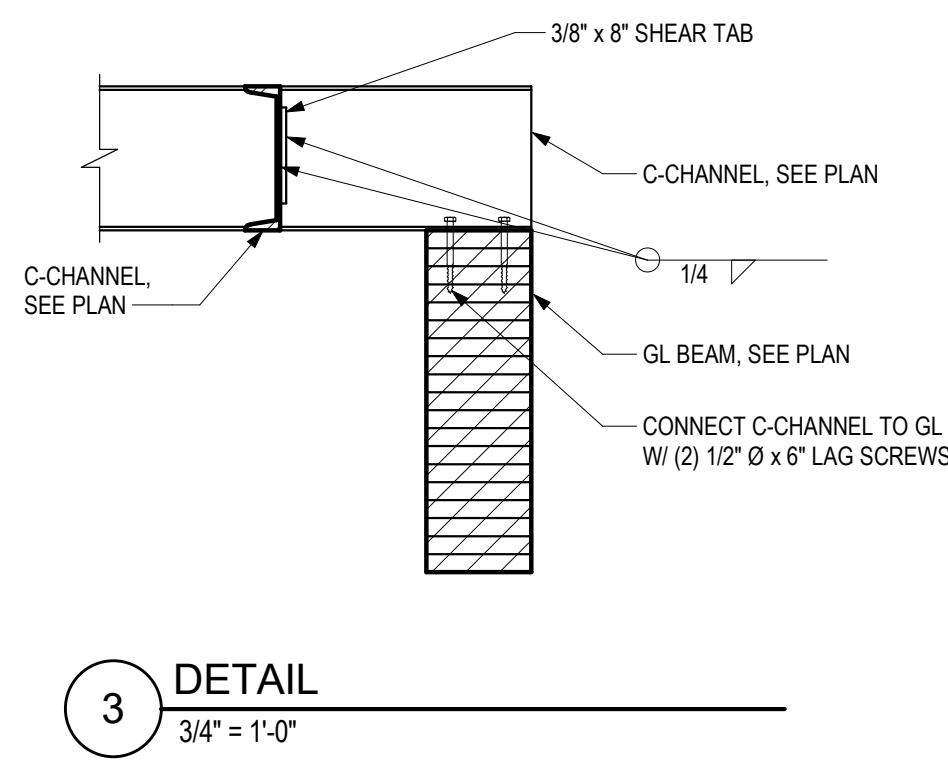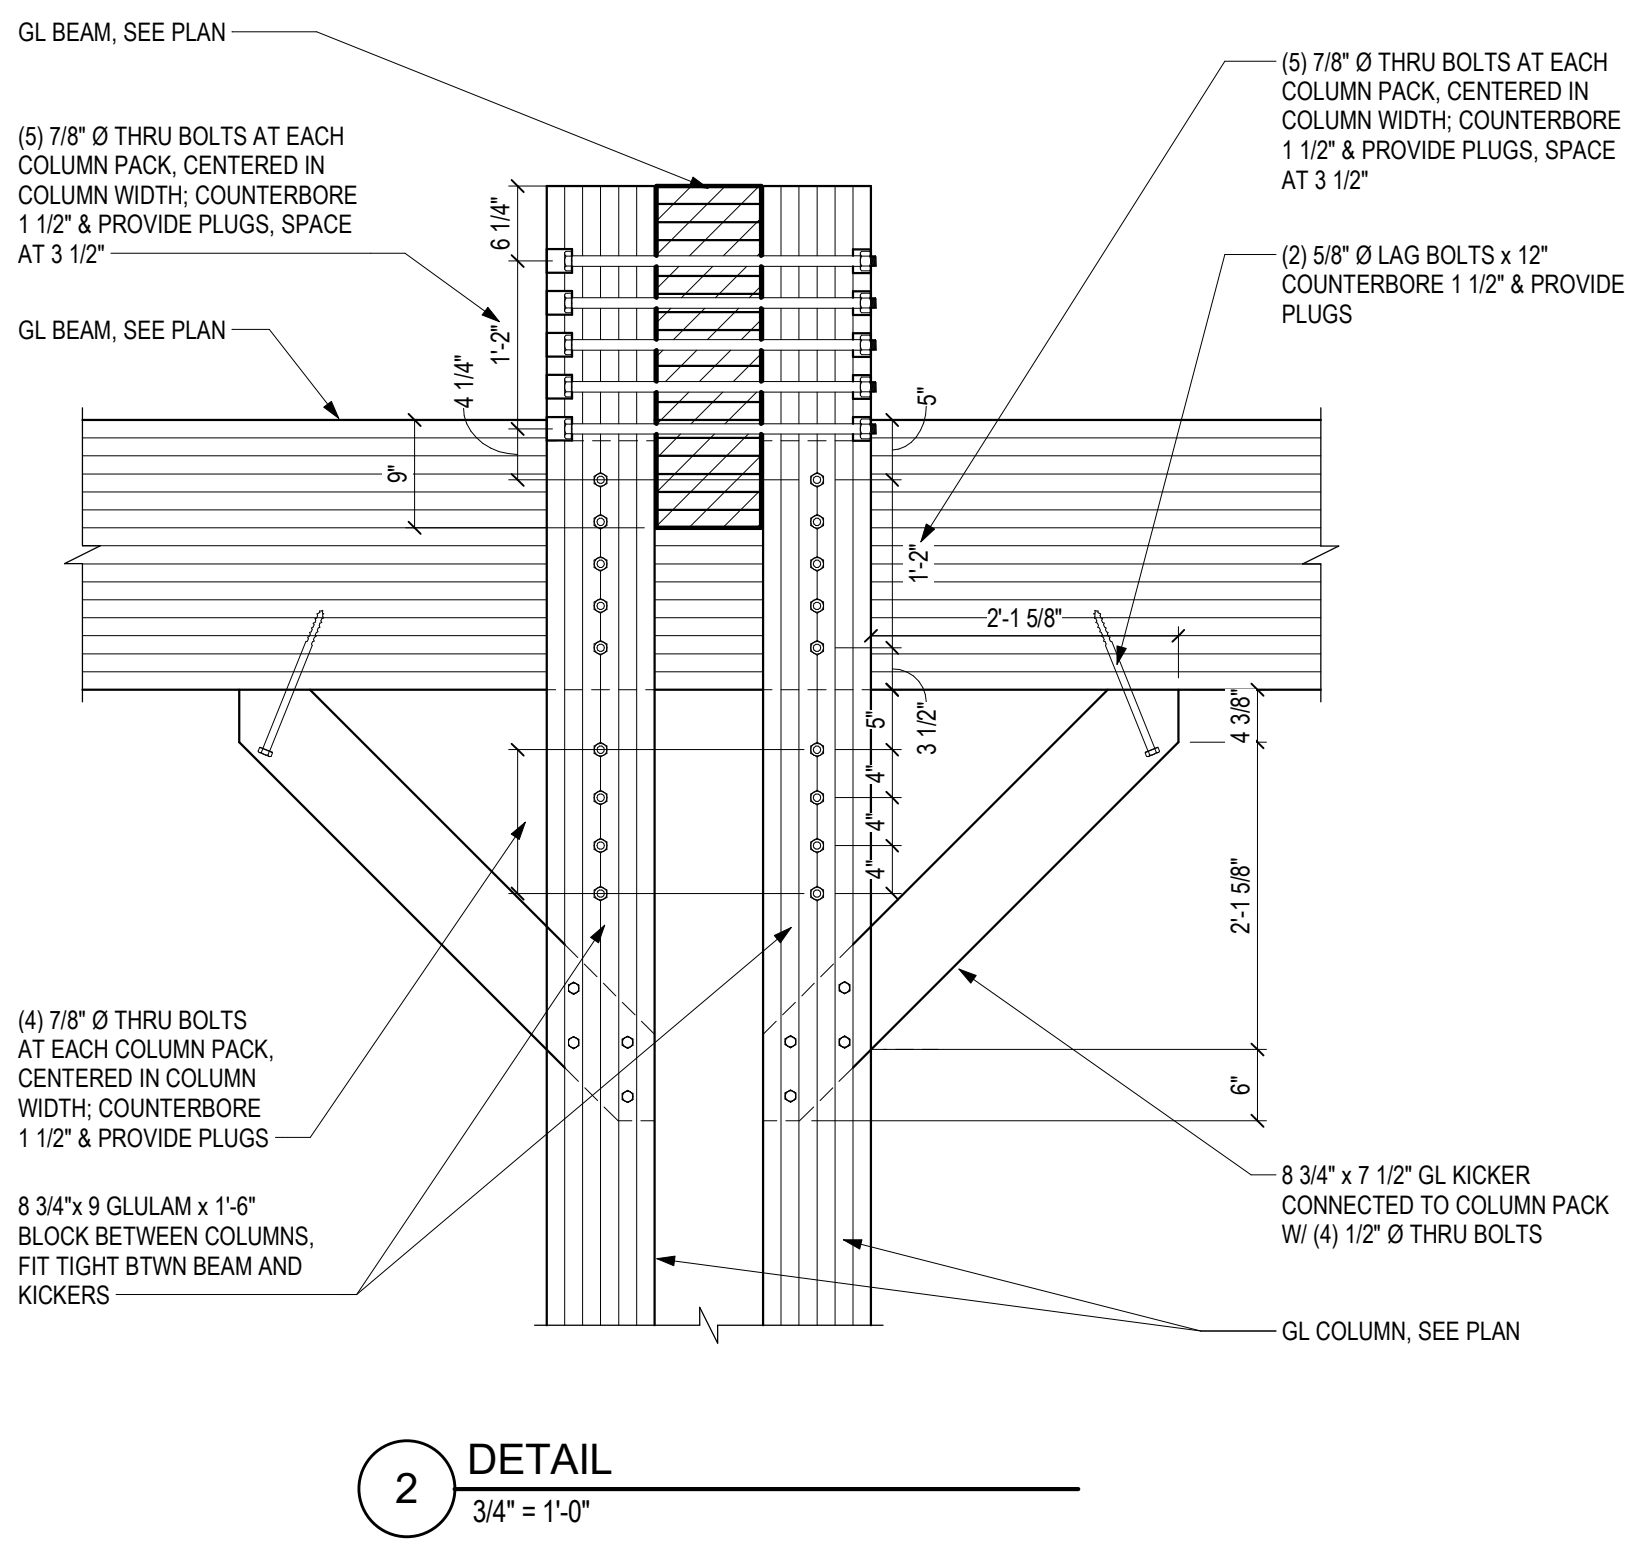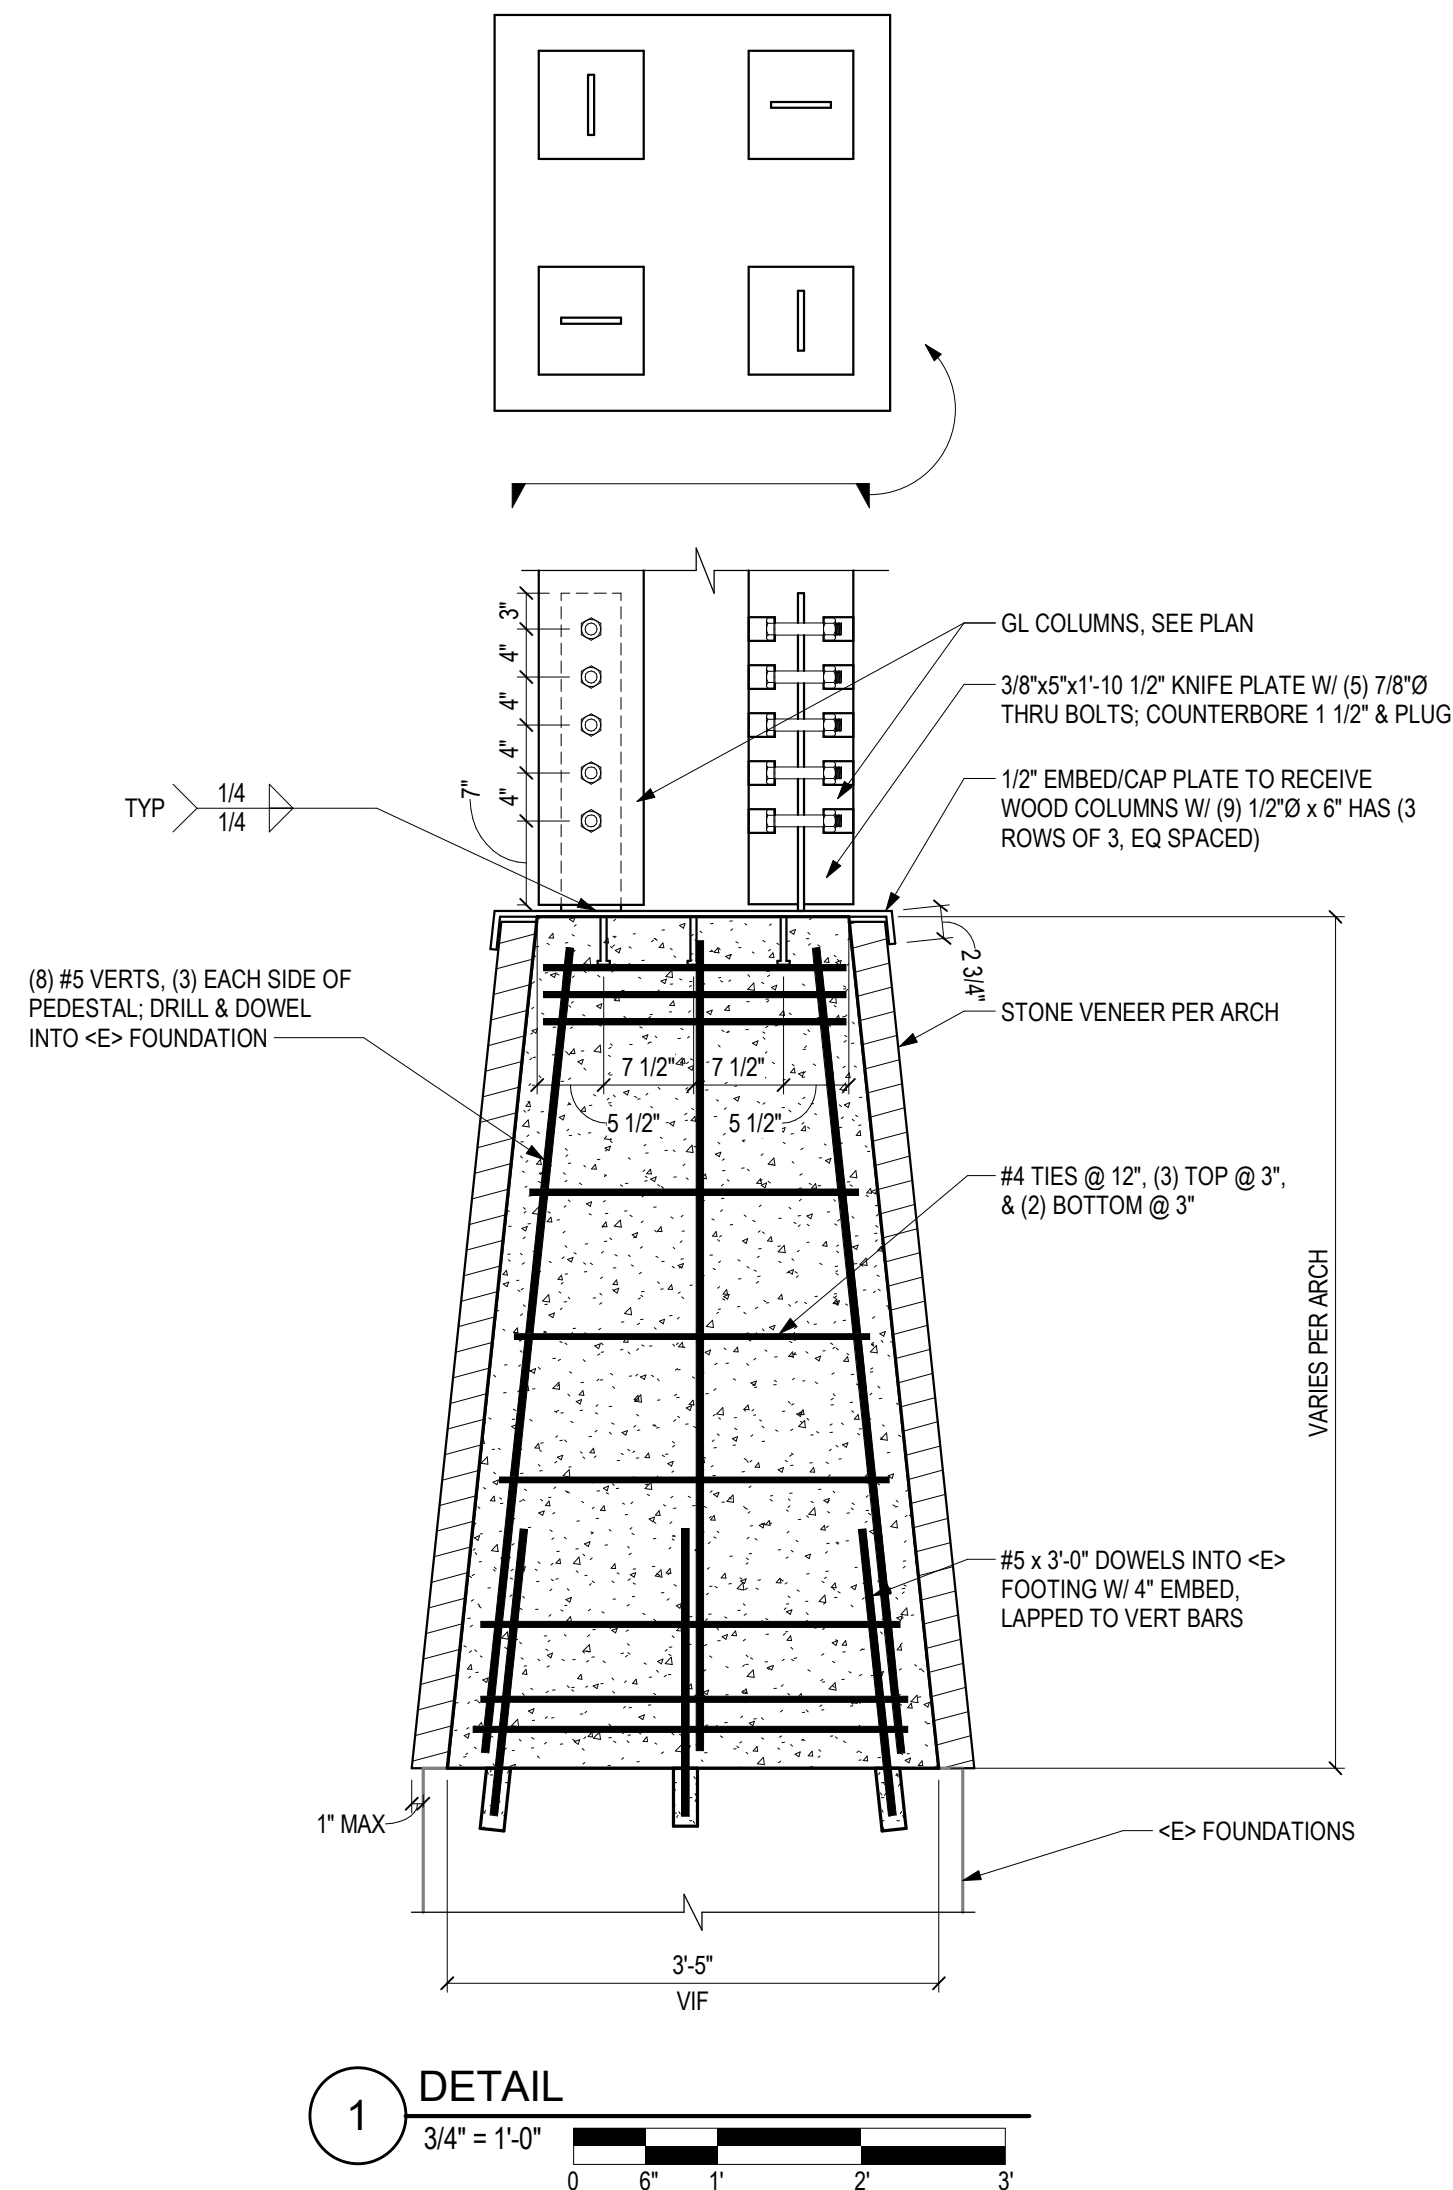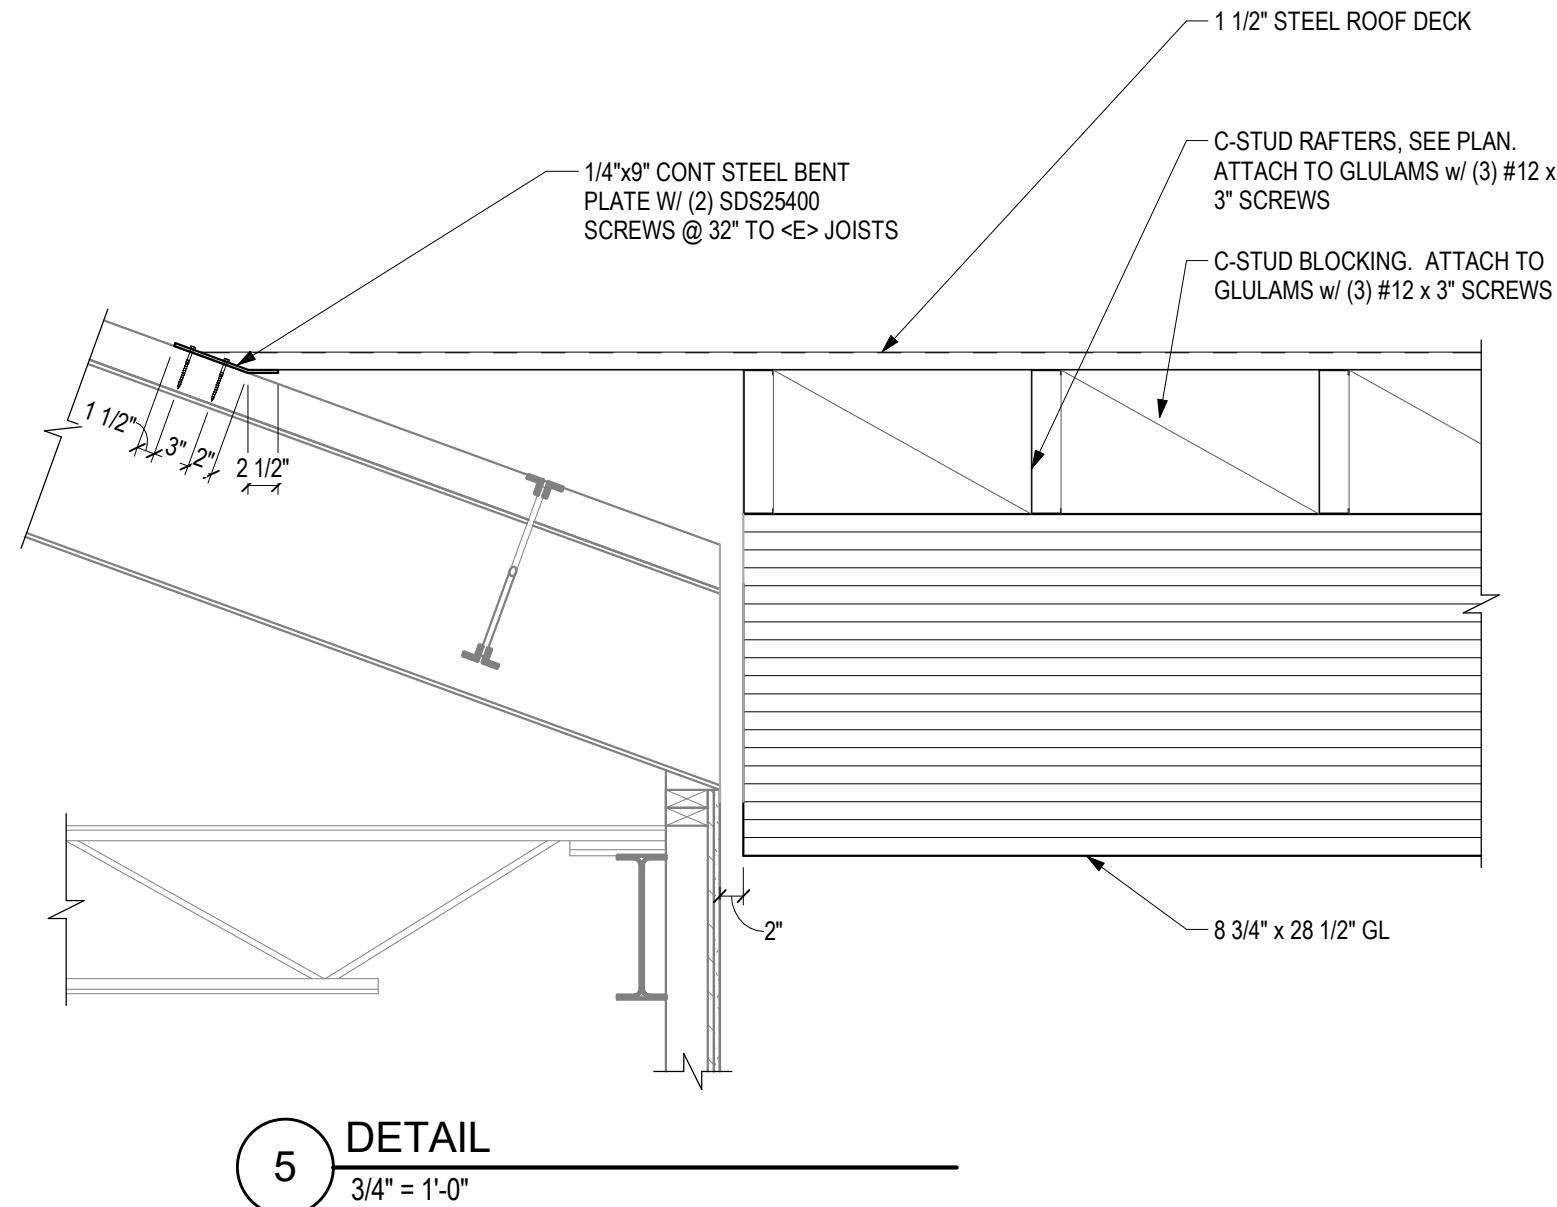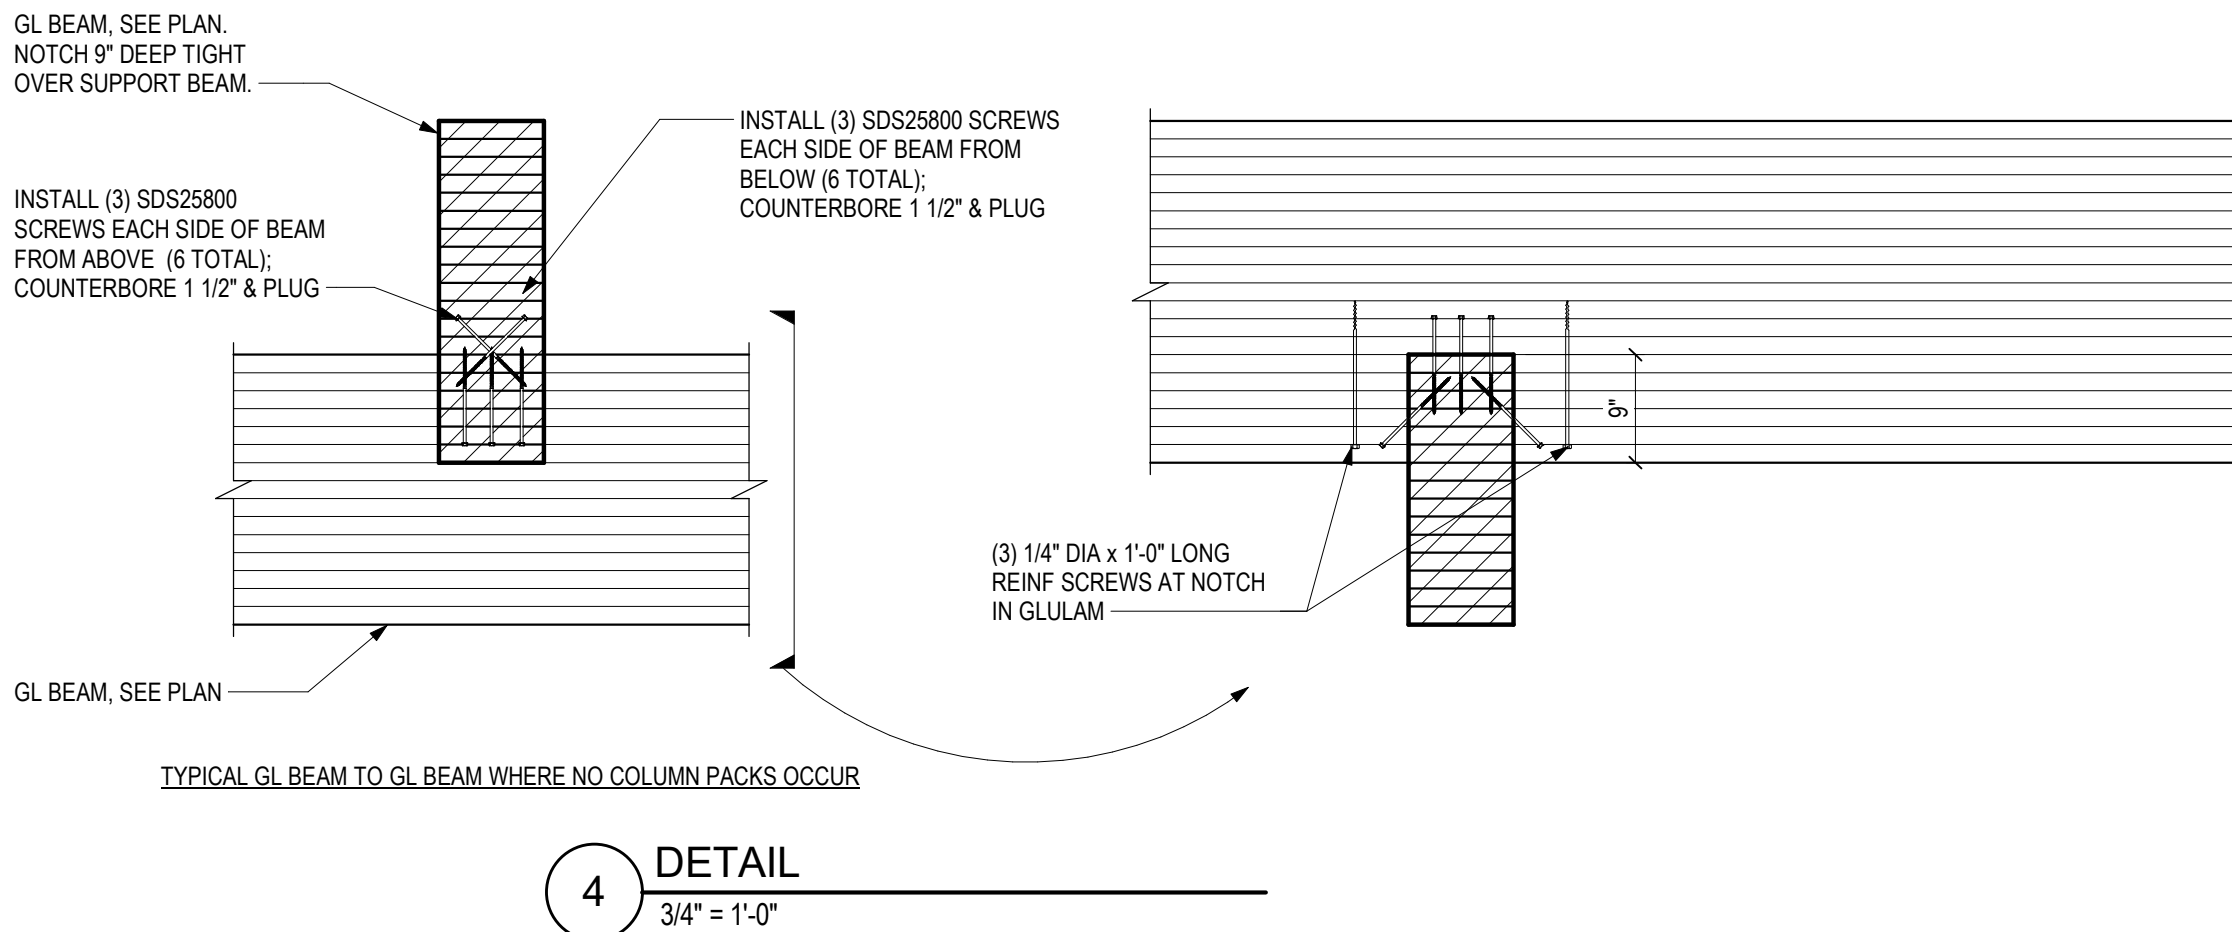

BEAR CLAW II
EXTERIOR REMODEL
2420 SKI TRAIL LANE
STEAMBOAT SPRINGS, CO



ERIC SMITH ASSOCIATES, P.C.
2241 SEVENTEENTH STREET
BOULDER, COLORADO, 80502
(303) 442-5456, (303) 442-1745 FAX

Job Number:	17022
Date:	03/29/2019
Drawn By:	DRS/EJS
Checked By:	EJS

Project Phase
Permit Review Set
Sheet Title
Details
Sheet Number
S105