

### UTILITY INSPECTION RECORD

Location 202 Sundance Ct. Unit B Permit SPRSF241798  
Owner McEntee Group, LLC  
Contractor Krafted Homes, Inc.

#### WATER

Line Size 3/4" Line Type CU Depth 7'-8' Length 40'

No. Fittings 2 Fitting Type Comp.

Test Type Water Test PSI Static

Left on/off On Tracer Wire Y (Y/N)

Comments: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

Date: 9/25/25 Inspector: R. Sterling

#### SEWER

Line Size 4" Line Type SDR-35 Depth 4'-5'

Length 36' No. Bends 1 Joint Type Gasketed

Bend Size 22.5°


Clean Out 1 Clean Out Location See Drawing

Test Type Air Test PSI 3.5

Bell Openings Upstream Y (Y/N) Tracer Wire Y (Y/N)

Comments: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

Date: 8/20/25 Inspector: J. Sterling

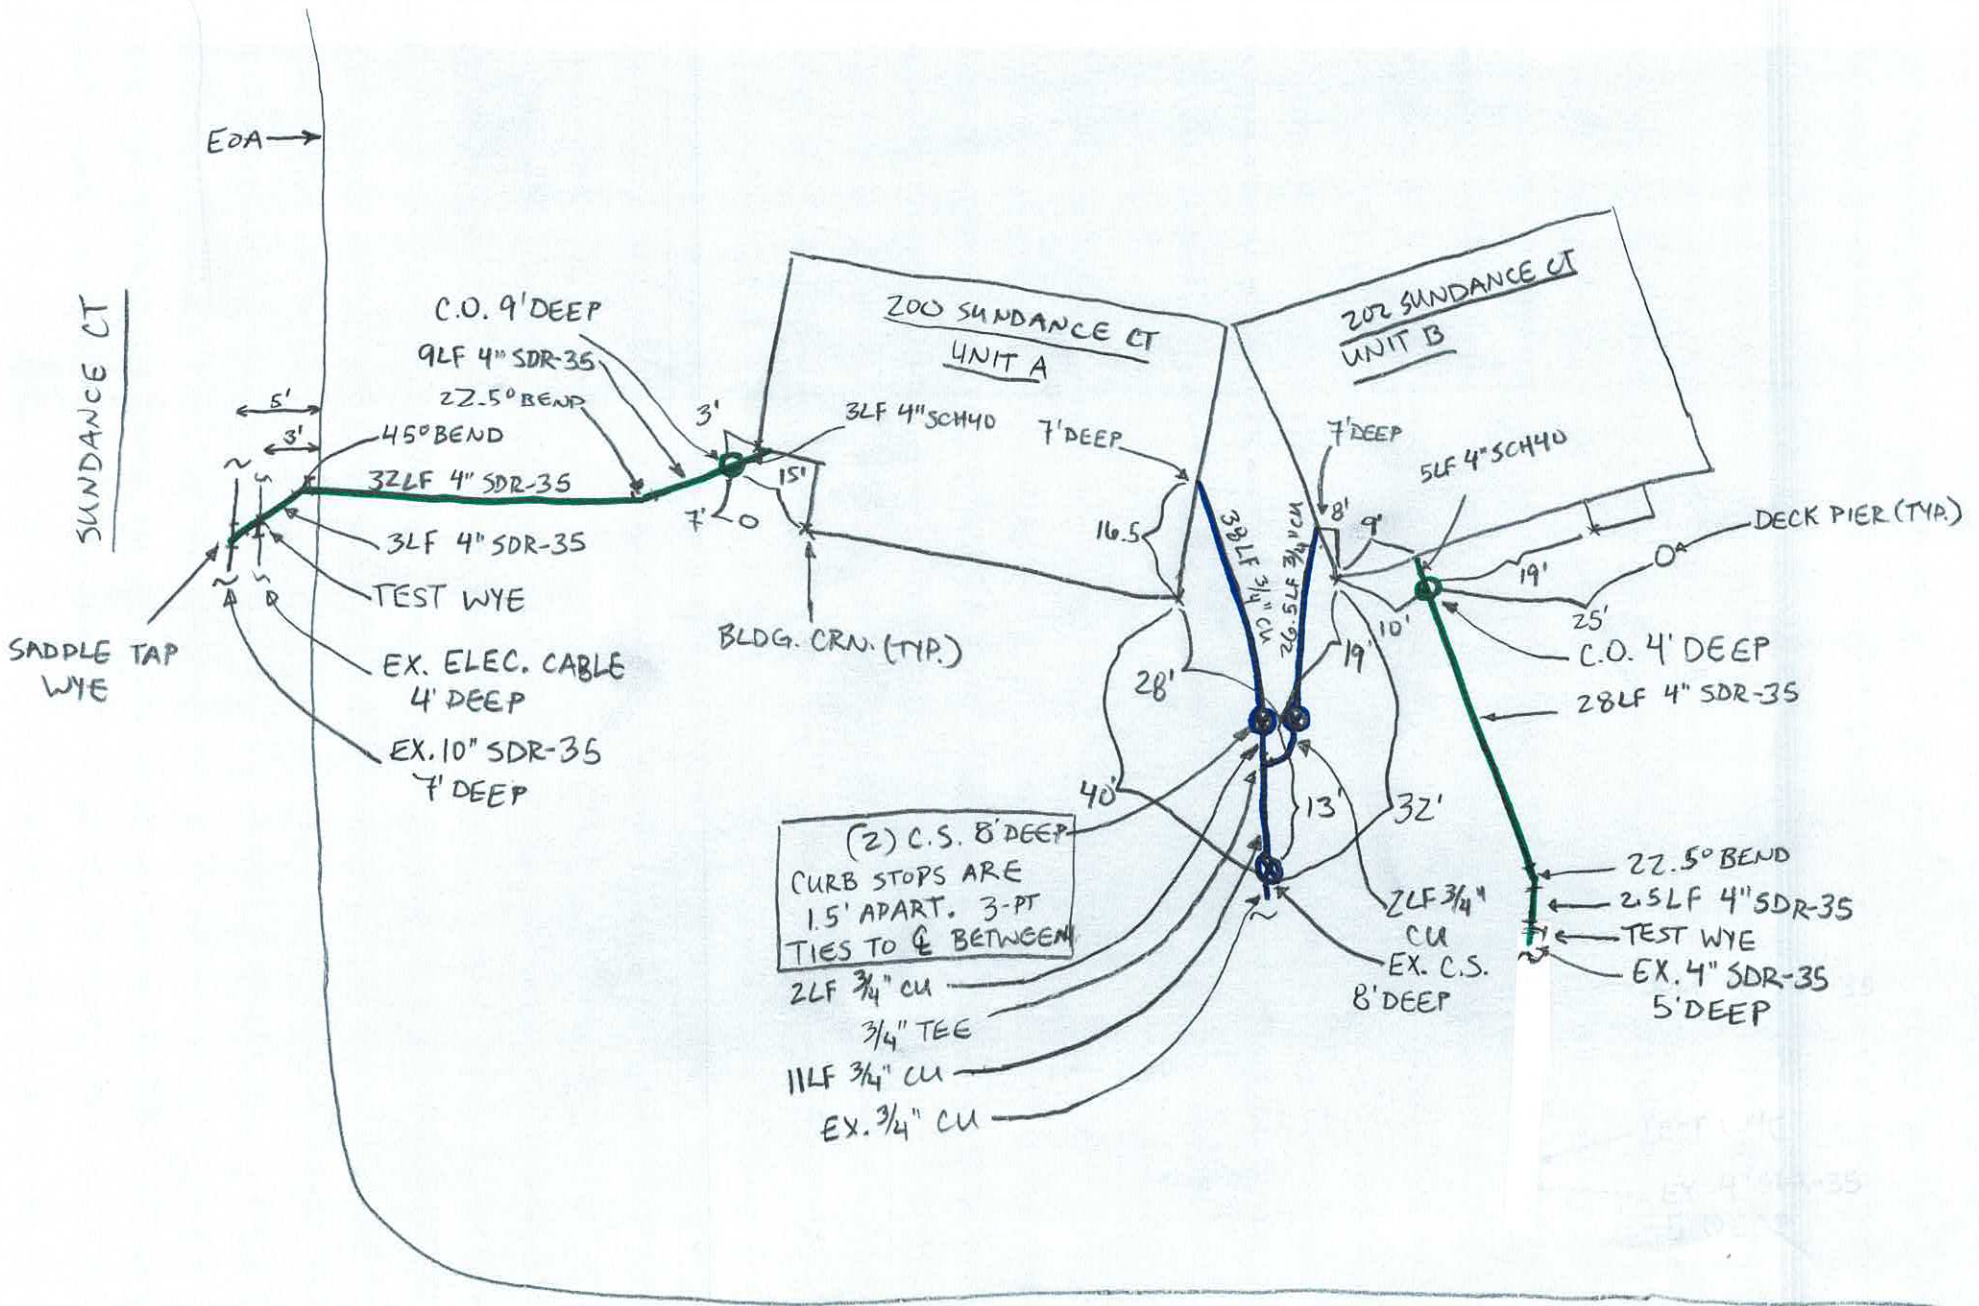

N.T.S.

STEAMBOAT BLVD.