

UTILITY INSPECTION RECORD

Location 200 Sundance Ct. Unit A Permit SPRSF 241394
Owner McEntee Group, LLC
Contractor Krafted Homes, Inc

WATER

Line Size 3/4" Line Type CU Depth 7'-8' Length 51'

No. Fittings 2 Fitting Type Comp.

Test Type Water Test PSI Static

Left on/off On Tracer Wire Y (Y/N)

Comments: _____

Date: 9/25/25 Inspector: R. Sterling

SEWER

Line Size 4" Line Type SDR-35 Depth 7'-9'

Length 47' No. Bends 2 Joint Type Gasketed

Bend Size (1) 22.5° (1) 45°


Clean Out 1 Clean Out Location See Drawing


Test Type Air Test PSI 3.5

Bell Openings Upstream Y (Y/N) Tracer Wire Y (Y/N)

Comments: _____

Date: 10/24/25 Inspector: J. Stephens

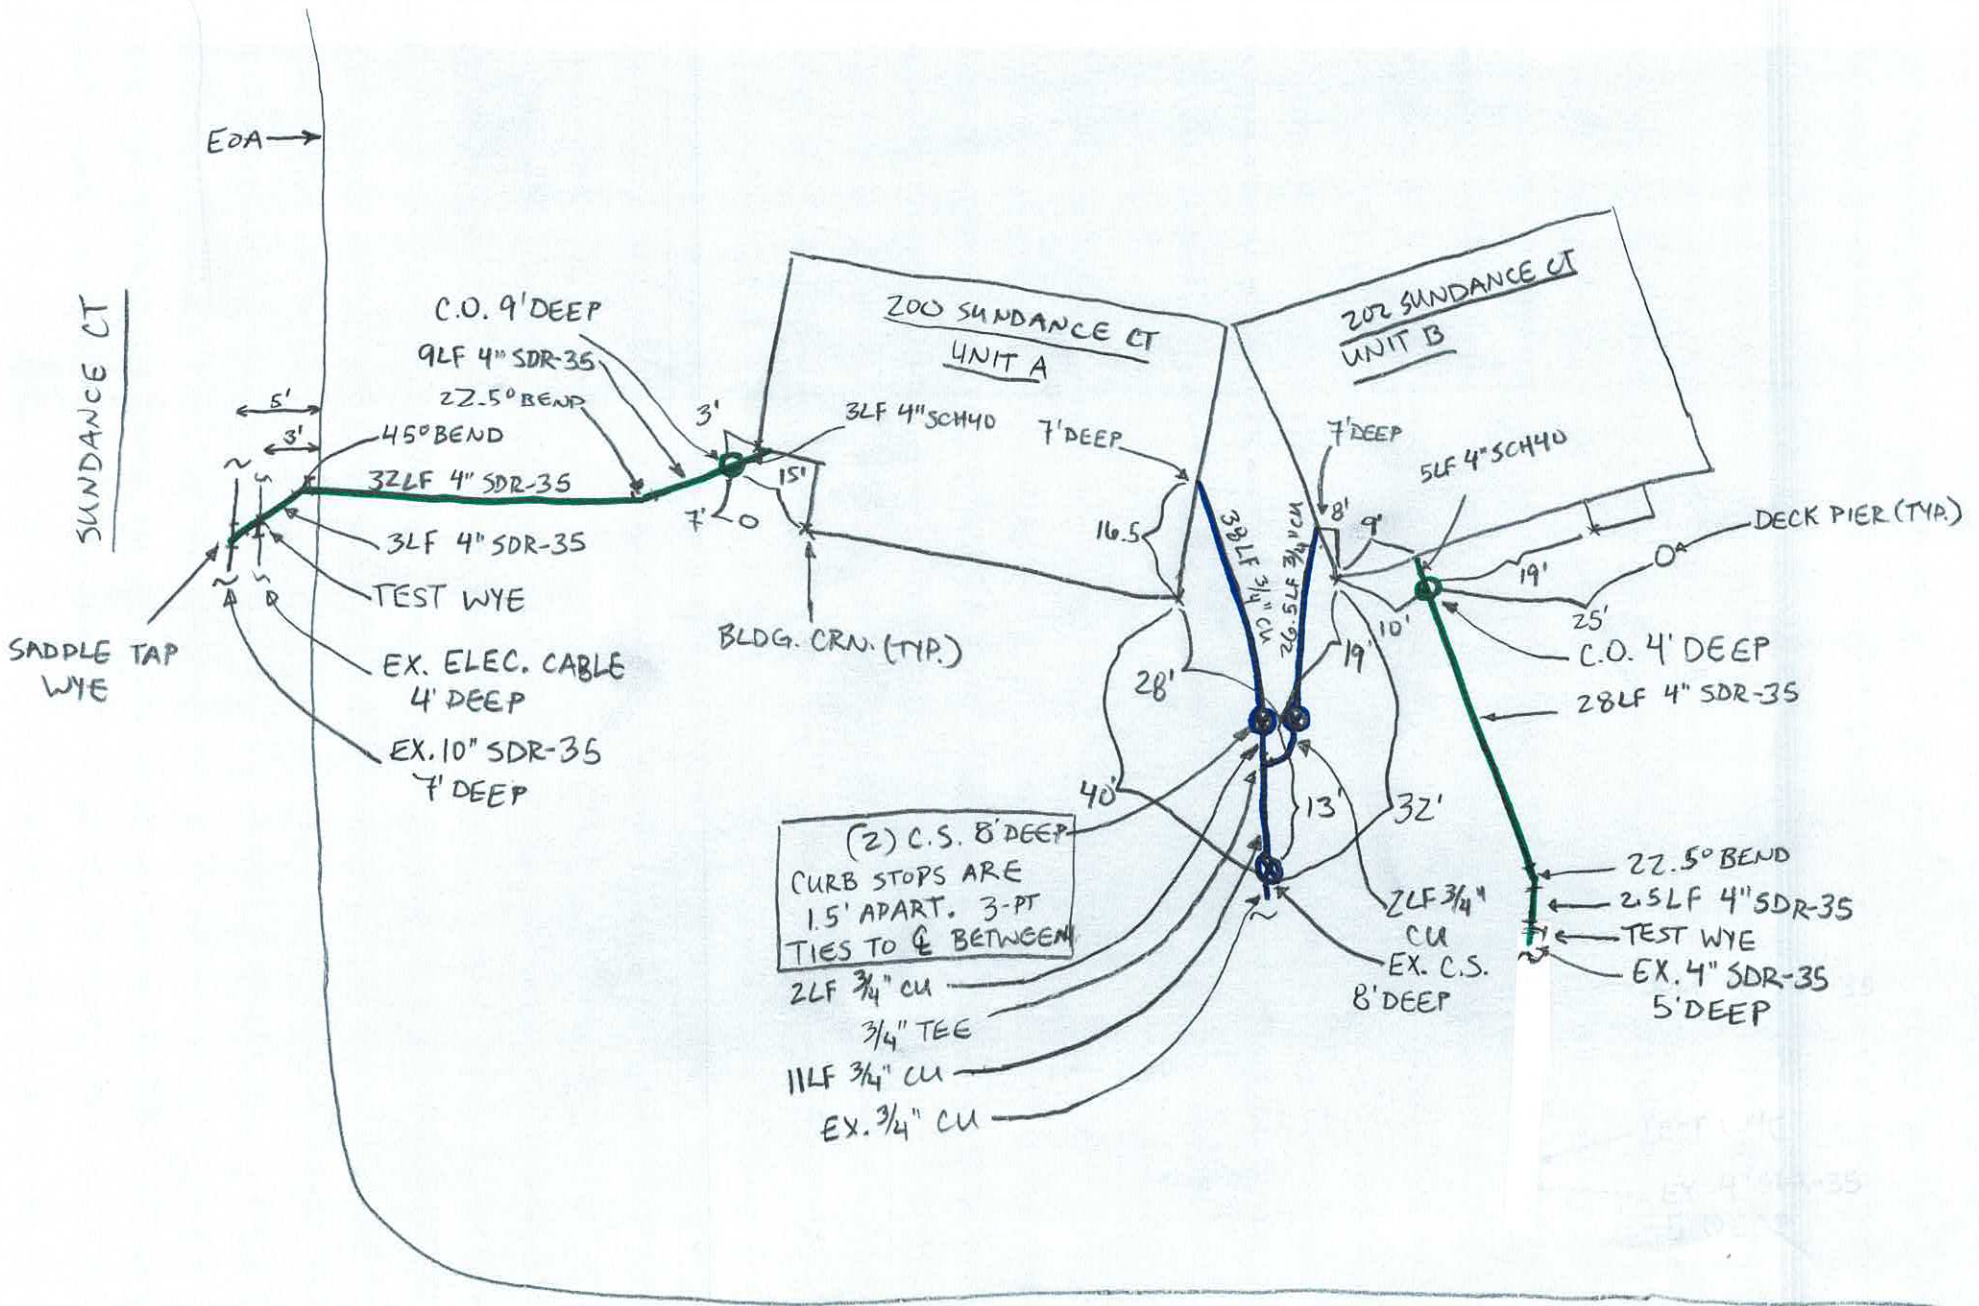


 N.T.S.

STEAMBOAT BLVD.