

GENERAL DRAWING NOTES

- WHERE DIFFERENCES APPEAR BETWEEN PLUMBING DRAWINGS AND ARCHITECTURAL DRAWINGS IN THE QUANTITIES AND LOCATIONS OF PLUMBING FIXTURES, THE ARCHITECTURAL DRAWINGS SHALL BE USED FOR PRICING. WHERE NECESSARY, THE CONTRACTOR SHALL USE UNIT PRICING FOR WASTE AND VENT PIPING TO EACH PLUMBING FIXTURE.

GENERAL PLUMBING CONTRACT REQUIREMENTS

- PREPARE SHOP DRAWINGS OF ALL NEW WORK (INCLUDING SLEEVE LOCATIONS) TO VERIFY LOCATIONS AND COORDINATION OF WORK BETWEEN TRADES PRIOR TO INSTALLATION.
- ALL DRAIN GRATES, CLEANOUT COVERS, AND OTHER FINISHED OR EXPOSED COMPONENTS SHALL BE PROTECTED FROM DAMAGE. DAMAGED COMPONENTS SHALL BE REPLACED BY CONTRACTOR AT NO ADDITIONAL COST TO THE CONTRACT.
- COORDINATE ROUTING OF ALL PLUMBING PIPING BELOW SLAB WITH STRUCTURAL GRADE BEAMS, TIE BEAMS, ETC. ALLOW FOR REROUTING OF PIPING AS REQUIRED.
- PIPING ROUTING ON DRAWINGS IS GENERALLY DIAGRAMMATIC WITH EFFORTS DURING DESIGN TO AVOID STRUCTURAL CONFLICTS. CONTRACTOR SHALL COORDINATE ROUTING OF ALL PIPING THROUGH BUILDING WITH STRUCTURAL CONDITIONS. CONTRACTOR COORDINATION DRAWINGS SHALL REFLECT ALL PIPE ROUTING AND PIPING THAT MAY HAVE TO BE SHIFTED OR MOVED TO AVOID CONFLICTS. SHIFTED OR MOVED PIPING SHALL REFLECT NO ADDITIONAL COST TO THE PROJECT.
- ALL REQUIRED OPENINGS IN CONCRETE BEAMS AND STRUCTURAL WALLS ARE TO BE ACCOMPLISHED USING SLEEVES PROPERLY SIZED FOR THE PIPE THEY SERVE. CORE DRILLING IN BEAMS IS NOT ALLOWED. CORE DRILLING IN PANS IS ALLOWED UPON PRIOR APPROVAL OF ARCHITECT AND STRUCTURAL ENGINEER.
- ALL HORIZONTAL SANITARY PIPING 2-1/2" AND SMALLER WHETHER BELOW OR ABOVE GRADE SHALL SLOPE AT 1/4" FT. ALL PIPING 3" AND LARGER SHALL SLOPE AT 1/8" FT. UNLESS OTHERWISE NOTED. ALL STORM AND OVERFLOW PIPING SHALL SLOPE AT 1/8" FT. UNLESS OTHERWISE NOTED. ALL GREASE WASTE PIPING SHALL SLOPE AT 1/4" FT.
- REFERENCE CIVIL DIVISION DRAWINGS FOR REQUIRED POINT OF CONNECTION AND INVERT REQUIREMENTS. IN GENERAL, THE POINT OF CONNECTION IS AT A POINT 5 FEET OUTSIDE OF BUILDING FOOTPRINT. CONFORM WORK TO MEET INVERT ELEVATIONS ON CIVIL PLANS.
- CAP ALL SANITARY AND STORM TEES FOR FUTURE BRANCH PIPING AND STAKE LOCATION OF PIPING FOR CONNECTION TO FUTURE BRANCH LINES.
- WHERE SHOWN, MINIMIZE THE NUMBER OF JOINTS ON ANY PRESSURIZED PIPING BELOW CONCRETE SLABS. ALL BELOW GRADE PIPING TO BE PRESSURE TESTED AND WITNESSED BY ARCHITECT PRIOR TO BACKFILLING.
- ALL CLEANOUTS FOR HORIZONTAL STORM DRAINAGE SYSTEM SHALL BE PIPE SIZE OR MAXIMUM 6" FOR LARGER PIPE.
- IN ADDITION TO THE CLEANOUT LOCATIONS SHOWN ON DRAWINGS, CLEANOUTS SHALL BE PROVIDED IN ACCORDANCE WITH THE LOCAL GOVERNING CODE. ADDITIONAL CLEANOUTS SHALL BE PROVIDED AS FOLLOWS:
 - EACH RUN OF PIPING WHICH IS MORE THAN 75 FEET IN LENGTH OR FRACTION THEREOF.
 - HORIZONTAL LINES 5 FEET OR MORE.
 - HORIZONTAL LINES FOR EACH AGGREGATE CHANGE OF DIRECTION EXCEEDING 135 DEGREES.
 - AT THE BASE OF ALL SANITARY AND STORM RISERS, ALL VERTICAL CLEANOUTS SHALL BE SIZED TO ACCOMMODATE THE LARGEST PIPE ON THAT BRANCH LINE, BUT NEVER LARGER THAN 4".
 - ALL GREASE WASTE PIPING SHALL HAVE CLEANOUTS EVERY 50 FEET OR FRACTION THEREOF AND AS NOTED ABOVE.
 - AT THE END OF FIXTURE BANKS TO INCLUDE WATER CLOSETS, URINALS AND LAVATORIES. CLEANOUT PLUG SHALL BE A MINIMUM OF 2" AFF.
- NO GAS LINES SHALL BE LOCATED BELOW BUILDING SLAB. ALL GAS PIPING IN AIR PLenums SHALL BE WELDED.
- PROVIDE ISOLATION VALVES ON ALL PIPING SERVING HOSE BIBBS.
- STANDARD ROOF DRAINAGE IS SIZED AT 3"/HR. OVERFLOW DRAINAGE IS ACCOMPLISHED THROUGH ARCHITECTURAL ROOF SCUPPERS, WHERE OVERFLOW DRAINS ARE USED, THEY WILL BE SIZED USING 3"/HR. RATE.
- WATER HAMMER ARRESTORS (SHOCK ABSORBERS) SHALL BE INSTALLED BETWEEN THE LAST 2 FLUSH VALVE FIXTURES. WHEN THE COLD WATER HEADER IS 20 FEET OR LONGER, A SECOND ARRESTOR SHALL BE INSTALLED HALFWAY DOWN THE HEADER. THE SIZES OF THE ARRESTORS SHALL BE BASED ON PDI SIZING.
- ALL FLOOR DRAINS IN BUILDING EXCEPT DRAINS IN SHOWERS AND SHOWER AREAS SHALL BE INSTALLED WITH A PROSET TRAP GUARD.
- ALL DOMESTIC WATER PIPING SERVING TOILET OR RESTROOM GROUPS SHALL BE INSTALLED WITH ISOLATION VALVES IN ORDER TO ISOLATE THESE AREAS WITHOUT CLOSING DOWN ANY OTHER PORTION OF THE BUILDING WATER SUPPLY SYSTEMS. ALL ISOLATION VALVES SHALL BE ACCESSIBLE WITH ACCESS PANELS. MINIMUM ACCESS PANEL SIZE SHALL BE 12" X 12". ACCESS PANELS SHALL BE OF THE SAME RATING AS THE STRUCTURAL ELEMENT IN WHICH THEY ARE INSTALLED.
- ALL GAS PRESSURE REDUCING VALVES SHALL BE PROVIDED WITH VENT PIPING TO ATMOSPHERE.
- THROUGHOUT THE DRAWINGS, NUMBERS ARE SHOWN IN BRACKETS TO INDICATE QUANTITIES OF UNITS CARRIED WITHIN THE DIFFERENT PIPING SYSTEMS. THEY REPRESENT THE FOLLOWING:
 - CW (X)X = (GPM)X(GPM)
 - HW (X)X = (CFH)X(CFH)
 - SAN (X)X = (DFU)X(DFU)
 - VENT (X)X = (DFU)X(DFU)
 - STORM (X)X = (FTZ)X(FTZ)

FOR CALCULATION PURPOSES OF ALL PIPE SIZES, VALUES SHOWN ARE WITHIN 10 PERCENT OF ACTUAL LOAD VALUES.
- ALL EQUIPMENT AND PIPING SHALL BE BRACED FOR SEISMIC REQUIREMENTS APPLICABLE FOR SEISMIC ZONE REQUIREMENTS FOR THIS PROJECT.
- REFER TO GENERAL MECHANICAL CONTRACT REQUIREMENT NOTES ON MECHANICAL DRAWINGS FOR GENERAL PIPING HEAT TRACE INSTALLATION REQUIREMENTS.
- PROVIDE DIELECTRIC FITTINGS AT ALL CONNECTIONS BETWEEN DISSIMILAR METALS AND AS SHOWN ON DRAWINGS.
- ALL TEMPERING VALVES TO BE SET FOR 110° F WATER TEMPERATURE MAXIMUM UNLESS OTHERWISE NOTED.
- PROVIDE HEAT TRACE IN LOCATIONS SHOWN, AS REQUIRED BY SPECIFICATIONS, AND TO THE FOLLOWING SYSTEMS WHEN EXPOSED TO FREEZING CONDITIONS:
 - DOMESTIC COLD WATER
 - DOMESTIC HOT WATER
 - DOMESTIC HOT WATER RECIRC
 - SANITARY
 - STORM


ALL HEAT TRACED PIPE SHALL BE INSULATED PER SPECIFICATIONS. COORDINATE ALL HEAT TRACING AND REQUIRED CIRCUITS WITH ELECTRICAL DRAWINGS AND ELECTRICAL CONTRACTOR.
- PROVIDE WATER HAMMER ARRESTORS FOR ALL FIXTURES/EQUIPMENT THAT HAVE QUICK CLOSING VALVES TO INCLUDE:
 - WATER CLOSETS AND URINAL FLUSH VALVES
 - ELECTRONIC FAUCETS
 - REFRIGERATOR ICE MAKERS
 - DISHWASHERS
 - MECHANICAL MAKE-UP
- REFER TO MECHANICAL PLANS FOR ALL EQUIPMENT REQUIRING MAKE-UP WATER. PROVIDE A REDUCED PRESSURE BACKFLOW FOR EACH REQUIRED LINE.
- REFER TO LANDSCAPE PLANS FOR IRRIGATION REQUIREMENTS. WHEN AN IRRIGATION TAP IS REQUIRED OFF THE DOMESTIC WATER SERVICE, PROVIDE THE RECOMMENDED LINE SIZE WITH A REDUCED PRESSURE BACKFLOW PREVENTER.

PLUMBING LEGEND

(NOT ALL SYMBOLS LISTED BELOW ARE BEING USED IN THIS SET OF PLUMBING DRAWINGS)

SYMBOL	ABBR	DESCRIPTION	SYMBOL	ABBR	DESCRIPTION	SYMBOL	ABBR	DESCRIPTION
	MA	MEDICAL AIR			ELBOW UP			SECTION NO.
	O	OXYGEN			ELBOW DOWN			SECTION VIEW SHEET NO.
	VAC	VACUUM			TEE UP			DETAIL DESIGNATION
	NO	NITROUS OXIDE			TEE DOWN			EQUIPMENT DESIGNATION
	G	NAT. GAS OUTLET			PIPE CAP OR ROOF			SHEET KEY NOTES
	O	OXYGEN OUTLET		GC	GAS COCK			POINT OF CONN. (CONN. NEW TO EXISTING)
	V	VACUUM OUTLET		CO	CLEANOUT PLUG			POINT OF DISCONNECTION
	MA	MEDICAL AIR OUTLET		HB WH	HOSE BIBB WALL HYDRANT			ARROW INDICATES DIRECTION OF FLOW
	MA	MED AIR OUTLET		VB	VACUUM BREAKER			RISE IN DIRECTION OF FLOW
				RD	ROOF DRAIN			DROP IN DIRECTION OF FLOW
		EXISTING SPRINKLER HEAD TO REMAIN		OD	OVERFLOW ROOF DRAIN		TB	THRUST BLOCK
		EXISTING SPRINKLER HEAD TO RELOCATED		DSN	DOWNSPOUT NOZZLE		DN	DOWN
		NEW SPRINKLER HEAD TO MATCH EXISTING		SA	SHOCK ARRESTOR W/BALL VALVE		AFF	ABOVE FIN. FLOOR
	(E)	EXISTING PIPING		AD	AREA DRAIN		AFG	ABOVE FIN. GRADE
	(E)	EXISTING PIPING TO BE REMOVED		FCO	FLOOR CLEANOUT		TOP	TOP OF PIPE (AFF)
	CW	DOMESTIC COLD WATER		GCO	GRADE CLEANOUT		BOP	BOT. OF PIPE (AFF)
	HW	DOMESTIC HOT WATER		WCO	WALL CLEANOUT		I.E.	INVERT ELEVATION
	T	TEMPERED WATER		CO	CLEANOUT PLUG		VB	VENT BELOW FLOOR
	SAN	SANITARY WASTE ABOVE FLOOR		VTR	VENT THRU ROOF		NTS	NOT TO SCALE
	SAN	SANITARY WASTE BELOW FLOOR		GV	GATE VALVE		(E)	EXISTING
	GW	GREASE WASTE BELOW FLOOR		OS&Y	OUTSIDE STEM AND YOKE		(N)	NEW
	V	SANITARY VENT		DV	DRAIN VALVE W/ HOSE END CONN.		(R)	REMOVE OR RELOCATE
	ST	STORM PIPING ABOVE FLOOR			BALL VALVE W/ HOSE CONNECTION			
	ST	STORM PIPING BELOW FLOOR		CV	CHECK VALVE WITH FLOW DIRECTION			
	OD	STORM OVERFLOW ABOVE FLOOR		PRV	PRESSURE REDUCING VALVE			
	OD	STORM OVERFLOW BELOW FLOOR		SV	SOLENOID VALVE			
	G	NATURAL GAS		FCV	AUTO FLOW CONTROL VALVE W/ TEST PORT			
	F	FIRE		CS	CIRCUIT SETTER			
	DR	EQUIP. DRAIN		GLV	GLOBE VALVE (STRAIGHT PATTERN)			
	A	PIPE SIZE/ PIPE TYPE		GLV	GLOBE VALVE (ANGLE PATTERN)			
	EJ	EXPANSION JOINT		BFV	BUTTERFLY VALVE			
	U	UNION		BV	BALL VALVE			
		THERMOMETER W/THERMOWELL		TCV	AUTO TEMP CONTROL VALVE, 2-WAY			
	AV	AIR VENT		TCV	AUTO TEMP CONTROL VALVE, 3-WAY			
	FC	FLEXIBLE PIPE CONNECTOR		PV	PLUG VALVE			
	FS	FLOW SWITCH		TPR	TEMP/PRESSURE RELIEF VALVE			
	PS	PRESSURE SWITCH			VALVE IN RISER			
	PG	PRESSURE GAUGE W/GAUGE COCK		STR	STRAINER W/ BLOW-OFF & CAPPED HOSE- END CONNECTION			

EQUIPMENT DESIGNATIONS



Date	Description
2021.05.19	BP3: GOLDWALK - ISSUE FOR BID AND PERMIT

Seal / Signature



Project Name

SSRC | BASE AREA IMPROVEMENTS

Project Number

003.7835.000

Description

GOLD WALK - PLUMBING LEGEND

Scale

1/8" = 1'-0"

1B-P0.000

PLUMBING FIXTURE SCHEDULE - GOLDWALK

GENERAL NOTES:

1. PLUMBING DESIGN AND SIZES ARE BASED ON THE 2018 INTERNATIONAL PLUMBING CODE.
2. ALL EXPOSED PIPING SERVING PLUMBING FIXTURES THAT MAY BE USED FOR ADA PURPOSES SHALL HAVE TRAPS AND SUPPLIES INSULATED PER ADA REQUIREMENTS.
3. ALL FIXTURES ARE WHITE UNLESS OTHERWISE NOTED.
4. ALL PUBLIC ACCESS LAVATORY AND SINKS WILL HAVE AN ASSE 1070 APPROVED TEMPERING VALVE INSTALLED.

CODE	FIXTURE	DESCRIPTION	MIN CW CONN	MIN HW CONN	MIN SAN CONN	MIN VENT CONN	MANUFACTURER	FIXTURE MODEL NUMBER	MANUFACTURER	FAUCET / FLUSH VALVE MODEL NUMBER	REMARKS
AD-1	AREA DRAIN	TWO-STAGE AREA DRAIN: CAST IRON TOP BODY WITH 8" SQUARE NICKEL-BRONZE TOP; PERFORATED STAINLESS STEEL PERFORATED EXTENSION; CAST IRON BOTTOM BODY WITH FLASHING RING AND FLANGE, GRAVEL STOP, AND ALUMINUM DOME.	-	-	-	-	WADE	3358-1-DF-XNH	-	-	COORDINATE REQUIRED EXTENSIONS WITH INSTALLATION LOCATION PRIOR TO ORDERING; COORDINATE OUTLET SIZE WITH EACH LOCATION.
FD-1	FLOOR DRAIN	CAST IRON BODY FLOOR DRAIN WITH 5" NICKEL-BRONZE STRAINER; PROVIDE WITH JAY R. SMITH MODEL 2692 TRAP GUARD.	-	-	RE: PLANS	2"	JAY R. SMITH	2005Y-NB-A	-	-	-
FS-1	FLOOR SINK	12-1/2" SQUARE, 8" DEEP CAST IRON RECEPTOR FLOOR SINK WITH ACID RESISTANT COATED INTERIOR, POLISHED ALUMINUM DOME BOTTOM STRAINER, AND SECURED 1/2 GRATE.	-	-	SEE PLANS	SEE PLANS	JAY R. SMITH	3150Y-PDBS-12	-	-	-

SUMP PUMP SCHEDULE

GENERAL NOTES:

1. PROVIDE CHECK VALVE AND SHUTOFF VALVE ON EACH PUMP.
2. PROVIDE PREMIUM EFFICIENCY MOTORS (RELIANCE E+ OR EQUIVALENT) WITH MAGNETIC STARTER AND DRY CONTACTS.
3. ALL UNITS SHALL HAVE INTEGRAL DISCONNECT AND OVERCURRENT/SHORT CIRCUIT PROTECTION.

REMARK NOTES:

- A. PROVIDE Poured in place sump in bottom of stair pit.
- B. PROVIDE TYPE 4X SIMPLEX CONTROL PANEL.
- C. PROVIDE STANDARD TETHERED FLOAT SWITCH.

CODE	MANUFACTURER	MODEL NUMBER	SERVICE	TYPE	NO. OF PUMPS	FLOW (GPM)	PRESSURE (FT)	DISCHARGE (IN)	RPM	POWER(HP)	VOLT	PH	FLA	ELECTRICAL				REMARKS
														FUSE	DISC.	FEEDER		
ESP-1	WEIL	1411	ESCALATOR / STAIR PIT	SIMPLEX SUBMERSIBLE	1	50.00	20	2	1750	0.5	460	3	3.40	5A FRS -RK	30A/3P	(3#12.#12G) 3/4"C	A, B, C	

SAND/OIL INTERCEPTOR SCHEDULE

GENERAL NOTES:

1. UNITS SHALL MEET ALL REQUIREMENTS OF LOCAL AUTHORITY HAVING JURISDICTION.

REMARK NOTES:

- A. PREFABBED, DESIGN LOAD H-20 TRAFFIC.

CODE	DESCRIPTION	SERVICE	MANUFACTURER	MODEL NUMBER	WEIGHT (LBS)	CAPACITY (GAL)	LENGTH	WIDTH	HEIGHT	REMARKS
SOL-1	TWO CHAMBER PRECAST CONCRETE SAND/OIL INTERCEPTOR	ESP-1	COPELAND PRECAST	11010	11,300	320	6' - 10"	4' - 10"	4' - 2"	A



ALTEIRA east west partners
MOUNTAIN COMPANY

2305 Mount Werner Circle
Steamboat Springs, CO 80487

Gensler

1225 17th Street
Suite 150
Denver, CO 80202
United States
Tel 303.595.8886
Fax 303.825.6823



141 9th Street
PO Box 774943
Steamboat Springs, CO
80477
Tel 970.871.9494

DESIGNWORKSHOP

1390 Lawrence Street
Suite 100
Denver, CO 80204
Tel 303.623.5186



12499 West Cofax Ave.
Lakewood, CO 80215
United States
Tel 303.431.6100



14143 Denver West Pkwy
Suite 300
Golden, CO
United States
Tel 303.421.6655

Date	Description
2021.05.19	BP3: GOLDWALK - ISSUE FOR BID AND PERMIT

Seal / Signature



05/18/2021

Project Name

SSRC | BASE AREA IMPROVEMENTS

Project Number

003.7835.000

Description

GOLD WALK - PLUMBING SCHEDULES

Scale

1B-P0.001

GENERAL NOTES:

- FIELD VERIFY THE EXACT LOCATION OF ALL EXISTING PIPING, FIXTURES, AND EQUIPMENT SCHEDULED TO BE DEMOLISHED PRIOR TO COMMENSING WORK.
- FIELD VERIFY THE EXACT LOCATION OF ALL EXISTING PIPING THAT REQUIRES CONNECTION TO NEW PRIOR TO COMMENSING WORK.
- REQUIRED PIPE SIZES ARE SHOWN NEXT TO KEY NOTE.
- PROVIDE BALL VALVE SHUTOFF AND 12"X12" ACCESS PANEL AT EACH SHOCK ABSORBER (SA) PANEL LOCATION TO BE VERIFIED AND COORDINATED WITH ARCHITECT.
- ALL CIRCUIT SETTERS SHALL BE SET AT 1.0 GPM UNLESS NOTED OTHERWISE.

KEY NOTES: (SOME KEY NOTES MAY NOT APPLY TO THIS SHEET)

- SANITARY PIPING UP
- SANITARY PIPING DN
- SANITARY PIPING UP & DN
- GW PIPING UP
- GW PIPING DN
- GW PIPING UP & DN
- SANITARY VENT UP
- SANITARY VENT DN
- SANITARY VENT UP & DN
- CW PIPING UP
- CW PIPING DN
- CW PIPING UP & DN
- HW PIPING UP
- HW PIPING DN
- HW PIPING UP & DN
- HWC PIPING UP
- HWC PIPING DN
- HWC PIPING UP & DN
- CW & HW PIPING UP
- CW & HW PIPING DN
- CW & HW PIPING UP & DN
- GAS PIPING UP
- GAS PIPING DN
- GAS PIPING UP & DN
- STORM PIPING UP
- STORM PIPING DN
- STORM PIPING UP & DN
- OVERFLOW PIPING UP
- OVERFLOW PIPING DN
- OVERFLOW PIPING UP & DN
- OVERFLOW PIPING DOWN AND THRU WALL TO DOWNSPOUT NOZZLE +12" AFG
- SANITARY PIPING UP TO PLUMBING FIXTURES
- PIPING UP TO CLEANOUT
- 1/2" CW & HW TO EACH LAV/SK
- PIPING UP TO DRAIN
- 1/2" CW & HW DOWN TO SHOWER VALVE & 1/2" UP TO SHOWERHEAD

Date	Description
2021.05.19	BP3: GOLDWALK - ISSUE FOR BID AND PERMIT

Seal / Signature



05/18/2021

Project Name

SSRC | BASE AREA IMPROVEMENTS

Project Number

003.7835.000


Description

GOLD WALK - PLUMBING PLAN - LEVEL 01


Scale

1/8" = 1'-0"

1B-P1.201

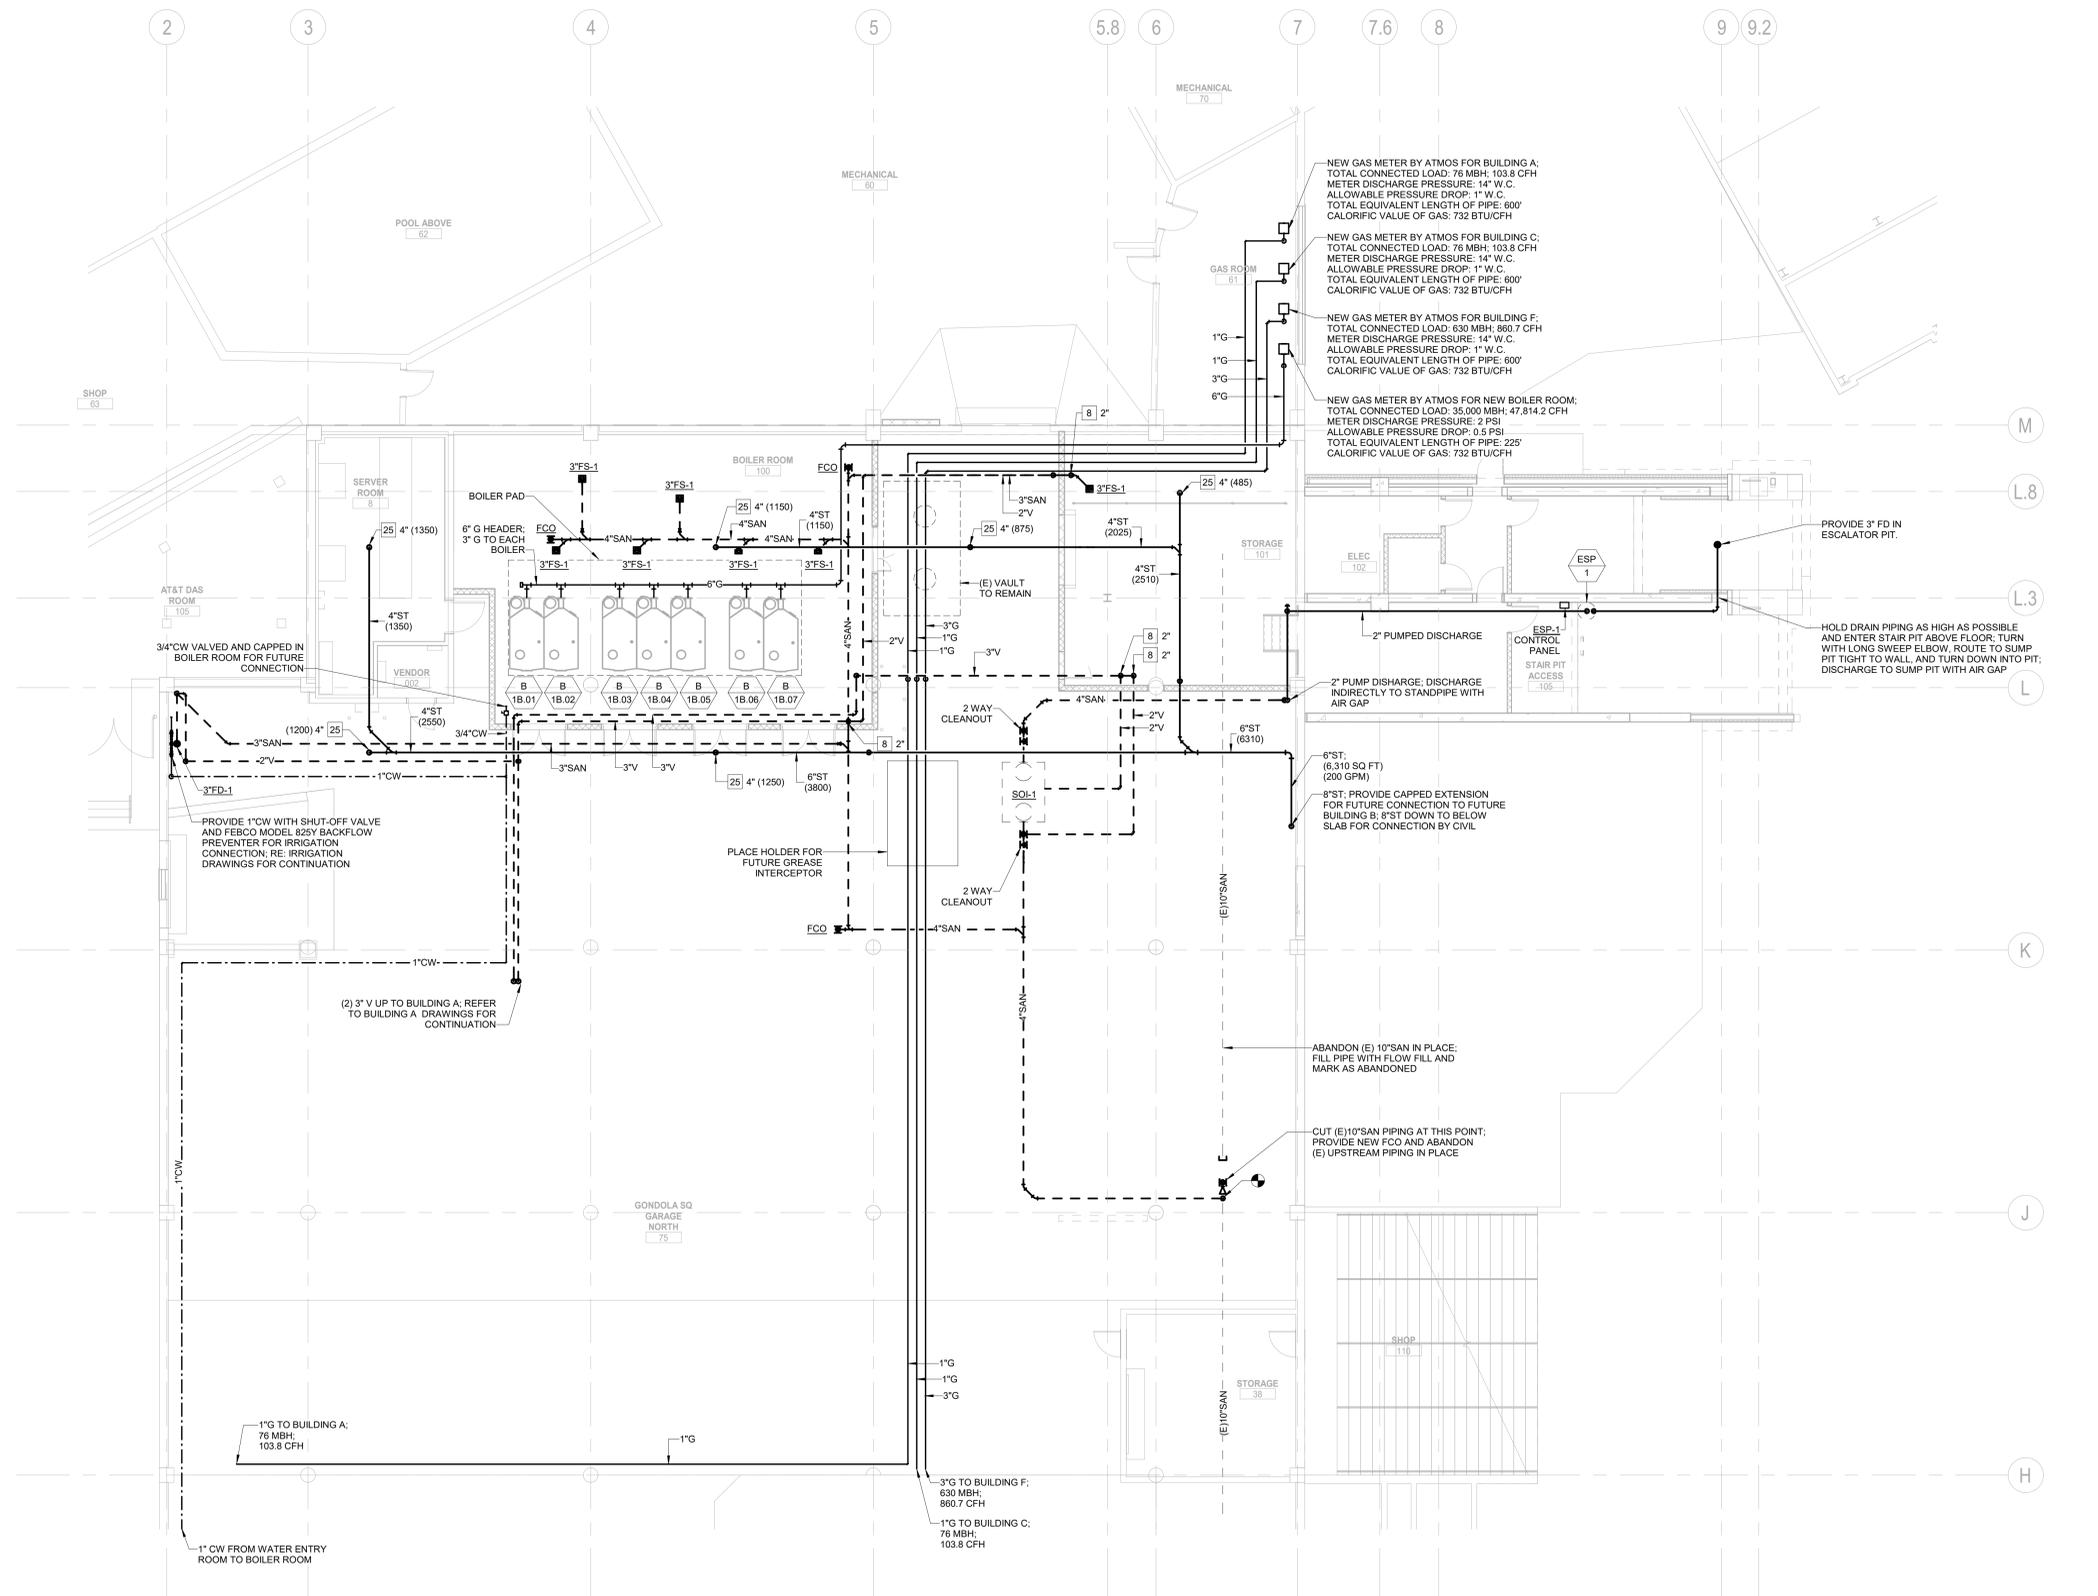

KEY PLAN



GENERAL NOTES:

1. FIELD VERIFY THE EXACT LOCATION OF ALL EXISTING PIPING, FIXTURES, AND EQUIPMENT SCHEDULED TO BE DEMOLISHED PRIOR TO COMMENSING WORK.
2. FIELD VERIFY THE EXACT LOCATION OF ALL EXISTING PIPING THAT REQUIRES CONNECTION TO NEW PRIOR TO COMMENSING WORK.
3. REQUIRED PIPE SIZES ARE SHOWN NEXT TO KEY NOTE.
4. PROVIDE BALL VALVE SHUTOFF AND 12"x12" ACCESS PANEL AT EACH SHOCK ABSORBER (SA). PANEL LOCATION TO BE VERIFIED AND COORDINATED WITH ARCHITECT.
5. ALL CIRCUIT SETTERS SHALL BE SET AT 1.0 GPM UNLESS NOTED OTHERWISE.

KEY NOTES:
(SOME KEY NOTES MAY NOT APPLY TO THIS SHEET)

- 1 SANITARY PIPING UP
- 2 SANITARY PIPING DN
- 3 SANITARY PIPING UP & DN
- 4 GW PIPING UP
- 5 GW PIPING DN
- 6 GW PIPING UP & DN
- 7 SANITARY VENT UP
- 8 SANITARY VENT DN
- 9 SANITARY VENT UP & DN
- 10 CW PIPING UP
- 11 CW PIPING DN
- 12 CW PIPING UP & DN
- 13 HW PIPING UP
- 14 HW PIPING DN
- 15 HW PIPING UP & DN
- 16 HWC PIPING UP
- 17 HWC PIPING DN
- 18 HWC PIPING UP & DN
- 19 CW & HW PIPING UP
- 20 CW & HW PIPING DN
- 21 CW & HW PIPING UP & DN
- 22 GAS PIPING UP
- 23 GAS PIPING DN
- 24 GAS PIPING UP & DN
- 25 STORM PIPING UP
- 26 STORM PIPING DN
- 27 STORM PIPING UP & DN
- 28 OVERFLOW PIPING UP
- 29 OVERFLOW PIPING DN
- 30 OVERFLOW PIPING UP & DN
- 31 OVERFLOW PIPING DOWN AND THRU WALL TO DOWNSPOUT NOZZLE +12" AFG
- 32 SANITARY PIPING UP TO PLUMBING FIXTURES
- 33 PIPING UP TO CLEANOUT
- 34 1/2" CW & HW TO EACH LAV/SK
- 35 PIPING UP TO DRAIN
- 36 1/2" CW & HW DOWN TO SHOWER VALVE & 1/2" UP TO SHOWERHEAD

Date	Description
2021.05.19	BP3: GOLDWALK - ISSUE FOR BID AND PERMIT

Seal / Signature



05/18/2021

Project Name

SSRC | BASE AREA IMPROVEMENTS

Project Number

003.7835.000


Description


GOLD WALK - PLUMBING PLAN - LEVEL 03

Scale


1/8" = 1'-0"

1B-P1.203

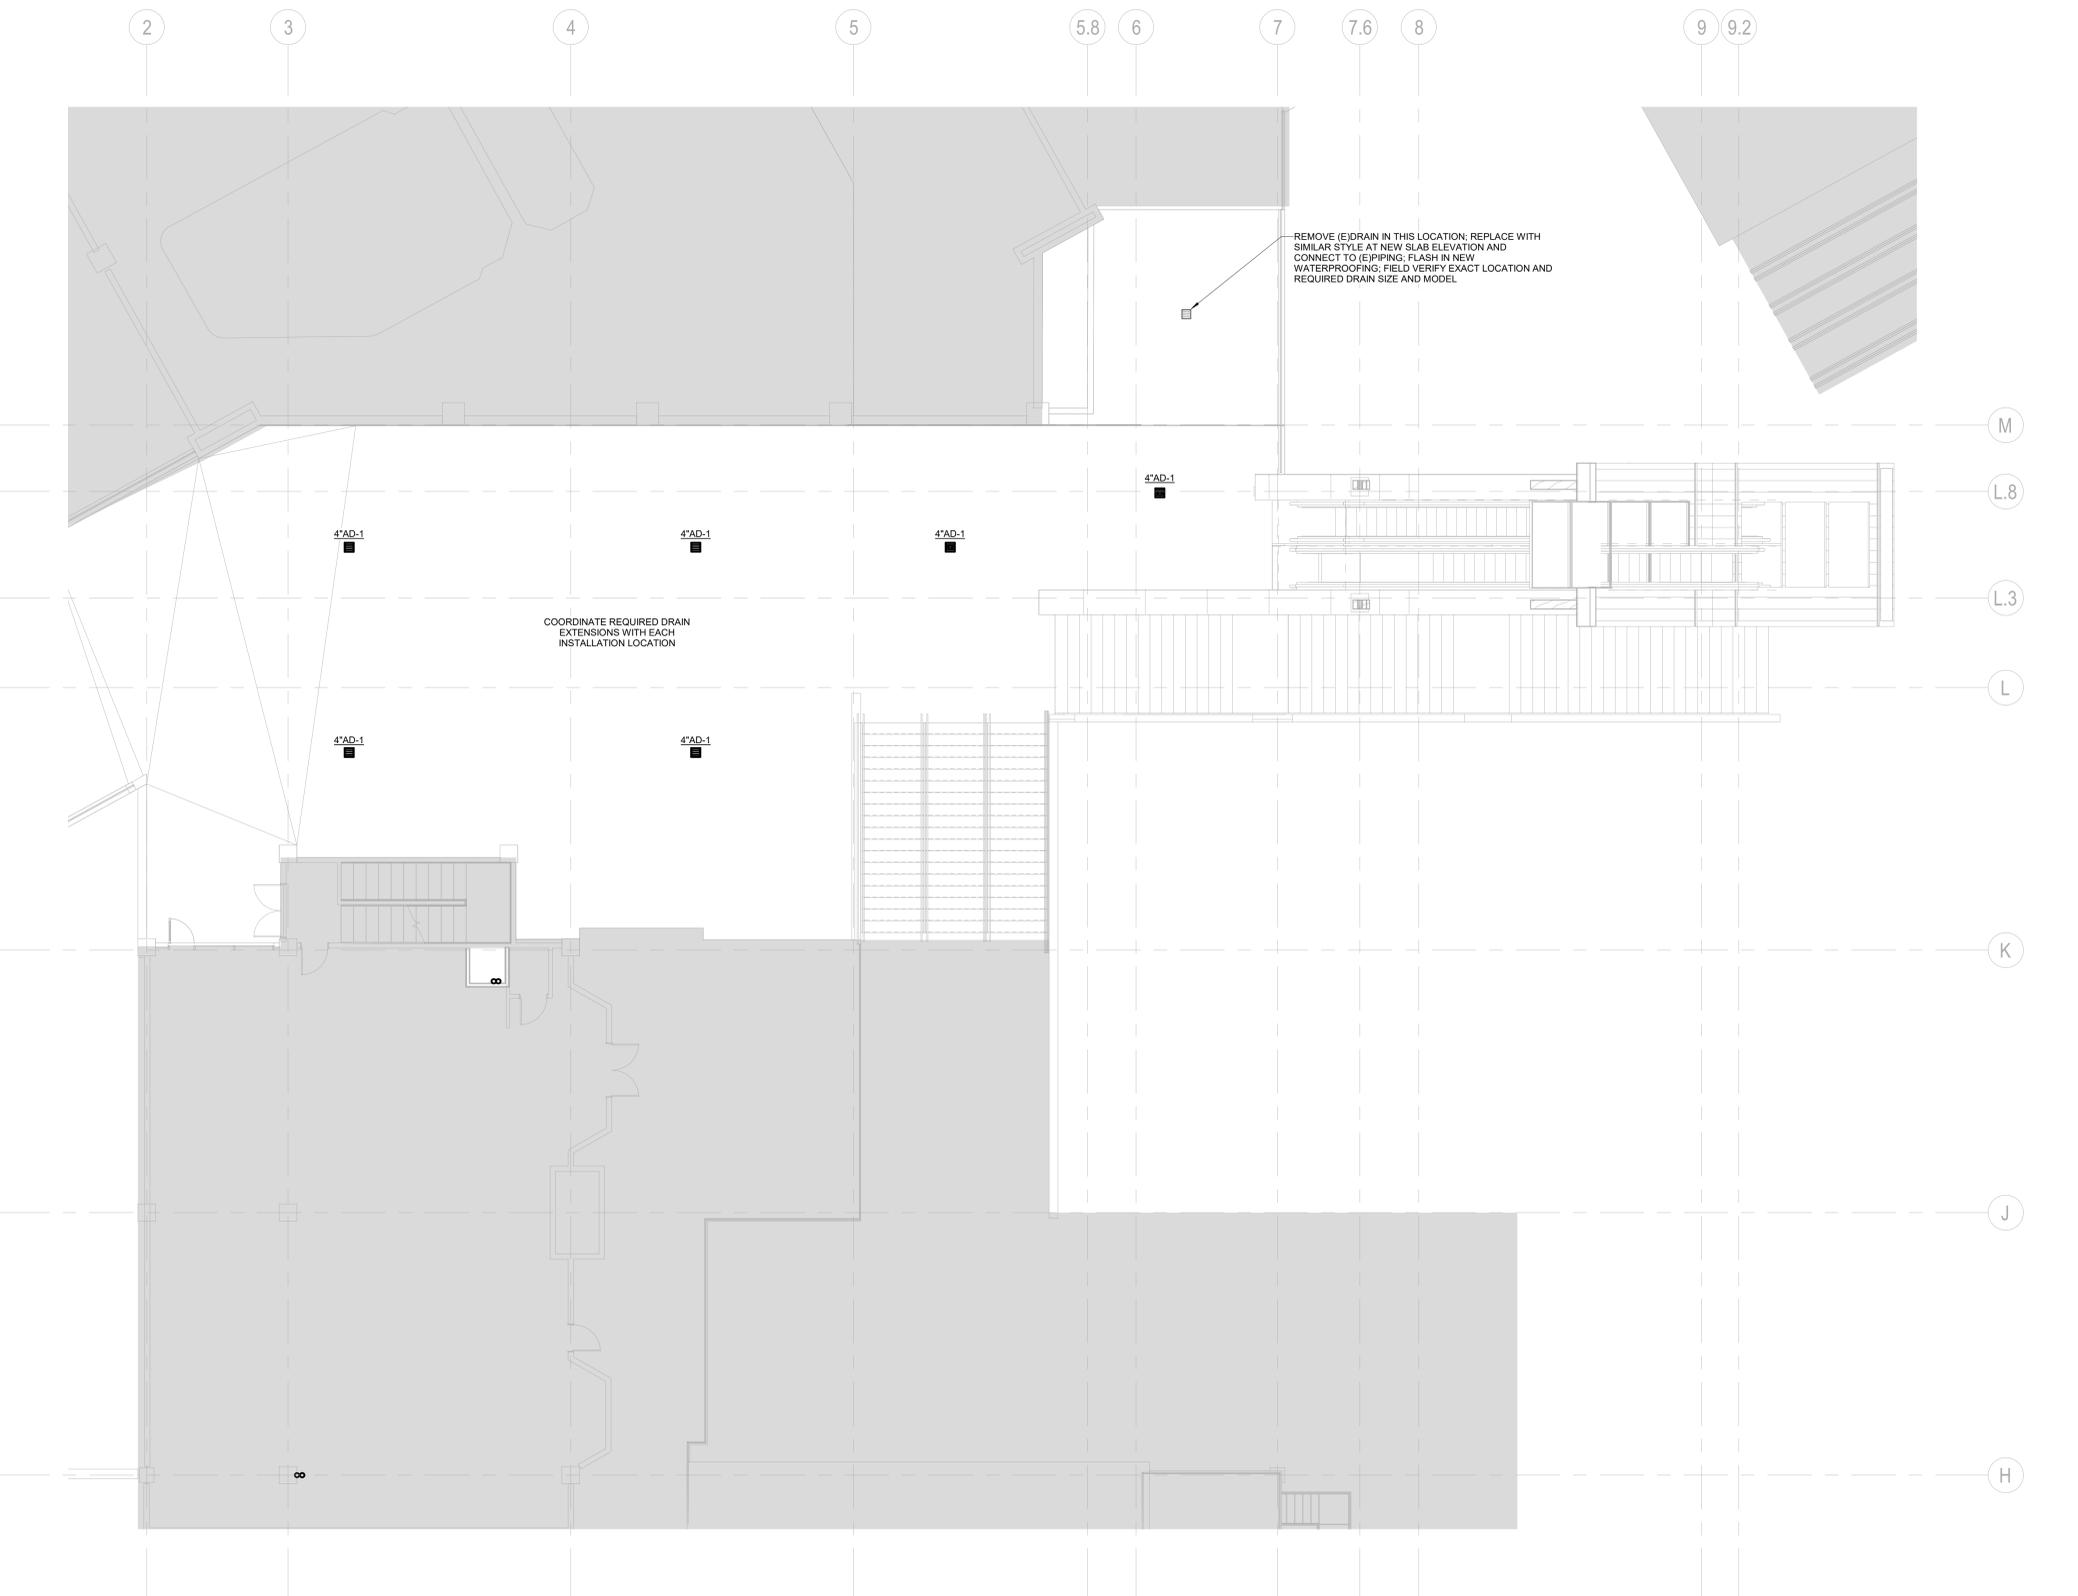


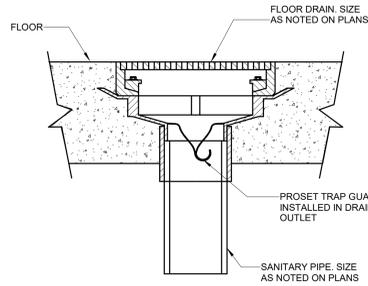


4 TRAP GUARD DETAIL
NO SCALE

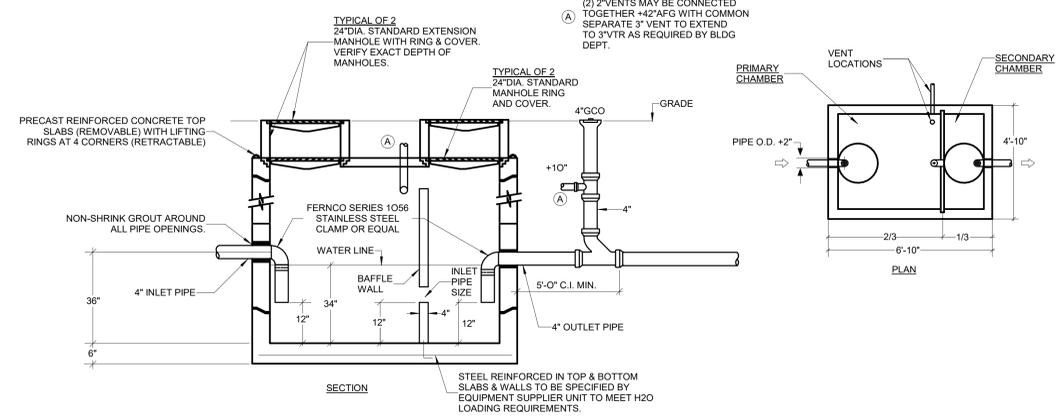


1 TWO COMPARTMENT SAND OIL INTERCEPTOR DETAIL
NO SCALE

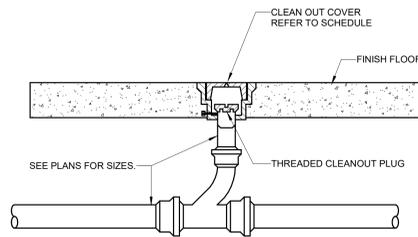


5 FINISHED FLOOR CLEANOUT INSTALLATION
NO SCALE

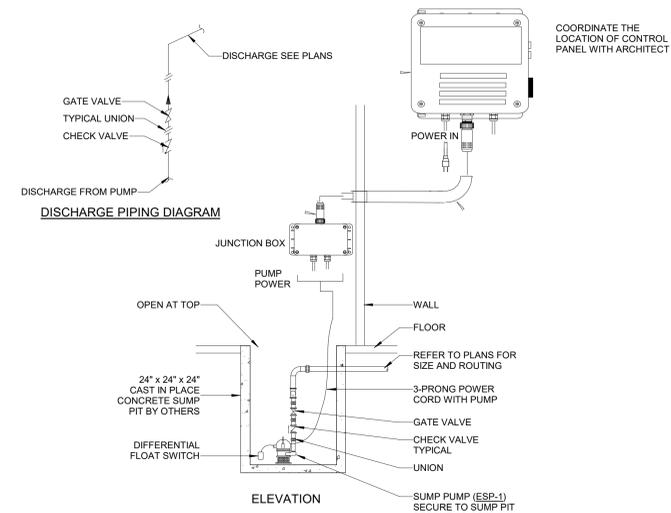


2 ESCALATOR SUMP PUMP DETAIL
NO SCALE

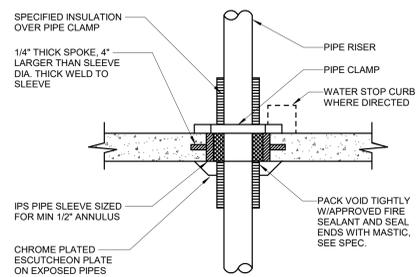

6 PIPE THRU FLOOR SLAB
NO SCALE

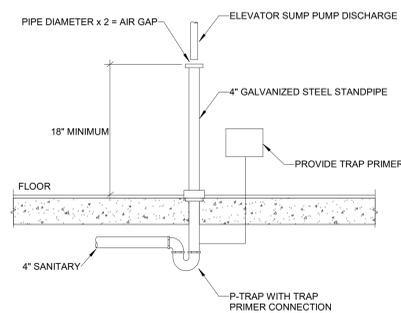

7 STANDPIPE DETAIL
NO SCALE

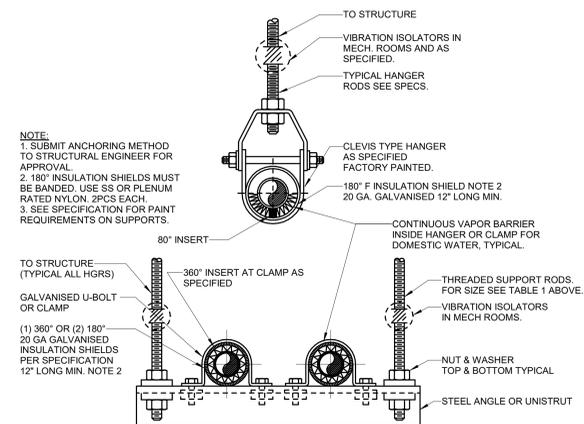

3 DOMESTIC PIPING HANGER DETAIL
NO SCALE

Date	Description
2021.05.19	BP3: GOLDWALK - ISSUE FOR BID AND PERMIT

Seal / Signature



05/18/2021

Project Name

SSRC | BASE AREA IMPROVEMENTS

Project Number

003.7835.000

Description

GOLD WALK - PLUMBING DETAILS

Scale

NO SCALE

1B-P8.000