



---

Ph: 970-871-6772 · Fax: 970-879-8023 · P.O. Box 775966 · Steamboat Springs, Colorado 80477

# Draft Drainage Study & Stormwater Quality Plan for Lot 1 Indian Meadows Hotels Development Plan

Address: TBD

Draft: 12/2/2022

Final:

**Prepared by: Joe Wiedemeier, P.E.  
Four Points Surveying & Engineering**

**P.O. Box 775966  
Steamboat Springs, Colorado 80477  
(970) 871-6772**

---

---

## Table of Contents

<b>1.0 Introduction</b>	1
A. Location	1
B. Owner/Developer	1
C. Drainage Reports for Adjacent Developments	1
D. Stormwater Quality Purpose, Goal, and Special Requirements	1
<b>2.0 Drainage Criteria and Methodology Used</b>	2
A. Design Rainfall and Storm Frequency	2
B. Runoff Calculation Methodology	2
C. Stormwater Quality Design Standard	2
<b>3.0 Existing Conditions</b>	2
A. Ground Cover, Imperviousness, Topography and Size	2
B. Existing Stormwater Systems	2
C. Notable Features	3
D. Site Outfall and Ultimate Outfall Locations	3
E. USDA NRCS Soil Type	3
F. Existing Easements	3
G. FEMA Map Review and Walton Creek Split Flow Analysis	3
<b>4.0 Proposed Conditions</b>	3
A. Ground Cover, Imperviousness, Topography and Size	3
B. Proposed Stormwater Systems	4
C. Outlets: Historic and Proposed Flow	4
D. Hydraulic Calculations	4
E. Major and Minor Flow Summary Table	5
F. Proposed Easements	5
G. Off Site Flows	5
H. Impacts to Downstream Properties	6
I. Potential Site Contaminants	6
J. On-Site Stormwater Flows	6
K. Water Quality Design Standard	6
L. Channels	7
M. Inlets and Stormwater Pipe	7
N. Culverts	8

<b>5.0 Construction Stormwater Management .....</b>	<b>8</b>
<b>6.0 Post Construction Stormwater Management.....</b>	<b>8</b>
<b>7.0 Concluding General Summary .....</b>	<b>8</b>
A.    Compliance.....	8
B.    Historic and Proposed Site Flows .....	8
C.    Proposed New Stormwater System Requirements.....	8
<b>8.0 References .....</b>	<b>9</b>
<b>9.0 Appendices.....</b>	<b>9</b>
A.    Existing Conditions Drainage Exhibit, DR1 .....	9
B.    Proposed Conditions Drainage Exhibit, DR2 .....	9
C.    USDA NRCS Web Soil Survey .....	9
D.    Basin Runoff Calculations .....	9
E.    BMP Design Spreadsheet Calculations for TSS .....	9
F.    Channel Flow Calculations.....	9
G.    Inlet Capacity Curves .....	9
H.    Storm Sewer Capacity Calculations and EGL/HGL profiles.....	9
I.    Standard forms No. 3, 4, & 5.....	9
J.    Project Design Sheets .....	9
K.    Operation and Maintenance Plan for Stormwater BMPs and Conveyance Network .....	9

NOTE

City of Steamboat Springs plan review and approval is only for general conformance with City design criteria and City code. The City is not responsible for the accuracy and adequacy of the design, dimensions, and elevations that shall be confirmed and correlated at this job site. The City of Steamboat Springs assumes no responsibility for the completeness or accuracy of this document.

CERTIFICATION

I hereby affirm that this Drainage Report for the (name of project) was prepared by me (or under my direct supervision) for the owners thereof and is, to the best of my knowledge, in accordance with the provisions of the City of Steamboat Springs Storm Drainage Criteria and approved variances. I understand that the City of Steamboat Springs does not and will not assume liability for drainage facilities designed by others.

\_\_\_\_\_  
Joe Wiedemeier, P.E.  
State of Colorado No. 0054959  
Date: \_\_\_\_\_




## 1.0 Introduction

This report provides a detailed analysis of existing and proposed post-development drainage conditions and proposed water quality facilities for the development at Lot 1 Indian Meadows. The proposed development consists of two commercial lodging facilities or hotels and all associated infrastructure. This report includes all data, engineering methods, assumptions, and calculations used by Four Points Surveying and Engineering (Four Points) to design the stormwater drainage system for the Project. Four Points prepared this report and performed engineering for the Project in accordance with the most recent version of the City of Steamboat Springs Drainage Criteria and Engineering Standards.

### A. Location

*Figure 1: Vicinity Map – Lot 1 Indian Meadows*

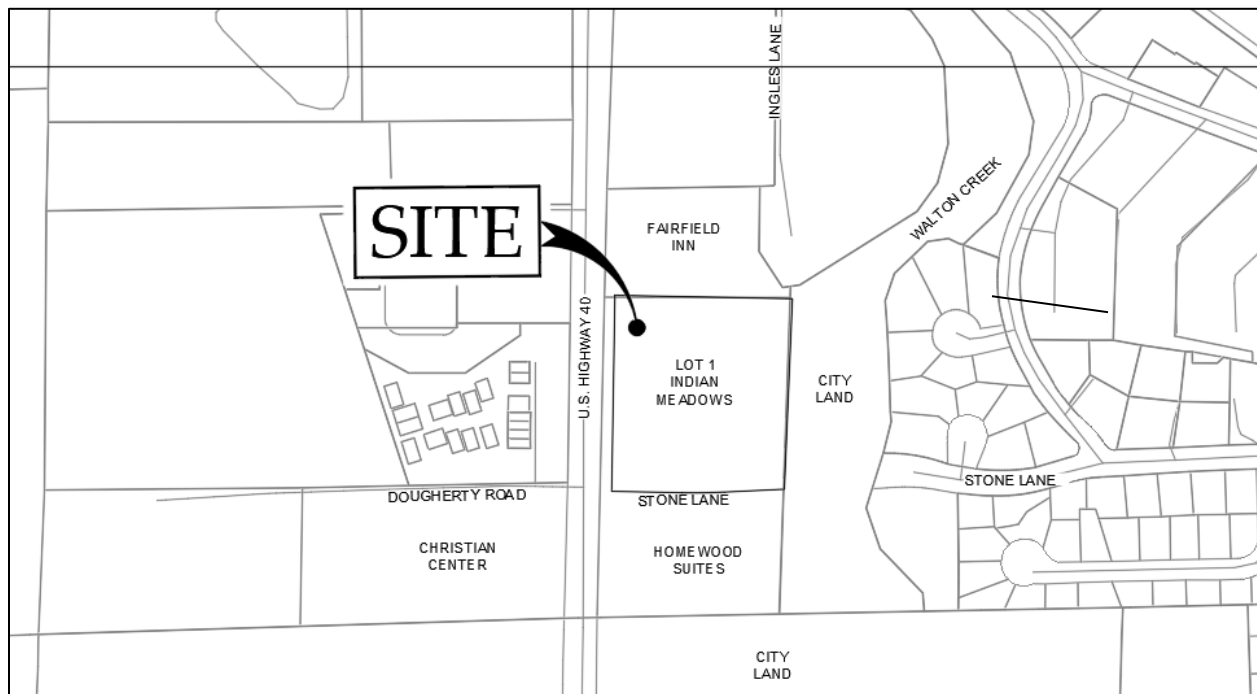

### B. Owner/Developer

Gray Stone, LLC (Bob Amin)

### C. Drainage Reports for Adjacent Developments

Homewood Suites Hotel Final Drainage Study Report, March 2006. Owen Consulting Group, Inc. Larry C. Owen, P.E.

### D. Stormwater Quality Purpose, Goal, and Special Requirements

The purpose of the stormwater quality plan is to design a conveyance and treatment system that fits with the proposed Project and provides both functionality and aesthetics. Water quality

treatment facilities were incorporated across the development and into the landscaping. The goal is to treat stormwater runoff from the developed impervious areas per City standards while maintaining a natural and aesthetically pleasing appeal.

## **2.0 Drainage Criteria and Methodology Used**

### **A. Design Rainfall and Storm Frequency**

Design rainfall: NOAA Atlas 14, Volume 8, Version 2 for Steamboat Springs, CO.

- Minor Event (5-year) 24-hour rainfall depth: 1.59 inches
- Major Event (100-year) 24-hour rainfall depth: 2.91 inches

### **B. Runoff Calculation Methodology**

Runoff calculation method: Small basin peak flow runoff was analyzed using the Rational Method, shown in Eq-1.

$$\text{Rational Method: } Q = CiA \quad (\text{Eq-1})$$

Where:

- Q = runoff, CFS
- C = runoff coefficient, dimensionless
- i = rainfall intensity, inches per hour
- A = basin area, acres

### **C. Stormwater Quality Design Standard**

Proposed permanent stormwater treatment facilities will meet total suspended solids (TSS) design standards. TSS calculations were performed for grass buffers, grass lined water quality swales, and rain gardens (bioretention) per City drainage engineering standards.

## **3.0 Existing Conditions**

### **A. Ground Cover, Imperviousness, Topography and Size**

- Vacant Lot with bare ground, native grasses, and wetlands vegetation
- 24-foot-wide paved vehicle access and 8-foot-wide pedestrian sidewalk to Fairfield Inn
- 5-10% imperviousness
- Flat to gentle sloping terrain, 5% slopes max
- Total lot size: 3.875 acres

### **B. Existing Stormwater Systems**

Refer to the existing conditions drainage exhibit and existing drainage basin designations. Drainage from EB1 (the portion of the lot to be developed) generally sheet flows west to east across Lot 1. A low spot in the northeast corner appears to be the only defined outfall point. Wetlands are present along much of the eastern property line. No stormwater infrastructure is located within EB1. EB2 generally sheet flows east to west and into the US 40 roadside ditch and wetlands. Flows between EB1 and EB2 are generally split by the existing Fairfield Inn access road. EB3 primarily consists of the Stone Lane right-of-way. Flows are directed into curb and gutter conveyance and into the Homewood Suites stormwater collection network to the south.

**C. Notable Features**

- Floodplain - FEMA Zone A (100-year base flood)
- Wetlands present

**D. Site Outfall and Ultimate Outfall Locations**

EB1 outfalls into Walton Creek and ultimately the Yampa River.

**E. USDA NRCS Soil Type**

A USDA NRCS Web Soil Survey was performed to determine basic soil characteristics within the project area. Soil types include:

- Slocum Loam → Hydrologic Soil Group Rating: B/D
- Venable → Hydrologic Soil Group Rating: B/D

**F. Existing Easements**

See existing conditions drainage exhibit for existing easements. There are no dedicated drainage easements within EB1.

**G. FEMA Map Review and Walton Creek Split Flow Analysis.**

FEMA flood map No. 08107C0883D effective 2/4/2005 was reviewed. Lot 1 is partially located within a FEMA designated floodplain AKA a special flood hazard area (SFHS) with designation Zone AE. Base flood elevations were revised and indicated on the drainage exhibits based on the Hampton Inn and Holiday Inn Express Walton Creek HEC-RAS Split Flow Model Analysis report by Wohnrade Civil Engineers, Inc. April 22, 2022. The report concludes that proposed development in the floodplain SFHA will not increase base flood elevations within Walton Creek and the surrounding area.

**4.0 Proposed Conditions**

Proposed development is two commercial lodging facilities or Hotels and all associated infrastructure including but not limited to: access roads, parking lots, stormwater conveyance, stormwater treatment, open spaces areas, and utilities. The hotels are designated as a Holiday Inn Express and Hotel B (yet to be named). The proposed development is typical of that of surrounding lodging facilities located along the east side of US 40 including Homewood Suites, Storm Peak Apartments, and Holiday Inn.

**A. Ground Cover, Imperviousness, Topography and Size**

- Total area of development is approximately 3.0 acres.
- Finished ground cover will consist of paving, multi-story hotels, landscaping, gravel, stone, and both maintained and unmaintained grasses.
- The proposed grading scheme will direct surface runoff to the proposed stormwater treatment BMPs which consist of rain gardens, grass buffers and water quality swales.
- Impervious area: 69% (on average).
- Area to be treated: 3.10 acres
- Impervious area to be treated: 2.14 acres

## B. Proposed Stormwater Systems

Stormwater swales, rain garden basins, valley pans, curb & gutter, stormwater inlets and stormwater piping will collect and convey all runoff to the historical outfall point identified as design point No. 1. Sheet flow from the access road and parking lot will be conveyed to one of the permanent water quality treatment BMPs that drain into the private stormwater collection network. The stormwater collection network shall consist of Nyloplast inlets connected via smooth wall PVC or HDPE stormwater pipe. No public stormwater infrastructure is proposed.

Runoff from the Storm Peak Apartments shall be conveyed and collected into the proposed rain gardens where runoff will infiltrate into the ground. The westerly area shall be designated as a grass buffer to treat snowmelt from the snow storage.

Energy grades lines (EGL) and hydraulic grade lines (HGL) were developed for each run of storm sewer to analyze surcharging conditions under the minor and major event flows. The stormwater collection network was designed to handle the minor event without surcharging the system, and will effectively convey the major event without overflowing the water quality swales.

Pipe velocities were analyzed for standards conformance. Storm sewer velocities were analyzed for the major event. Pipe velocity was found to be within the required standards. See Appendix K for a summary table of pipe flow velocities.

A temporary 24-inch diameter CMP culvert may be used to convey flows from hotel and parking lot areas as this area will be undeveloped and require drainage across the new access road. This road will essentially act as a levee, holding back runoff from the lot until the parking lot is constructed with infill and associated drainage improvements and water quality features.

During and following the phase 1 construction of the Holiday Inn Express, the site will be raised and create ponding at a low point. It is proposed that this collection point of water be outfitted with a temporary sedimentation basin, submersible pump and sump area to pump stormwater across the access road. This temporary measure will need to be inspected and maintained regularly and shall be treated as a construction temporary control measure.

## C. Outlets: Historic and Proposed Flow

SB1 will outfall into the grass lined buffer along the east side of the access road. Flows from sub-basins associated with the west side of the access road, the parking lot, and hotels will receive stormwater quality treatment and then enter the storm sewer network and outfall at design point No. 1. Runoff associated with the modified existing access to Storm Peak Apartments shall receive stormwater quality treatment via the rain gardens and infiltrate directly into the ground. Runoff associated with the snow storage area along the west side of the property shall receive stormwater quality treatment via the grass buffer and outfall into the US Highway 40 roadside ditch and wetlands area.

## D. Hydraulic Calculations

- Inlet capacity was analyzed using manufacturer capacity curves,

- Conveyance piping was analyzed with AutoCAD Storm Sewers software,
- and drainage swales and the temporary culvert crossing were analyzed using AutoCAD Hydroflow Express software.

#### E. Major and Minor Flow Summary Table

Existing and proposed drainage was analyzed by dividing the lot into existing basins (e.g. EB1) and sub-basins (e.g. SB1). Major and minor flows for each basin are summarized in the following table, Table 1.

*Table 1: Major and Minor Flow Summary Table*

Basin Condition	Area (acres)	Impervious Area (%)	Runoff	
			Q <sub>5</sub> (cfs)	Q <sub>100</sub> (cfs)
<b>EB1</b>	2.96	5%	0.86	5.34
<b>EB2</b>	1.14	15%	0.37	4.67
<b>EB3</b>	0.30	67%	0.32	1.50
<b>SB1</b>	0.30	48%	0.24	1.46
<b>SB2</b>	0.35	80%	0.65	1.68
<b>SB3</b>	0.38	74%	0.64	1.75
<b>SB4</b>	0.40	68%	0.54	1.53
<b>SB5</b>	0.23	91%	0.58	1.41
<b>SB6</b>	0.08	88%	0.19	0.47
<b>SB7</b>	0.12	84%	0.28	0.71
<b>SB8</b>	0.23	79%	0.44	1.15
<b>SB9</b>	0.30	84%	0.61	1.56
<b>SB10</b>	0.35	70%	0.49	1.36
<b>SB11</b>	0.16	88%	0.43	1.06
<b>SB12</b>	0.20	90%	0.56	1.36
<b>SB13</b>	0.37	10%	0.17	0.93
<b>SB14</b>	0.35	10%	0.16	0.88

#### F. Proposed Easements

Drainage easements are proposed for all permanent water quality treatment BMPs. The drainage easements shall be accessible from the proposed 24-foot-wide new access to the hotels and 30-foot-wide shared access easement. Additionally, drainage easements along the west side of the hotels shall be accessible from the existing Storm Peak Apartments access road and easement.

#### G. Off Site Flows

No significant off-site flows exist.

#### H. Impacts to Downstream Properties

There are no anticipated impacts to downstream properties due to the proposed development. Please reference *Summary of Preliminary Findings for Hampton Inn and Holiday Inn Express Walton Creek HEC-RAS Split Flow Analysis* provided as part of the development plan package.

#### I. Potential Site Contaminants

- Sediment, sand, grit, and salts,
- Vehicular pollutants (Oils, antifreeze, carbon deposits, etc.),
- Fertilizers, nutrients, pesticides, and herbicides.

#### J. On-Site Stormwater Flows

On site flows will originate primarily from the cross access road, parking lot, paved walkways, and the hotel rooftops. Flows shall be managed as designed and depicted in the proposed conditions drainage exhibit.

#### K. Water Quality Design Standard

The TSS design standards were used for the water quality swale designs and the WQCV design standards were used for the rain gardens. TSS removal was determined using the City's prescribed method. Table 2, Table 3, and Table 4 below outline the design variables for the water quality swales, rain gardens, and grass buffers; respectively.

*Table 2: Water Quality Swale Design Variables*

Water Quality Feature Design Variables	SB2	SB8
	1.25 year	1.25 year
Design Event	1.25 year	1.25 year
Total Area Treated (acres)	0.35	0.23
Imperviousness of Area Treated	80%	80%
C Values of Area Treated	0.60	0.58
Hydrologic Soil Types of Treatment Area	B	B
Design Treatment Area (ft <sup>2</sup> )	200	150
Design Flow Rate (cfs)	0.29	0.19
Design Velocity (ft/sec)	(See appendix)	(See appendix)

Table 3: Rain Garden Design Variables

Water Quality Feature Design Variables	SB3	SB5	SB6	SB7	SB9	SB11	SB12
Design Event	1.25 yR	1.25 yr	1.25 yr	1.25 yr	1.25 yr	1.25 yr	1.25 yr
Total Area Treated (acres)	0.38	0.23	0.08	0.12	0.30	0.16	0.20
Imperviousness of Area Treated	74%	91%	88%	84%	84%	90%	90%
C Values of Area Treated	0.53	0.75	0.69	0.64	0.64	0.69	0.73
Hydrologic Soil Types of Treatment Area	B	B	B	B	B	B	B
Design Treatment Area (ft <sup>2</sup> )	300	150	200	250	100	200	200
Design Flow Rate (cfs)	0.28	0.26	0.09	0.13	0.18	0.19	0.25

Table 4: Grass Buffer Design Variables

Water Quality Feature Design Variables	SB1	SB13	SB14
Design Event	1.25 year	1.25 year	1.25 year
Total Area Treated (acres)	0.30	0.37	0.35
Imperviousness of Area Treated	50%	10%	10%
C Values of Area Treated	0.32	0.11	0.11
Hydrologic Soil Types of Treatment Area	B	B	B
Design Treatment Area (ft <sup>2</sup> )	3,200	3,000	3,500
Design Flow Rate (cfs)	0.17	0.04	0.04

#### L. Channels

Drainage swales and the stormwater quality swales shall be utilized to convey and treat surface runoff from the access road and parking lot. All drainage swales shall be capable of conveying the major event peak flow rate. See appendices for drainage swale flow calculations.

#### M. Inlets and Stormwater Pipe

Nyloplast inlets with dome are proposed to collect stormwater flows from gutters, swales, and valley pans throughout the site. Each inlet has the capacity to capture the minor storm event with 100% efficiency. Major events may cause ponding within the swales and rain gardens, however there is minimal threat of over inundation and the occurrence of such is minimal. Dome inlets are proposed to limit clogging that is commonly associate with flat area inlets.

#### **N. Culverts**

A temporary 24” circular CMP culvert crossing shall be installed with the new cross access road construction parallel to the permanent storm sewer crossing. This culvert will remain until the parking lot construction is completed.

#### **5.0 Construction Stormwater Management**

The contractor and owner shall be required to obtain a state general permit for the discharge of construction site stormwater associated with the approximate 3.0 acres of development. The contractor shall be responsible for obtaining this permit prior to construction.

A detailed stormwater management plan prepared by a Colorado professional engineer shall be required for all phases construction. The stormwater management plan should take into account the changing topography and conditions of the site throughout the construction process.

Lastly, it should be emphasized that Lot 1 discharges into delineated wetlands on City property that leads directly into Walton Creek a few hundred feet downstream of design point No. 1. This is a sensitive area and temporary stormwater control measures shall be properly implemented, inspected, and maintained throughout the entire construction phase and until at least 80% of final revegetation is achieved for the site.

#### **6.0 Post Construction Stormwater Management**

See Operation and Maintenance Plans provided in the appendices.

#### **7.0 Concluding General Summary**

Approximately 3.0 acres of land are proposed for development of two commercial hotel establishments. Existing drainage patterns will be changed due to the extent of development but the historic outfall points will be maintained under the proposed conditions. Permanent drainage features for the Project include a combination of sheet flow, channel flow, stormwater BMPs and a stormwater collection and conveyance network to manage stormwater runoff. Treated stormwater runoff will be discharged onto City Land in the northeast corner of the existing Lot 1 Indian Meadows that leads to Walton Creek via wetland drainage ways. All parking lot and access roads of the development will receive water quality treatment via the water quality swales, rain gardens, and grass buffers.

#### **A. Compliance**

The proposed stormwater drainage system complies with City Drainage Criteria.

#### **B. Historic and Proposed Site Flows**

Peak proposed flows will be higher than historic peak flows. However, flows from the site immediately discharge into the Walton Creek floodplain and the increase in peak flow does not affect surrounding base flood elevations. Therefore, detention is not required.

#### **C. Proposed New Stormwater System Requirements**

The proposed stormwater system shall effectively convey and treat all flows on site with proper installation and maintenance.



## **8.0 References**

*Urban Drainage and Flood Control District Criteria Manual, 2018.*

*NOAA Precipitation Frequency Server. NOAA Atlas 14, Volume 8, Version 2. [www.NOAA.com](http://www.NOAA.com)*

*City of Steamboat Springs Engineering Drainage Criteria, Latest Version.*

*Summary of Preliminary Findings for the Hampton Inn and Holiday Inn Express – Walton Creek HEC-RAS Split Flow Analysis. Wohnrade Civil Engineers Inc., Mary B. Wohnrade, P.E.*

## **9.0 Appendices**

- A. Existing Conditions Drainage Exhibit, DR1
- B. Proposed Conditions Drainage Exhibit, DR2
- C. USDA NRCS Web Soil Survey
- D. Basin Runoff Calculations
- E. BMP Design Spreadsheet Calculations for TSS
- F. Channel Flow Calculations
- G. Inlet Capacity Curves
- H. Storm Sewer Capacity Calculations and EGL/HGL profiles
- I. Standard forms No. 3, 4, & 5
- J. Project Design Sheets
- K. Operation and Maintenance Plan for Stormwater BMPs and Conveyance Network

**Appendix A: Existing Conditions Drainage Exhibit, DR1**








# National Flood Hazard Layer FIRMette



106°49'15"W 40°26'54"N

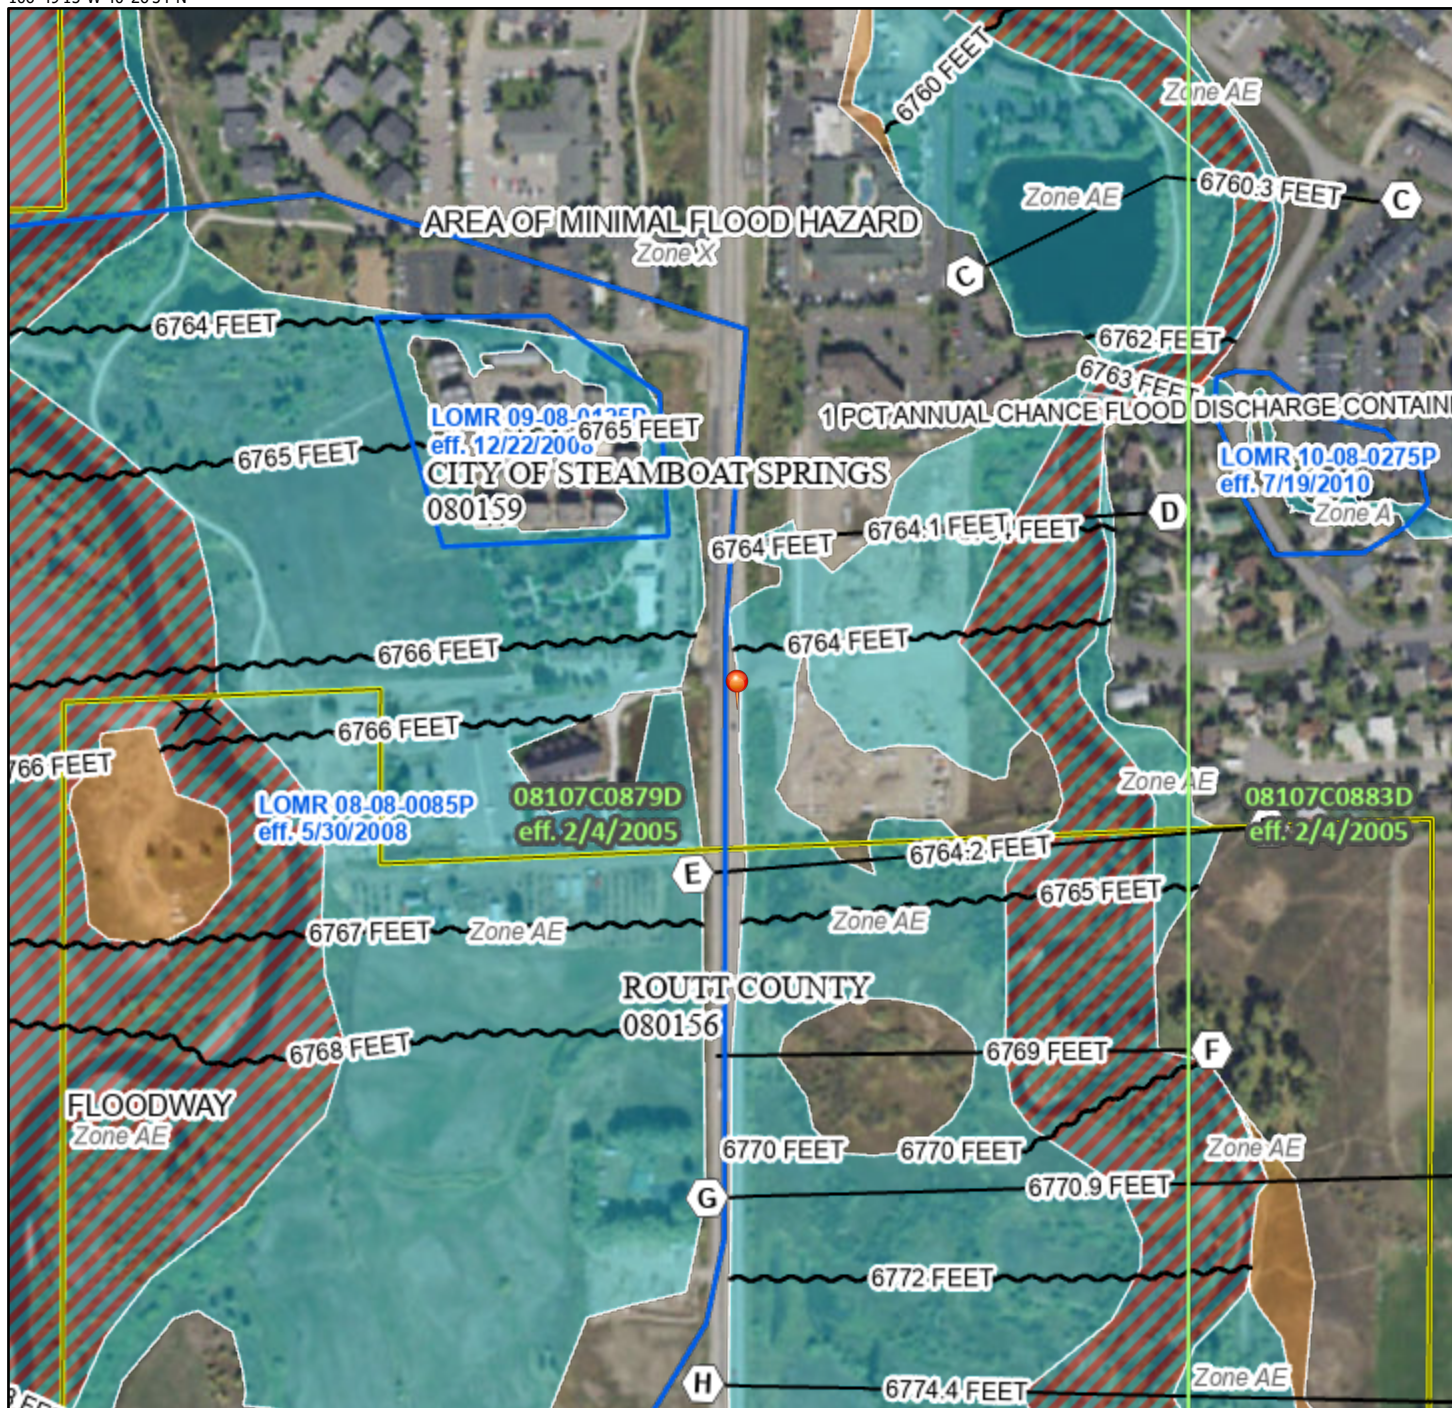

0 250 500 1,000 1,500 2,000 Feet

1:6,000

106°48'38"W 40°26'26"N

Basemap: USGS National Map: Orthoimagery: Data refreshed October, 2020

## Legend

SEE FIS REPORT FOR DETAILED LEGEND AND INDEX MAP FOR FIRM PANEL LAYOUT

SPECIAL FLOOD HAZARD AREAS		Without Base Flood Elevation (BFE) Zone A, V, A99
		With BFE or Depth Zone AE, AO, AH, VE, AR
		Regulatory Floodway
OTHER AREAS OF FLOOD HAZARD		0.2% Annual Chance Flood Hazard, Areas of 1% annual chance flood with average depth less than one foot or with drainage areas of less than one square mile Zone X
		Future Conditions 1% Annual Chance Flood Hazard Zone X
		Area with Reduced Flood Risk due to Levee. See Notes. Zone X
		Area with Flood Risk due to Levee Zone D
OTHER AREAS		NO SCREEN Area of Minimal Flood Hazard Zone X
		Effective LOMRs
GENERAL STRUCTURES		Area of Undetermined Flood Hazard Zone D
		Channel, Culvert, or Storm Sewer
		Levee, Dike, or Floodwall
OTHER FEATURES		20.2 Cross Sections with 1% Annual Chance Water Surface Elevation
		17.5
		Coastal Transect
		Base Flood Elevation Line (BFE)
		Limit of Study
		Jurisdiction Boundary
MAP PANELS		Coastal Transect Baseline
		Profile Baseline
		Hydrographic Feature
		Digital Data Available
		No Digital Data Available
		Unmapped



The pin displayed on the map is an approximate point selected by the user and does not represent an authoritative property location.

This map complies with FEMA's standards for the use of digital flood maps if it is not void as described below. The basemap shown complies with FEMA's basemap accuracy standards

The flood hazard information is derived directly from the authoritative NFHL web services provided by FEMA. This map was exported on 7/13/2021 at 10:50 AM and does not reflect changes or amendments subsequent to this date and time. The NFHL and effective information may change or become superseded by new data over time.

This map image is void if the one or more of the following map elements do not appear: basemap imagery, flood zone labels, legend, scale bar, map creation date, community identifiers, FIRM panel number, and FIRM effective date. Map images for unmapped and unmodernized areas cannot be used for regulatory purposes.


**Appendix B: Proposed Conditions Drainage Exhibit, DR2**



C:\PFS\BNC\B

PLOT DATE: 12/6/2022 5:08 PM

DRAWING FILE: F:\1448-005 LOT 1 INDIAN MEADOWS F3 HOTELS\VFSE\DRAWING\1448-005 PROPOSED CONDITIONS DRAINAGE.DWG

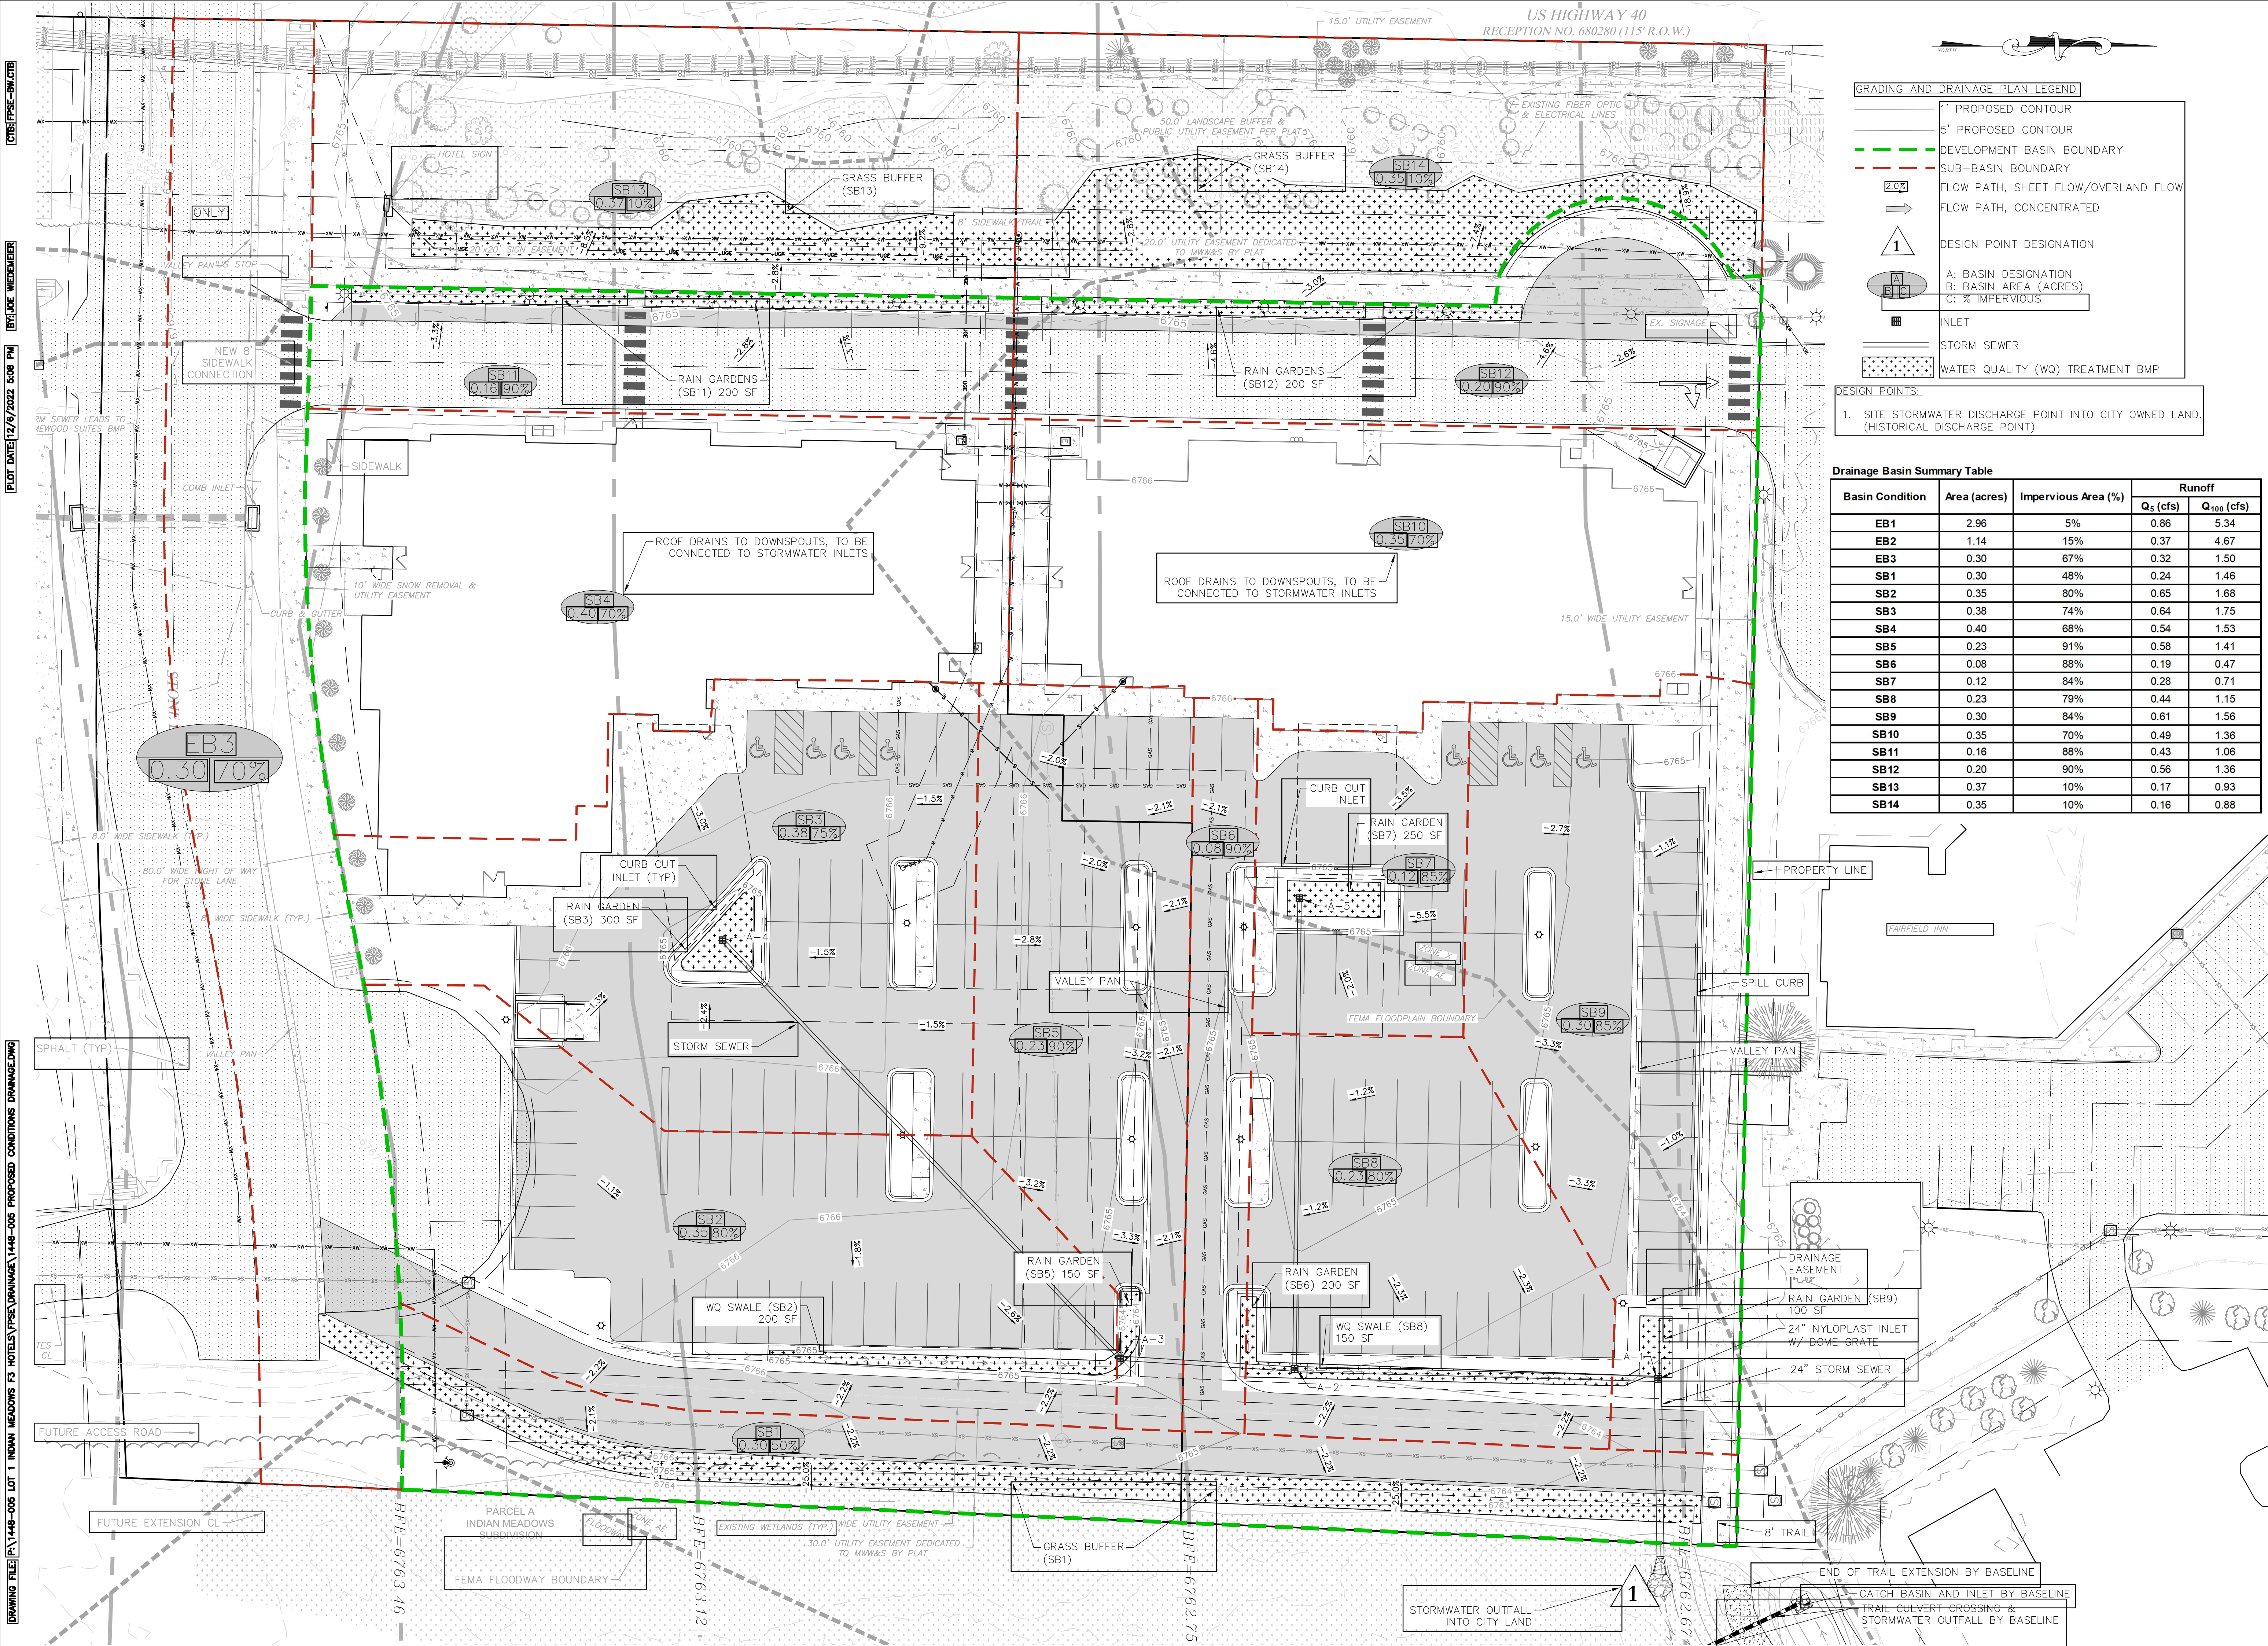

#### GRADING AND DRAINAGE PLAN LEGEND


- 1' PROPOSED CONTOUR
- 5' PROPOSED CONTOUR
- DEVELOPMENT BASIN BOUNDARY
- SUB-BASIN BOUNDARY
- 2.0% FLOW PATH, SHEET FLOW/OVERLAND FLOW
- 1.0% FLOW PATH, CONCENTRATED
- DESIGN POINT DESIGNATION
- A: BASIN DESIGNATION
- B: BASIN AREA (ACRES)
- C: % IMPERVIOUS
- INLET
- STORM SEWER
- WATER QUALITY (WQ) TREATMENT BMP

#### DESIGN POINTS:

1. SITE STORMWATER DISCHARGE POINT INTO CITY OWNED LAND. (HISTORICAL DISCHARGE POINT)

#### Drainage Basin Summary Table

Basin Condition	Area (acres)	Impervious Area (%)	Runoff	
			Q <sub>s</sub> (cfs)	Q <sub>100</sub> (cfs)
EB1	2.96	5%	0.86	5.34
EB2	1.14	15%	0.37	4.67
EB3	0.30	67%	0.32	1.50
SB1	0.30	48%	0.24	1.46
SB2	0.35	80%	0.65	1.68
SB3	0.38	74%	0.64	1.75
SB4	0.40	68%	0.54	1.53
SB5	0.23	91%	0.58	1.41
SB6	0.08	88%	0.19	0.47
SB7	0.12	84%	0.28	0.71
SB8	0.23	79%	0.44	1.15
SB9	0.30	84%	0.61	1.56
SB10	0.35	70%	0.49	1.36
SB11	0.16	88%	0.43	1.06
SB12	0.20	90%	0.56	1.36
SB13	0.37	10%	0.17	0.93
SB14	0.35	10%	0.16	0.88

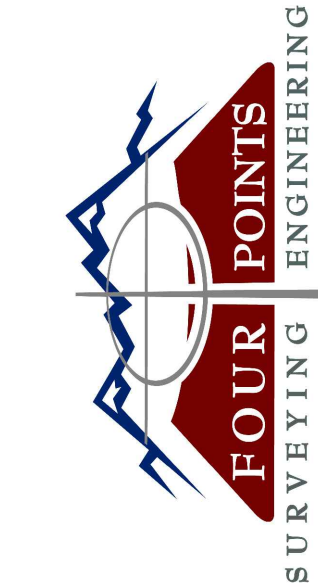

440 S. Lincoln Ave, Suite 4A  
P.O. Box 775966  
Steamboat Springs, CO 80487  
(970)-871-6772  
www.fourpointse.com

NO.	DATE	REVISIONS
1		

LOT 1 INDIAN MEADOWS HOTELS  
LOT 1, INDIAN MEADOWS FILING NO. 3  
STEAMBOAT SPRINGS, CO 80487

#### HORIZONTAL SCALE

0 20' 40'

SCALE: 1" = 20'

CONTOUR INTERVAL = 1 FT

DATE: 11/8/2022

JOB #: 1448-005

DRAWN BY: JLW

DESIGN BY: JLW

REVIEW BY:

IF THIS DRAWING IS PRESENTED IN A  
FORMAT OTHER THAN 24" X 36" THE  
GRAPHIC SCALE SHOULD BE UTILIZED.

GRADING &  
DRAINAGE PLAN

SHEET NO.

DR2



**Appendix C: USDA NRCS Web Soil Survey**




United States  
Department of  
Agriculture

NRCS

Natural  
Resources  
Conservation  
Service

A product of the National  
Cooperative Soil Survey,  
a joint effort of the United  
States Department of  
Agriculture and other  
Federal agencies, State  
agencies including the  
Agricultural Experiment  
Stations, and local  
participants

# Custom Soil Resource Report for Routt Area, Colorado, Parts of Rio Blanco and Routt Counties

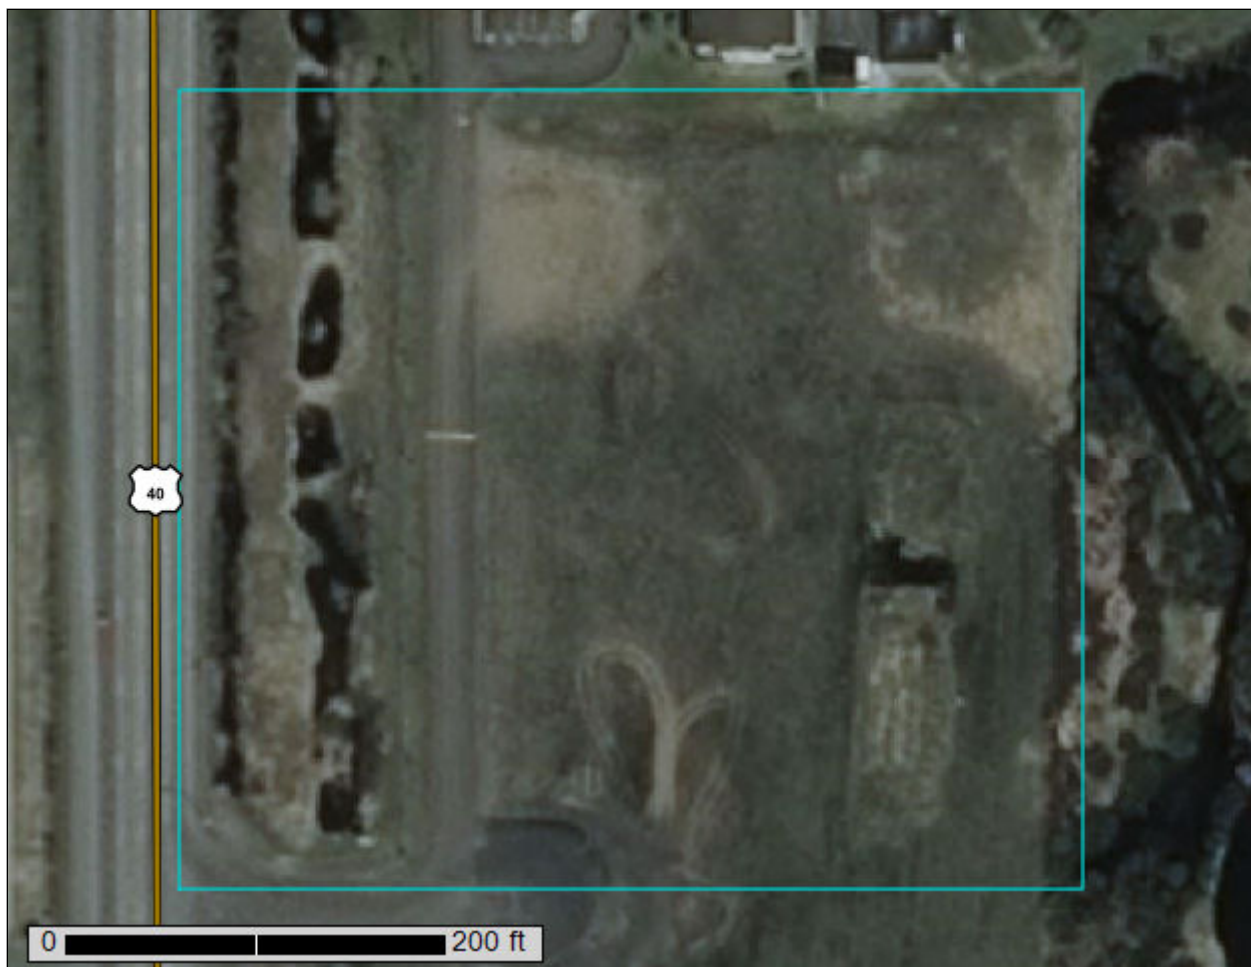



# Custom Soil Resource Report Soil Map



# Custom Soil Resource Report

## MAP LEGEND

### Area of Interest (AOI)

 Area of Interest (AOI)

### Soils

 Soil Map Unit Polygons

 Soil Map Unit Lines

 Soil Map Unit Points

### Special Point Features

 Blowout

 Borrow Pit

 Clay Spot

 Closed Depression

 Gravel Pit

 Gravelly Spot

 Landfill

 Lava Flow

 Marsh or swamp

 Mine or Quarry

 Miscellaneous Water

 Perennial Water

 Rock Outcrop

 Saline Spot

 Sandy Spot

 Severely Eroded Spot

 Sinkhole

 Slide or Slip

 Sodic Spot

 Spoil Area

 Stony Spot

 Very Stony Spot

 Wet Spot

 Other

 Special Line Features

### Water Features

 Streams and Canals

### Transportation

 Rails

 Interstate Highways

 US Routes

 Major Roads

 Local Roads

### Background

 Aerial Photography

## MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service  
Web Soil Survey URL:  
Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Routt Area, Colorado, Parts of Rio Blanco and Routt Counties  
Survey Area Data: Version 11, Sep 2, 2021

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: May 8, 2012—Oct 5, 2017

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background

## Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
25A	Toponas loam, 0 to 3 percent slopes	0.1	1.4%
49A	Slocum loam, gravelly substratum, 0 to 3 percent slopes	2.6	56.4%
AW	Venable, mucky peat, 0 to 3 percent slopes, frequently flooded	1.9	42.2%
<b>Totals for Area of Interest</b>		<b>4.5</b>	<b>100.0%</b>

## Map Unit Descriptions


The map units delineated on the detailed soil maps in a soil survey represent the soils or miscellaneous areas in the survey area. The map unit descriptions, along with the maps, can be used to determine the composition and properties of a unit.

A map unit delineation on a soil map represents an area dominated by one or more major kinds of soil or miscellaneous areas. A map unit is identified and named according to the taxonomic classification of the dominant soils. Within a taxonomic class there are precisely defined limits for the properties of the soils. On the landscape, however, the soils are natural phenomena, and they have the characteristic variability of all natural phenomena. Thus, the range of some observed properties may extend beyond the limits defined for a taxonomic class. Areas of soils of a single taxonomic class rarely, if ever, can be mapped without including areas of other taxonomic classes. Consequently, every map unit is made up of the soils or miscellaneous areas for which it is named and some minor components that belong to taxonomic classes other than those of the major soils.

Most minor soils have properties similar to those of the dominant soil or soils in the map unit, and thus they do not affect use and management. These are called noncontrasting, or similar, components. They may or may not be mentioned in a particular map unit description. Other minor components, however, have properties and behavioral characteristics divergent enough to affect use or to require different management. These are called contrasting, or dissimilar, components. They generally are in small areas and could not be mapped separately because of the scale used. Some small areas of strongly contrasting soils or miscellaneous areas are identified by a special symbol on the maps. If included in the database for a given area, the contrasting minor components are identified in the map unit descriptions along with some characteristics of each. A few areas of minor components may not have been observed, and consequently they are not mentioned in the descriptions, especially where the pattern was so complex that it was impractical to make enough observations to identify all the soils and miscellaneous areas on the landscape.

The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The objective of mapping is not to delineate

Custom Soil Resource Report  
Map—Hydrologic Soil Group

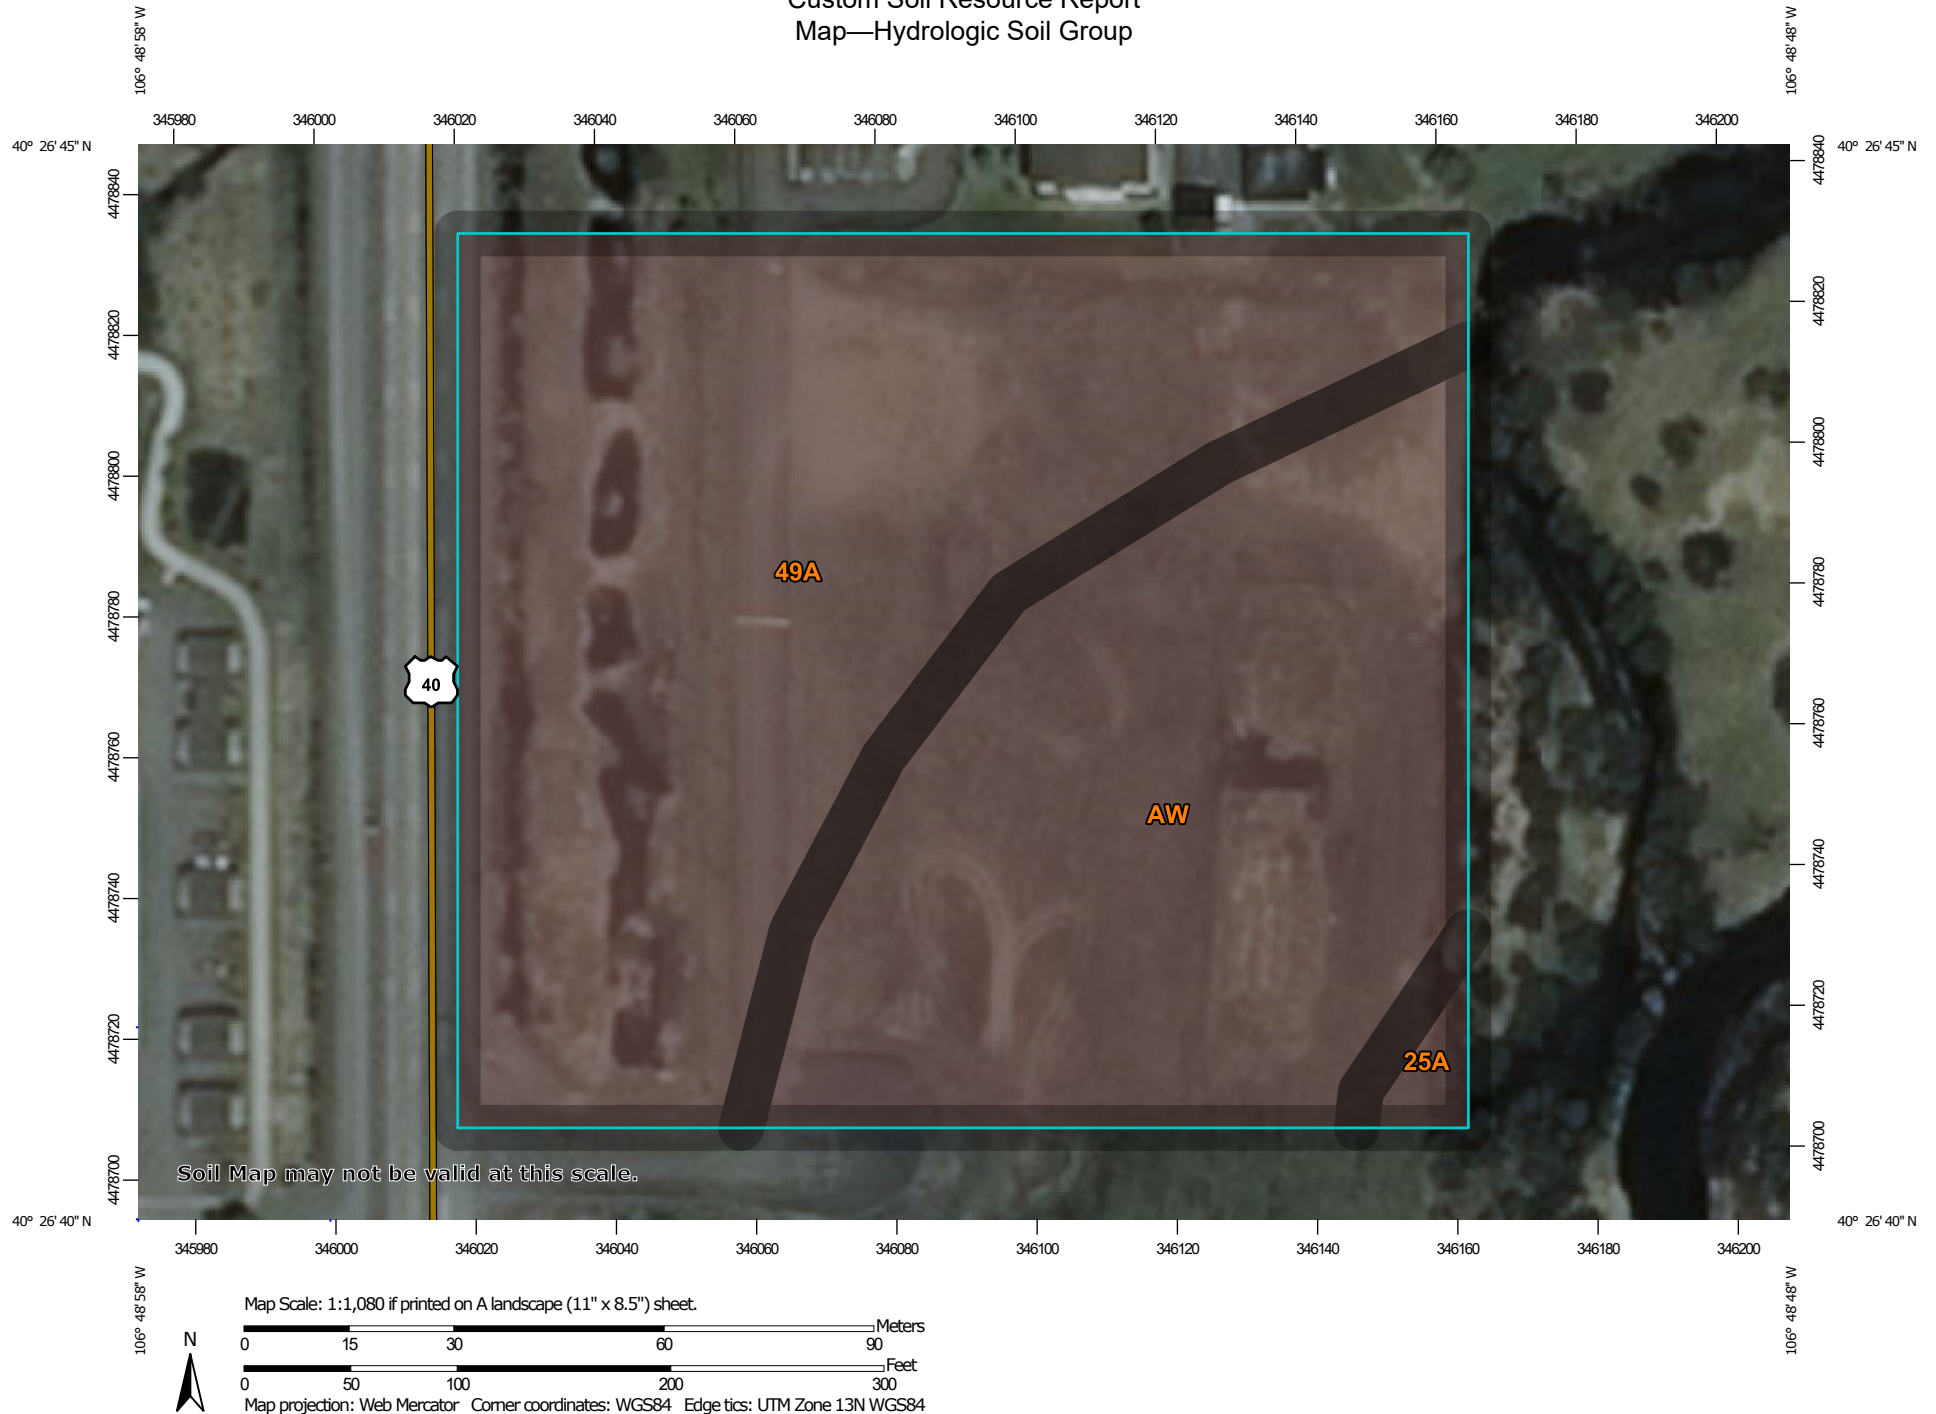

**Table—Hydrologic Soil Group**

Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
25A	Toponas loam, 0 to 3 percent slopes	B/D	0.1	1.4%
49A	Slocum loam, gravelly substratum, 0 to 3 percent slopes	B/D	2.6	56.4%
AW	Venable, mucky peat, 0 to 3 percent slopes, frequently flooded	B/D	1.9	42.2%
<b>Totals for Area of Interest</b>			<b>4.5</b>	<b>100.0%</b>

**Rating Options—Hydrologic Soil Group***Aggregation Method: Dominant Condition**Component Percent Cutoff: None Specified**Tie-break Rule: Higher*

**Appendix D: Basin Runoff Calculations**

# RATIONAL METHOD RUNOFF ANALYSIS

Job # 1448-005  
Job Name Lot 1 Indian Meadows  
Designed by: JLW

Date: October 28, 2022  
Revised:

## Existing Basin 1 (EB1)

BASIN CHARACTERISTICS				TIME OF CONCENTRATION						RESULTS					
	Area, ac	% imp	Soil Type	Overland Flow - Surface Type 1		Overland Flow - Surface Type 2		Channel Flow		Tc, min	Event	C	i, in/hr	A, acres	Q, cfs
Landscape	2.86	2%	C	Surface Imperviousness	0.05	Surface Imperviousness	0.02	Land Surface	Paved Areas and Shallow Swales	Minimum	1.25 YR	0.08	0.7	2.96	0.17
Asphalt Parking & Walkways	0.10	100%		Length, ft	300	Length, ft	0	Length, ft		0	Tc, min	2-YR	0.08	1.1	2.96
Roof	0.00	90%	P2	Slope, percent	1.0000	Slope, percent	30.0000	Slope, ft/ft	2.0000	5.0	5-YR	0.18	1.6	2.96	0.86
Gravel	0.00	40%	1.4	Runoff Coefficient	0.18	Runoff Coefficient	0.162	Conveyance Coefficient	20	Final	10-YR	0.28	2.0	2.96	1.67
Other	0.00	0%						Velocity, ft/s	28.3	Tc, min	25-YR	0.39	2.6	2.96	3.04
	2.96	5%		Ti, min=	28.7	Ti, min=	0.0	Tt, min=	0.0	28.7	100-YR	0.52	3.5	2.96	5.34

## Existing Basin 2 (EB2)

BASIN CHARACTERISTICS				TIME OF CONCENTRATION						RESULTS					
	Area, ac	% imp	Soil Type	Overland Flow - Surface Type 1		Overland Flow - Surface Type 2		Channel Flow		Tc, min	Event	C	i, in/hr	A, acres	Q, cfs
Landscape	0.99	2%	C	Surface Imperviousness	0.15	Surface Imperviousness	0	Land Surface	Paved Areas and Shallow Swales	Minimum	1.25 YR	0.14	1.6	1.14	0.26
Asphalt Parking & Walkways	0.15	100%		Length, ft	100	Length, ft	0	Length, ft	0	Tc, min	2-YR	0.14	2.3	1.14	0.37
Roof	0.00	90%	P2	Slope, percent	15.0000	Slope, percent	2.0000	Slope, ft/ft	0.0200	5.0	5-YR	0.24	3.4	1.14	0.92
Gravel	0.00	0%	1.4	Runoff Coefficient	0.24	Runoff Coefficient	0.15	Conveyance Coefficient	20	Final	10-YR	0.32	4.4	1.14	1.62
Other	0.00	0%						Velocity, ft/s	2.8	Tc, min	25-YR	0.43	5.6	1.14	2.76
1.14 15%				Ti, min= 6.3		Ti, min= 0.0		Tt, min= 0.0		6.3	100-YR	0.54	7.5	1.14	4.67

## Existing Basin 3 (EB3)

BASIN CHARACTERISTICS				TIME OF CONCENTRATION						RESULTS					
	Area, ac	% imp	Soil Type	Overland Flow - Surface Type 1		Overland Flow - Surface Type 2		Channel Flow		Tc, min	Event	C	i, in/hr	A, acres	Q, cfs
Landscape	0.10	2%	C	Surface Imperviousness	0.7	Surface Imperviousness	0	Land Surface	Paved Areas and Shallow Swales	Minimum	1.25 YR	0.47	1.6	0.30	0.22
Asphalt Parking & Walkways	0.20	100%		Length, ft	50	Length, ft	0	Length, ft	100	Tc, min	2-YR	0.47	2.3	0.30	0.32
Roof	0.00	90%	P2	Slope, percent	2.0000	Slope, percent	2.0000	Slope, ft/ft	0.0200	5.0	5-YR	0.51	3.4	0.30	0.52
Gravel	0.00	0%	1.4	Runoff Coefficient	0.53	Runoff Coefficient	0.15	Conveyance Coefficient	20	Final	10-YR	0.56	4.4	0.30	0.73
Other	0.00	0%		Velocity, ft/s	2.8	Tc, min	25-YR	0.61	5.6	0.30	1.03				
	0.30	67%		Ti, min=	5.8	Ti, min=	0.0	Tt, min=	0.6	6.3	100-YR	0.66	7.5	0.30	1.50

## Sub Basin 1 (SB1)

BASIN CHARACTERISTICS				TIME OF CONCENTRATION						RESULTS					
	Area, ac	% imp	Soil Type	Overland Flow - Surface Type 1		Overland Flow - Surface Type 2		Channel Flow		Tc, min	Event	C	i, in/hr	A, acres	Q, cfs
Landscape	0.16	2%	C	Surface Imperviousness	0.5	Surface Imperviousness	0	Land Surface	Grassed Waterways	Minimum	1.25 YR	0.32	1.7	0.30	0.17
Asphalt Parking & Walkways	0.14	100%		Length, ft	25	Length, ft	0	Length, ft	0	Tc, min	2-YR	0.32	2.5	0.30	0.24
Roof	0.00	90%	P2	Slope, percent	10.0000	Slope, percent	2.0000	Slope, ft/ft	0.0100	5.0	5-YR	0.39	3.7	0.30	0.43
Gravel	0.00	0%	1.4	Runoff Coefficient	0.4	Runoff Coefficient	0.15	Conveyance Coefficient	15	Final	10-YR	0.45	4.7	0.30	0.64
Other	0.00	0%						Velocity, ft/s	1.5	Tc, min	25-YR	0.52	6.1	0.30	0.95
	0.30	48%		Ti, min=	2.9	Ti, min=	0.0	Tt, min=	0.0	5.0	100-YR	0.60	8.2	0.30	1.46

## Sub Basin 2 (SB2)

BASIN CHARACTERISTICS				TIME OF CONCENTRATION							RESULTS				
	Area, ac	% imp	Soil Type	Overland Flow - Surface Type 1		Overland Flow - Surface Type 2		Channel Flow		Tc, min	Event	C	i, in/hr	A, acres	Q, cfs
Landscape	0.07	2%	C	Surface Imperviousness	0.8	Surface Imperviousness	0	Land Surface	Grassed Waterways	Minimum	1.25 YR	0.60	1.4	0.35	0.29
Asphalt Parking & Walkways	0.28	100%		Length, ft	200	Length, ft	0	Length, ft	0	Tc, min	2-YR	0.60	2.0	0.35	0.41

# RATIONAL METHOD RUNOFF ANALYSIS

Job #	1448-005	Date:	October 28, 2022
Job Name	Lot 1 Indian Meadows	Revised:	
Designed by:	JLW		

Roof	0.00	90%	P2	Slope, percent	2.0000	Slope, percent	1.0000	Slope, ft/ft	0.0100	5.0	5-YR	0.63	2.9	0.35	0.65
Gravel	0.00	0%	1.4	Runoff Coefficient	0.63	Runoff Coefficient	0.15	Conveyance Coefficient	15	Final	10-YR	0.67	3.7	0.35	0.87
Other	0.00	0%						Velocity, ft/s	1.5	Tc, min	25-YR	0.71	4.8	0.35	1.19
	0.35	80%		Ti, min=	9.5	Ti, min=	0.0	Tt, min=	0.0	9.5	100-YR	0.75	6.4	0.35	1.68

## Sub Basin 3 (SB3)

BASIN CHARACTERISTICS				TIME OF CONCENTRATION						RESULTS					
	Area, ac	% imp	Soil Type	Overland Flow - Surface Type 1		Overland Flow - Surface Type 2		Channel Flow		Tc, min	Event	C	i, in/hr	A, acres	Q, cfs
Landscape	0.10	2%	C	Surface Imperviousness	0.75	Surface Imperviousness	0	Land Surface	Grassed Waterways	Minimum	1.25 YR	0.53	1.4	0.38	0.28
Asphalt Parking & Walkways	0.28	100%		Length, ft	150	Length, ft	0	Length, ft	0	Tc, min	2-YR	0.53	2.0	0.38	0.41
Roof	0.00	90%	P2	Slope, percent	2.0000	Slope, percent	1.0000	Slope, ft/ft	0.0100	5.0	5-YR	0.57	3.0	0.38	0.64
Gravel	0.00	0%	1.4	Runoff Coefficient	0.58	Runoff Coefficient	0.15	Conveyance Coefficient	15	Final	10-YR	0.61	3.8	0.38	0.88
Other	0.00	0%						Velocity, ft/s	1.5	Tc, min	25-YR	0.65	4.9	0.38	1.22
	0.38	74%		Ti, min=	9.1	Ti, min=	0.0	Tt, min=	0.0	9.1	100-YR	0.70	6.6	0.38	1.75

## Sub Basin 4 (SB4)

BASIN CHARACTERISTICS				TIME OF CONCENTRATION						RESULTS					
	Area, ac	% imp	Soil Type	Overland Flow - Surface Type 1		Overland Flow - Surface Type 2		Channel Flow		Tc, min	Event	C	i, in/hr	A, acres	Q, cfs
Landscape	0.10	2%	C	Surface Imperviousness	0.7	Surface Imperviousness	0.4	Land Surface	Paved Areas and Shallow Swales	Minimum	1.25 YR	0.47	1.2	0.40	0.23
Asphalt Parking & Walkways	0.00	100%		Length, ft	200	Length, ft	0	Length, ft	100	Tc, min	2-YR	0.47	1.8	0.40	0.33
Roof	0.30	90%	P2	Slope, percent	2.0000	Slope, percent	10.0000	Slope, ft/ft	0.0100	5.0	5-YR	0.51	2.6	0.40	0.54
Gravel	0.00	0%	1.4	Runoff Coefficient	0.53	Runoff Coefficient	0.35	Conveyance Coefficient	20	Final	10-YR	0.56	3.3	0.40	0.75
Other	0.00	0%						Velocity, ft/s	2.0	Tc, min	25-YR	0.61	4.3	0.40	1.05
	0.40	68%		Ti, min=	11.5	Ti, min=	0.0	Tt, min=	0.8	12.3	100-YR	0.67	5.7	0.40	1.53

## Sub Basin 5 (SB5)

BASIN CHARACTERISTICS				TIME OF CONCENTRATION						RESULTS					
	Area, ac	% imp	Soil Type	Overland Flow - Surface Type 1		Overland Flow - Surface Type 2		Channel Flow		Tc, min	Event	C	i, in/hr	A, acres	Q, cfs
Landscape	0.02	2%	C	Surface Imperviousness	0.9	Surface Imperviousness	0.4	Land Surface	Grassed Waterways	Minimum	1.25 YR	0.75	1.5	0.23	0.26
Asphalt Parking & Walkways	0.21	100%		Length, ft	200	Length, ft	0	Length, ft	0	Tc, min	2-YR	0.75	2.2	0.23	0.38
Roof	0.00	90%	P2	Slope, percent	2.0000	Slope, percent	10.0000	Slope, ft/ft	0.0100	5.0	5-YR	0.77	3.3	0.23	0.58
Gravel	0.00	0%	1.4	Runoff Coefficient	0.75	Runoff Coefficient	0.35	Conveyance Coefficient	15	Final	10-YR	0.79	4.2	0.23	0.76
Other	0.00	0%						Velocity, ft/s	1.5	Tc, min	25-YR	0.82	5.4	0.23	1.02
	0.23	91%		Ti, min=	7.1	Ti, min=	0.0	Tt, min=	0.0	7.1	100-YR	0.85	7.2	0.23	1.41

## Sub Basin 6 (SB6)

BASIN CHARACTERISTICS				TIME OF CONCENTRATION						RESULTS					
	Area, ac	% imp	Soil Type	Overland Flow - Surface Type 1		Overland Flow - Surface Type 2		Channel Flow		Tc, min	Event	C	i, in/hr	A, acres	Q, cfs
Landscape	0.01	2%	C	Surface Imperviousness	0.9	Surface Imperviousness	0.4	Land Surface	Grassed Waterways	Minimum	1.25 YR	0.69	1.5	0.08	0.09
Asphalt Parking & Walkways	0.07	100%		Length, ft	200	Length, ft	0	Length, ft	0	Tc, min	2-YR	0.69	2.2	0.08	0.12
Roof	0.00	90%	P2	Slope, percent	2.0000	Slope, percent	10.0000	Slope, ft/ft	0.0100	5.0	5-YR	0.72	3.3	0.08	0.19
Gravel	0.00	0%	1.4	Runoff Coefficient	0.75	Runoff Coefficient	0.35	Conveyance Coefficient	15	Final	10-YR	0.75	4.2	0.08	0.25
Other	0.00	0%						Velocity, ft/s	1.5	Tc, min	25-YR	0.78	5.4	0.08	0.34
	0.08	88%		Ti, min=	7.1	Ti, min=	0.0	Tt, min=	0.0	7.1	100-YR	0.81	7.2	0.08	0.47



# RATIONAL METHOD RUNOFF ANALYSIS

Job # 1448-005  
Job Name Lot 1 Indian Meadows  
Designed by: JLW

Date: October 28, 2022  
Revised:

## Sub Basin 7(SB7)

BASIN CHARACTERISTICS				TIME OF CONCENTRATION						RESULTS					
	Area, ac	% imp	Soil Type	Overland Flow - Surface Type 1		Overland Flow - Surface Type 2		Channel Flow		Tc, min	Event	C	i, in/hr	A, acres	Q, cfs
Landscape	0.02	2%	C	Surface Imperviousness	0.85	Surface Imperviousness	0.4	Land Surface	Grassed Waterways	Minimum	1.25 YR	0.64	1.6	0.12	0.13
Asphalt Parking & Walkways	0.10	100%		Length, ft	100	Length, ft	0	Length, ft	0	Tc, min	2-YR	0.64	2.3	0.12	0.18
Roof	0.00	90%	P2	Slope, percent	2.0000	Slope, percent	10.0000	Slope, ft/ft	0.0100	5.0	5-YR	0.67	3.5	0.12	0.28
Gravel	0.00	0%	1.4	Runoff Coefficient	0.68	Runoff Coefficient	0.35	Conveyance Coefficient	15	Final	10-YR	0.70	4.5	0.12	0.37
Other	0.00	0%						Velocity, ft/s	1.5	Tc, min	25-YR	0.74	5.7	0.12	0.51
0.12      84%				Ti, min=      6.0		Ti, min=      0.0		Tt, min=      0.0		6.0	100-YR	0.77	7.7	0.12	0.71

## Sub Basin 8(SB8)

BASIN CHARACTERISTICS				TIME OF CONCENTRATION						RESULTS					
	Area, ac	% imp	Soil Type	Overland Flow - Surface Type 1		Overland Flow - Surface Type 2		Channel Flow		Tc, min	Event	C	i, in/hr	A, acres	Q, cfs
Landscape	0.05	2%	C	Surface Imperviousness	0.8	Surface Imperviousness	0.4	Land Surface	Grassed Waterways	Minimum	1.25 YR	0.58	1.5	0.23	0.19
Asphalt Parking & Walkways	0.18	100%		Length, ft	150	Length, ft	0	Length, ft	0	Tc, min	2-YR	0.58	2.1	0.23	0.28
Roof	0.00	90%	P2	Slope, percent	2.0000	Slope, percent	10.0000	Slope, ft/ft	0.0100	5.0	5-YR	0.61	3.1	0.23	0.44
Gravel	0.00	0%	1.4	Runoff Coefficient	0.63	Runoff Coefficient	0.35	Conveyance Coefficient	15	Final	10-YR	0.65	4.0	0.23	0.59
Other	0.00	0%						Velocity, ft/s	1.5	Tc, min	25-YR	0.69	5.1	0.23	0.81
0.23 79%				Ti, min= 8.2		Ti, min= 0.0		Tt, min= 0.0		8.2	100-YR	0.73	6.8	0.23	1.15

## Sub Basin 9(SB9)

BASIN CHARACTERISTICS				TIME OF CONCENTRATION						RESULTS					
	Area, ac	% imp	Soil Type	Overland Flow - Surface Type 1		Overland Flow - Surface Type 2		Channel Flow		Tc, min	Event	C	i, in/hr	A, acres	Q, cfs
Landscape	0.05	2%	C	Surface Imperviousness	0.85	Surface Imperviousness	0.4	Land Surface	Grassed Waterways	Minimum	1.25 YR	0.64	1.4	0.30	0.28
Asphalt Parking & Walkways	0.25	100%		Length, ft	200	Length, ft	0	Length, ft	0	Tc, min	2-YR	0.64	2.1	0.30	0.40
Roof	0.00	90%	P2	Slope, percent	2.0000	Slope, percent	10.0000	Slope, ft/ft	0.0100	5.0	5-YR	0.67	3.1	0.30	0.61
Gravel	0.00	0%	1.4	Runoff Coefficient	0.68	Runoff Coefficient	0.35	Conveyance Coefficient	15	Final	10-YR	0.70	3.9	0.30	0.82
Other	0.00	0%						Velocity, ft/s	1.5	Tc, min	25-YR	0.74	5.0	0.30	1.11
0.30 84%				Ti, min= 8.5		Ti, min= 0.0		Tt, min= 0.0		8.5	100-YR	0.77	6.7	0.30	1.56

## Sub Basin 10(SB10)

BASIN CHARACTERISTICS				TIME OF CONCENTRATION								RESULTS				
	Area, ac	% imp	Soil Type	Overland Flow - Surface Type 1		Overland Flow - Surface Type 2		Channel Flow		Tc, min	Event	C	i, in/hr	A, acres	Q, cfs	
Landscape	0.08	2%	C	Surface Imperviousness	0.7	Surface Imperviousness	0.4	Land Surface	Paved Areas and Shallow Swales	Minimum	1.25 YR	0.49	1.2	0.35	0.21	
Asphalt Parking & Walkways	0.00	100%		Length, ft	200	Length, ft	0	Length, ft		100	Tc, min	2-YR	0.49	1.8	0.35	0.30
Roof	0.27	90%	P2	Slope, percent	2.0000	Slope, percent	10.0000	Slope, ft/ft	0.0100	5.0	5-YR	0.53	2.6	0.35	0.49	
Gravel	0.00	0%	1.4	Runoff Coefficient	0.53	Runoff Coefficient	0.35	Conveyance Coefficient	20	Final	10-YR	0.57	3.3	0.35	0.67	
Other	0.00	0%		Velocity, ft/s	2.0	Tc, min	25-YR	0.62	4.3	0.35	0.94					
	0.35	70%		Ti, min=	11.5	Ti, min=	0.0	Tt, min=	0.8	12.3	100-YR	0.68	5.7	0.35	1.36	

## Sub Basin 11(SB11)

BASIN CHARACTERISTICS				TIME OF CONCENTRATION								RESULTS				
	Area, ac	% imp	Soil Type	Overland Flow - Surface Type 1		Overland Flow - Surface Type 2		Channel Flow		Tc, min	Event	C	i, in/hr	A, acres	Q, cfs	
Landscape	0.02	2%	C	Surface Imperviousness	0.9	Surface Imperviousness	0.4	Land Surface	Paved Areas and Shallow Swales	Minimum	1.25 YR	0.69	1.7	0.16	0.19	
Asphalt Parking & Walkways	0.14	100%		Length, ft	50	Length, ft	0	Length, ft	0	Tc, min	2-YR	0.69	2.5	0.16	0.28	
Roof	0.00	90%	P2	Slope, percent	2.0000	Slope, percent	10.0000	Slope, ft/ft	0.0100	5.0	5-YR	0.72	3.7	0.16	0.43	

# RATIONAL METHOD RUNOFF ANALYSIS

Job # 1448-005 Date: October 28, 2022  
Job Name Lot 1 Indian Meadows Revised:  
Designed by: JLW

Gravel	0.00	0%	1.4	Runoff Coefficient	0.75	Runoff Coefficient	0.35	Conveyance Coefficient	20	Final	10-YR	0.75	4.7	0.16	0.56
Other	0.00	0%						Velocity, ft/s	2.0	Tc, min	25-YR	0.78	6.1	0.16	0.76
	0.16	88%		Ti, min=	3.5	Ti, min=	0.0	Tt, min=	0.0	5.0	100-YR	0.81	8.2	0.16	1.06

## Sub Basin 12 (SB12)

BASIN CHARACTERISTICS				TIME OF CONCENTRATION						RESULTS					
	Area, ac	% imp	Soil Type	Overland Flow - Surface Type 1		Overland Flow - Surface Type 2		Channel Flow		Tc, min	Event	C	i, in/hr	A, acres	Q, cfs
Landscape	0.02	2%	C	Surface Imperviousness	0.9	Surface Imperviousness	0.4	Land Surface	Paved Areas and Shallow Swales	Minimum	1.25 YR	0.73	1.7	0.20	0.25
Asphalt Parking & Walkways	0.18	100%		Length, ft	50	Length, ft	0	Length, ft	0	Tc, min	2-YR	0.73	2.5	0.20	0.36
Roof	0.00	90%	P2	Slope, percent	2.0000	Slope, percent	10.0000	Slope, ft/ft	0.0100	5.0	5-YR	0.75	3.7	0.20	0.56
Gravel	0.00	0%	1.4	Runoff Coefficient	0.75	Runoff Coefficient	0.35	Conveyance Coefficient	20	Final	10-YR	0.78	4.7	0.20	0.73
Other	0.00	0%						Velocity, ft/s	2.0	Tc, min	25-YR	0.81	6.1	0.20	0.98
	0.20	90%		Ti, min=	3.5	Ti, min=	0.0	Tt, min=	0.0	5.0	100-YR	0.84	8.2	0.20	1.36

## Sub Basin 13 (SB13)

BASIN CHARACTERISTICS				TIME OF CONCENTRATION						RESULTS					
	Area, ac	% imp	Soil Type	Overland Flow - Surface Type 1		Overland Flow - Surface Type 2		Channel Flow		Tc, min	Event	C	i, in/hr	A, acres	Q, cfs
Landscape	0.34	2%	C	Surface Imperviousness	0.1	Surface Imperviousness	0.4	Land Surface	Paved Areas and Shallow Swales	Minimum	1.25 YR	0.11	1.0	0.37	0.04
Asphalt Parking & Walkways	0.03	100%		Length, ft	200	Length, ft	0	Length, ft		0	Tc, min	2-YR	0.11	1.4	0.37
Roof	0.00	90%	P2	Slope, percent	2.0000	Slope, percent	10.0000	Slope, ft/ft	0.0100	5.0	5-YR	0.21	2.2	0.37	0.17
Gravel	0.00	0%	1.4	Runoff Coefficient	0.21	Runoff Coefficient	0.35	Conveyance Coefficient	20	Final	10-YR	0.30	2.7	0.37	0.31
Other	0.00	0%						Velocity, ft/s	2.0	Tc, min	25-YR	0.41	3.5	0.37	0.54
	0.37	10%		Ti, min=	18.0	Ti, min=	0.0	Tt, min=	0.0	18.0	100-YR	0.53	4.7	0.37	0.93

## Sub Basin 14 (SB14)

BASIN CHARACTERISTICS				TIME OF CONCENTRATION						RESULTS					
	Area, ac	% imp	Soil Type	Overland Flow - Surface Type 1		Overland Flow - Surface Type 2		Channel Flow		Tc, min	Event	C	i, in/hr	A, acres	Q, cfs
Landscape	0.32	2%	C	Surface Imperviousness	0.1	Surface Imperviousness	0.4	Land Surface	Paved Areas and Shallow Swales	Minimum	1.25 YR	0.11	1.0	0.35	0.04
Asphalt Parking & Walkways	0.03	100%		Length, ft	200	Length, ft	0	Length, ft	0	Tc, min	2-YR	0.11	1.4	0.35	0.06
Roof	0.00	90%	P2	Slope, percent	2.0000	Slope, percent	10.0000	Slope, ft/ft	0.0100	5.0	5-YR	0.21	2.2	0.35	0.16
Gravel	0.00	0%	1.4	Runoff Coefficient	0.21	Runoff Coefficient	0.35	Conveyance Coefficient	20	Final	10-YR	0.30	2.7	0.35	0.29
Other	0.00	0%						Velocity, ft/s	2.0	Tc, min	25-YR	0.41	3.5	0.35	0.51
	0.35	10%		Ti, min=	18.0	Ti, min=	0.0	Tt, min=	0.0	18.0	100-YR	0.53	4.7	0.35	0.88

## COMBINED SUB-BASIN CALCS FOR STORM SEWER DESIGN

### SB3 and SB4 (A-4)

BASIN CHARACTERISTICS				TIME OF CONCENTRATION						RESULTS					
	Area, ac	% imp	Soil Type	Overland Flow - Surface Type 1		Overland Flow - Surface Type 2		Channel Flow		Tc, min	Event	C	i, in/hr	A, acres	Q, cfs
Landscape	0.20	2%	C	Surface Imperviousness	0.7	Surface Imperviousness	0.4	Land Surface	Paved Areas and Shallow Swales	Minimum	1.25 YR	0.50	1.1	0.78	0.45
Asphalt Parking & Walkways	0.28	100%		Length, ft	300	Length, ft	0	Length, ft		0	Tc, min	2-YR	0.50	1.6	0.78
Roof	0.30	90%	P2	Slope, percent	2.0000	Slope, percent	10.0000	Slope, ft/ft	0.0100	5.0	5-YR	0.54	2.5	0.78	1.03
Gravel	0.00	0%	1.4	Runoff Coefficient	0.53	Runoff Coefficient	0.35	Conveyance Coefficient	20	Final	10-YR	0.58	3.1	0.78	1.42
Other	0.00	0%						Velocity, ft/s	2.0	Tc, min	25-YR	0.63	4.0	0.78	1.98
	0.78	71%		Ti, min= 14.1		Ti, min= 0.0		Ti, min= 0.0		14.1	100-YR	0.68	5.4	0.78	2.87

### SB2 and SB5 (A-3)

BASIN CHARACTERISTICS				TIME OF CONCENTRATION				RESULTS			
-----------------------	--	--	--	-----------------------	--	--	--	---------	--	--	--

# RATIONAL METHOD RUNOFF ANALYSIS

Job #  
Job Name  
Designed by:

1448-005  
Lot 1 Indian Meadows  
JLW

Date:  
Revised:

October 28, 2022

	Area, ac	% imp	Soil Type	Overland Flow - Surface Type 1		Overland Flow - Surface Type 2		Channel Flow		Tc, min	Event	C	i, in/hr	A, acres	Q, cfs
Landscape	0.09	2%	C	Surface Imperviousness	0.85	Surface Imperviousness	0.4	Land Surface	Paved Areas and Shallow Swales	Minimum	1.25 YR	0.65	1.3	0.58	0.50
Asphalt Parking & Walkways	0.49	100%		Length, ft	300	Length, ft	0	Length, ft	0	Tc, min	2-YR	0.65	1.9	0.58	0.72
Roof	0.00	90%	P2	Slope, percent	2.0000	Slope, percent	10.0000	Slope, ft/ft	0.0100	5.0	5-YR	0.68	2.6	0.58	1.11
Gravel	0.00	0%	1.4	Runoff Coefficient	0.68	Runoff Coefficient	0.35	Conveyance Coefficient	20	Final	10-YR	0.71	3.6	0.58	1.49
Other	0.00	0%						Velocity, ft/s	2.0	Tc, min	25-YR	0.75	4.6	0.58	2.01
	0.58	85%		Ti, min=	10.4	Ti, min=	0.0	Tt, min=	0.0	10.4	100-YR	0.78	6.2	0.58	2.82

## SB7 and SB10 (A-5)

BASIN CHARACTERISTICS				TIME OF CONCENTRATION						RESULTS					
	Area, ac	% imp	Soil Type	Overland Flow - Surface Type 1		Overland Flow - Surface Type 2		Channel Flow		Tc, min	Event	C	i, in/hr	A, acres	Q, cfs
Landscape	0.10	2%	C	Surface Imperviousness	0.75	Surface Imperviousness	0.4	Land Surface	Paved Areas and Shallow Swales	Minimum	1.25 YR	0.52	1.2	0.47	0.30
Asphalt Parking & Walkways	0.10	100%		Length, ft	300	Length, ft	0	Length, ft	0	Tc, min	2-YR	0.52	1.7	0.47	0.42
Roof	0.27	90%	P2	Slope, percent	2.0000	Slope, percent	10.0000	Slope, ft/ft	0.0100	5.0	5-YR	0.56	2.6	0.47	0.68
Gravel	0.00	0%	1.4	Runoff Coefficient	0.58	Runoff Coefficient	0.35	Conveyance Coefficient	20	Final	10-YR	0.60	3.3	0.47	0.92
Other	0.00	0%						Velocity, ft/s	2.0	Tc, min	25-YR	0.65	4.2	0.47	1.28
	0.47	73%		Ti, min=	12.9	Ti, min=	0.0	Tt, min=	0.0	12.9	100-YR	0.70	5.6	0.47	1.84

## SB8 and SB9 (A-1)

BASIN CHARACTERISTICS				TIME OF CONCENTRATION						RESULTS					
	Area, ac	% imp	Soil Type	Overland Flow - Surface Type 1		Overland Flow - Surface Type 2		Channel Flow		Tc, min	Event	C	i, in/hr	A, acres	Q, cfs
Landscape	0.10	2%	C	Surface Imperviousness	0.8	Surface Imperviousness	0.4	Land Surface	Paved Areas and Shallow Swales	Minimum	1.25 YR	0.61	1.3	0.53	0.41
Asphalt Parking & Walkways	0.43	100%		Length, ft	300	Length, ft	0	Length, ft	0	Tc, min	2-YR	0.61	1.8	0.53	0.59
Roof	0.00	90%	P2	Slope, percent	2.0000	Slope, percent	10.0000	Slope, ft/ft	0.0100	5.0	5-YR	0.64	2.7	0.53	0.91
Gravel	0.00	0%	1.4	Runoff Coefficient	0.63	Runoff Coefficient	0.35	Conveyance Coefficient	20	Final	10-YR	0.68	3.4	0.53	1.23
Other	0.00	0%						Velocity, ft/s	2.0	Tc, min	25-YR	0.72	4.4	0.53	1.67
	0.53	82%		Ti, min=	11.6	Ti, min=	0.0	Tt, min=	0.0	11.6	100-YR	0.76	5.9	0.53	2.36

**Appendix E: BMP Design Spreadsheet Calculations for TSS**

## TSS Removal

**BMP Designation** SB1 Grass Buffer

### Event Mean TSS Per Table 5.12.3

140 mg/L

Variable	Value	Unit	
n	2	-	(Turbulence Factor: 1=bad, 5=good)
$V_s$	0.0059	ft/sec	(Settling Velocity of Particles)
Q	0.18	ft <sup>3</sup> /sec	(Applied Flow Rate, 1.25 Yr Peak Flow)
A	3000	ft <sup>2</sup>	(Area of Treatment)
R	1.00	-	(Fraction of solids removed)

### TSS Concentration After Treatment

0.06 mg/L Min 80% Removal of Event Mean TSS

## TSS Removal

### BMP Designation

SB2 Grass Swale

### Event Mean TSS Per Table 5.12.3

140 mg/L

Variable	Value	Unit	
n	1	-	(Turbulence Factor: 1=bad, 5=good)
$V_s$	0.0059	ft/sec	(Settling Velocity of Particles)
Q	0.29	ft <sup>3</sup> /sec	(Applied Flow Rate, 1.25 Yr Peak Flow)
A	200	ft <sup>2</sup>	(Area of Treatment)
R	0.80	-	(Fraction of solids removed)

### TSS Concentration After Treatment

27.62 mg/L

Min 80% Removal of Event Mean TSS

## TSS Removal

**BMP Designation** SB3 Rain Garden

### Event Mean TSS Per Table 5.12.3

140 mg/L

Variable	Value	Unit	
n	5	-	(Turbulence Factor: 1=bad, 5=good)
$V_s$	0.0059	ft/sec	(Settling Velocity of Particles)
Q	0.28	ft <sup>3</sup> /sec	(Applied Flow Rate, 1.25 Yr Peak Flow)
A	300	ft <sup>2</sup>	(Area of Treatment)
R	0.98	-	(Fraction of solids removed)

### TSS Concentration After Treatment

2.35 mg/L Min 80% Removal of Event Mean TSS

## TSS Removal

**BMP Designation** SB5 Rain Garden

### Event Mean TSS Per Table 5.12.3

140 mg/L

Variable	Value	Unit	
n	5	-	(Turbulence Factor: 1=bad, 5=good)
$V_s$	0.0059	ft/sec	(Settling Velocity of Particles)
Q	0.26	ft <sup>3</sup> /sec	(Applied Flow Rate, 1.25 Yr Peak Flow)
A	150	ft <sup>2</sup>	(Area of Treatment)
R	0.93	-	(Fraction of solids removed)

### TSS Concentration After Treatment

10.44 mg/L Min 80% Removal of Event Mean TSS



## TSS Removal

**BMP Designation** SB6 Rain Garden

### Event Mean TSS Per Table 5.12.3

140 mg/L

Variable	Value	Unit	
n	5	-	(Turbulence Factor: 1=bad, 5=good)
$V_s$	0.0059	ft/sec	(Settling Velocity of Particles)
Q	0.1	ft <sup>3</sup> /sec	(Applied Flow Rate, 1.25 Yr Peak Flow)
A	200	ft <sup>2</sup>	(Area of Treatment)
R	1.00	-	(Fraction of solids removed)

### TSS Concentration After Treatment

0.33 mg/L Min 80% Removal of Event Mean TSS

## TSS Removal

**BMP Designation** SB7 Rain Garden

### Event Mean TSS Per Table 5.12.3

140 mg/L

Variable	Value	Unit	
n	5	-	(Turbulence Factor: 1=bad, 5=good)
$V_s$	0.0059	ft/sec	(Settling Velocity of Particles)
Q	0.13	ft <sup>3</sup> /sec	(Applied Flow Rate, 1.25 Yr Peak Flow)
A	250	ft <sup>2</sup>	(Area of Treatment)
R	1.00	-	(Fraction of solids removed)

### TSS Concentration After Treatment

0.37 mg/L Min 80% Removal of Event Mean TSS

## TSS Removal

### BMP Designation

SB8 Grass Swale

### Event Mean TSS Per Table 5.12.3

140 mg/L

Variable	Value	Unit	
n	1	-	(Turbulence Factor: 1=bad, 5=good)
$V_s$	0.0059	ft/sec	(Settling Velocity of Particles)
Q	0.2	ft <sup>3</sup> /sec	(Applied Flow Rate, 1.25 Yr Peak Flow)
A	150	ft <sup>2</sup>	(Area of Treatment)
R	0.82	-	(Fraction of solids removed)

### TSS Concentration After Treatment

25.81 mg/L

Min 80% Removal of Event Mean TSS

## TSS Removal

**BMP Designation** SB9 Rain Garden

### Event Mean TSS Per Table 5.12.3

140 mg/L

Variable	Value	Unit	
n	5	-	(Turbulence Factor: 1=bad, 5=good)
$V_s$	0.0059	ft/sec	(Settling Velocity of Particles)
Q	0.3	ft <sup>3</sup> /sec	(Applied Flow Rate, 1.25 Yr Peak Flow)
A	150	ft <sup>2</sup>	(Area of Treatment)
R	0.90	-	(Fraction of solids removed)

### TSS Concentration After Treatment

13.78 mg/L Min 80% Removal of Event Mean TSS

## TSS Removal

**BMP Designation** SB11 Rain Garden

### Event Mean TSS Per Table 5.12.3

140 mg/L

Variable	Value	Unit	
n	3	-	(Turbulence Factor: 1=bad, 5=good)
$V_s$	0.0059	ft/sec	(Settling Velocity of Particles)
Q	0.2	ft <sup>3</sup> /sec	(Applied Flow Rate, 1.25 Yr Peak Flow)
A	200	ft <sup>2</sup>	(Area of Treatment)
R	0.96	-	(Fraction of solids removed)

### TSS Concentration After Treatment

5.36 mg/L Min 80% Removal of Event Mean TSS

## TSS Removal

**BMP Designation** SB12 Rain Garden

### Event Mean TSS Per Table 5.12.3

140 mg/L

Variable	Value	Unit	
n	3	-	(Turbulence Factor: 1=bad, 5=good)
$V_s$	0.0059	ft/sec	(Settling Velocity of Particles)
Q	0.25	ft <sup>3</sup> /sec	(Applied Flow Rate, 1.25 Yr Peak Flow)
A	200	ft <sup>2</sup>	(Area of Treatment)
R	0.94	-	(Fraction of solids removed)

### TSS Concentration After Treatment


8.22 mg/L Min 80% Removal of Event Mean TSS

**Appendix F: Channel Flow Calculations**

# Channel Report

## WQ Swale for SB2 - 1.25 yr Event

<b>Trapezoidal</b>		<b>Highlighted</b>	
Bottom Width (ft)	= 2.00	Depth (ft)	= 0.13
Side Slopes (z:1)	= 4.00, 4.00	Q (cfs)	= 0.290
Total Depth (ft)	= 0.50	Area (sqft)	= 0.33
Invert Elev (ft)	= 100.00	Velocity (ft/s)	= 0.89
Slope (%)	= 1.00	Wetted Perim (ft)	= 3.07
N-Value	= 0.035	Crit Depth, Yc (ft)	= 0.09
<b>Calculations</b>		Top Width (ft)	= 3.04
Compute by:		EGL (ft)	= 0.14
Known Q			
Known Q (cfs)		= 0.29	

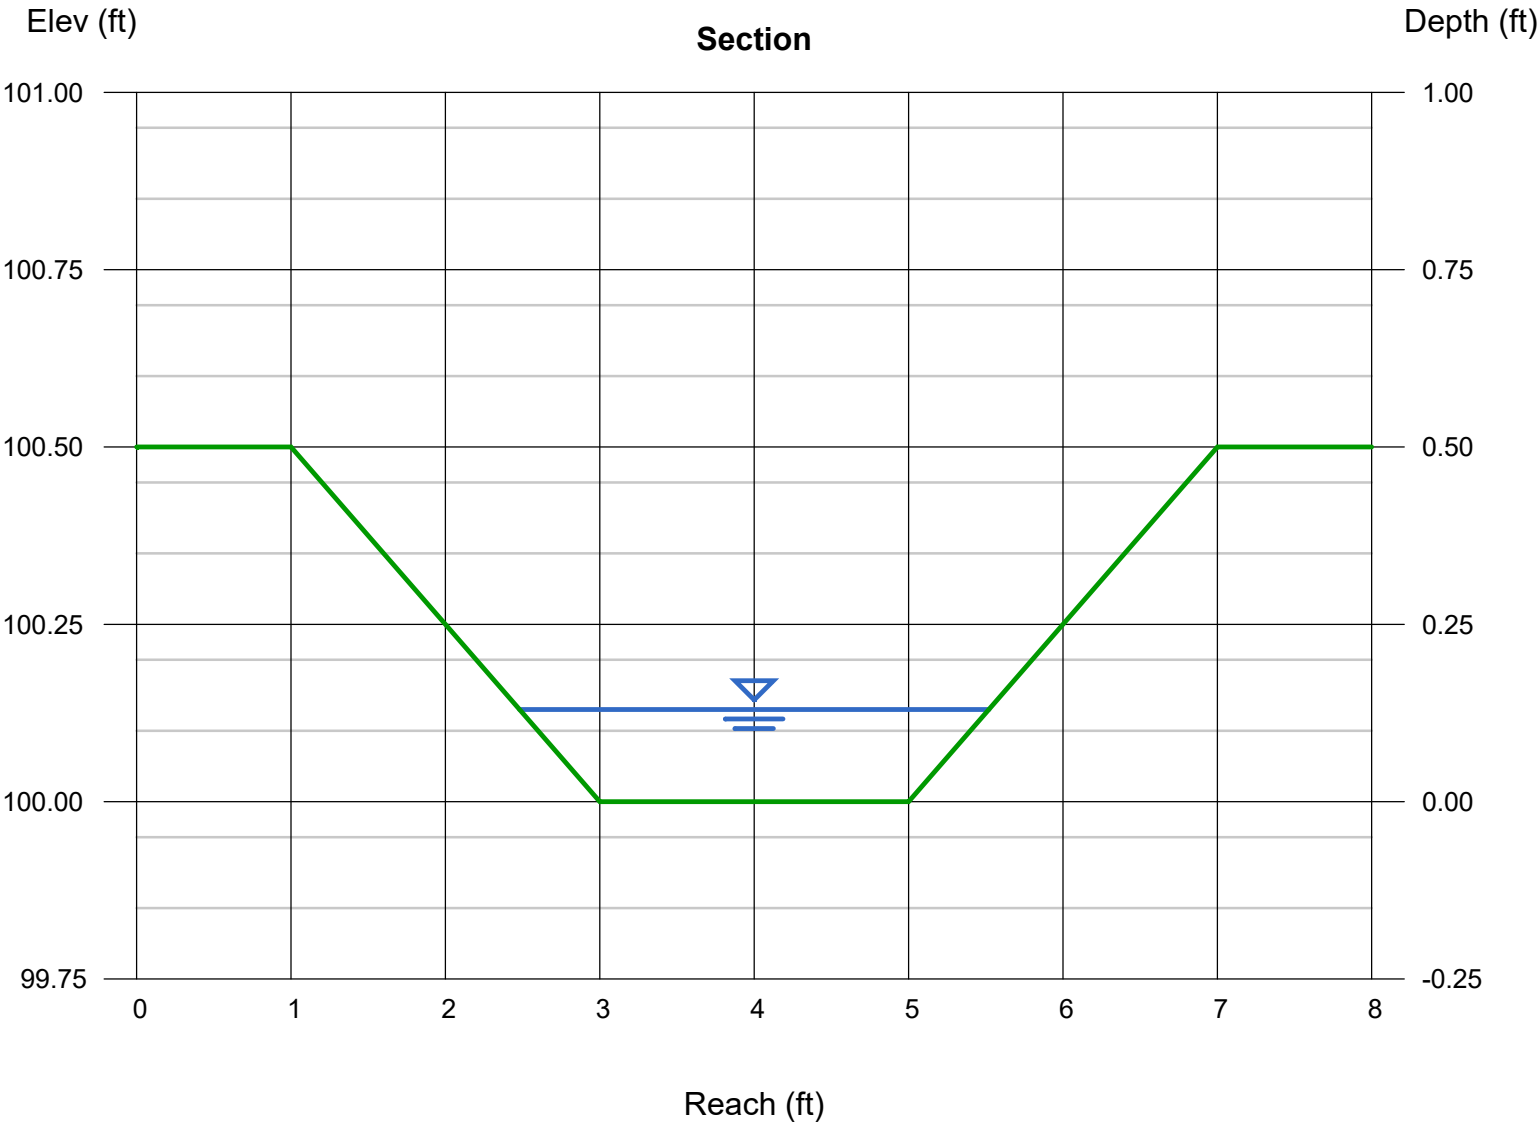




# Channel Report

## WQ Swale for SB2 - Major Event

<b>Trapezoidal</b>		<b>Highlighted</b>	
Bottom Width (ft)	= 2.00	Depth (ft)	= 0.33
Side Slopes (z:1)	= 4.00, 4.00	Q (cfs)	= 1.680
Total Depth (ft)	= 0.50	Area (sqft)	= 1.10
Invert Elev (ft)	= 100.00	Velocity (ft/s)	= 1.53
Slope (%)	= 1.00	Wetted Perim (ft)	= 4.72
N-Value	= 0.035	Crit Depth, Yc (ft)	= 0.24
<b>Calculations</b>		Top Width (ft)	= 4.64
Compute by:		EGL (ft)	= 0.37
Known Q (cfs)	= 1.68		

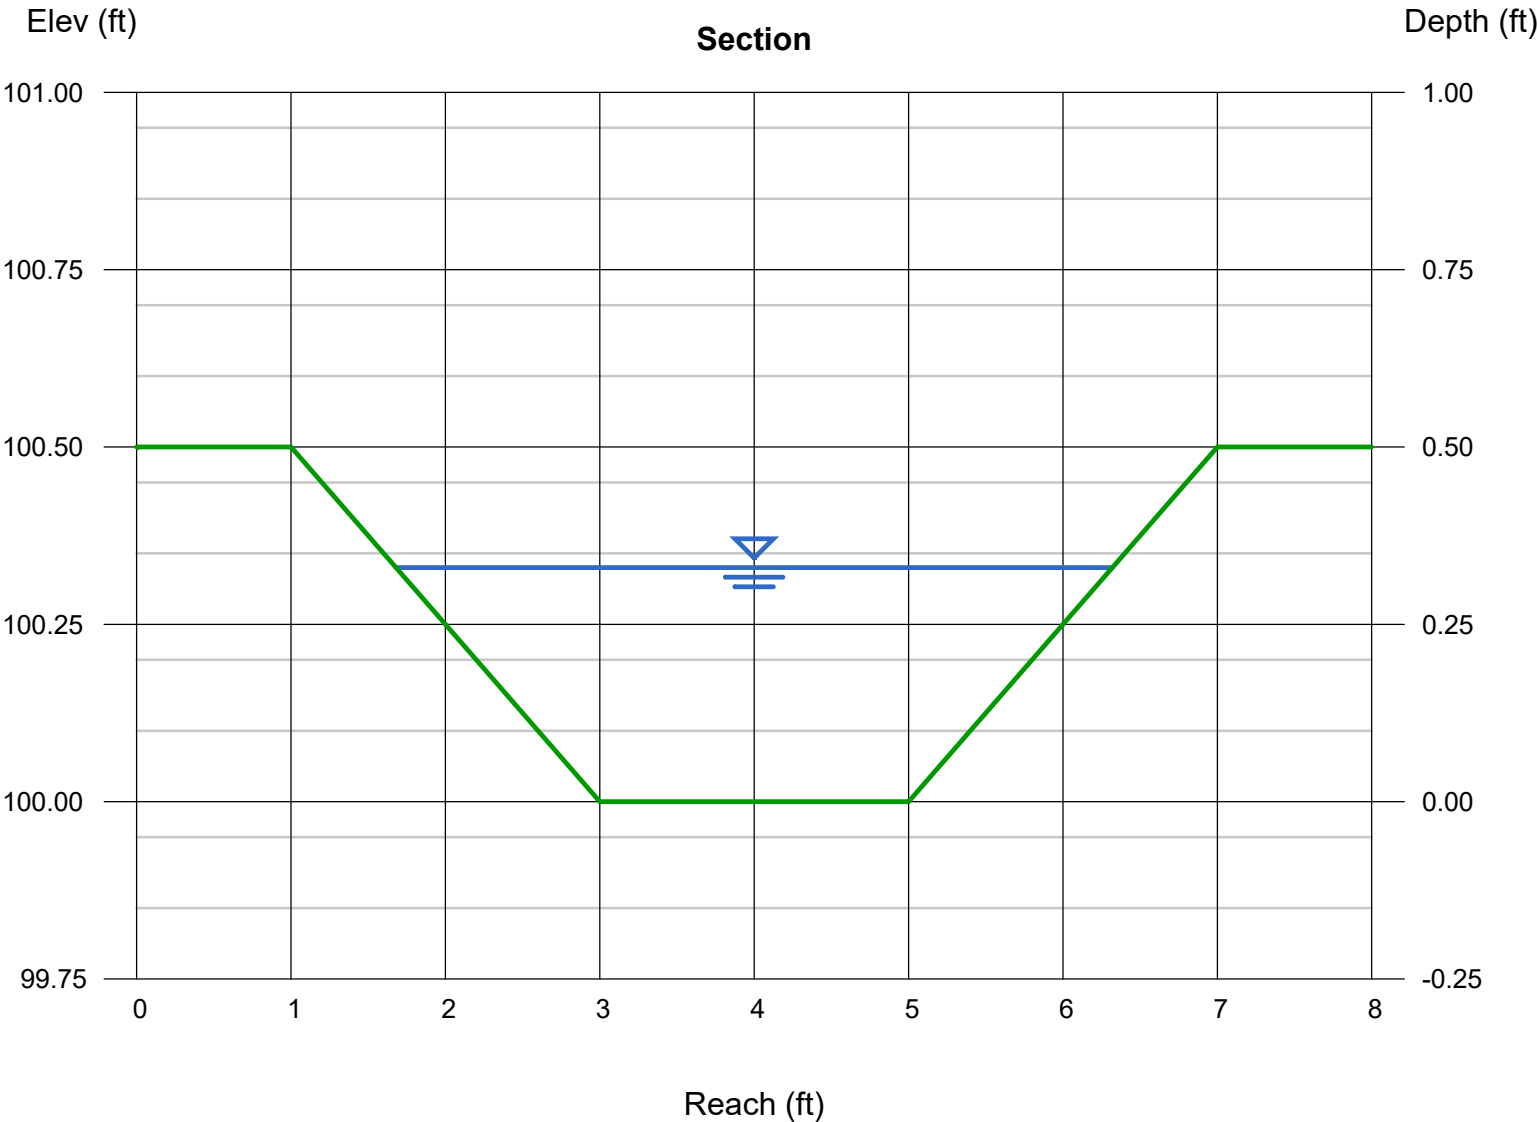

# Channel Report

## WQ Swale for SB8 - 1.25 yr Event

### Trapezoidal


Bottom Width (ft)	= 2.00
Side Slopes (z:1)	= 4.00, 4.00
Total Depth (ft)	= 0.50
Invert Elev (ft)	= 100.00
Slope (%)	= 1.00
N-Value	= 0.035

### Highlighted

Depth (ft)	= 0.11
Q (cfs)	= 0.200
Area (sqft)	= 0.27
Velocity (ft/s)	= 0.75
Wetted Perim (ft)	= 2.91
Crit Depth, Yc (ft)	= 0.07
Top Width (ft)	= 2.88
EGL (ft)	= 0.12

### Calculations


Compute by:	Known Q
Known Q (cfs)	= 0.20

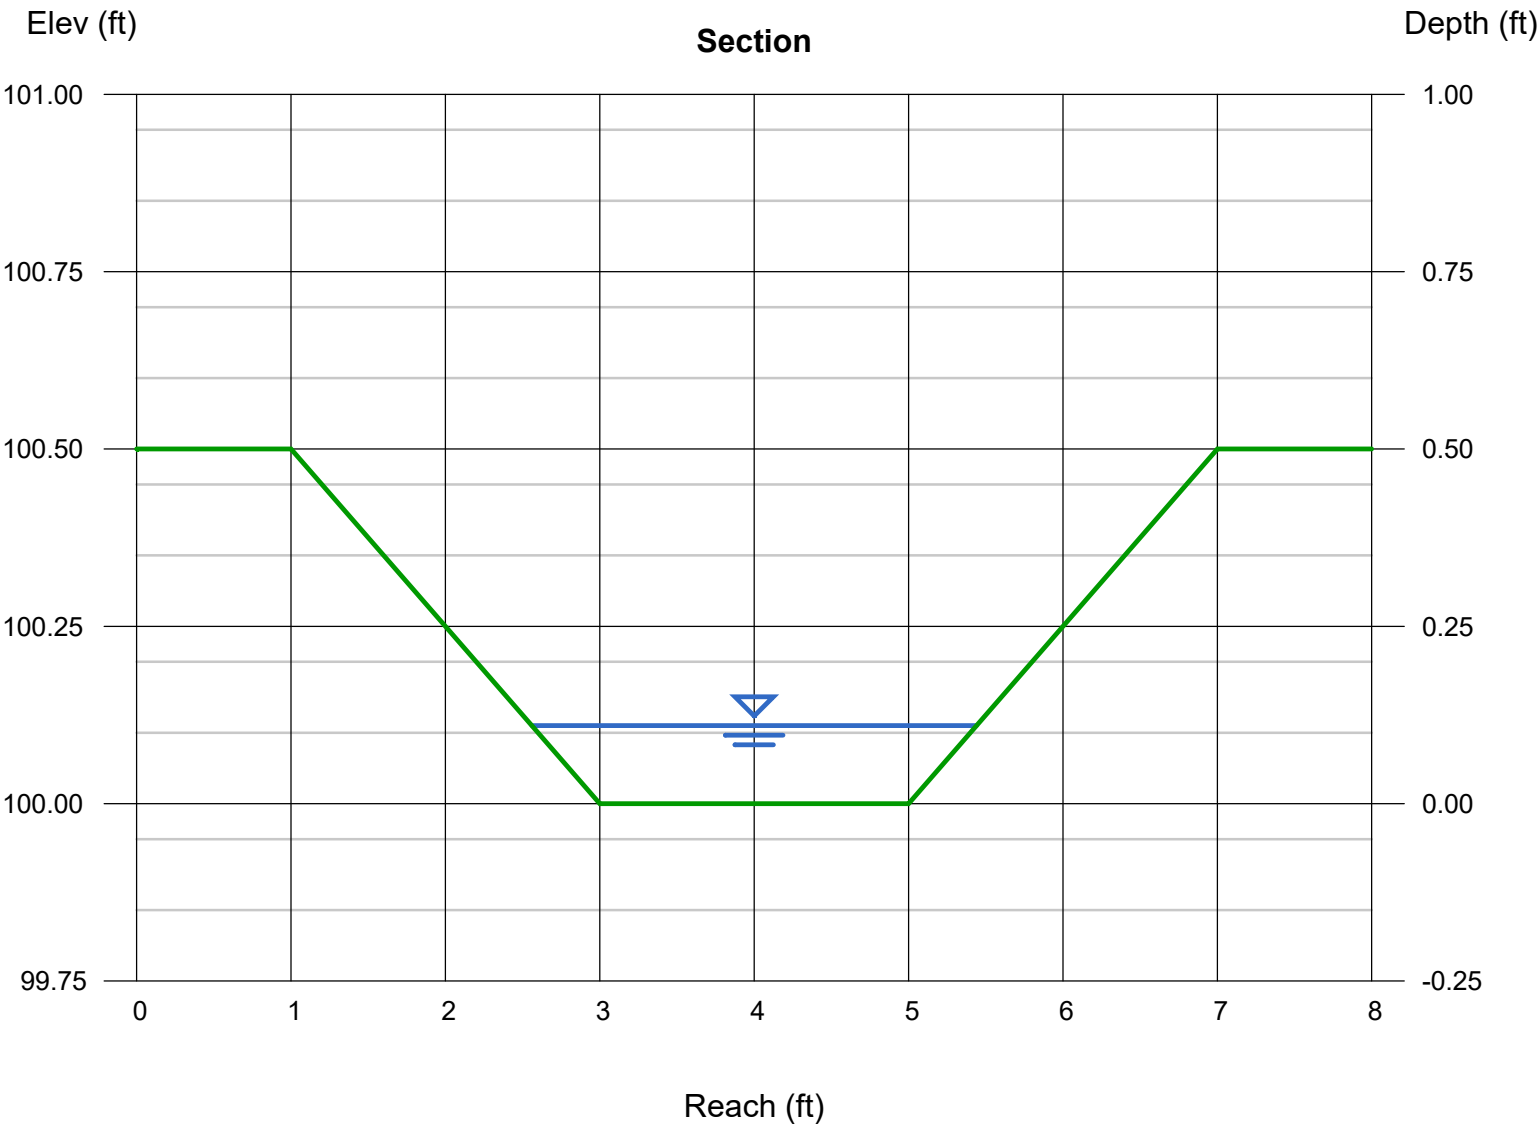

# Channel Report


## WQ Swale for SB8 - Major Event

<b>Trapezoidal</b>		<b>Highlighted</b>	
Bottom Width (ft)	= 2.00	Depth (ft)	= 0.27
Side Slopes (z:1)	= 4.00, 4.00	Q (cfs)	= 1.150
Total Depth (ft)	= 0.50	Area (sqft)	= 0.83
Invert Elev (ft)	= 100.00	Velocity (ft/s)	= 1.38
Slope (%)	= 1.00	Wetted Perim (ft)	= 4.23
N-Value	= 0.035	Crit Depth, Yc (ft)	= 0.20
<b>Calculations</b>		Top Width (ft)	= 4.16
Compute by:		EGL (ft)	= 0.30
Known Q (cfs)	= 1.15		

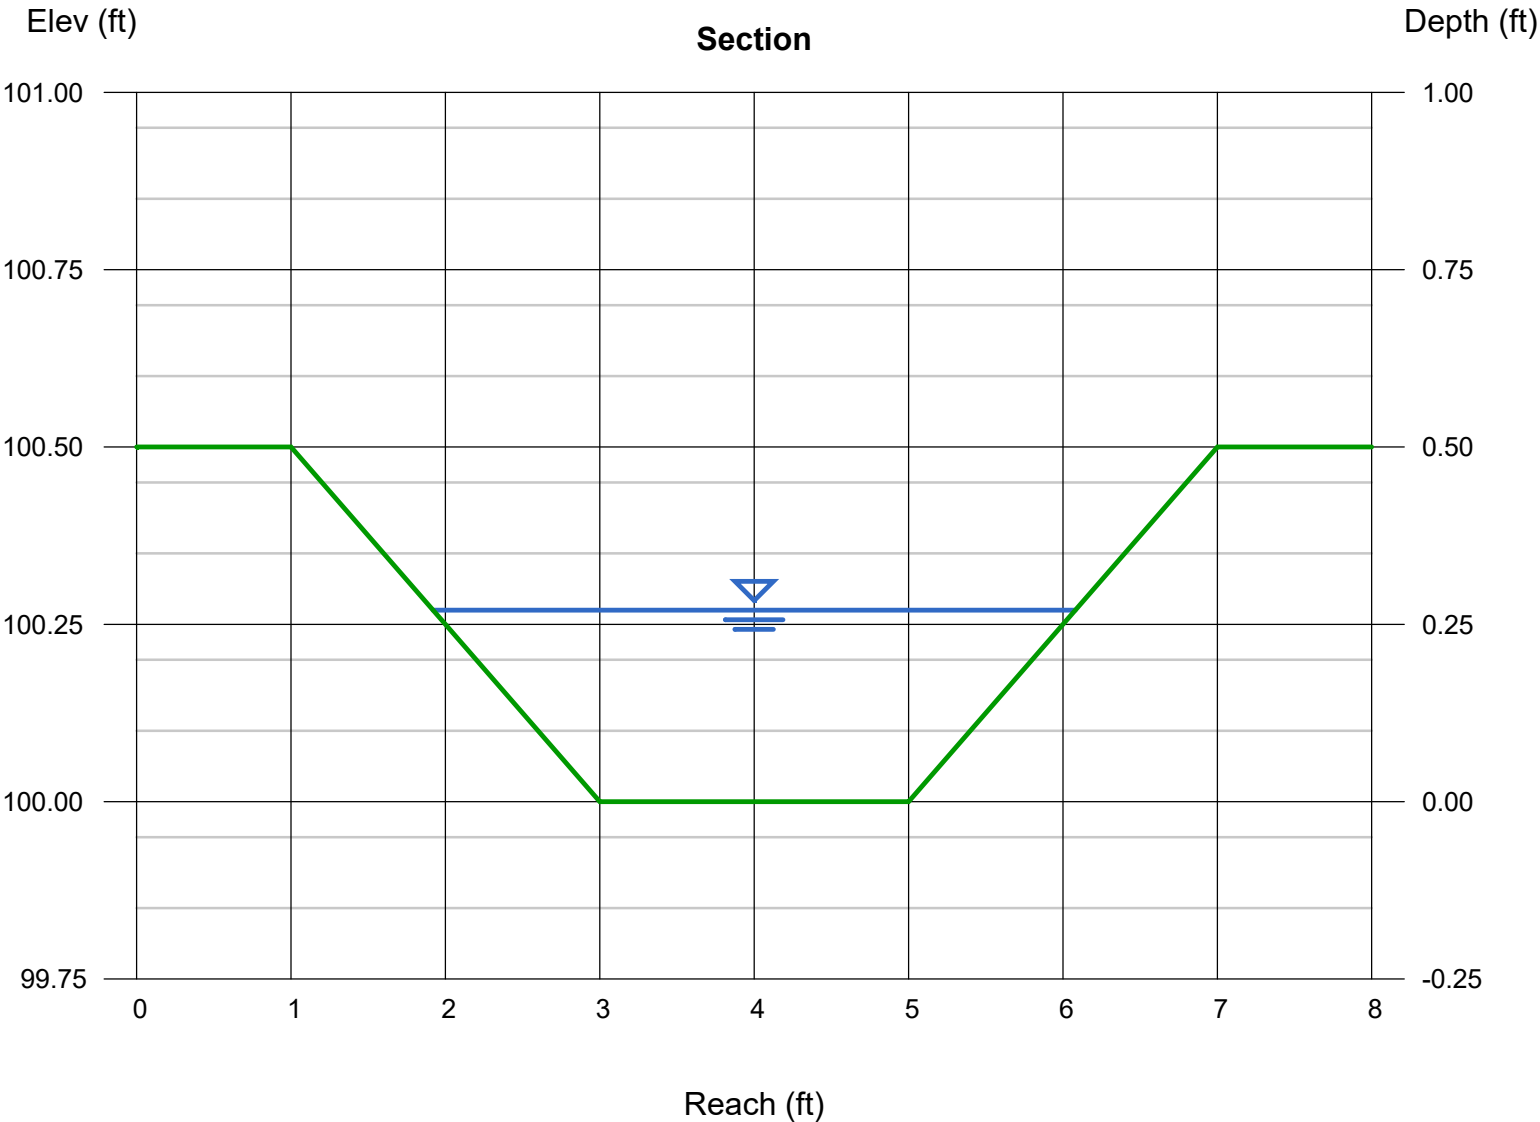

**Appendix G: Inlet Capacity Curves**

Nyloplast 18" Dome Grate Inlet Capacity Chart

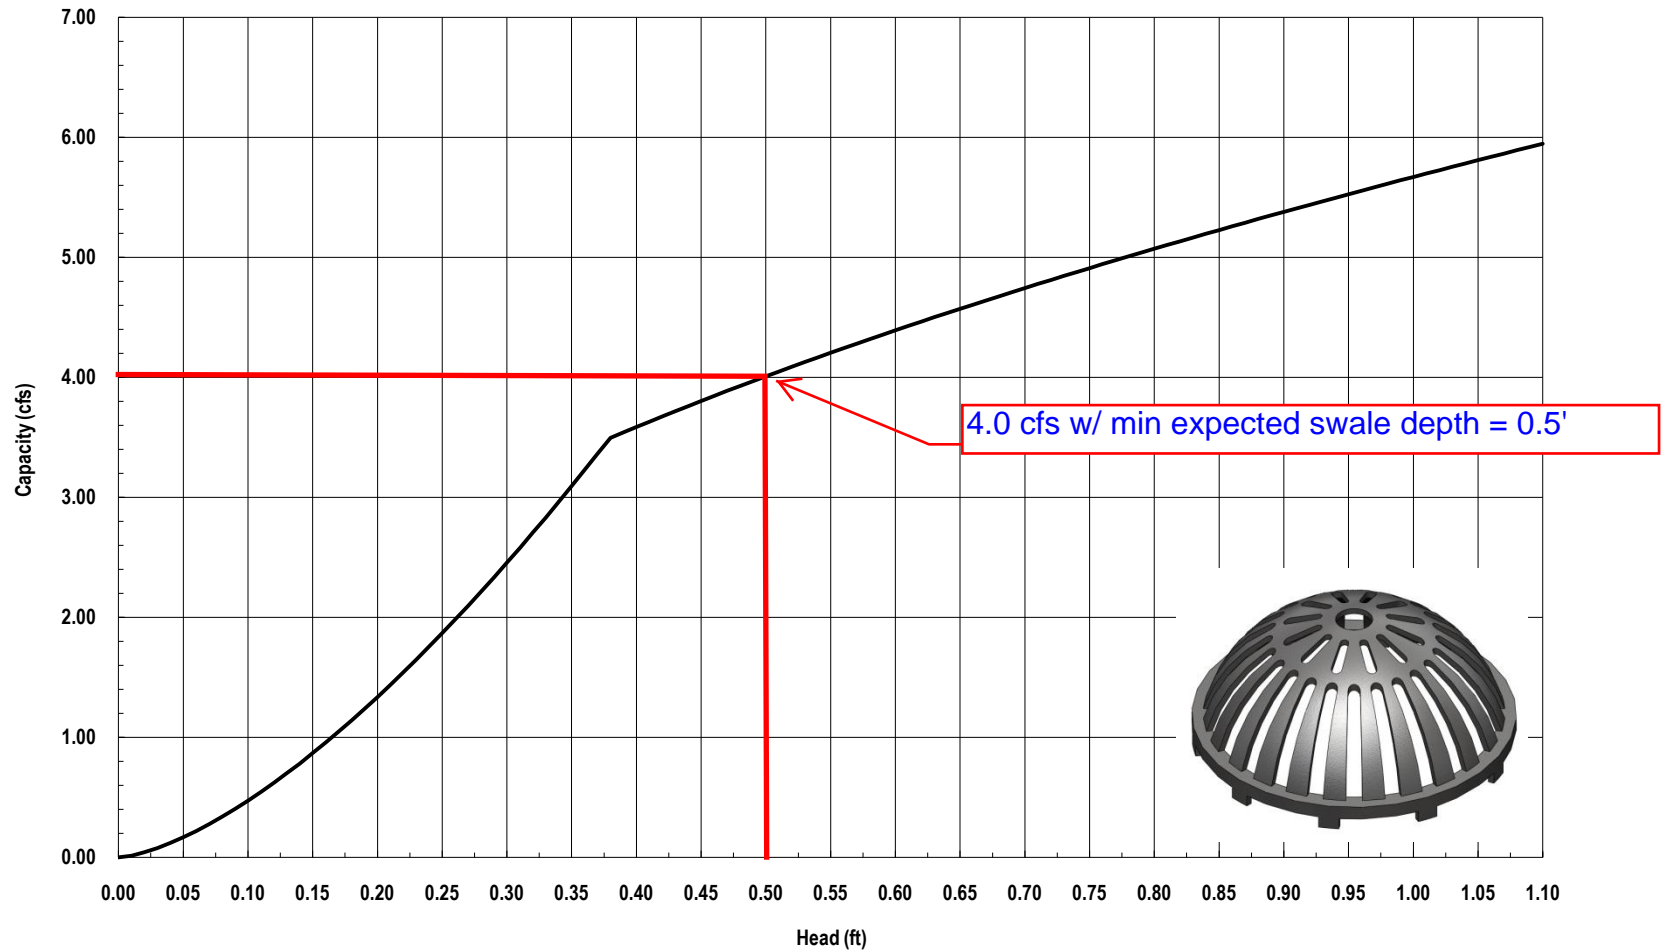

**Nyloplast**<sup>®</sup>


3130 Verona Avenue • Buford, GA 30518  
(866) 888-8479 / (770) 932-2443 • Fax: (770) 932-2490  
© Nyloplast Inlet Capacity Charts June 2012

**Appendix H: Storm Sewer Capacity Calculations**

# Hydraulic Grade Line Computations

Line	Size  (in)	Q  (cfs)	Downstream								Len  (ft)	Upstream								Check		JL coeff  (K)	Minor loss  (ft)
			Invert elev (ft)	HGL elev (ft)	Depth (ft)	Area (sqft)	Vel (ft/s)	Vel head (ft)	EGL elev (ft)	Sf (%)		Invert elev (ft)	HGL elev (ft)	Depth (ft)	Area (sqft)	Vel (ft/s)	Vel head (ft)	EGL elev (ft)	Sf (%)	Ave Sf (%)	Enrgy loss (ft)		
1	24	3.88	6760.00	6761.15	1.15	1.87	2.08	0.07	6761.22	0.063	50.378	6760.16	6761.17	1.00	1.58	2.46	0.09	6761.26	0.099	0.081	0.041	1.50	0.14
2	18	2.98	6760.31	6761.31	1.00	0.74	2.39	0.25	6761.56	0.000	103.341	6761.09	6761.75 j	0.66**	0.74	4.01	0.25	6762.00	0.000	0.000	n/a	1.50	0.38
3	15	2.10	6761.04	6761.75	0.71	0.55	2.94	0.22	6761.97	0.000	46.734	6761.43	6762.01 j	0.58**	0.55	3.79	0.22	6762.23	0.000	0.000	n/a	1.11	n/a
4	12	1.00	6761.79	6762.20	0.41*	0.30	3.33	0.16	6762.36	0.000	166.886	6762.72	6763.14	0.42**	0.31	3.20	0.16	6763.30	0.000	0.000	n/a	1.00	0.16
5	12	0.68	6761.22	6761.75	0.53	0.24	1.63	0.13	6761.87	0.000	133.802	6762.31	6762.65 j	0.34**	0.24	2.84	0.13	6762.78	0.000	0.000	n/a	1.00	0.13
Project File: NETWORK_11-28-22_MINOR.stm														Number of lines: 5					Run Date: 11/10/2022				
Notes: * depth assumed; ** Critical depth.; j-Line contains hyd. jump ; c = cir e = ellip b = box																							


Storm Sewer Profile

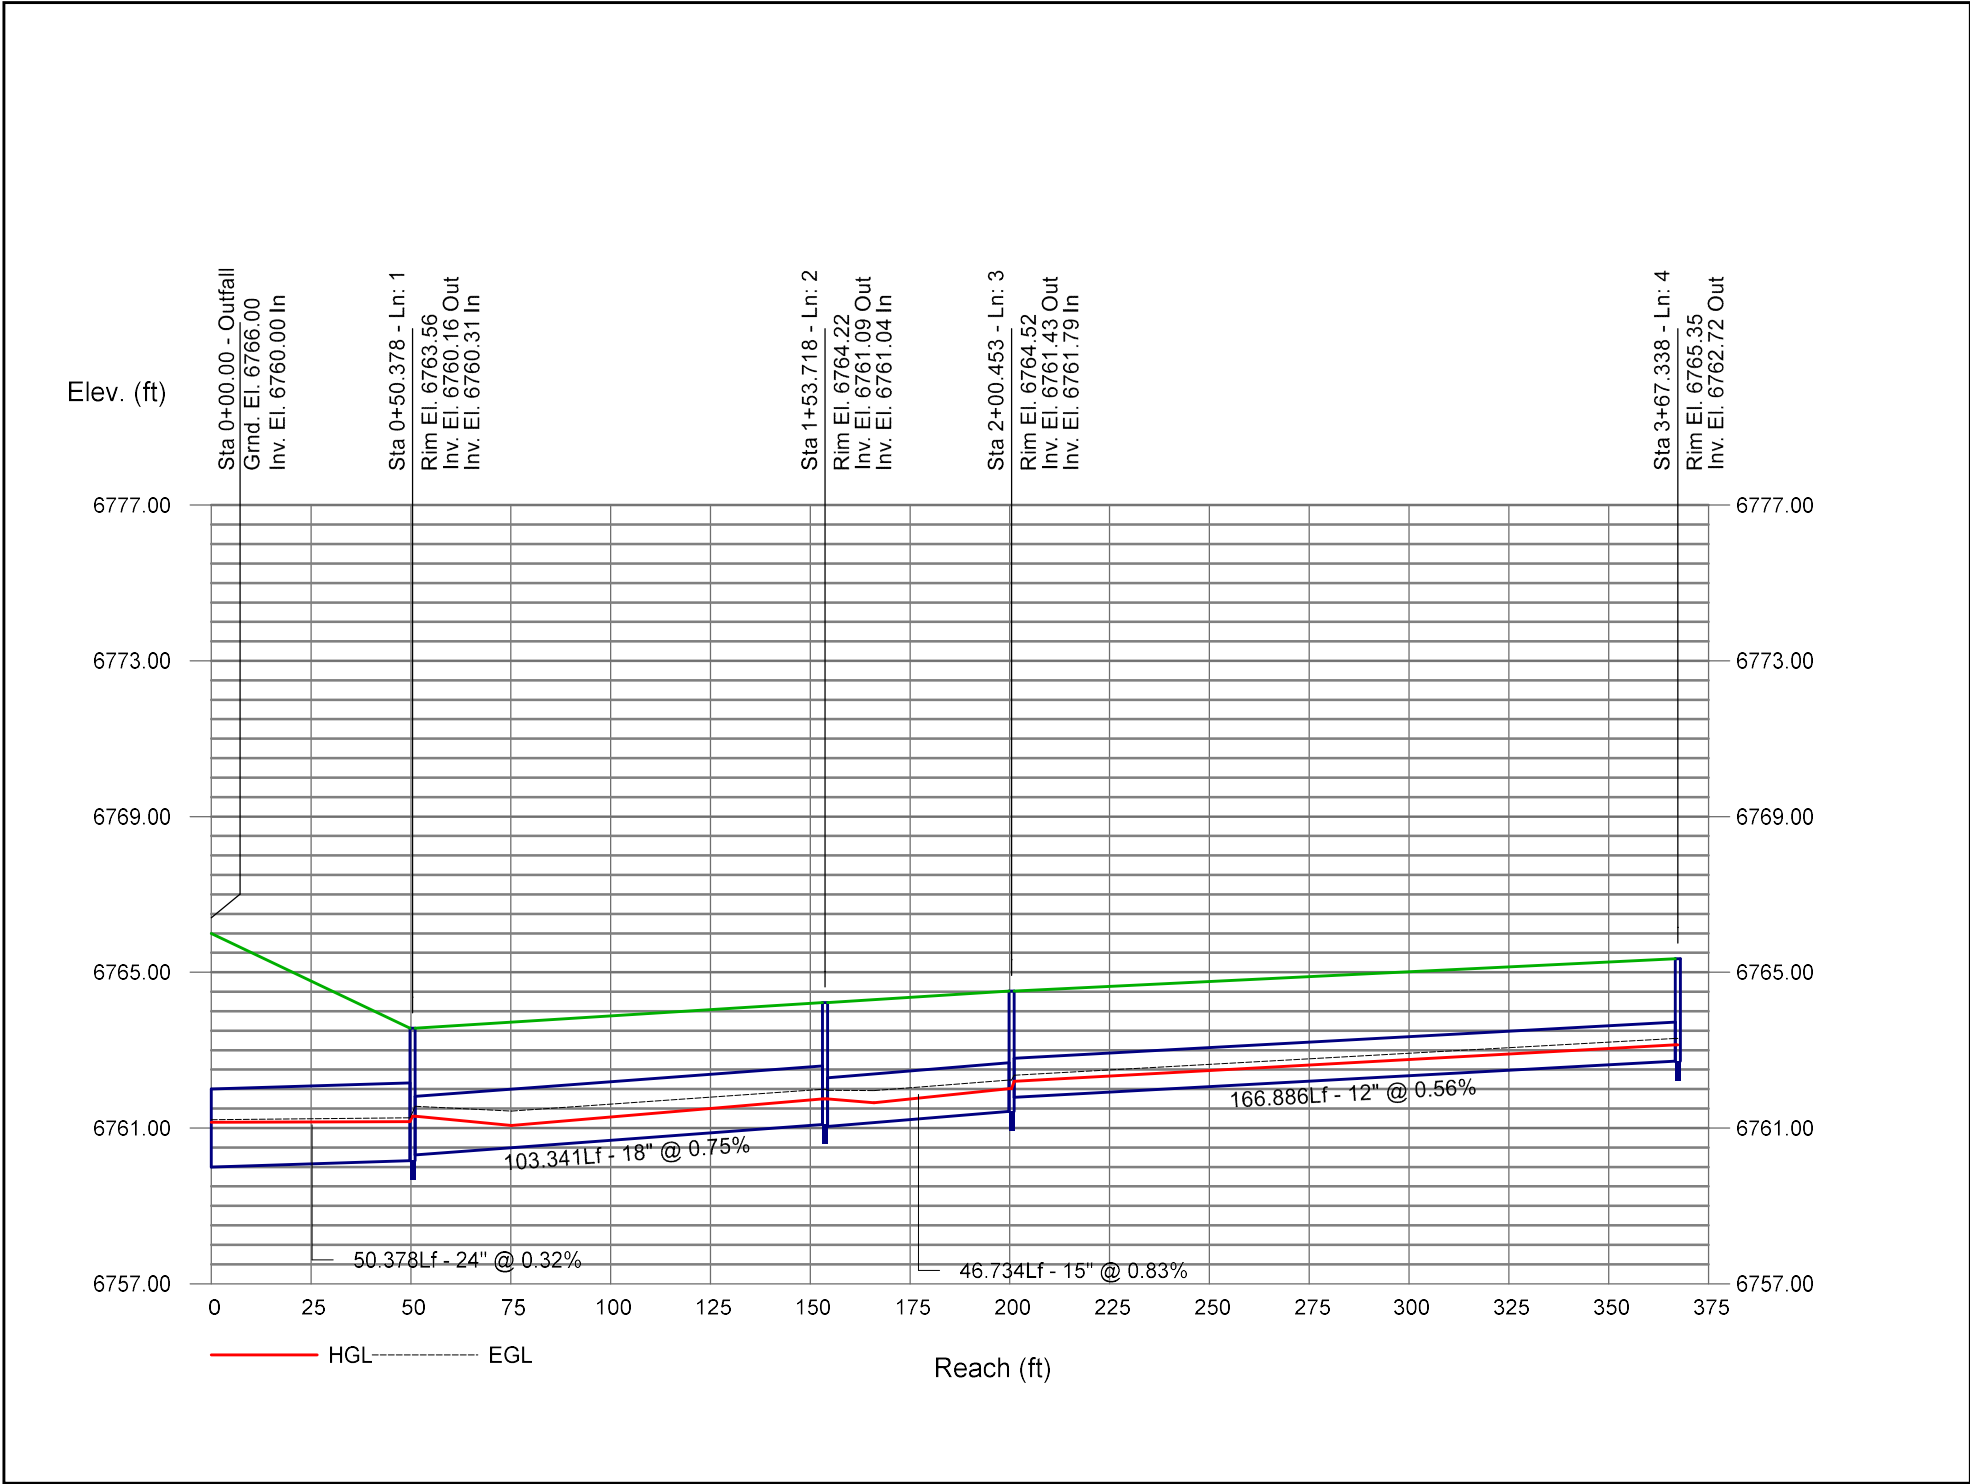




# Storm Sewer Profile


Proj. file: NETWORK\_11-28-22\_MAJOR.stm

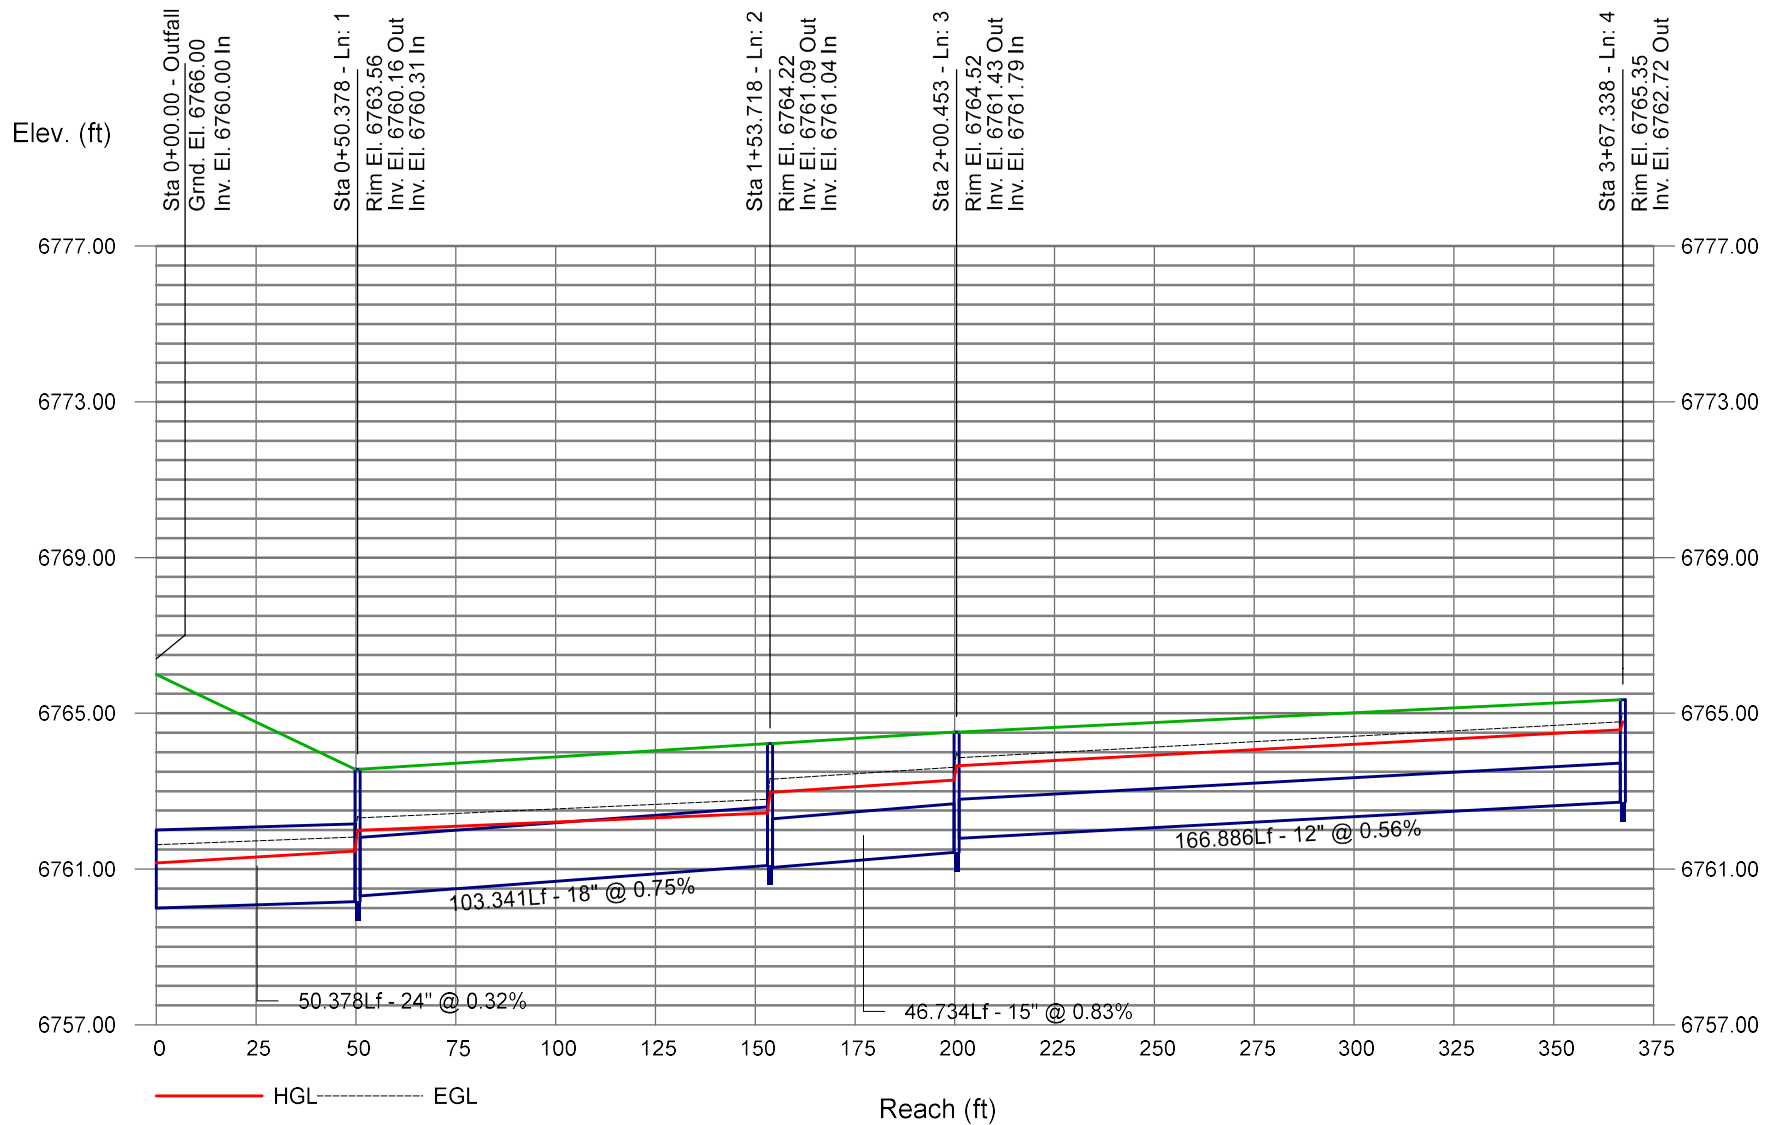

Storm Sewer Profile

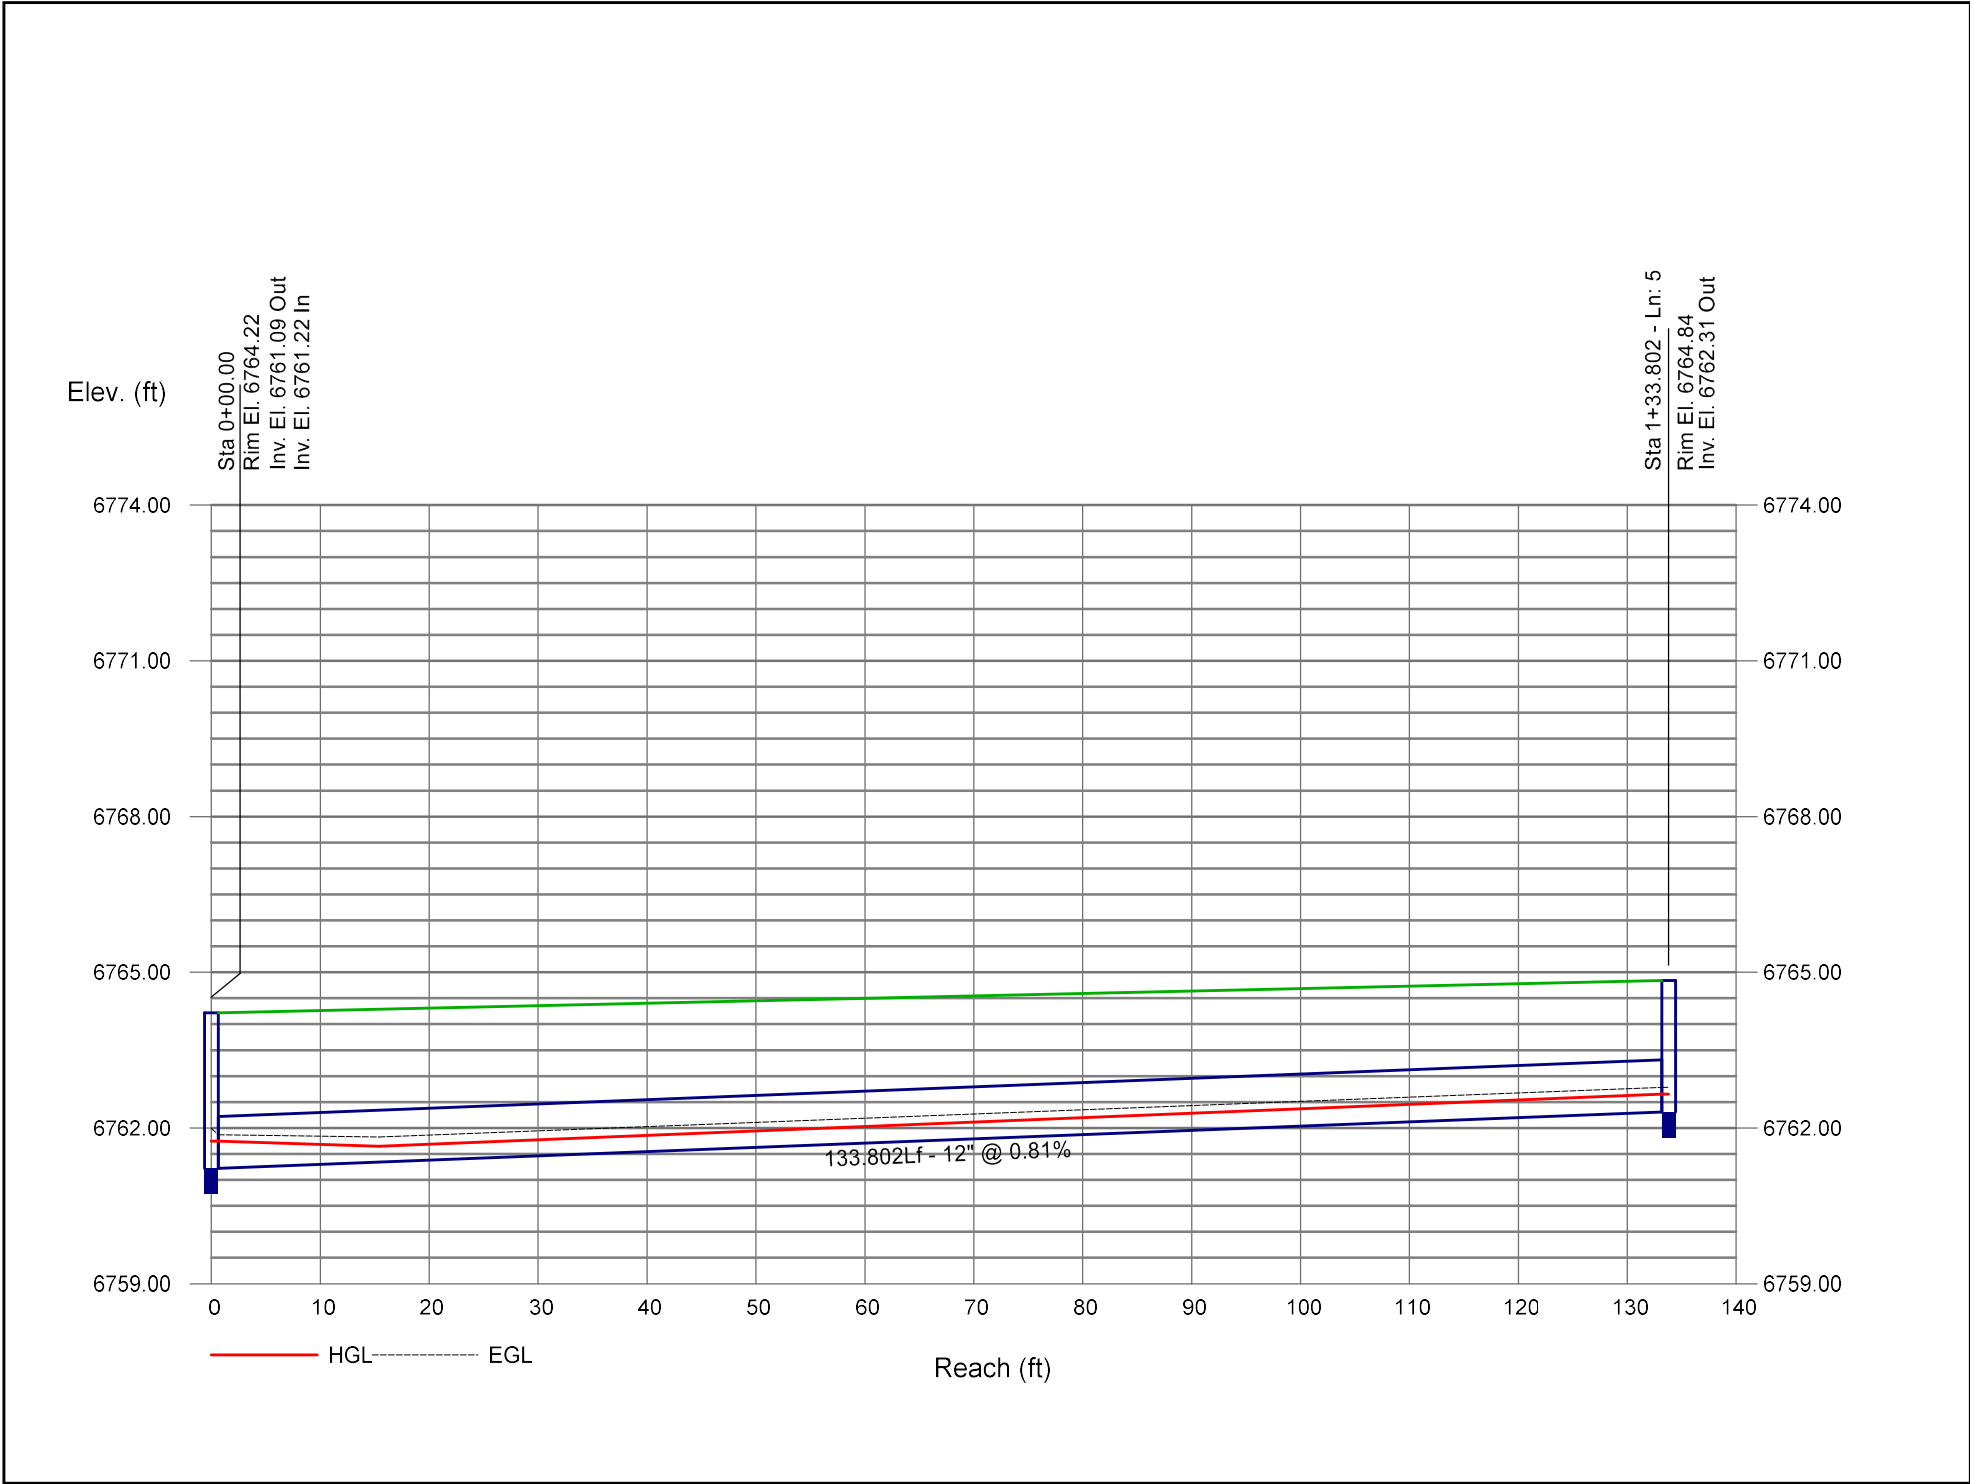

# Storm Sewer Profile

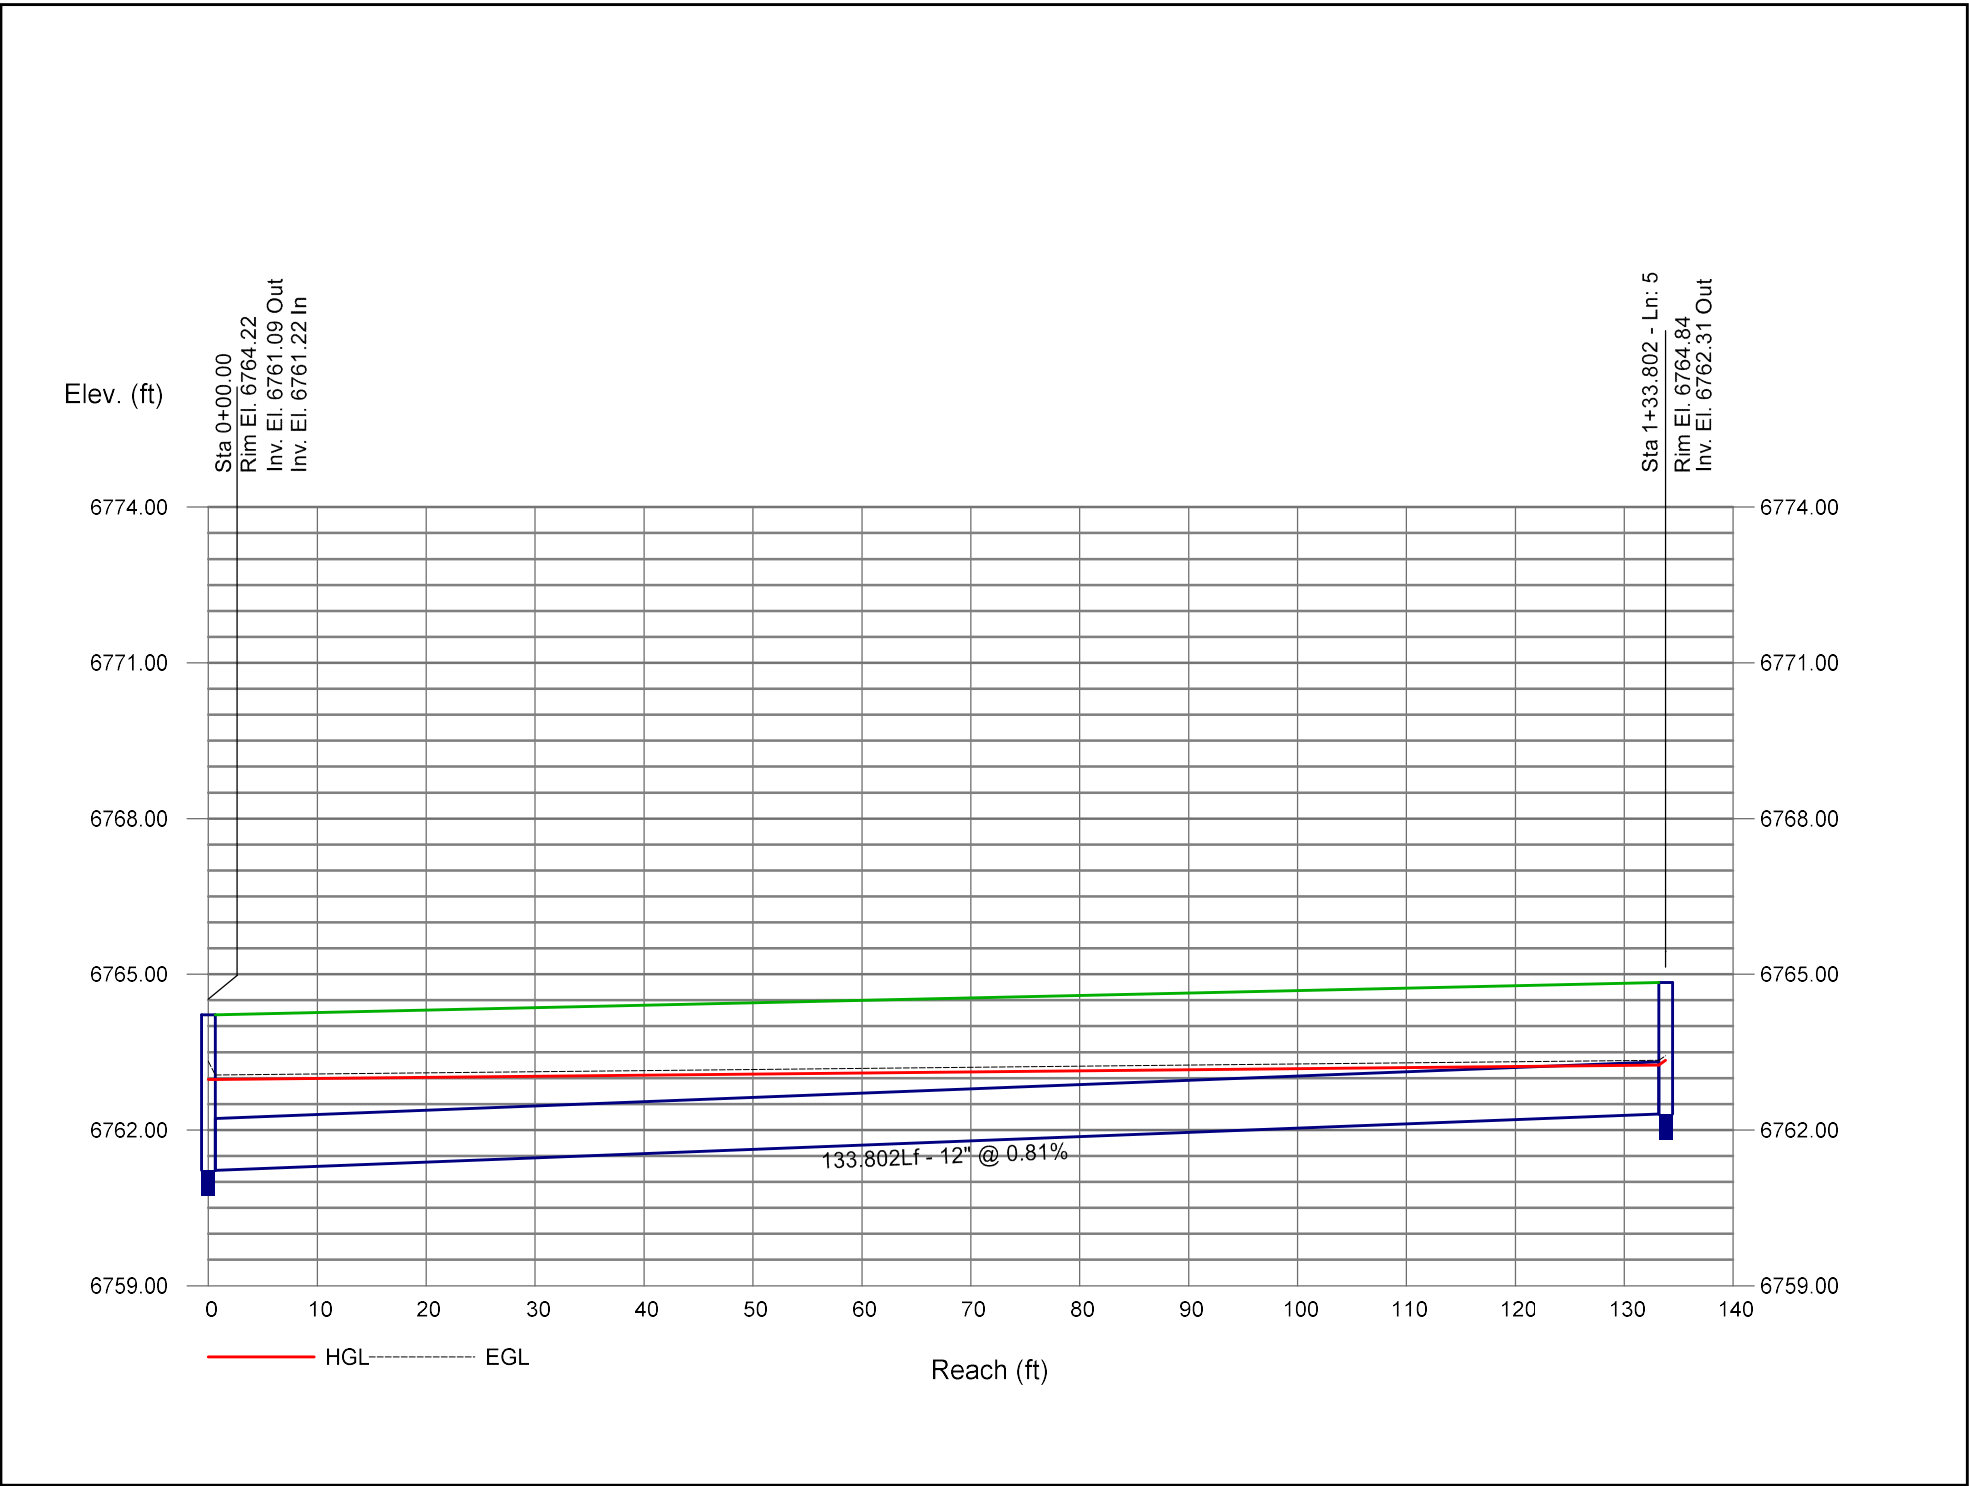

**Appendix I: Standard forms No. 3, 4, & 5**

# CITY OF STEAMBOAT SPRINGS ENGINEERING STANDARDS

## Standard Form No. 3 Final Drainage Study Checklist

### Instructions:

1. The applicant shall identify with a "check mark" if information is provided with letter. If applicant believes information is not required, indicate with "N/A" and attach separate sheet with explanation.
2. The reviewer will determine if information labeled "N/A" is required and whether additional information must be submitted.

### I. General

- \_\_\_\_\_ A. Report typed and legible in 8½" x 11" format.
- \_\_\_\_\_ B. Report bound (comb, spiral, or staple – no notebook).
- \_\_\_\_\_ C. Drawings that are 8½ x 11 or 11 x 17 bound within report, larger drawings (up to 24 x 36) included in a pocket attached to the report. Drawings shall be at an appropriate size and scale to be legible and include project area.

### II. Cover

- \_\_\_\_\_ A. Report Type – Final Drainage Study.
- \_\_\_\_\_ B. Project Name, Subdivision, Original Date, Revision Date.
- \_\_\_\_\_ C. Preparer's name, firm, address, phone number.
- \_\_\_\_\_ D. "DRAFT" for 1<sup>st</sup> submittal and revisions; "FINAL" once approved.

### III. Title Sheet

- \_\_\_\_\_ A. Table of Contents.
- \_\_\_\_\_ B. Certification, PE Stamp, signature, and date from licensed Colorado PE.
- \_\_\_\_\_ C. Note: City of Steamboat Springs plan review and approval is only for general conformance with City design criteria and the City code. The City is not responsible for the accuracy and adequacy of the design, dimensions, and elevations that shall be confirmed and correlated at the job site. The City of Steamboat Springs assumes no responsibility for the completeness or accuracy of this document.

### IV. Introduction

- \_\_\_\_\_ A. Description of site location, size in acres, existing and proposed land use, and any pertinent background info.
- \_\_\_\_\_ B. Reference planning application type and plan set date and preparer.
- \_\_\_\_\_ C. Identify drainage reports for adjacent development.

### V. Drainage Criteria and Methodology Used

- \_\_\_\_\_ A. Identify design rainfall and storm frequency.
- \_\_\_\_\_ B. Identify the runoff calculation method used.
- \_\_\_\_\_ C. Identify culvert and storm sewer design methodology.
- \_\_\_\_\_ D. Identify detention discharge and storage methodology.
- \_\_\_\_\_ E. Discuss HEC-HMS methodologies and parameters, if HEC-HMS is used.

## CITY OF STEAMBOAT SPRINGS ENGINEERING STANDARDS

### VI. Existing Conditions (Pre-Development/Historic)

- \_\_\_\_\_ A. Indicate ground cover, imperviousness, topography, and size of site (acres).
- \_\_\_\_\_ B. Describe existing stormwater system (sizes, materials, etc.).
- \_\_\_\_\_ C. Describe other notable features (canals, major utilities, etc.).
- \_\_\_\_\_ D. Note site outfall locations and ultimate outfall location (typically Yampa River).
- \_\_\_\_\_ E. Note capacity of existing system and identify any constraints.
- \_\_\_\_\_ F. Identify NRCS soil type.
- \_\_\_\_\_ G. Discuss any existing easements.
- \_\_\_\_\_ H. Identify the FEMA Map reviewed, if site is in floodplain/way, and zone designation.

### VII. Proposed Conditions

- \_\_\_\_\_ A. Indicate ground cover, imperviousness, topography, and disturbed area (acres).
- \_\_\_\_\_ B. Describe proposed stormwater system (sizes, materials, etc.).
- \_\_\_\_\_ C. Describe proposed outlets and indicate historic and proposed flow for each.
- \_\_\_\_\_ D. Include calculations for all culverts, ditches, ponds, etc. in appendix.
- \_\_\_\_\_ E. Include a summary table for the 5- and 100-year events showing historic flow and proposed flow for total site and each basin.
- \_\_\_\_\_ F. Discuss proposed easements.
- \_\_\_\_\_ G. Describe off-site flows to be passed thru site.
- \_\_\_\_\_ H. Summarize any impacts to downstream properties or indicate none. Reference CLOMR/LOMR and impacts.
- \_\_\_\_\_ I. Detention Ponds.
  - \_\_\_\_\_ 1. Indicate pond volume and area (size and depth) requirement.
  - \_\_\_\_\_ 2. Indicate release rates.
  - \_\_\_\_\_ 3. Discuss outfall design, location, and overflow location.
  - \_\_\_\_\_ 4. Discuss maintenance requirements.
- \_\_\_\_\_ J. Curb and Gutter
  - \_\_\_\_\_ 1. Indicate gutter capacity.
  - \_\_\_\_\_ 2. Indicate curb capacity.
  - \_\_\_\_\_ 3. Indicate design velocity
  - \_\_\_\_\_ 4. Indicate design depth of flow in street.
- \_\_\_\_\_ K. Culverts
  - \_\_\_\_\_ 1. Indicate whether each culvert is under inlet or outlet control.
  - \_\_\_\_\_ 2. Show that headwater is less than the maximum allowable.
  - \_\_\_\_\_ 3. Indicate design velocity.
  - \_\_\_\_\_ 4. Indicate required and provided flow rates.
  - \_\_\_\_\_ 5. Discuss whether outlet protection is required and what will be used.
- \_\_\_\_\_ L. Inlets
  - \_\_\_\_\_ 1. Indicate inlet capacity.
  - \_\_\_\_\_ 2. Indicate the type of inlet(s) used.
- \_\_\_\_\_ M. Channels
  - \_\_\_\_\_ 1. Indicate design velocity (and type of dissipation if required).
  - \_\_\_\_\_ 2. Indicate required and provided flow capacity.
  - \_\_\_\_\_ 3. Show critical cross-section(s) including water surface.
- \_\_\_\_\_ N. Site Discharge
  - \_\_\_\_\_ 1. Discuss use and design of detention to ensure discharge is less than or equal to historic flow.
  - \_\_\_\_\_ 2. Provide documentation that downstream facilities are adequate and no adverse impacts to downstream property owners (i.e. no rise certification)

# CITY OF STEAMBOAT SPRINGS ENGINEERING STANDARDS

## VIII. Post Construction Stormwater Management

- \_\_\_\_\_ A. Discuss in general terms which permanent BMP practices will be used to control pollutant and sediment discharge after construction is complete. Exhibit A, Storm Water Quality Plan shall be attached that will give details (see separate checklist)

## IX. Conclusions

- \_\_\_\_\_ A. Provide general summary.
- \_\_\_\_\_ B. Note if site complies with criteria and any variances to criteria.
- \_\_\_\_\_ C. Indicate if peak proposed flow is less than, equal to, or greater than peak historic flow for each outfall, design point, and for the total site.
- \_\_\_\_\_ D. List proposed new stormwater system requirements.

## X. References

- \_\_\_\_\_ A. Provide a reference list of all criteria, master plans, drainage reports and technical information used.

## XI. Tables

- \_\_\_\_\_ A. Include a copy of all tables prepared for the study.

## XII. Figures

- \_\_\_\_\_ A. Vicinity Map.
- \_\_\_\_\_ B. Site Plan (include the horizontal and vertical datum used and all benchmarks).
- \_\_\_\_\_ C. Existing conditions.
  - \_\_\_\_\_ 1. Delineate existing basin boundaries.
  - \_\_\_\_\_ 2. Delineate offsite basins impacting the site.
  - \_\_\_\_\_ 3. Show existing and proposed topography at an interval of at least 2-ft.
  - \_\_\_\_\_ 4. Show existing runoff flow arrows.
  - \_\_\_\_\_ 5. Show existing stormwater features (structures, sizes, materials, etc.).
  - \_\_\_\_\_ 6. Show floodplain limits and information.
  - \_\_\_\_\_ 7. For each basin show bubble with basin number, acreage and % impervious.
  - \_\_\_\_\_ 8. For each outlet show bubble with acreage and historic flow and proposed flow or provide information in summary table on figure.
- \_\_\_\_\_ D. Proposed Conditions
  - \_\_\_\_\_ 1. Delineate proposed basin boundaries.
  - \_\_\_\_\_ 2. Show proposed runoff flow arrows.
  - \_\_\_\_\_ 3. Show existing and proposed topography at an interval of at least 2-ft.
  - \_\_\_\_\_ 4. For each basin show bubble with basin number, acreage and percent impervious or provide a summary table or figure.
  - \_\_\_\_\_ 5. For each outlet show bubble with acreage, historic flow, and proposed flow or provide a summary table or figure.
  - \_\_\_\_\_ 6. Show floodplain limits and information.
  - \_\_\_\_\_ 7. Show proposed building footprints and FFE for commercial and multi-family
  - \_\_\_\_\_ 8. Show property lines and easements (existing and proposed).
  - \_\_\_\_\_ 9. Label public and private facilities. A general note can be placed on the plans in lieu of labeling all facilities, if applicable.

## CITY OF STEAMBOAT SPRINGS ENGINEERING STANDARDS

### **XIII. Appendices**

- \_\_\_\_\_ A. Runoff Calculations.
- \_\_\_\_\_ B. Culvert Calculations.
- \_\_\_\_\_ C. Pond Calculations.
- \_\_\_\_\_ D. Other Calculations.

### **Acknowledgements**

Standard Form No. 3 was prepared by: \_\_\_\_\_

\_\_\_\_\_

Date

**Include Attachment A – Scope Approval Form (see Standard Form No. 5)**

**Include Attachment B – Storm Water Quality Plan (see Standard Form No. 4)**



# CITY OF STEAMBOAT SPRINGS ENGINEERING STANDARDS

## Standard Form No. 4 Stormwater Quality Plan Checklist

This list is not an exhaustive list of every possible item that may be required or requested in a Stormwater Quality Plan but provides a general guideline for preparation of the Stormwater Quality Plan.

### Instructions:

1. The applicant shall identify with a "check mark" if information is provided within the Stormwater Quality Plan. If applicant believes information is not required, indicate with "N/A" and attach separate sheet with explanation. If information is included with the associated drainage letter or study, indicated with a "D."
2. The reviewer will determine if information labeled "N/A" is required and whether additional information must be submitted.

### I. General

- ☐ A. Report typed and legible in 8½" x 11" format.
- ☐ B. Report bound (comb, spiral, or staple – no notebook) and in digital PDF format.
- ☐ C. Drawings that are 11" x 17" bound within letter, larger drawings (up to 24" x 36") included in a pocket attached to the letter, and a digital PDF copy. Drawings shall be at an appropriate size and scale to be legible and include project area.

### II. Cover

- ☐ A. Report Type – Stormwater Quality Plan.
- ☐ B. Project Name, Subdivision or Development, Original Date, Revision Date.
- ☐ C. Preparer's name, firm, address, and phone number.
- ☐ D. "DRAFT" for 1<sup>st</sup> submittal and revisions; "FINAL" once approved.

### III. Title Sheet

- ☐ A. Table of Contents.
- ☐ B. Certification, PE Stamp, signature and date from licensed Colorado PE (for Final).
- ☐ C. Note: City of Steamboat Springs plan review and approval is only for general conformance with City design criteria and City code. The City is not responsible for the accuracy and adequacy of the design, dimensions, and elevations that shall be confirmed and correlated at the job site. The City of Steamboat Springs assumes no responsibility for the completeness or accuracy of this document.

### IV. Introduction and Background

- ☐ A. Description of site location, study limits, size in acres, existing and proposed land use, soil data, permeability of the site, drainage patterns, and any pertinent background info.
- ☐ B. State purpose and goal of Stormwater Quality Plan and report along with any special requirements of the desired outcome.
- ☐ C. List any project stakeholders and/or requestors.
- ☐ D. Describe the background of the flooding source and any previous studies.

## CITY OF STEAMBOAT SPRINGS ENGINEERING STANDARDS

### V. Design Criteria and Methodology Used

- \_\_\_\_\_ A. Identify design rainfall and storm frequency used to design permanent stormwater treatment facilities.
- \_\_\_\_\_ B. Identify the runoff calculation method used to design permanent stormwater treatment facilities.
- \_\_\_\_\_ C. Identify the standard the design will meet and the means and methodologies by which it will use to meet the standard.
- \_\_\_\_\_ D. Provide all details supporting the use of the selected design standard.

### VI. Proposed Conditions

- \_\_\_\_\_ A. Identify total site area, total site imperviousness, area to be treated, and impervious area to be treated. Include justification for treating less than the total site area.
- \_\_\_\_\_ B. Describe potential site contaminant sources including sediment.
- \_\_\_\_\_ C. Identify source and quantity of on-site and off-site stormwater flows that need to be managed and how they will be managed.
- \_\_\_\_\_ D. For each permanent treatment facility, identify the design standard, MDCIA level (if applicable), area treated (& percentage of total), imperviousness of area treated, C values of area treated, soil types, and all pertinent data for design.
- \_\_\_\_\_ E. Volume based facilities: Provide total storage pond volume, WQCV, drain time, release rate, sediment storage, outlet & overflow structures, area and depth of pond, micropool, forebays, etc. (include all calculations in the appendix).
- \_\_\_\_\_ F. Flow based facilities: Provide design flow rate and all treatment calculations and how flows larger than the water quality design flow rate will be handled. If proprietary facilities are proposed, provide the justification and sizing requirements from manufacturer.
- \_\_\_\_\_ G. If stormwater detention is provided, discuss how water quality is provided within the detention facility. No underground detention is allowed.

### VII. Operation and Maintenance Plan Requirements

See template O&M plan and guidance document.

- \_\_\_\_\_ A. Describe general project information, facility description, ROW and access information, vegetation management, hydraulic design parameters, environmental permitting, snow and ice control, and additional pertinent information in the notes.
- \_\_\_\_\_ B. Indicate, describe, and detail the permanent stormwater treatment facilities.
- \_\_\_\_\_ C. Include section details where necessary of the permanent treatment facilities.
- \_\_\_\_\_ D. Provide an inspection and maintenance schedule and procedure of permanent treatment facilities and who is responsible for them.
- \_\_\_\_\_ E. Identify design specifications for construction.

### Acknowledgements

Standard Form No. 4 prepared by: \_\_\_\_\_

\_\_\_\_\_  
Date

**Include appropriate Project Sheet(s) and Design Checklist(s) (See Section 5.12)**  
**Include this form as part of the Stormwater Quality Plan.**

# CITY OF STEAMBOAT SPRINGS ENGINEERING STANDARDS

## Standard Form No. 5 Drainage and Stormwater Treatment Scope Approval Form

Prior to starting a development plan and before the first drainage submittal, a Drainage and Stormwater Treatment Scope Approval Form must be submitted for review and signed by the City Engineer. A signed form shall also be included in every drainage submittal as Attachment A. This Scope Approval Form is for City requirements only. Values may be approximate. The City encourages supporting calculations and figures to be attached.

Project Information	
Project name:	Lot 1 Indian Meadows (Name subject to change)
Project location:	Lot 1 Indian Meadows
Developer name/contact info:	GRAY STONE, LLC
Drainage engineer name/contact info:	Joe Wiedemeier, PE FPSE
Application Type:	Development Plan
Proposed Land Use:	Hotel - Commercial
Project Site Parameters	
Total parcel area (acres):	3.875
Disturbed area (acres):	3.5
Existing impervious area (acres, if applicable):	0.25
Proposed new impervious area (acres):	2.5
Proposed total impervious area (acres):	2.5
Proposed number of project outfalls:	3
Number of additional parking spaces:	160+-
Description and site percentage of existing cover/land use(s):	Vacant except for paved access roads Sparse vegetation and bare ground Wetlands located along the east property line
Description and site percentage of proposed cover/land use(s):	Commercial Development (2) new hotels and all associated infrastructure
Expected maximum proposed conveyance gradient (%):	5%
Description of size (acres) and cover/land use(s) of offsite areas draining to the site	Minimal off site areas draining to the site.

# CITY OF STEAMBOAT SPRINGS ENGINEERING STANDARDS

## Type of Study Required:

- ☐ Drainage Letter
 ☐ Conceptual Drainage Study  
☒ Final Drainage Study
 ☒ Stormwater Quality Plan

## Hydrologic Evaluation:

- ☒ Rational Method
 ☐ CUHP/SWMM
 ☐ HEC-HMS
 ☐ Other \_\_\_\_\_

Project Drainage	
Number of subbasins to be evaluated:	3 main basins, multiple sub basins
Presence of pass through flow (circle):	YES <b>NO</b>
Description of proposed stormwater conveyance on site:	See drainage exhibit, DR1. Sheet flow, curb/gutter combo (rollback curbs), inlets, swales, WQ features
Project includes roadway conveyance as part of design evaluation (circle):	<b>YES</b> NO
Description of conveyance of site runoff downstream of site, identify any infrastructure noted in Stormwater Master Plan noted as lacking capacity for minor or major storm event:	Runoff from DB1 basin will outfall along the east property line and in the form of concentrated flow at the NE property corner.
Detention expected onsite (circle):	YES <b>NO</b> Per hydraulic study of Walton Creek/Yampa
Presence of Floodway or Floodplain on site (circle):	<b>YES</b> NO Floodplains associated with the site
Anticipated modification of Floodway or Floodplain proposed (circle):	<b>YES</b> NO <b>Floodplain development proposed</b>
Describe culvert or storm sewer conveyance evaluative method:	mannings for partial flow, inlet and outlet control for full flow conditions

## Permanent Stormwater Treatment Facility Design Standard (check all that apply with only one standard per tributary basin):

- ☒ WQCV Standard
 ☒ TSS Standard
 ☐ Infiltration Standard  
☐ Constrained Redevelopment WQCV Standard  
☐ Constrained Redevelopment TSS Standard  
☐ Constrained Redevelopment Infiltration Standard  
☐ Does not Require Permanent Stormwater Treatment (attach Exclusion Tracking Form)

# CITY OF STEAMBOAT SPRINGS ENGINEERING STANDARDS

Project Permanent Stormwater Treatment	
Justification of choice of proposed design standard, including how the site meets the constrained redevelopment standard, infiltration test results, etc.:	Possibly both WQCV and TSS standards for a treatment train configuration. Otherwise one of the two will be used. Perhaps one large sand filter to treat all runoff.
Concept-level permanent stormwater treatment facility design details (type, location of facilities, proprietary structure selection, treatment train concept, etc.):	Combination of water quality swales, rain gardens, and sand filtration. Facilities will be combined into the parking lot design and primarily along the east property line and NE property corner (sand filter location). Water quality swale along the East edge of parkign lot.
Proposed LID measures to reduce runoff volume:	Possible rain gardens designed into the landscape islands in the parking lot.
Will treatment evaluation include off-site, pass through flow (circle):	YES <input checked="" type="radio"/> NO

## Approvals

Joe Wiedemeier, PE   FPSE   10-13-2021                      515-451-5377

Prepared By: \_\_\_\_\_ Date \_\_\_\_\_ Phone number \_\_\_\_\_  
(Insert drainage engineer name & firm)

Approved By: \_\_\_\_\_

Printed Name: \_\_\_\_\_ Date \_\_\_\_\_  
City Engineer

**APPROVED**  
 to be generally in  
 accordance with  
**CITY ENGINEERING**  
**STANDARDS**  
  
**12/17/2021**

# CITY OF STEAMBOAT SPRINGS ENGINEERING STANDARDS

## Standard Form No. 5 Drainage and Stormwater Treatment Scope Approval Form

Prior to starting a development plan and before the first drainage submittal, a Drainage and Stormwater Treatment Scope Approval Form must be submitted for review and signed by the City Engineer. A signed form shall also be included in every drainage submittal as Attachment A. This Scope Approval Form is for City requirements only. Values may be approximate. The City encourages supporting calculations and figures to be attached.

Project Information	
Project name:	Lot 1 Indian Meadows (Name subject to change)
Project location:	Lot 1 Indian Meadows
Developer name/contact info:	GRAY STONE, LLC
Drainage engineer name/contact info:	Mary B. Wohnrade, P.E., 11582 Colony Row, Broomfield, CO 80021, 720-259-0965, Ext 103
Application Type:	Development Plan
Proposed Land Use:	Hotel - Commercial
Project Site Parameters	
Total parcel area (acres):	3.875
Disturbed area (acres):	3.5
Existing impervious area (acres, if applicable):	0.25
Proposed new impervious area (acres):	2.5
Proposed total impervious area (acres):	2.5
Proposed number of project outfalls:	3
Number of additional parking spaces:	162+-
Description and site percentage of existing cover/land use(s):	Vacant except for paved access roads Sparse vegetation and bare ground Wetlands located along the east property line
Description and site percentage of proposed cover/land use(s):	Commercial Development (2) new hotels and all associated infrastructure
Expected maximum proposed conveyance gradient (%):	5%
Description of size (acres) and cover/land use(s) of offsite areas draining to the site	Minimal off site areas draining to the site.

# CITY OF STEAMBOAT SPRINGS ENGINEERING STANDARDS

## Type of Study Required:

- ☐ Drainage Letter
 ☐ Conceptual Drainage Study  
☒ Final Drainage Study
 ☐ Stormwater Quality Plan

## Hydrologic Evaluation:

- ☐ Rational Method
 ☐ CUHP/SWMM
 ☐ HEC-HMS
 ☒ Other Provided by FEMA

Project Drainage	
Number of subbasins to be evaluated:	3 main basins, multiple sub basins
Presence of pass through flow (circle):	YES <b>NO</b>
Description of proposed stormwater conveyance on site:	See drainage exhibit, DR1. Sheet flow, curb/gutter combo (rollback curbs), inlets, swales, WQ features
Project includes roadway conveyance as part of design evaluation (circle):	<b>YES</b> NO
Description of conveyance of site runoff downstream of site, identify any infrastructure noted in Stormwater Master Plan noted as lacking capacity for minor or major storm event:	Runoff from DB1 basin will outfall along the east property line and in the form of concentrated flow at the NE property corner.
Detention expected onsite (circle):	YES <b>NO</b> Per hydraulic study of Walton Creek/Yampa
Presence of Floodway or Floodplain on site (circle):	<b>YES</b> NO Floodplains associated with the site
Anticipated modification of Floodway or Floodplain proposed (circle):	<b>YES</b> NO <b>Floodplain development proposed</b>
Describe culvert or storm sewer conveyance evaluative method:	

## Permanent Stormwater Treatment Facility Design Standard (check all that apply with only one standard per tributary basin):

- ☐ WQCV Standard
 ☐ TSS Standard
 ☐ Infiltration Standard  
☐ Constrained Redevelopment WQCV Standard  
☐ Constrained Redevelopment TSS Standard  
☐ Constrained Redevelopment Infiltration Standard  
☐ Does not Require Permanent Stormwater Treatment (attach Exclusion Tracking Form)

# CITY OF STEAMBOAT SPRINGS ENGINEERING STANDARDS

Project Permanent Stormwater Treatment	
Justification of choice of proposed design standard, including how the site meets the constrained redevelopment standard, infiltration test results, etc.:	
Concept-level permanent stormwater treatment facility design details (type, location of facilities, proprietary structure selection, treatment train concept, etc.):	
Proposed LID measures to reduce runoff volume:	
Will treatment evaluation include off-site, pass through flow (circle):	<div style="display: flex; justify-content: space-around;"> <span>YES</span> <span>NO</span> </div> <div style="text-align: right; font-size: 1.2em;">n/a</div>

## Approvals

Mary Wohnrade, P.E., Wohnrade Civil Engineers, Inc.     **October 16, 2021**     720-259-0965, Ext. 103

Prepared By: (Insert drainage engineer name & firm)	Date	Phone number
--	------	--------------

Approved By:

Printed Name: City Engineer	Date
--------------------------------	------

APPROVED  
to be generally in  
accordance with  
CITY ENGINEERING  
STANDARDS

12/17/2021



**Appendix J: Project Design Sheets**

# CITY OF STEAMBOAT SPRINGS ENGINEERING STANDARDS

## PROJECT SHEET – BASE DESIGN STANDARDS (Site is not constrained)

Complete a Project Sheet for each project that includes Permanent Stormwater Treatment Facilities.

### SITE INFORMATION

Project Name:		
Project Location:		
Submitted Date:	Submitted By:	
Acreage Disturbed:		
Existing Impervious:	New Net Impervious:	
Review Date:	Reviewed By:	
<b>Preparer</b>	<b>City</b>	<b>Requirements</b>
		Design Details are included for all Treatment Facilities
		List or include a description of any source controls or other non-structural practices:

### DESIGN STANDARDS

Multiple Design Standards may be used on a site, as necessary, to meet the requirements, but only one Design Standard may be used for each treatment facility's tributary area. Evaluation of suitability of permanent stormwater treatment facilities is based on meeting the specified Design Standard and ease of long-term maintenance. Facilities must be designed in accordance with the most current versions of the City's Engineering Standards and Volume 3 of the USDCM and meet the specific requirements for each Design Standard used.

1. Indicate below, which Design Standard(s) will be used for the project, and
2. Complete a separate, corresponding Design Standards checklist for each facility (e.g., WQCV)

<i>Design Standard</i>	<i>Quantity</i>	<i>Tributary Area</i>	<i>Location/Identifying information</i>
WQCV			
Pollutant Removal			
Runoff Reduction			

## DESIGN CHECKLIST – Pollutant Removal (TSS) Standard

### POLLUTANT REMOVAL STANDARD Criteria

Treatment facilities must be designed to provide treatment of the 80<sup>th</sup> percentile storm event. The treatment facilities shall be designed to treat stormwater runoff in a manner expected to reduce the event mean concentration of total suspended solids (TSS), at a minimum, to a median value of 30mg/L or less for 100% of the site. Substantiating data must meet criteria in Volume 3 of the USDCM and be included in the submittal. All runoff from the site shall be captured. Under certain conditions, up to 20% of the site may be excluded, not to exceed 1 acre. This may apply if it is not practicable to capture runoff from portions of the site and it is not practicable to construct a separate treatment facility for those same portions of the site.

*Complete checklist if using the Pollutant Removal Standard to meet Design Standard requirements.*

Project Name:		
Preparer	City	Requirements
		Facilities provide treatment of the 80 <sup>th</sup> percentile storm event. The facilities treat stormwater runoff in a manner expected to reduce the event mean concentration of total suspended solids (TSS) to a median value of 30mg/L or less for 100% of the site.
		Facility Type: Facility Location:
		Storm event:
		TSS mg/L reduction:
		% of site treated:
		See Drainage Report section:

*If less than 100% of the site is treated, complete the following:*

Preparer	City	Requirements
		% of site not treated by control measures (not to exceed 20% or 1 acre):
		<div style="display: flex; justify-content: space-between; align-items: center;"> <span>0 %</span> <span>0 Size (acres)</span> </div>
		Provide explanation of why the excluded area is impractical to treat:
		Provide explanation of why another facility is not practicable for the untreated area:

**Appendix K: Operation and Maintenance Plan for Stormwater BMPs and Conveyance Network**



# PERMANENT STORM WATER QUALITY BMPs for the HOTELS AT LOT 1 INDIAN MEADOWS

## 2. GENERAL FACILITY DESCRIPTION

THE FACILITIES ASSOCIATED WITH THIS DEVELOPMENT ARE GRASS-LINED WATER QUALITY (WQ) SWALES, BIO-RETENTION UNITS (RAIN GARDENS), AND GRASS BUFFERS THAT ARE CAPABLE OF TREATING RUNOFF FOR TOTAL SUSPENDED SOLIDS (TSS) AND OTHER POLLUTANTS COMMONLY DERIVED FROM VEHICLES AND OTHER MOTORIZED EQUIPMENT. THESE STORM WATER BEST MANAGEMENT PRACTICES (BMPs) WERE DESIGNED AND ENGINEERED ACCORDING TO STEAMBOAT SPRINGS STANDARDS AND SPECIFICATIONS.

### 3. INSPECTION & MAINTENANCE FREQUENCY & PROCEDURE

A. THE FOLLOWING TABLES PROVIDES AN INSPECTION AND MAINTENANCE SCHEDULE FOR THE PROPOSED BMPs:

Grass Lined Water Quality Swale and Grass Buffer Inspection and Maintenance Schedule	
Activity	Required Frequency
Inspection for uniform cover, sediment accumulation, fill and gully development, and impacts from foot or vehicle traffic; maintain as necessary. Debris and litter removal.	Twice annually
Aeration practices	None required. Swales will be outfitted with a turf reinforcement matting that will provide a growing medium for grasses. Aeration would damage the turf reinforcement matting and should not be performed.
Mowing	As needed to maintain ~6" height
Irrigation and application of fertilizer, herbicide, and pesticide	As needed to maintain vegetative health.

Rain Garden Inspection and Maintenance Schedule	
Activity	Required Frequency
Inspection for uniform mulch cover, plant health, sediment accumulation, rill and gully development, and impacts from foot or vehicle traffic; maintain as necessary. Debris, sediment, and litter removal.	Twice annually. Typically performed in the spring and fall periods.
Inspect curb cut inlets and storm inlets. Ensure inlets are functioning properly and free of sediment buildup, debris, trash, etc. Weeding and Mulching. Pull intrusive weeds. Apply a shredded hardwood mulch 2"-3" deep AFTER the aforementioned activities are completed.	Twice annually. Typically performed in the spring and fall periods.  Once annually. Typically performed in the spring.
Irrigation and watering.	Rain gardens are outfitted with irrigation. Ensure irrigation heads are working properly. Adjust irrigation schedule accordingly based on moisture conditions. Watering frequency is vital for first few years of vegetation establishment. At a minimum, rain gardens should be irrigated for 2 mins for grasses and shrubs and 5 minutes for trees at least two times per week during the growing season. (Spring/Summer/Early Fall)
Pruning may be performed on well established shrubs and trees by qualified personell.	As needed.

B. INLET INSPECTION AND MAINTENANCE: ALL PRIVATE STORMWATER INLETS ARE OUTFITTED W/ 12" SUMPS. INLETS AND SUMPS SHOULD BE INSPECTED AND MAINTAINED ONCE ANNUALLY FOR BLOCKAGE AND SEDIMENT BUILDUP IN THE SUMP. SEDIMENT SHOULD BE REMOVED FROM SUMPS IF THE DEPTH EXCEEDS 6". DAMAGED INLETS SHOULD BE REPAIRED OR REPLACED IMMEDIATELY.

#### 4. EQUIPMENT, STAFFING AND VEGETATION MANAGEMENT

A. EQUIPMENT:

- A.A. VEGETATION MAINTENANCE TOOLS SUCH AS A LAWNMOWER, WEED WHACKER, AND BLOWER.
- A.B. SEDIMENT AND DEBRIS REMOVAL TOOLS SUCH AS RAKES, SHOVELS, BUCKETS, BLOWERS, AND/OR LANDSCAPING VACUUM.

B. STAFFING: TBD BY OWNER

C. SEEDING: WQ SWALES WILL BE INSTALLED W/ PROPER SEEDING AND FERTILIZER TO ESTABLISH GROWTH. ANY BARE AREAS THAT APPEAR DURING THE WQ SWALE LIFE CYCLE SHOULD BE RE-SEEDING AS NECESSARY W/ NATIVE SEED MIX.

D. MOWING: VEGETATION HEALTH SHOULD BE MAINTAINED IN AND AROUND THE WQ SWALES WITH REGULAR MOWING AND WEEDEATING. THE REQUIRED MOW AREA POST-CONSTRUCTION FOR THE ENTIRE SITE WAS ESTIMATED TO BE 0.25 ACRES.

E. UNDESIRABLE VEGETATION AND WEEDS:

LANDSCAPING STAFF. WEEDS SHOULD BE MOWED OR REMOVED BY HAND.

## 5. SNOW AND ICE CONTROL

THE GRASS LINED WQ SWALES WILL SERVE AS A SNOW STORAGE AREAS DURING THE WINTER MONTHS. SNOW CAN BE PLOWED INTO THE SWALES. PLOW OPERATORS SHALL TAKE CARE NOT TO DAMAGE OR DISTURB THE FINISHED GRADE OF THE SWALES OR THE INSTALLED TRM AND UNDERDRAIN FEATURES. PLOW OPERATORS SHALL TAKE CARE NOT TO DAMAGE STORMWATER INLET GRATES.

## 6. RIGHT-OF-WAY, ADJACENT OWNERSHIP & ACCESS

A. ACCESS INFORMATION AND DETAILS: ACCESS FROM THE SHARED PRIVATE ACCESS RUNNING NORTH-SOUTH OFF STONE LANE.

- B. MAINTENANCE OPERATIONS WILL REQUIRE TEMPORARY OBSTRUCTION OF THE PRIVATE SHARED CROSS ACCESS ROAD TO FAIRFIELD INN FOR MAINTENANCE OPERATIONS. A RIGHT-OF-WAY PERMIT SHOULD NOT BE REQUIRED FOR TEMPORARY OBSTRUCTIONS BUT IT SHOULD BE NOTED THAT TRAFFIC WILL LIKELY NEED TO BE MANAGED FOR A ONE-WAY SCENARIO IF A SERVICE VEHICLE AND EQUIPMENT IS TO PARK ON THE CROSS ACCESS ROAD SHOULDER. MAINTENANCE CREWS SHOULD PLACE MUTCD APPROVED TRAFFIC CONTROL DEVICES (ORANGE CONES AND/OR BARRICADES) AROUND ALL VEHICLES AND EQUIPMENT THAT ARE TEMPORARILY WITHIN THE 30-FOOT ACCESS EASEMENT.

## 7. HYDRAULIC DESIGN OF WATER QUALITY SWALES





(SEE THE APPROVED FINAL DRAINAGE REPORT FOR HOTELS AT LOT 1 INDIAN MEADOWS WITH HYDRAULIC CALCULATIONS AND RESULTS IN THE APPENDICES)

## 8. SENSITIVE AREA, WETLANDS & PERMITS

C. WETLANDS ARE PRESENT ON CITY OWNED LAND JUST ALONG THE EASTERLY PROPERTY LINE AND WHERE DRAINAGE FROM THE HOTEL PARKING LOTS ULTIMATELY OUTFALLS. WETLANDS SHOULD NOT BE DISTURBED AND SEDIMENT AND DEBRIS FROM MAINTENANCE OPERATIONS SHALL NOT BE DISCARDED INTO WETLANDS.

## 9. MISCELLANEOUS INFORMATION

A. PROJECT SURVEY; EXISTING CONDITIONS AND TOPOGRAPHIC SURVEY WAS PREPARED BY FOUR POINTS SURVEYING & ENGINEERING. ANY QUESTIONS COMMENTS OR CONCERNS REGARDING THIS OPERATION AND MAINTENANCE PLAN SHOULD BE CONVEYED TO FOUR POINTS SURVEYING AND ENGINEERING AND THE ENGINEER OF RECORD.

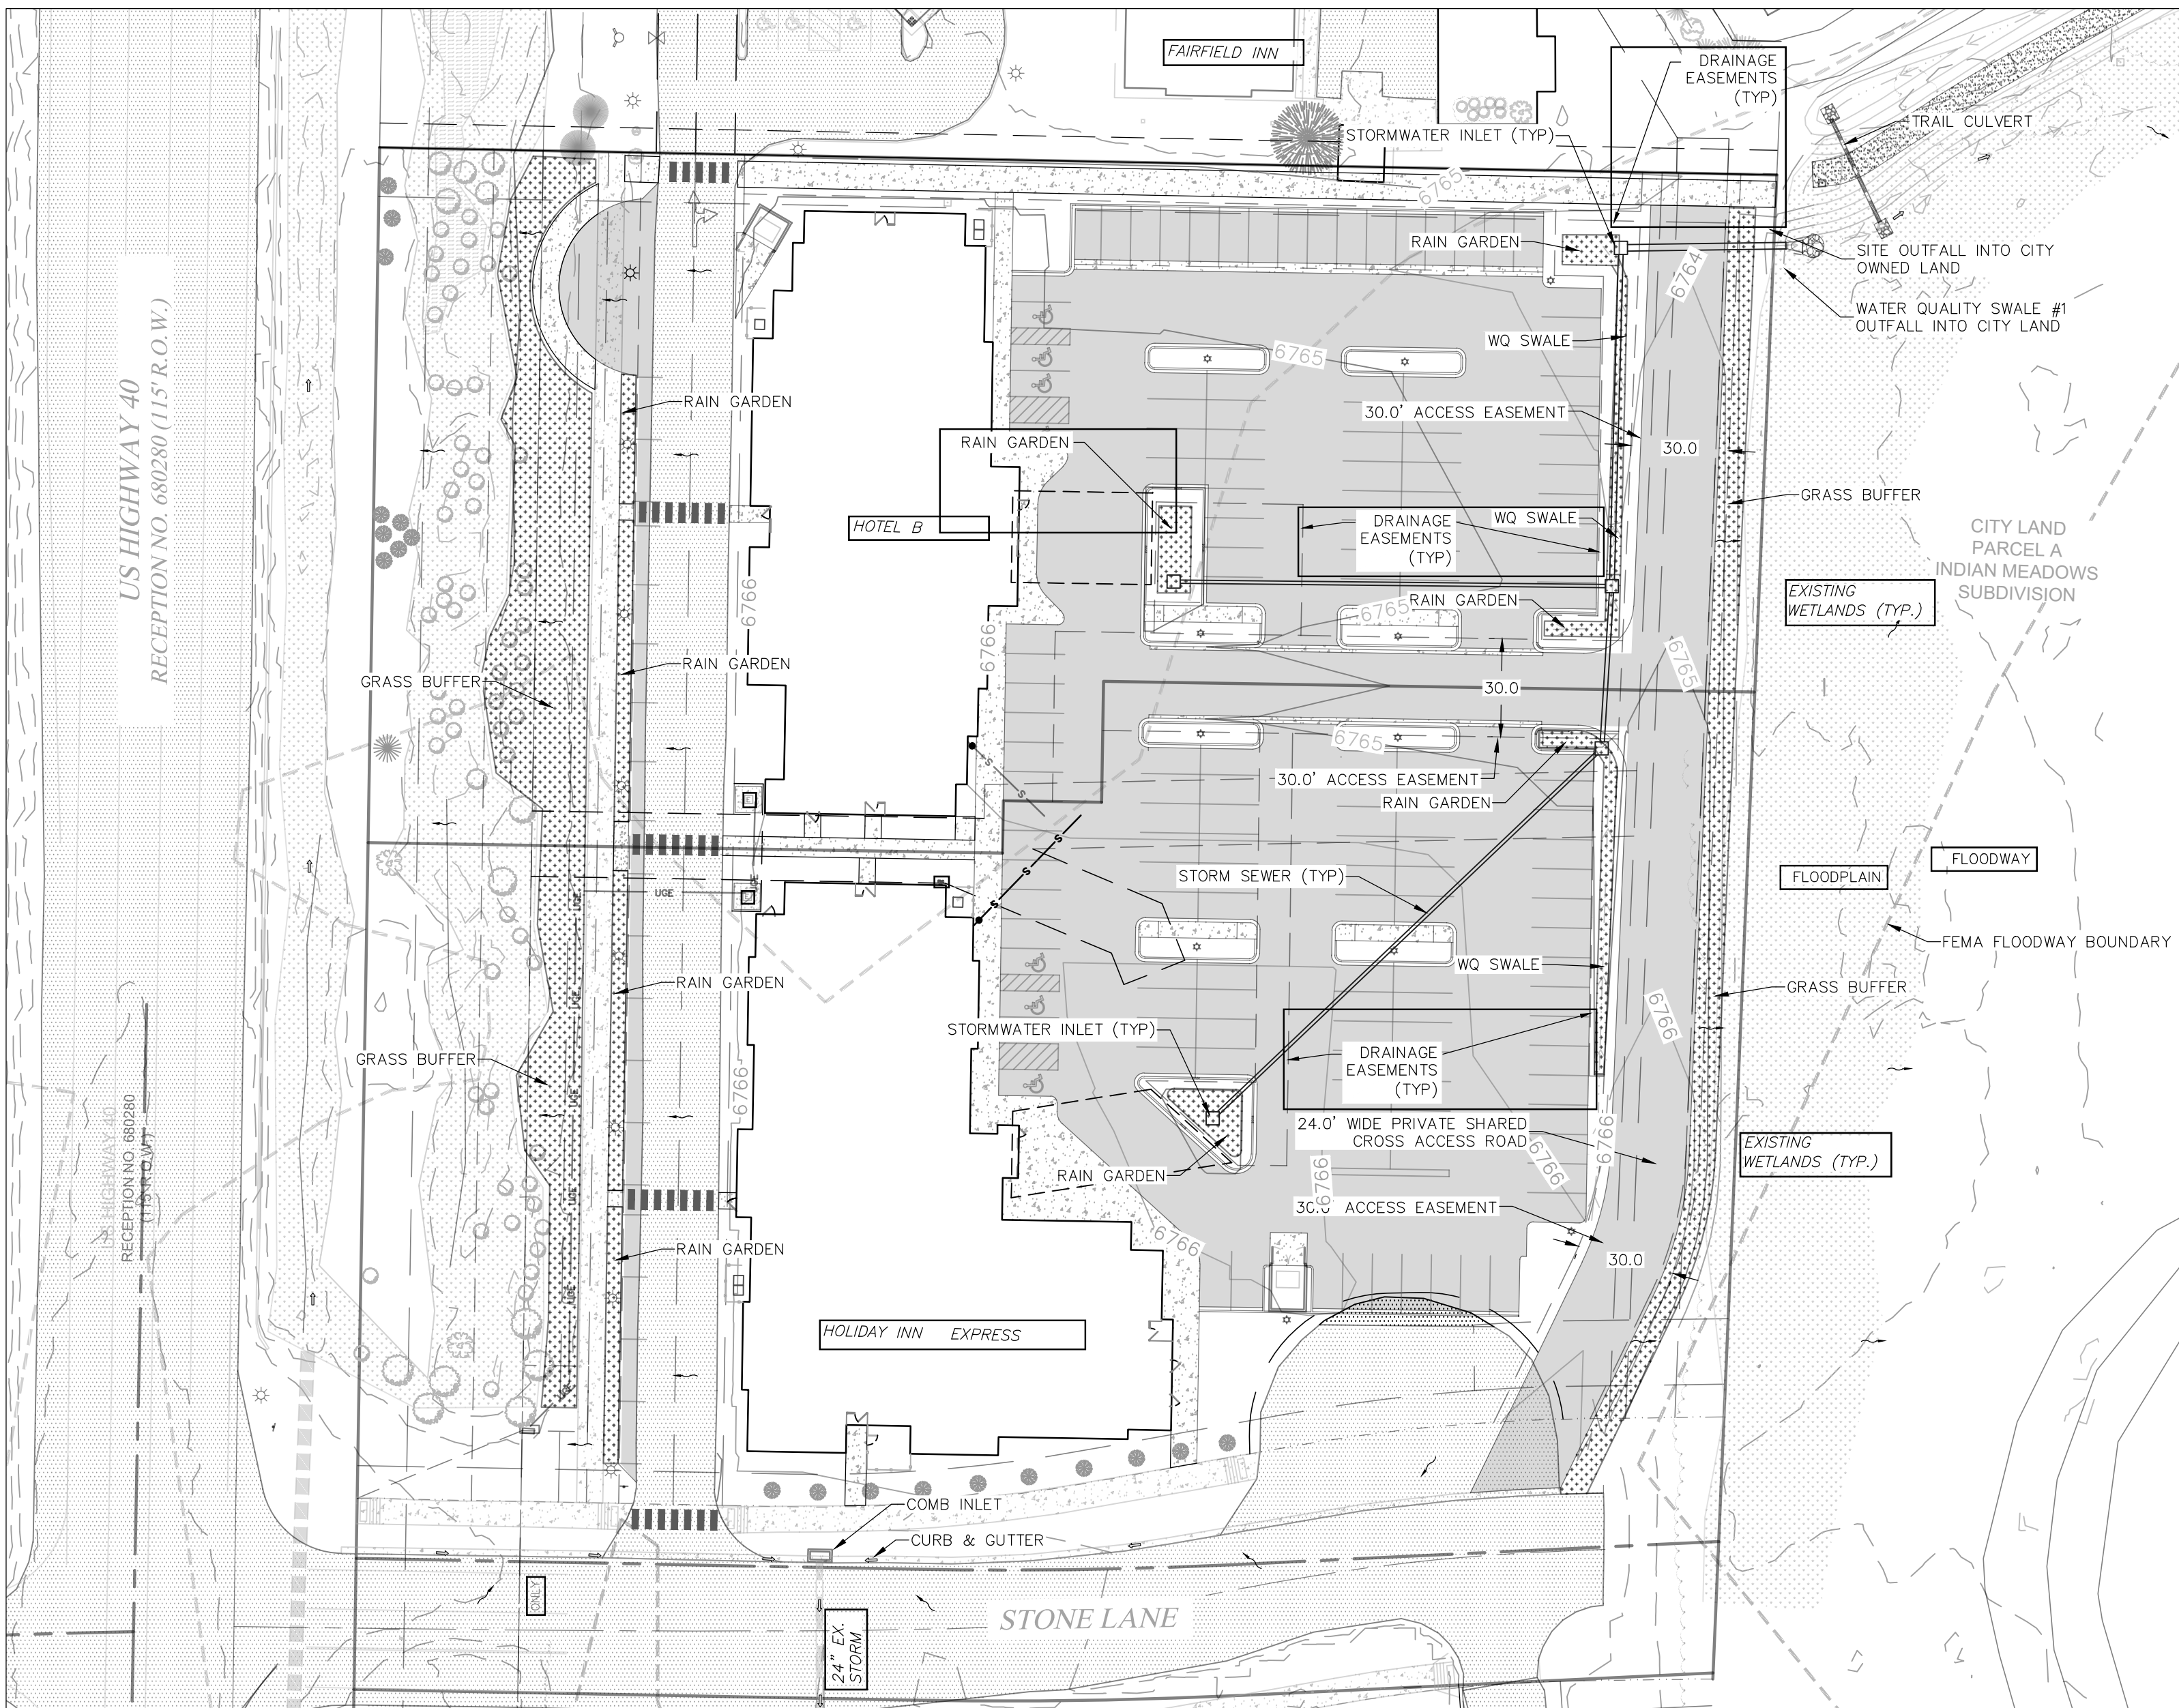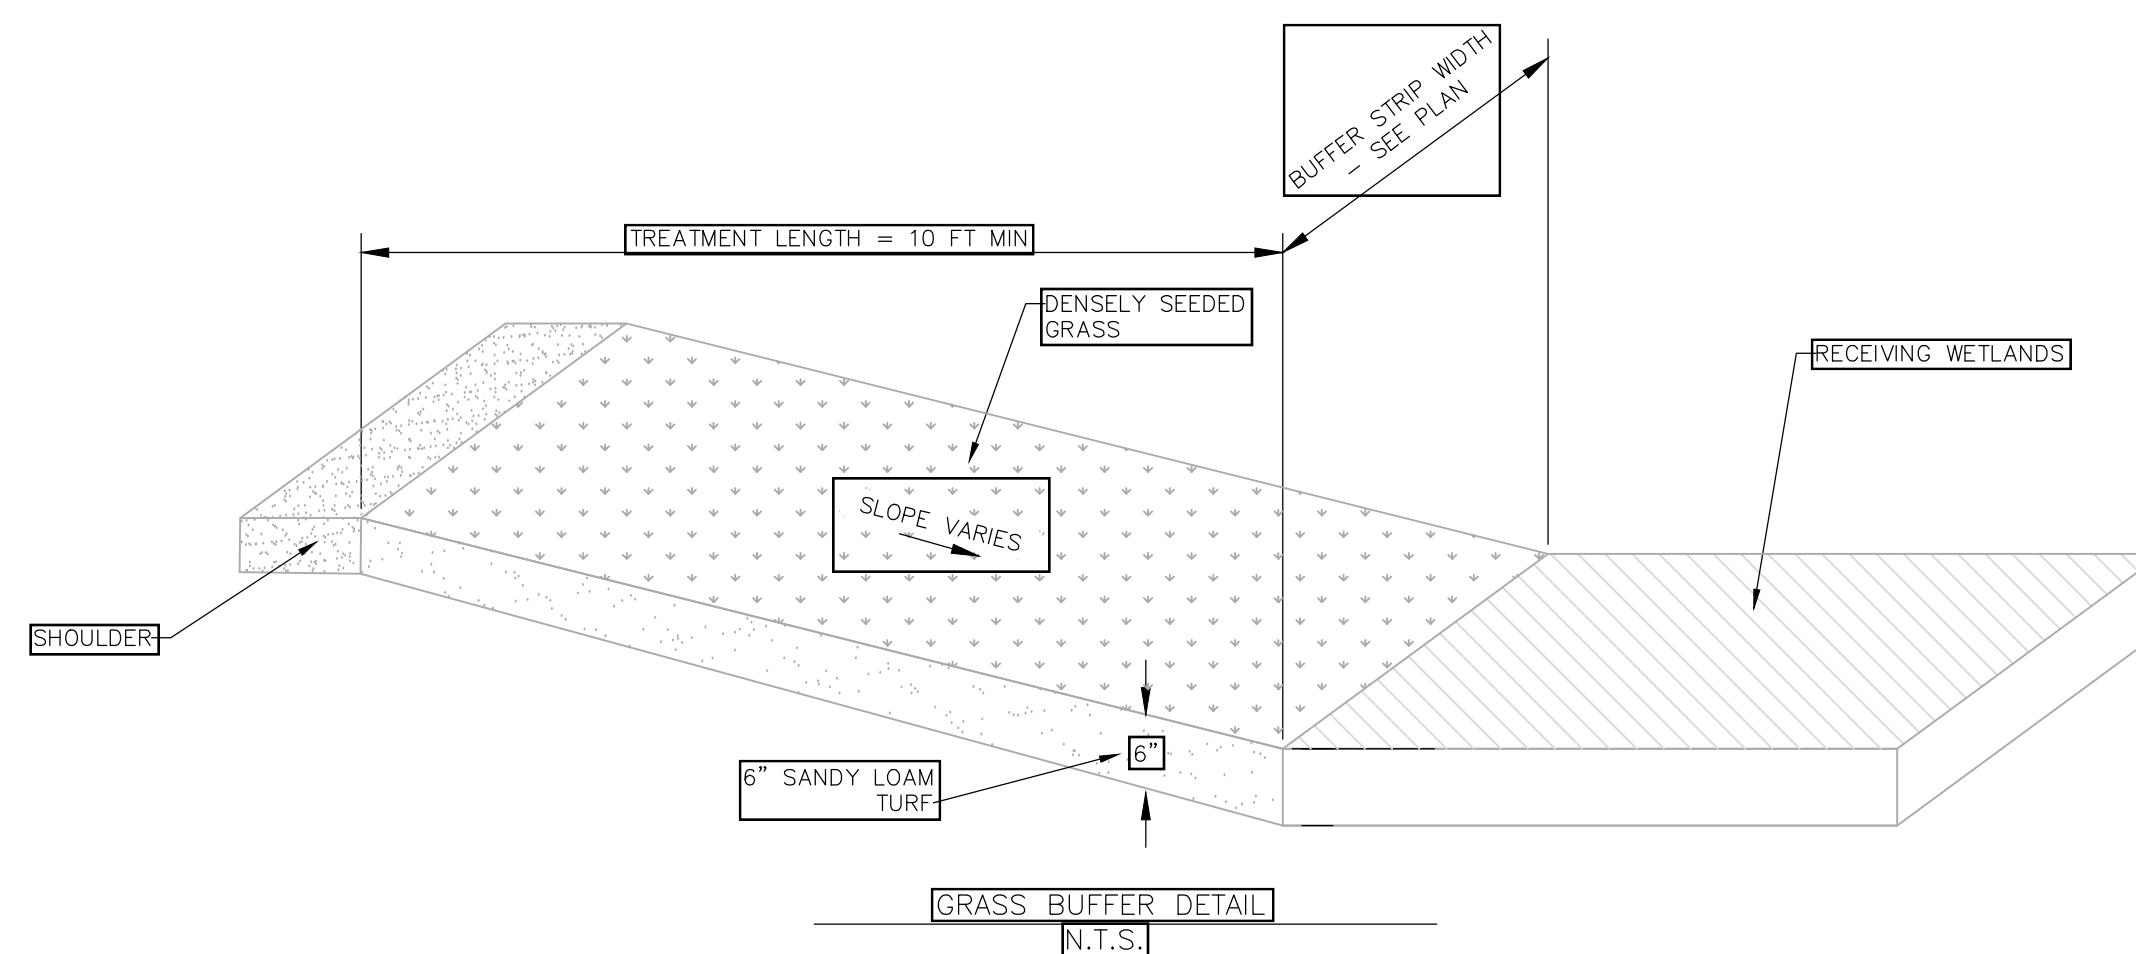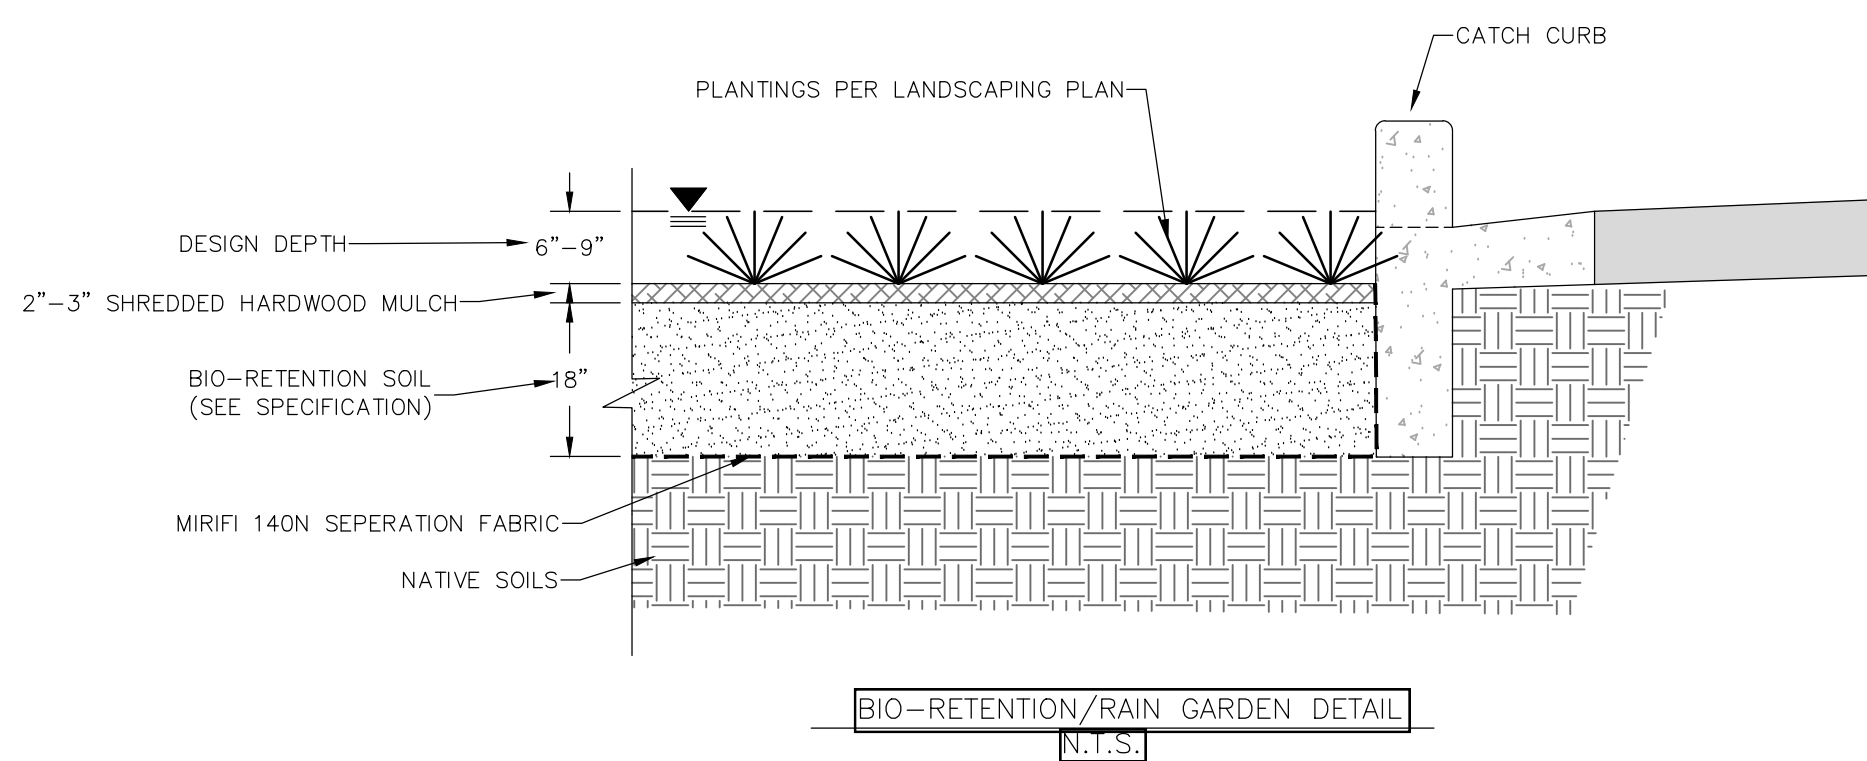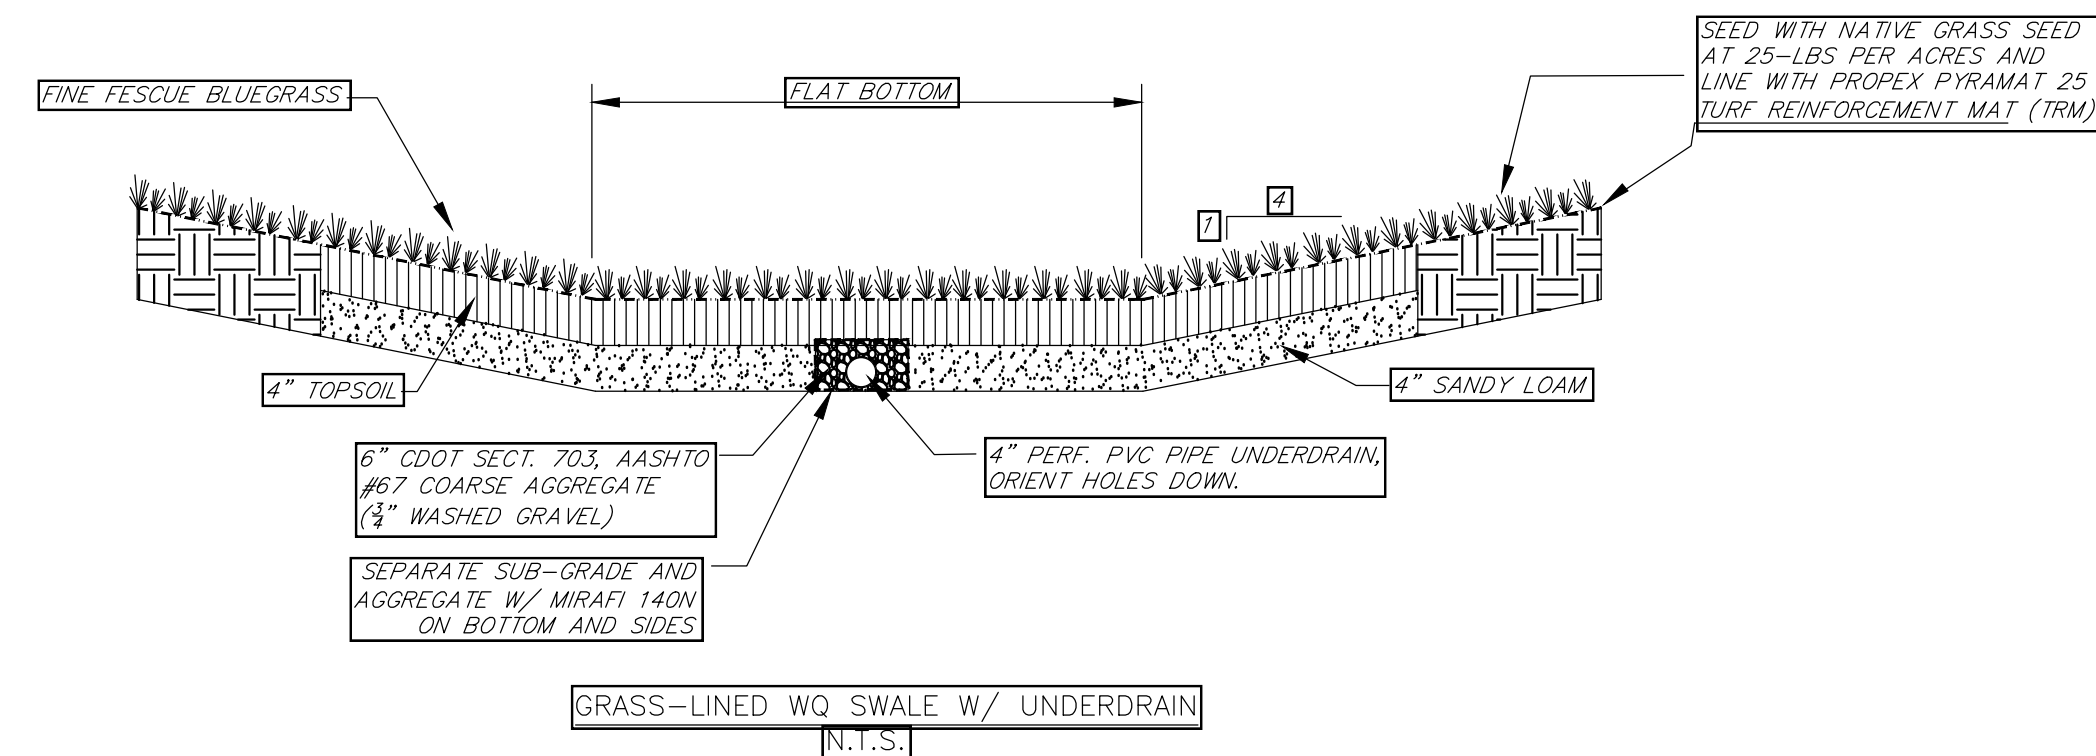
10. BMP DETAILS (SEE BELOW)11. RESOURCE INFORMATION FOR BMP MAINTENANCE (SEE FOLLOWING PAGE)

PROPOSED CONDITIONS SITE PLAN

[illegible]

LOT 1 INDIAN MEADOWS HOTELS  
LOT 1, INDIAN MEADOWS FILING NO. 3  
STEAMBOAT SPRINGS, CO 80487

HORIZONTAL SCALE

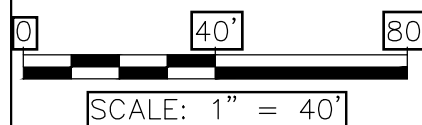

DATE: 11/8/2022
JOB #: 1448-005
DRAWN BY: JLW
DESIGN BY: JLW
REVIEW BY:

IF THIS DRAWING IS PRESENTED IN A  
FORMAT OTHER THAN 24" X 36", THE  
GRAPHIC SCALE SHOULD BE UTILIZED.

DRAWING: **OPERATION AND  
MAINTENANCE PLAN**

SHEET NO.
-----------

# OM1

**DRAFT - NOT FOR PRODUCTION**



